

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P910254

Luminaire Tested: DFN2DIP-TR4F0-110D050US840-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P910254
REPORT IS A COMBINATION OF REPORTS P900401 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-110D050US840-FLLFLL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15466.1 lumens
Efficiency: N/A
Efficacy: 102.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 150.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9613
Total Harmonic Distortion (THDi): 0.083
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P910254

CATALOG NUMBER: DFN2DIP-TR4F0-110D050US840-FLLFLL

Luminous Intensity Polar Plot

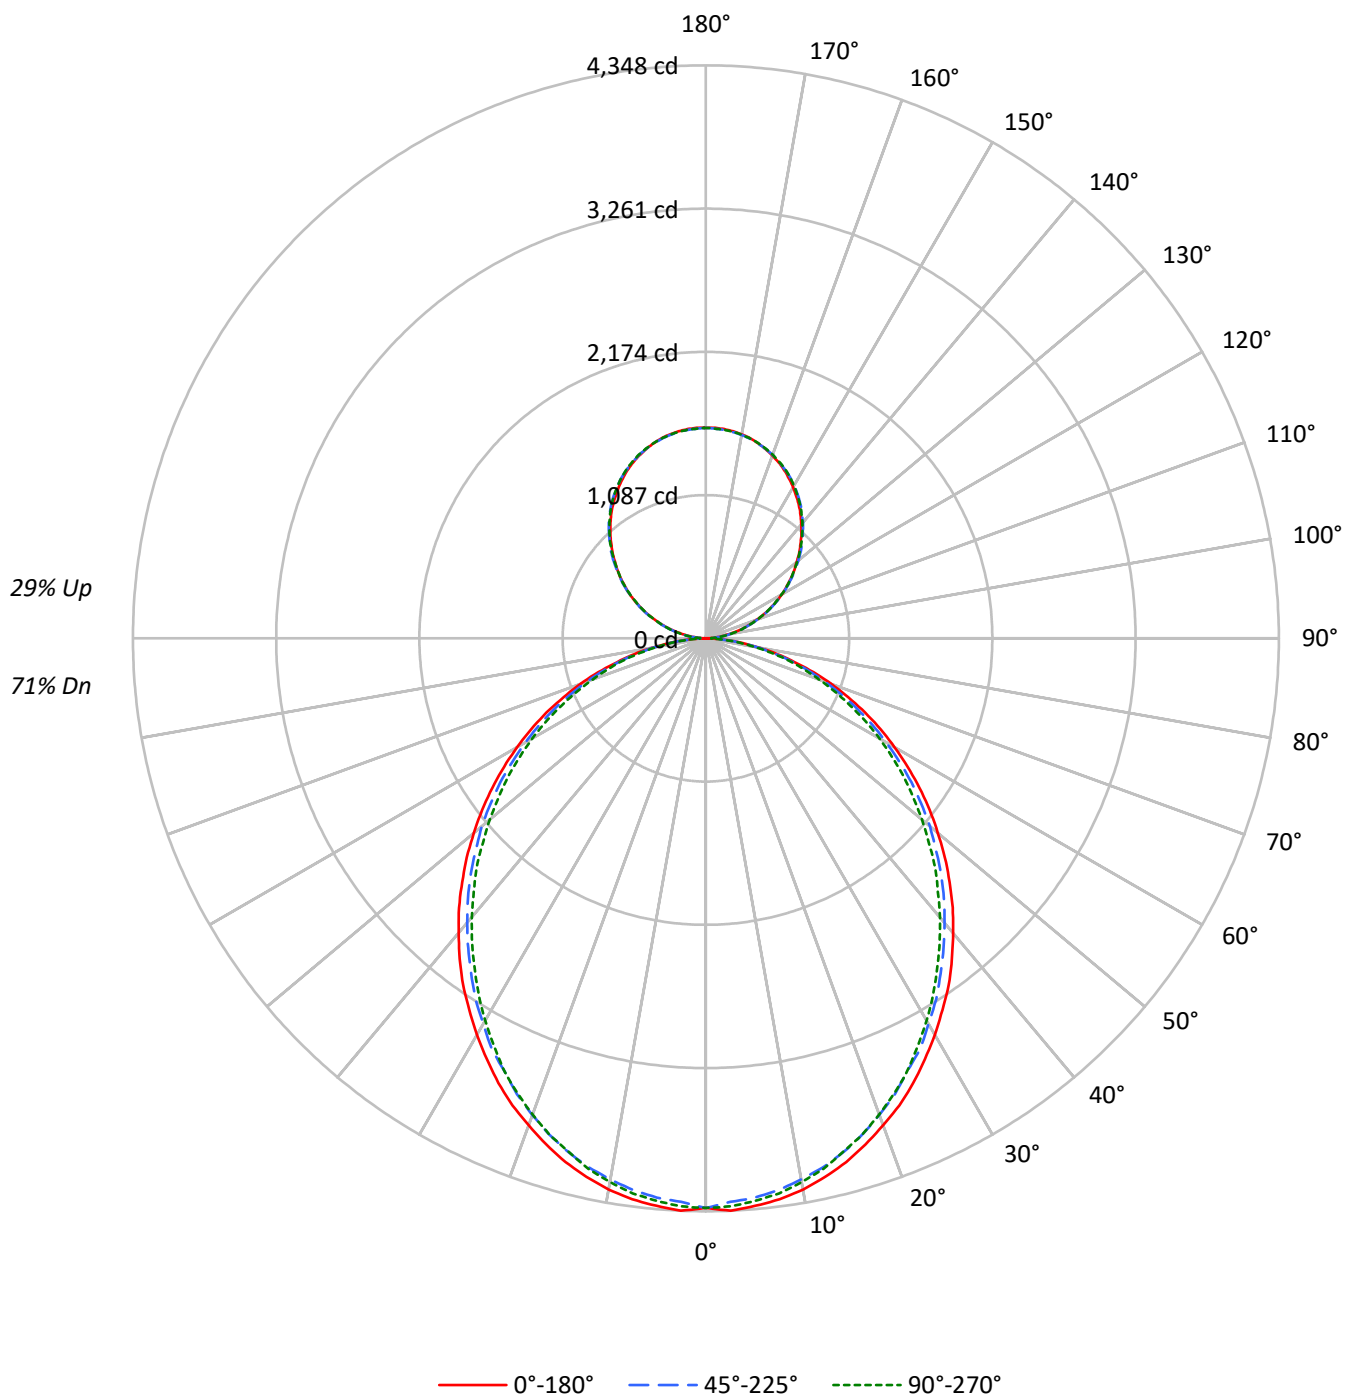

TEST NUMBER: P910254

CATALOG NUMBER: DFN2DIP-TR4F0-110D050US840-FLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	112	112	112	112	106	106	106	106	95	95	95	85	85	85	76	76	76
1	103	98	94	90	97	93	89	86	84	81	78	75	73	71	67	65	64
2	93	86	79	74	88	81	76	71	73	69	65	66	62	59	59	56	54
3	85	75	68	62	80	72	65	59	65	59	55	58	54	50	52	49	46
4	78	67	59	52	74	64	56	50	58	51	47	52	47	43	47	43	40
5	72	60	51	45	68	57	49	43	52	45	40	47	41	37	42	38	34
6	66	54	45	39	63	51	44	38	47	40	35	42	37	33	38	34	30
7	61	49	40	35	58	46	39	33	42	36	31	39	33	29	35	30	27
8	57	44	36	31	54	42	35	30	39	32	28	35	30	26	32	28	24
9	53	41	33	28	50	39	32	27	36	29	25	33	27	24	30	25	22
10	50	37	30	25	47	36	29	24	33	27	23	30	25	21	28	23	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3434	3434	3434
5°	3439	3386	3409
10°	3412	3340	3362
15°	3361	3285	3290
20°	3294	3209	3216
25°	3226	3118	3131
30°	3142	3032	3022
35°	3062	2932	2907
40°	2963	2831	2798
45°	2865	2729	2686
50°	2758	2623	2557
55°	2645	2499	2437
60°	2518	2353	2301
65°	2379	2201	2140
70°	2203	2016	1966
75°	1958	1795	1807
80°	1664	1513	1501
85°	1204	1027	994

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2865 cd/sqm

TEST NUMBER: P910254

CATALOG NUMBER: DFN2DIP-TR4F0-110D050US840-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	406.8	2.6
10°-20°	1144.7	7.4
20°-30°	1682.2	10.9
30°-40°	1953.7	12.6
40°-50°	1951.3	12.6
50°-60°	1701.5	11.0
60°-70°	1257.8	8.1
70°-80°	711.6	4.6
80°-90°	192.4	1.2
90°-100°	98.8	0.6
100°-110°	314.0	2.0
110°-120°	537.3	3.5
120°-130°	706.6	4.6
130°-140°	793.2	5.1
140°-150°	777.8	5.0
150°-160°	652.5	4.2
160°-170°	432.7	2.8
170°-180°	151.2	1.0
0°-30°	3233.7	20.9
0°-40°	5187.4	33.5
0°-60°	8840.2	57.2
0°-90°	11002.0	71.1
90°-120°	950.1	6.1
90°-150°	3227.7	20.9
90°-180°	4464.0	28.9
0°-180°	15466.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4322	4322	4322	4322	4322	
5°	4322	4306	4260	4293	4285	410
15°	4115	4090	4036	4052	4032	1159
25°	3724	3691	3620	3628	3620	1714
35°	3213	3172	3105	3080	3059	2006
45°	2614	2585	2523	2477	2461	2018
55°	1979	1954	1904	1854	1833	1769
65°	1334	1309	1268	1230	1210	1319
75°	698	690	669	644	653	745
85°	170	166	162	150	146	190
90°	1	17	47	44	46	15
95°	70	84	86	86	84	78
105°	290	294	297	299	299	306
115°	539	547	544	543	539	533
125°	784	796	792	788	787	701
135°	1014	1029	1032	1031	1027	784
145°	1232	1241	1249	1250	1245	769
155°	1408	1412	1416	1423	1419	648
165°	1532	1530	1530	1540	1533	432
175°	1594	1590	1587	1597	1589	151
180°	1597	1597	1597	1597	1597	

TEST NUMBER: P910254

CATALOG NUMBER: DFN2DIP-TR4F0-110D050US840-FLLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4322.4	4322.4	4322.4	4322.4	4322.4
2.5°	4347.5	4326.8	4280.9	4322.4	4314.4
5°	4322.4	4306.1	4260.2	4293.2	4285.4
7.5°	4293.2	4268.6	4222.8	4256.3	4247.9
10°	4247.9	4218.7	4168.9	4201.9	4189.6
12.5°	4185.3	4160.5	4110.8	4131.5	4123.1
15°	4114.7	4090.0	4035.7	4052.5	4031.8
17.5°	4027.3	4002.7	3948.5	3969.2	3948.5
20°	3931.7	3907.0	3848.8	3861.1	3844.9
22.5°	3836.5	3798.9	3744.7	3744.7	3736.3
25°	3724.0	3691.0	3620.4	3628.3	3620.4
27.5°	3599.2	3570.1	3516.3	3503.9	3483.2
30°	3474.8	3441.3	3379.1	3366.8	3350.0
32.5°	3341.6	3317.0	3250.4	3225.2	3208.4
35°	3212.9	3171.5	3104.8	3079.7	3059.0
37.5°	3067.4	3029.9	2963.3	2934.2	2913.5
40°	2917.9	2884.4	2817.8	2780.8	2764.0
42.5°	2772.4	2738.9	2672.7	2630.8	2606.2
45°	2614.5	2585.4	2522.7	2477.4	2460.6
47.5°	2460.6	2431.6	2364.9	2319.1	2294.3
50°	2298.4	2277.7	2219.4	2161.2	2140.5
52.5°	2140.5	2111.3	2057.6	2011.7	1982.6
55°	1978.6	1953.5	1903.7	1853.8	1833.1
57.5°	1816.3	1795.6	1741.4	1691.5	1674.8
60°	1654.1	1637.8	1579.5	1533.7	1521.4
62.5°	1496.2	1467.1	1425.6	1384.2	1367.5
65°	1334.3	1309.2	1267.8	1230.3	1209.6
67.5°	1168.1	1147.0	1109.9	1080.9	1064.1
70°	1014.2	997.4	960.0	930.9	914.5
72.5°	856.4	839.6	818.9	789.8	777.4
75°	698.0	690.1	668.9	644.3	652.7
77.5°	556.9	540.2	531.8	519.5	507.2
80°	415.9	411.4	403.0	390.7	382.3
82.5°	282.7	282.7	278.7	262.0	262.0
85°	170.3	166.2	162.3	149.5	145.5
87.5°	74.9	66.6	58.2	45.8	41.4
90°	1.4	17.4	47.2	44.3	45.7
92.5°	29.9	40.4	41.9	43.3	43.3
95°	70.3	83.8	86.1	86.1	83.8
97.5°	116.9	129.5	134.8	134.8	134.8
100°	170.9	182.0	185.8	185.8	184.4
102.5°	227.7	235.9	241.2	242.7	241.2
105°	289.8	293.7	296.6	298.9	298.9
107.5°	351.4	357.2	357.2	358.2	351.4
110°	411.1	418.9	418.9	418.9	415.0



TEST NUMBER: P910254

CATALOG NUMBER: DFN2DIP-TR4F0-110D050US840-FLLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	475.6	483.8	482.4	478.6	475.6
115°	539.2	546.9	544.5	543.1	539.2
117.5°	602.3	612.9	606.1	602.3	598.4
120°	665.8	676.4	665.8	665.8	661.5
122.5°	723.6	737.1	730.3	726.5	723.6
125°	784.3	796.3	792.4	788.1	786.7
127.5°	843.4	858.4	853.1	847.3	843.4
130°	898.9	916.2	913.7	910.9	905.5
132.5°	961.0	974.4	975.4	968.7	964.8
135°	1014.4	1029.3	1032.2	1030.8	1026.9
137.5°	1074.1	1086.1	1088.5	1087.5	1081.8
140°	1126.5	1138.6	1145.3	1145.3	1140.0
142.5°	1180.4	1192.6	1196.4	1197.8	1192.6
145°	1231.5	1241.1	1248.8	1250.3	1245.0
147.5°	1277.3	1289.3	1295.1	1297.5	1292.1
150°	1324.4	1332.6	1337.9	1342.2	1337.9
152.5°	1366.3	1374.5	1381.2	1386.5	1381.2
155°	1408.2	1412.0	1416.3	1423.1	1418.8
157.5°	1444.3	1447.1	1449.6	1459.3	1452.5
160°	1476.5	1479.5	1480.9	1489.0	1483.3
162.5°	1506.4	1506.4	1507.8	1517.0	1510.3
165°	1532.0	1530.5	1530.5	1540.1	1533.4
167.5°	1555.0	1550.6	1550.6	1560.3	1553.6
170°	1572.4	1568.5	1567.1	1576.7	1568.5
172.5°	1584.4	1580.5	1579.1	1588.7	1580.5
175°	1594.1	1590.1	1587.3	1596.9	1588.7
177.5°	1599.3	1595.5	1592.6	1600.7	1592.6
180°	1596.9	1596.9	1596.9	1596.9	1596.9

TEST NUMBER: P910254

CATALOG NUMBER: DFN2DIP-TR4F0-110D050US840-FLLFL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.31	14.40	14.06	15.17	16.11	12.88	13.97	13.63	14.74	15.67
	3H	14.98	15.96	15.75	16.75	17.71	14.51	15.49	15.28	16.28	17.24
	4H	15.58	16.51	16.37	17.30	18.28	15.11	16.03	15.89	16.83	17.80
	6H	15.99	16.85	16.79	17.65	18.64	15.52	16.37	16.31	17.17	18.16
	8H	16.11	16.92	16.91	17.74	18.73	15.63	16.44	16.44	17.26	18.25
	12H	16.16	16.94	16.97	17.75	18.77	15.68	16.46	16.49	17.27	18.29
4H	2H	13.80	14.72	14.58	15.51	16.49	13.45	14.38	14.24	15.17	16.14
	3H	15.68	16.46	16.48	17.28	18.27	15.29	16.06	16.09	16.89	17.88
	4H	16.41	17.11	17.22	17.94	18.96	16.00	16.70	16.81	17.53	18.55
	6H	16.93	17.54	17.76	18.39	19.42	16.53	17.13	17.36	17.98	19.01
	8H	17.09	17.66	17.92	18.50	19.54	16.68	17.25	17.51	18.09	19.13
	12H	17.17	17.69	18.03	18.55	19.60	16.75	17.26	17.61	18.13	19.17
8H	4H	16.62	17.19	17.46	18.04	19.07	16.26	16.83	17.10	17.68	18.71
	6H	17.26	17.73	18.12	18.62	19.66	16.90	17.37	17.76	18.26	19.30
	8H	17.48	17.90	18.36	18.79	19.84	17.12	17.54	17.99	18.42	19.47
	12H	17.63	18.00	18.50	18.87	19.98	17.24	17.61	18.12	18.49	19.60
12H	4H	16.62	17.13	17.47	18.00	19.04	16.27	16.78	17.12	17.64	18.69
	6H	17.29	17.71	18.17	18.60	19.65	16.94	17.36	17.82	18.24	19.30
	8H	17.55	17.92	18.42	18.79	19.90	17.19	17.56	18.07	18.43	19.54