

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P910292

Luminaire Tested: DFN2DIP-TR4F0-120D050US840-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P910292
REPORT IS A COMBINATION OF REPORTS P900404 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-120D050US840-RLLFLL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14769.2 lumens
Efficiency: N/A
Efficacy: 90.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 163.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9821
Total Harmonic Distortion (THDi): 0.08
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P910292

CATALOG NUMBER: DFN2DIP-TR4F0-120D050US840-RLLFLL

Luminous Intensity Polar Plot

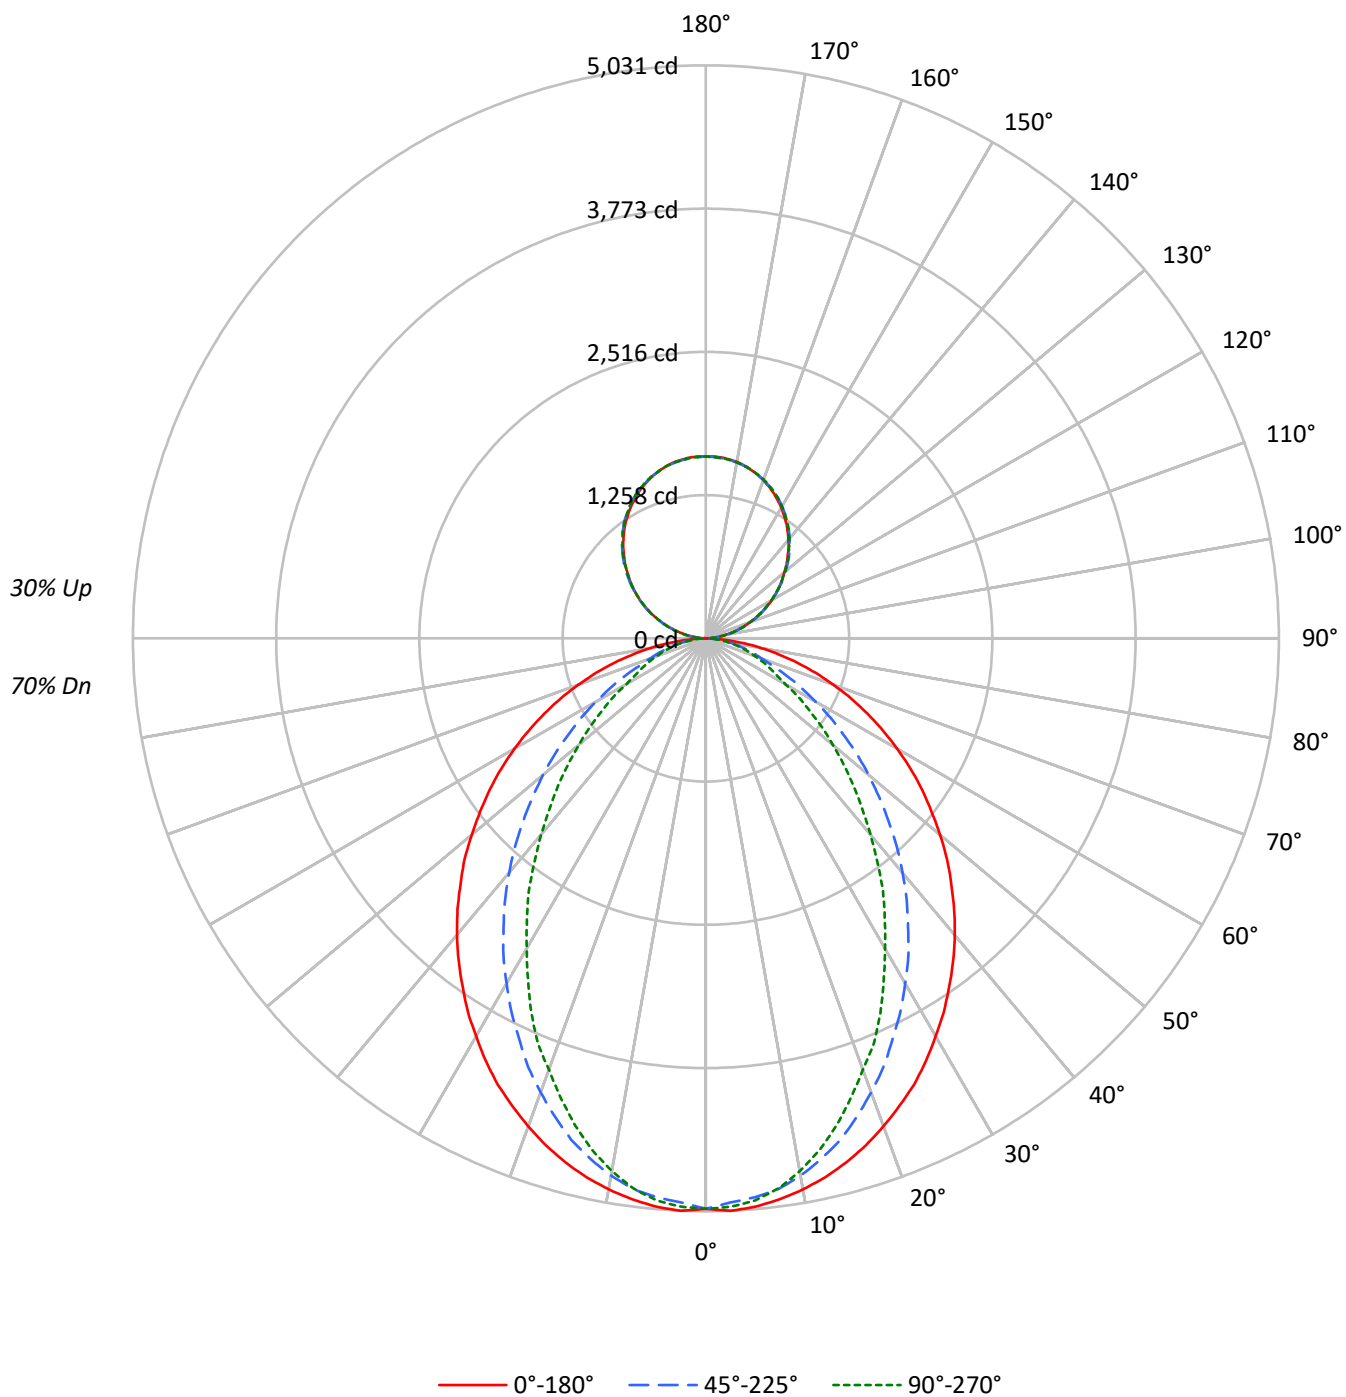

TEST NUMBER: P910292

CATALOG NUMBER: DFN2DIP-TR4F0-120D050US840-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	112	112	112	112	106	106	106	106	94	94	94	84	84	84	74	74	74
1	103	99	95	92	97	94	90	87	84	81	79	75	73	71	67	65	64
2	94	87	81	76	89	83	77	73	74	70	67	67	63	61	60	57	55
3	86	77	70	64	82	73	67	62	66	61	57	60	56	52	53	50	48
4	80	69	61	55	75	66	58	53	59	54	49	54	49	45	48	45	42
5	73	62	54	48	69	59	52	46	54	48	43	48	44	40	44	40	37
6	68	56	48	42	64	53	46	41	49	42	38	44	39	35	40	36	33
7	63	51	43	37	60	49	41	36	44	38	34	40	35	32	37	33	29
8	59	46	39	33	56	44	37	32	41	35	30	37	32	28	34	30	27
9	55	43	35	30	52	41	34	29	38	32	27	34	29	26	31	27	24
10	51	39	32	27	49	38	31	26	35	29	25	32	27	24	29	25	22

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3979	3979	3979
5°	3985	3916	3941
10°	3946	3839	3812
15°	3892	3712	3614
20°	3820	3537	3371
25°	3746	3341	3136
30°	3647	3140	2838
35°	3551	2924	2576
40°	3452	2700	2276
45°	3338	2452	2004
50°	3219	2201	1738
55°	3096	1934	1483
60°	2953	1654	1221
65°	2789	1369	1098
70°	2589	1104	994
75°	2339	973	904
80°	1976	816	783
85°	1378	544	588

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3338 cd/sqm

TEST NUMBER: P910292

CATALOG NUMBER: DFN2DIP-TR4F0-120D050US840-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	469.4	3.2
10°-20°	1288.6	8.7
20°-30°	1809.2	12.2
30°-40°	1972.1	13.4
40°-50°	1812.6	12.3
50°-60°	1423.5	9.6
60°-70°	926.6	6.3
70°-80°	476.9	3.2
80°-90°	126.3	0.9
90°-100°	98.8	0.7
100°-110°	314.0	2.1
110°-120°	537.3	3.6
120°-130°	706.6	4.8
130°-140°	793.2	5.4
140°-150°	777.8	5.3
150°-160°	652.5	4.4
160°-170°	432.7	2.9
170°-180°	151.2	1.0
0°-30°	3567.2	24.2
0°-40°	5539.3	37.5
0°-60°	8775.3	59.4
0°-90°	10305.1	69.8
90°-120°	950.1	6.4
90°-150°	3227.7	21.9
90°-180°	4464.0	30.2
0°-180°	14769.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	5008	5008	5008	5008	5008	
5°	5008	4986	4927	4968	4954	475
15°	4764	4714	4560	4474	4429	1342
25°	4324	4179	3880	3694	3626	1989
35°	3726	3495	3096	2810	2710	2332
45°	3046	2742	2266	1944	1836	2352
55°	2316	1963	1473	1201	1115	2070
65°	1564	1196	789	635	621	1550
75°	834	516	363	331	326	882
85°	195	100	86	86	86	224
90°	1	17	47	44	46	14
95°	70	84	86	86	84	78
105°	290	294	297	299	299	306
115°	539	547	544	543	539	533
125°	784	796	792	788	787	701
135°	1014	1029	1032	1031	1027	784
145°	1232	1241	1249	1250	1245	769
155°	1408	1412	1416	1423	1419	648
165°	1532	1530	1530	1540	1533	432
175°	1594	1590	1587	1597	1589	151
180°	1597	1597	1597	1597	1597	

TEST NUMBER: P910292

CATALOG NUMBER: DFN2DIP-TR4F0-120D050US840-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	5008.5	5008.5	5008.5	5008.5	5008.5
2.5°	5031.2	5008.5	4958.5	5004.2	4995.0
5°	5008.5	4985.9	4926.7	4967.6	4954.2
7.5°	4967.6	4940.7	4877.2	4895.0	4872.4
10°	4913.3	4881.6	4791.1	4777.2	4750.3
12.5°	4845.4	4804.6	4681.9	4655.1	4605.1
15°	4763.7	4713.7	4559.8	4473.7	4428.6
17.5°	4668.5	4595.9	4405.4	4306.0	4233.4
20°	4559.8	4469.0	4242.4	4129.4	4029.4
22.5°	4442.0	4337.7	4074.6	3920.7	3852.9
25°	4324.2	4178.9	3879.8	3694.2	3625.9
27.5°	4183.8	4029.4	3698.5	3485.6	3381.1
30°	4034.2	3861.6	3499.0	3268.1	3145.5
32.5°	3889.0	3680.3	3309.0	3036.9	2923.4
35°	3726.0	3494.6	3095.9	2810.4	2710.3
37.5°	3567.2	3317.7	2896.4	2583.3	2470.3
40°	3399.4	3127.8	2687.8	2366.0	2248.2
42.5°	3227.2	2937.3	2479.5	2143.8	2030.8
45°	3046.0	2742.1	2266.4	1944.3	1835.5
47.5°	2873.8	2552.1	2062.5	1740.4	1640.8
50°	2683.4	2361.7	1863.0	1549.9	1455.2
52.5°	2497.3	2157.3	1672.5	1373.4	1287.4
55°	2316.0	1962.6	1473.0	1201.2	1115.2
57.5°	2130.3	1767.8	1296.5	1042.6	970.0
60°	1940.0	1577.3	1110.3	879.6	807.0
62.5°	1754.3	1391.7	951.7	734.4	698.2
65°	1563.9	1196.5	788.7	634.8	620.9
67.5°	1382.6	1015.1	634.8	557.3	543.9
70°	1192.1	838.7	525.6	480.4	462.1
72.5°	1010.9	675.2	439.5	403.4	394.4
75°	833.8	516.4	362.6	330.8	326.5
77.5°	657.4	366.9	285.7	267.4	258.2
80°	493.9	263.1	217.3	199.5	199.5
82.5°	344.4	176.9	149.6	140.4	140.4
85°	194.8	99.6	86.0	86.0	86.0
87.5°	72.6	36.1	36.1	31.7	31.7
90°	1.4	17.4	47.2	44.3	45.7
92.5°	29.9	40.4	41.9	43.3	43.3
95°	70.3	83.8	86.1	86.1	83.8
97.5°	116.9	129.5	134.8	134.8	134.8
100°	170.9	182.0	185.8	185.8	184.4
102.5°	227.7	235.9	241.2	242.7	241.2
105°	289.8	293.7	296.6	298.9	298.9
107.5°	351.4	357.2	357.2	358.2	351.4
110°	411.1	418.9	418.9	418.9	415.0

TEST NUMBER: P910292

CATALOG NUMBER: DFN2DIP-TR4F0-120D050US840-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	475.6	483.8	482.4	478.6	475.6
115°	539.2	546.9	544.5	543.1	539.2
117.5°	602.3	612.9	606.1	602.3	598.4
120°	665.8	676.4	665.8	665.8	661.5
122.5°	723.6	737.1	730.3	726.5	723.6
125°	784.3	796.3	792.4	788.1	786.7
127.5°	843.4	858.4	853.1	847.3	843.4
130°	898.9	916.2	913.7	910.9	905.5
132.5°	961.0	974.4	975.4	968.7	964.8
135°	1014.4	1029.3	1032.2	1030.8	1026.9
137.5°	1074.1	1086.1	1088.5	1087.5	1081.8
140°	1126.5	1138.6	1145.3	1145.3	1140.0
142.5°	1180.4	1192.6	1196.4	1197.8	1192.6
145°	1231.5	1241.1	1248.8	1250.3	1245.0
147.5°	1277.3	1289.3	1295.1	1297.5	1292.1
150°	1324.4	1332.6	1337.9	1342.2	1337.9
152.5°	1366.3	1374.5	1381.2	1386.5	1381.2
155°	1408.2	1412.0	1416.3	1423.1	1418.8
157.5°	1444.3	1447.1	1449.6	1459.3	1452.5
160°	1476.5	1479.5	1480.9	1489.0	1483.3
162.5°	1506.4	1506.4	1507.8	1517.0	1510.3
165°	1532.0	1530.5	1530.5	1540.1	1533.4
167.5°	1555.0	1550.6	1550.6	1560.3	1553.6
170°	1572.4	1568.5	1567.1	1576.7	1568.5
172.5°	1584.4	1580.5	1579.1	1588.7	1580.5
175°	1594.1	1590.1	1587.3	1596.9	1588.7
177.5°	1599.3	1595.5	1592.6	1600.7	1592.6
180°	1596.9	1596.9	1596.9	1596.9	1596.9

TEST NUMBER: P910292

CATALOG NUMBER: DFN2DIP-TR4F0-120D050US840-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.61	14.64	14.39	15.43	16.39	9.59	10.61	10.36	11.40	12.36
	3H	15.31	16.22	16.09	17.02	18.01	10.79	11.71	11.58	12.51	13.50
	4H	15.92	16.79	16.73	17.59	18.60	11.25	12.11	12.06	12.92	13.93
	6H	16.35	17.15	17.17	17.97	18.98	11.58	12.38	12.40	13.20	14.21
	8H	16.49	17.24	17.31	18.08	19.09	11.68	12.44	12.51	13.27	14.29
	12H	16.55	17.27	17.39	18.10	19.15	11.73	12.45	12.56	13.28	14.32
4H	2H	13.66	14.52	14.47	15.33	16.33	10.21	11.07	11.02	11.88	12.88
	3H	15.50	16.22	16.32	17.06	18.08	11.57	12.29	12.40	13.13	14.15
	4H	16.20	16.85	17.04	17.69	18.74	12.13	12.78	12.97	13.62	14.67
	6H	16.73	17.29	17.58	18.15	19.21	12.56	13.12	13.41	13.99	15.04
	8H	16.91	17.43	17.76	18.29	19.35	12.69	13.22	13.55	14.08	15.14
	12H	17.01	17.48	17.88	18.36	19.43	12.77	13.24	13.64	14.12	15.19
8H	4H	16.18	16.71	17.04	17.57	18.63	12.43	12.95	13.28	13.81	14.87
	6H	16.76	17.19	17.64	18.09	19.16	12.95	13.38	13.83	14.29	15.35
	8H	16.97	17.36	17.87	18.26	19.34	13.14	13.53	14.04	14.43	15.51
	12H	17.12	17.46	18.01	18.35	19.48	13.27	13.61	14.17	14.50	15.63
12H	4H	16.14	16.62	17.02	17.50	18.57	12.44	12.91	13.31	13.79	14.86
	6H	16.73	17.12	17.62	18.02	19.10	13.00	13.39	13.89	14.28	15.36
	8H	16.96	17.30	17.86	18.19	19.32	13.22	13.56	14.11	14.45	15.58