

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P912784

Luminaire Tested: DFN2DIP-TR4F0-050D090US850-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P912784
REPORT IS A COMBINATION OF REPORTS P900462 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-050D090US850-RLLFLL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13546.5 lumens
Efficiency: N/A
Efficacy: 123.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 109.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P912784

CATALOG NUMBER: DFN2DIP-TR4F0-050D090US850-RLLFLL

Luminous Intensity Polar Plot

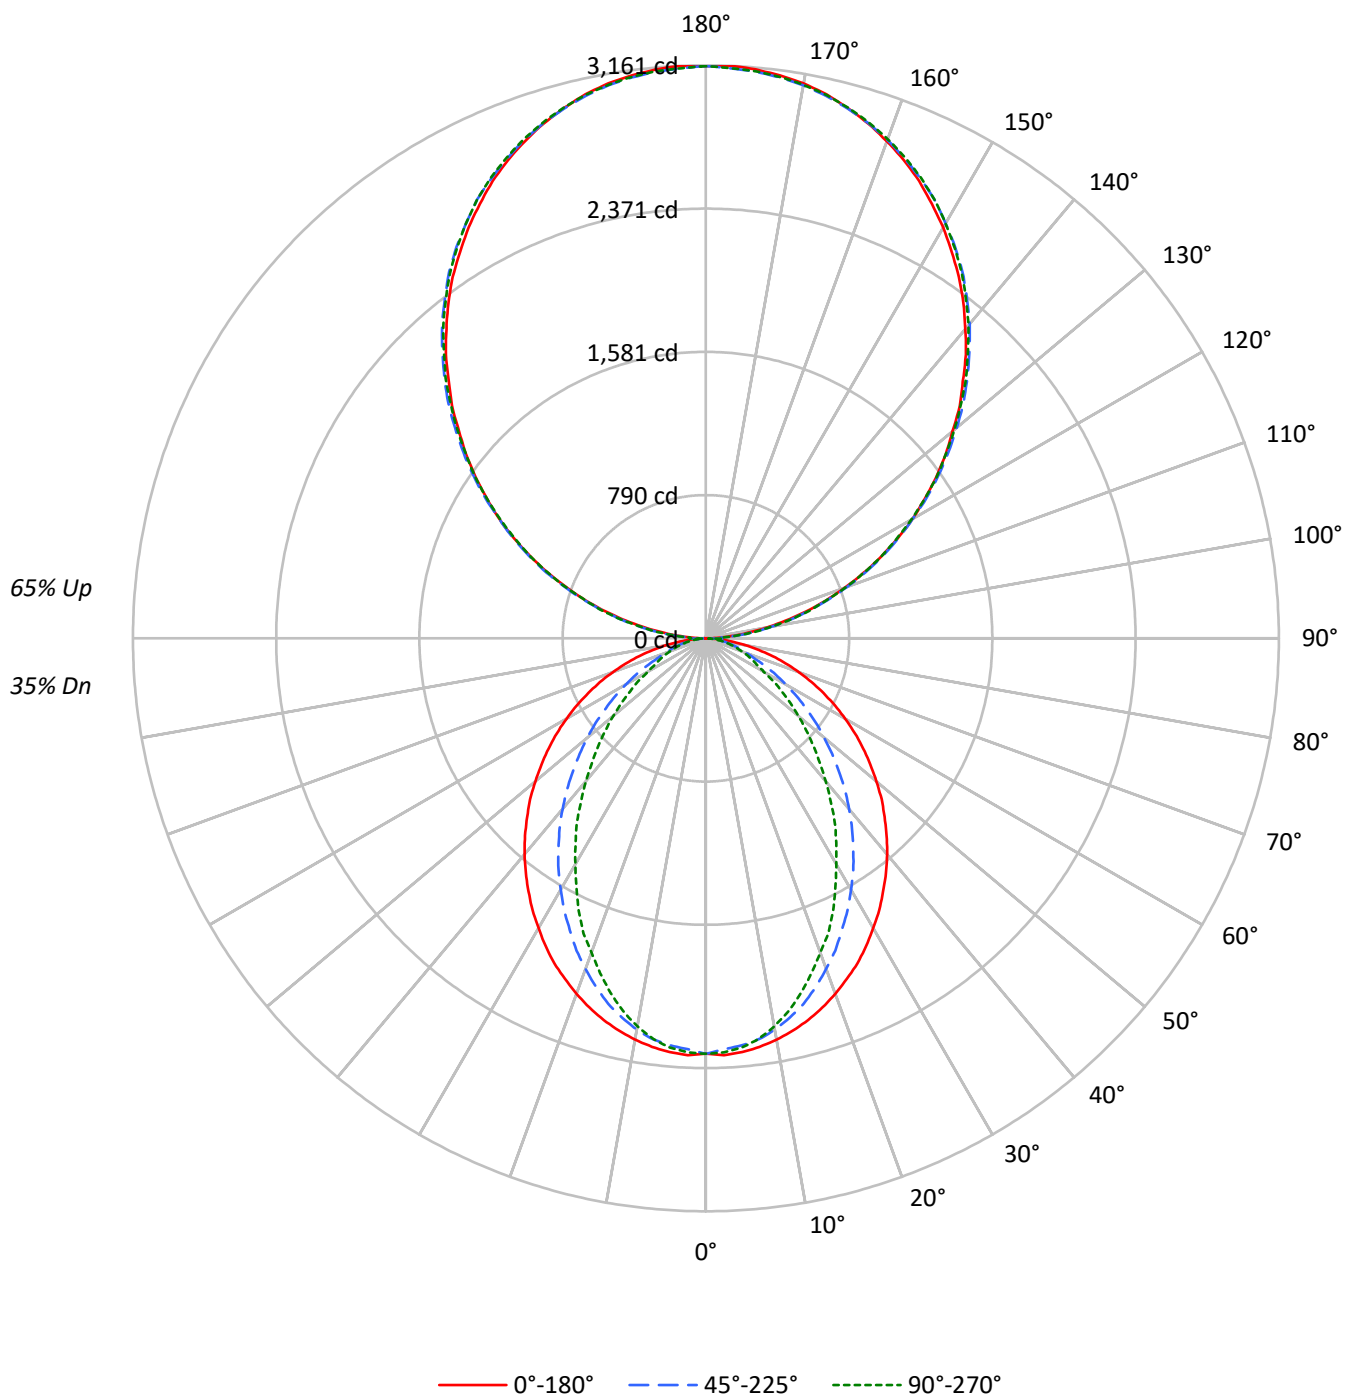

TEST NUMBER: P912784

CATALOG NUMBER: DFN2DIP-TR4F0-050D090US850-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	75	75	75	58	58	58	42	42	42
1	95	91	87	84	85	82	79	76	66	64	62	51	50	49	38	37	36
2	86	79	74	69	78	72	67	63	58	55	52	45	43	41	34	32	31
3	79	70	63	58	71	64	58	53	52	47	44	40	38	35	30	28	27
4	72	62	55	49	65	57	50	45	46	41	38	36	33	30	27	25	23
5	67	55	48	42	60	51	44	39	41	36	33	33	29	26	25	22	21
6	61	50	42	37	55	45	39	34	37	32	29	30	26	23	22	20	18
7	57	45	37	32	51	41	34	30	34	29	25	27	23	21	21	18	16
8	53	41	33	28	48	37	31	26	31	26	22	25	21	19	19	16	15
9	49	37	30	25	44	34	28	23	28	23	20	23	19	17	17	15	13
10	46	34	27	23	41	31	25	21	26	21	18	21	18	15	16	14	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1821	1821	1821
5°	1824	1792	1803
10°	1806	1757	1744
15°	1781	1699	1654
20°	1748	1618	1542
25°	1714	1529	1435
30°	1669	1437	1298
35°	1625	1338	1179
40°	1580	1235	1041
45°	1527	1122	917
50°	1473	1007	795
55°	1417	885	679
60°	1351	757	558
65°	1276	627	503
70°	1185	505	455
75°	1070	445	414
80°	904	374	358
85°	631	249	269

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2460 cd/sqm

TEST NUMBER: P912784

CATALOG NUMBER: DFN2DIP-TR4F0-050D090US850-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	214.8	1.6
10°-20°	589.6	4.4
20°-30°	827.8	6.1
30°-40°	902.4	6.7
40°-50°	829.4	6.1
50°-60°	651.3	4.8
60°-70°	424.0	3.1
70°-80°	218.2	1.6
80°-90°	64.7	0.5
90°-100°	195.3	1.4
100°-110°	620.6	4.6
110°-120°	1062.1	7.8
120°-130°	1396.8	10.3
130°-140°	1567.9	11.6
140°-150°	1537.5	11.3
150°-160°	1289.7	9.5
160°-170°	855.3	6.3
170°-180°	299.0	2.2
0°-30°	1632.2	12.0
0°-40°	2534.6	18.7
0°-60°	4015.3	29.6
0°-90°	4722.2	34.9
90°-120°	1878.1	13.9
90°-150°	6380.2	47.1
90°-180°	8824.0	65.1
0°-180°	13546.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2292	2292	2292	2292	2292	
5°	2292	2281	2254	2273	2267	217
15°	2180	2157	2086	2047	2026	614
25°	1979	1912	1775	1690	1659	910
35°	1705	1599	1417	1286	1240	1067
45°	1394	1255	1037	890	840	1076
55°	1060	898	674	550	510	947
65°	716	548	361	290	284	709
75°	382	236	166	151	149	404
85°	89	46	39	39	39	102
90°	3	34	93	88	90	13
95°	139	166	170	170	166	155
105°	573	580	586	591	591	605
115°	1066	1081	1076	1074	1066	1054
125°	1550	1574	1566	1558	1555	1385
135°	2005	2035	2040	2038	2030	1550
145°	2434	2453	2468	2471	2461	1521
155°	2784	2791	2800	2813	2805	1281
165°	3028	3025	3025	3044	3031	854
175°	3151	3143	3138	3157	3140	299
180°	3157	3157	3157	3157	3157	

TEST NUMBER: P912784

CATALOG NUMBER: DFN2DIP-TR4F0-050D090US850-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2291.7	2291.7	2291.7	2291.7	2291.7
2.5°	2302.1	2291.7	2268.9	2289.8	2285.5
5°	2291.7	2281.4	2254.4	2273.0	2266.9
7.5°	2273.0	2260.7	2231.6	2239.8	2229.4
10°	2248.2	2233.6	2192.3	2185.9	2173.5
12.5°	2217.1	2198.5	2142.4	2130.1	2107.1
15°	2179.7	2156.9	2086.5	2047.1	2026.4
17.5°	2136.2	2103.0	2015.8	1970.2	1937.0
20°	2086.5	2044.9	1941.2	1889.5	1843.7
22.5°	2032.6	1984.8	1864.5	1794.0	1763.0
25°	1978.6	1912.1	1775.3	1690.3	1659.1
27.5°	1914.4	1843.7	1692.3	1594.9	1547.2
30°	1845.9	1767.0	1601.1	1495.4	1439.3
32.5°	1779.5	1684.0	1514.1	1389.6	1337.7
35°	1704.9	1599.1	1416.6	1285.9	1240.2
37.5°	1632.2	1518.1	1325.4	1182.1	1130.4
40°	1555.5	1431.2	1229.8	1082.6	1028.7
42.5°	1476.7	1344.0	1134.5	980.9	929.2
45°	1393.8	1254.7	1037.0	889.6	839.8
47.5°	1314.9	1167.8	943.8	796.4	750.8
50°	1227.9	1080.6	852.5	709.2	665.8
52.5°	1142.7	987.1	765.3	628.5	589.1
55°	1059.8	898.0	673.9	549.6	510.3
57.5°	974.8	808.9	593.2	477.1	443.8
60°	887.6	721.7	508.0	402.5	369.2
62.5°	802.7	636.8	435.5	336.0	319.5
65°	715.5	547.5	360.9	290.4	284.1
67.5°	632.6	464.6	290.4	255.1	248.9
70°	545.5	383.7	240.5	219.8	211.5
72.5°	462.6	309.0	201.2	184.6	180.4
75°	381.6	236.3	165.9	151.4	149.4
77.5°	300.8	167.9	130.8	122.3	118.1
80°	226.0	120.3	99.5	91.3	91.3
82.5°	157.6	81.0	68.4	64.2	64.2
85°	89.2	45.6	39.4	39.4	39.4
87.5°	33.3	16.5	16.5	14.5	14.5
90°	2.9	34.3	93.3	87.5	90.4
92.5°	59.0	80.0	82.8	85.6	85.6
95°	139.0	165.6	170.3	170.3	165.6
97.5°	231.2	256.0	266.5	266.5	266.5
100°	337.8	359.8	367.3	367.3	364.5
102.5°	450.1	466.3	476.8	479.6	476.8
105°	572.9	580.5	586.2	591.0	591.0
107.5°	694.7	706.1	706.1	708.0	694.7
110°	812.7	828.0	828.0	828.0	820.3

TEST NUMBER: P912784

CATALOG NUMBER: DFN2DIP-TR4F0-050D090US850-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	940.2	956.4	953.5	946.0	940.2
115°	1065.9	1081.1	1076.3	1073.5	1065.9
117.5°	1190.5	1211.5	1198.2	1190.5	1182.9
120°	1316.2	1337.0	1316.2	1316.2	1307.5
122.5°	1430.3	1457.0	1443.7	1436.0	1430.3
125°	1550.3	1574.0	1566.5	1557.8	1555.0
127.5°	1667.3	1696.8	1686.3	1674.9	1667.3
130°	1776.7	1811.0	1806.2	1800.5	1790.0
132.5°	1899.5	1926.1	1928.0	1914.7	1907.1
135°	2005.1	2034.6	2040.3	2037.5	2029.9
137.5°	2123.1	2146.9	2151.7	2149.8	2138.4
140°	2226.9	2250.6	2263.9	2263.9	2253.5
142.5°	2333.4	2357.2	2364.8	2367.7	2357.2
145°	2434.4	2453.3	2468.5	2471.4	2461.0
147.5°	2524.7	2548.5	2559.9	2564.7	2554.2
150°	2618.0	2634.2	2644.6	2653.2	2644.6
152.5°	2700.7	2716.9	2730.2	2740.8	2730.2
155°	2783.6	2791.1	2799.8	2813.1	2804.6
157.5°	2854.9	2860.7	2865.4	2884.4	2871.1
160°	2918.7	2924.4	2927.3	2943.4	2932.0
162.5°	2977.7	2977.7	2980.5	2998.6	2985.3
165°	3028.1	3025.2	3025.2	3044.3	3031.0
167.5°	3073.8	3065.3	3065.3	3084.2	3070.9
170°	3108.1	3100.4	3097.7	3116.6	3100.4
172.5°	3131.8	3124.3	3121.4	3140.5	3124.3
175°	3150.9	3143.2	3137.6	3156.7	3140.5
177.5°	3161.3	3153.8	3148.0	3164.2	3148.0
180°	3156.7	3156.7	3156.7	3156.7	3156.7

TEST NUMBER: P912784

CATALOG NUMBER: DFN2DIP-TR4F0-050D090US850-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.62	8.34	8.70	9.42	10.89	3.59	4.31	4.67	5.39	6.86
	3H	9.29	9.93	10.38	11.02	12.51	4.77	5.42	5.86	6.50	8.00
	4H	9.89	10.50	10.99	11.59	13.09	5.22	5.83	6.32	6.92	8.42
	6H	10.30	10.87	11.42	11.96	13.47	5.53	6.10	6.64	7.19	8.70
	8H	10.43	10.96	11.54	12.07	13.57	5.62	6.16	6.74	7.26	8.77
	12H	10.49	10.99	11.60	12.09	13.62	5.66	6.17	6.78	7.27	8.80
4H	2H	7.62	8.23	8.73	9.32	10.82	4.17	4.78	5.28	5.87	7.37
	3H	9.44	9.95	10.56	11.06	12.57	5.51	6.02	6.63	7.14	8.65
	4H	10.13	10.59	11.25	11.70	13.23	6.06	6.52	7.18	7.63	9.16
	6H	10.64	11.04	11.76	12.16	13.69	6.47	6.87	7.60	8.00	9.52
	8H	10.81	11.18	11.94	12.30	13.84	6.60	6.97	7.72	8.09	9.63
	12H	10.90	11.24	12.04	12.37	13.91	6.66	7.00	7.80	8.13	9.67
8H	4H	10.09	10.46	11.21	11.58	13.12	6.33	6.70	7.46	7.82	9.36
	6H	10.65	10.96	11.80	12.12	13.66	6.84	7.15	7.99	8.31	9.85
	8H	10.87	11.13	12.02	12.28	13.83	7.04	7.30	8.19	8.45	10.00
	12H	11.00	11.24	12.16	12.37	13.97	7.15	7.39	8.31	8.53	10.12
12H	4H	10.03	10.37	11.18	11.50	13.05	6.33	6.67	7.47	7.80	9.34
	6H	10.63	10.89	11.78	12.04	13.59	6.89	7.16	8.05	8.30	9.86
	8H	10.84	11.08	12.00	12.22	13.81	7.10	7.34	8.26	8.47	10.07

END OF REPORT