

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P912803

Luminaire Tested: DFN2DIP-TR4F0-060D050US850-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P912803
REPORT IS A COMBINATION OF REPORTS P901911 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-060D050US850-FLLONL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12077.0 lumens
Efficiency: N/A
Efficacy: 132.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 91.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P912803

CATALOG NUMBER: DFN2DIP-TR4F0-060D050US850-FLLONL

Luminous Intensity Polar Plot

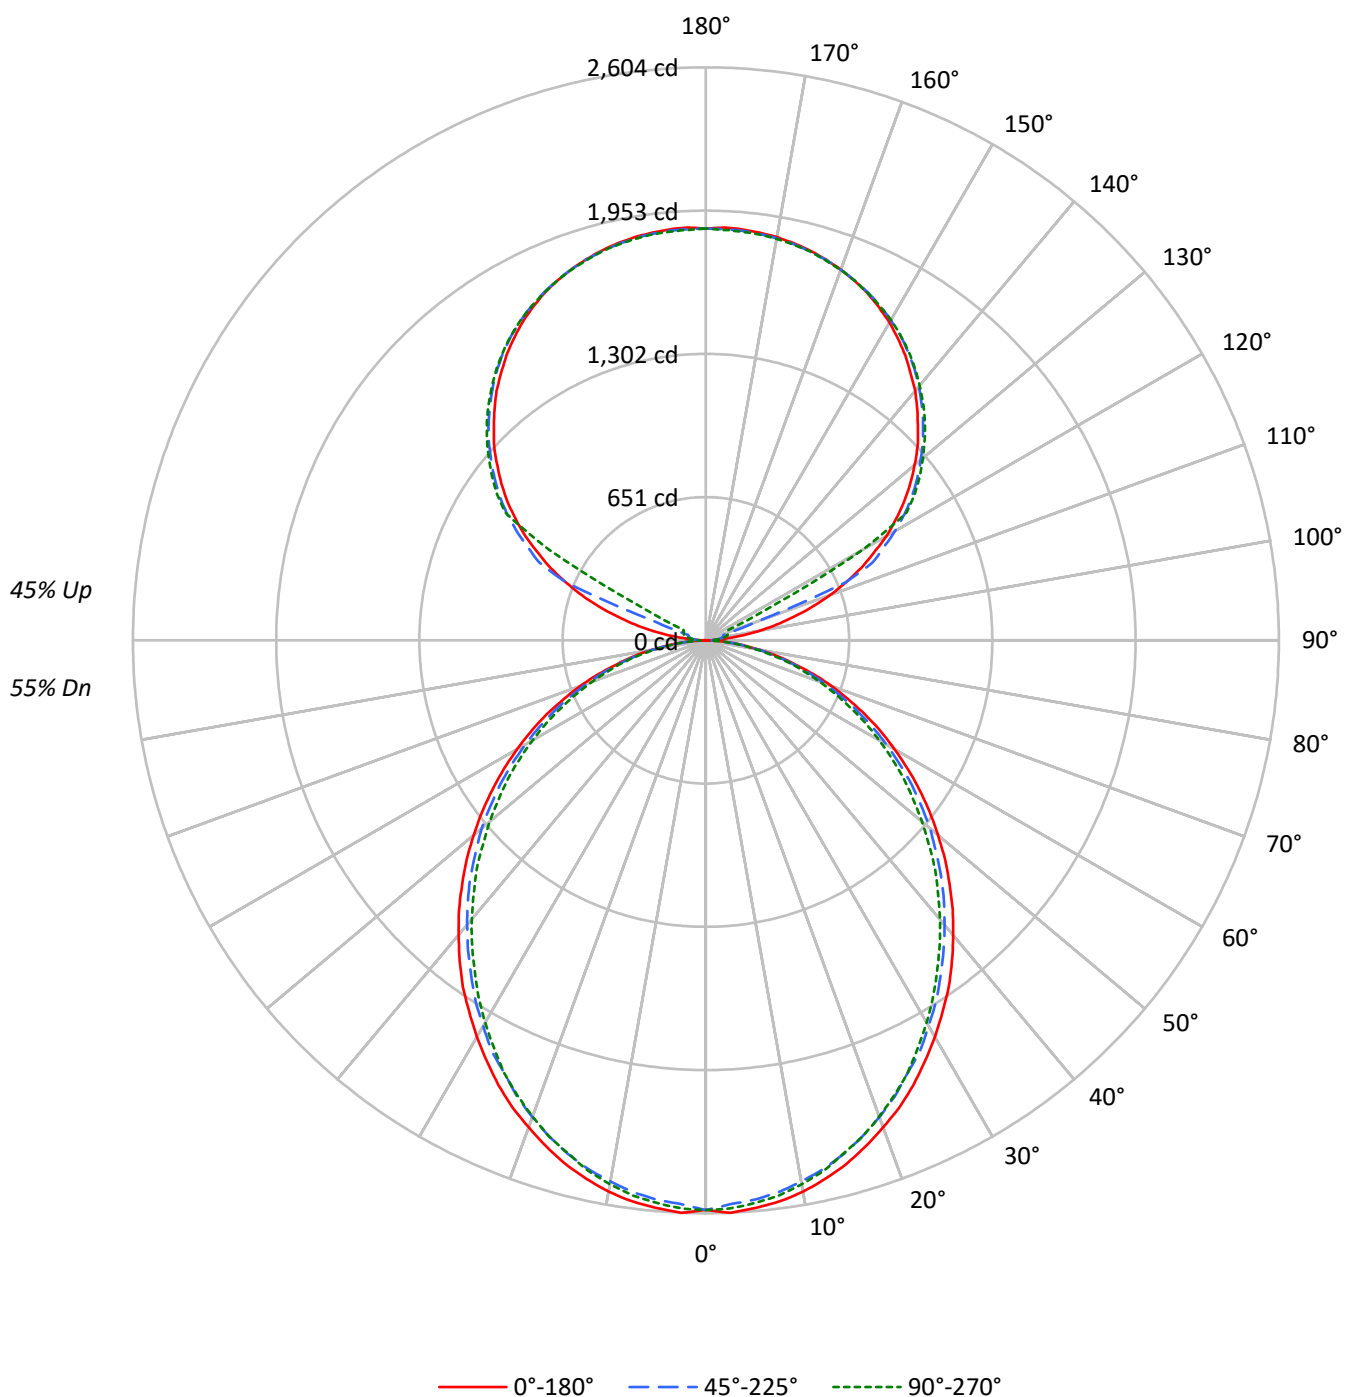

TEST NUMBER: P912803

CATALOG NUMBER: DFN2DIP-TR4F0-060D050US850-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	108	108	108	108	100	100	100	100	86	86	86		73	73	73		60
1	99	94	91	87	92	88	84	81	75	73	71		64	62	60		53
2	90	82	76	71	83	77	71	67	66	62	58		56	53	51		47
3	82	73	65	59	76	68	61	56	58	53	49		50	46	43		42
4	75	64	56	50	69	60	53	47	52	46	42		44	40	37		37
5	69	57	49	43	64	53	46	41	46	41	36		40	35	32		34
6	64	51	43	37	59	48	41	35	42	36	32		36	31	28		30
7	59	46	38	33	54	43	36	31	38	32	28		33	28	25		28
8	55	42	34	29	51	40	33	28	35	29	25		30	25	22		26
9	51	39	31	26	47	36	29	25	32	26	22		28	23	20		24
10	48	35	28	23	44	33	27	22	29	24	20		25	21	18		22

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2057	2057	2057
5°	2060	2028	2042
10°	2044	2001	2014
15°	2013	1968	1971
20°	1973	1922	1927
25°	1932	1867	1875
30°	1882	1816	1810
35°	1834	1756	1741
40°	1775	1696	1676
45°	1716	1635	1609
50°	1652	1571	1531
55°	1584	1497	1460
60°	1508	1409	1378
65°	1425	1319	1282
70°	1319	1208	1178
75°	1173	1075	1082
80°	997	906	899
85°	721	615	596

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1716 cd/sqm

TEST NUMBER: P912803

CATALOG NUMBER: DFN2DIP-TR4F0-060D050US850-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	243.7	2.0
10°-20°	685.6	5.7
20°-30°	1007.6	8.3
30°-40°	1170.3	9.7
40°-50°	1168.8	9.7
50°-60°	1019.2	8.4
60°-70°	753.4	6.2
70°-80°	426.3	3.5
80°-90°	115.8	1.0
90°-100°	61.7	0.5
100°-110°	230.0	1.9
110°-120°	610.1	5.1
120°-130°	1011.9	8.4
130°-140°	1074.8	8.9
140°-150°	999.0	8.3
150°-160°	803.1	6.7
160°-170°	517.5	4.3
170°-180°	178.1	1.5
0°-30°	1937.0	16.0
0°-40°	3107.2	25.7
0°-60°	5295.3	43.8
0°-90°	6590.7	54.6
90°-120°	901.9	7.5
90°-150°	3987.5	33.0
90°-180°	5486.0	45.4
0°-180°	12077.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2589	2589	2589	2589	2589	
5°	2589	2579	2552	2572	2567	246
15°	2465	2450	2417	2428	2415	694
25°	2231	2211	2168	2173	2168	1026
35°	1925	1900	1860	1845	1832	1202
45°	1566	1549	1511	1484	1474	1209
55°	1185	1170	1140	1110	1098	1060
65°	799	784	759	737	724	790
75°	418	413	401	386	391	446
85°	102	100	97	90	87	114
90°	1	16	27	34	36	11
95°	88	43	53	60	58	104
105°	412	452	83	98	103	440
115°	779	802	836	209	111	767
125°	1101	1118	1144	1154	1158	982
135°	1362	1384	1396	1410	1407	1052
145°	1580	1579	1602	1611	1605	988
155°	1740	1728	1744	1752	1742	802
165°	1833	1825	1829	1839	1829	518
175°	1875	1866	1869	1878	1865	178
180°	1871	1871	1871	1871	1871	



TEST NUMBER: P912803

CATALOG NUMBER: DFN2DIP-TR4F0-060D050US850-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2589.1	2589.1	2589.1	2589.1	2589.1
2.5°	2604.2	2591.7	2564.2	2589.1	2584.3
5°	2589.1	2579.3	2551.8	2571.7	2566.9
7.5°	2571.7	2556.9	2529.4	2549.5	2544.5
10°	2544.5	2527.1	2497.1	2517.0	2509.6
12.5°	2507.0	2492.1	2462.3	2474.7	2469.7
15°	2464.6	2449.9	2417.4	2427.5	2415.1
17.5°	2412.4	2397.7	2365.2	2377.5	2365.2
20°	2355.1	2340.3	2305.4	2312.8	2303.1
22.5°	2298.1	2275.6	2243.1	2243.1	2238.1
25°	2230.6	2210.9	2168.5	2173.3	2168.5
27.5°	2155.9	2138.5	2106.2	2098.9	2086.5
30°	2081.5	2061.3	2024.1	2016.7	2006.6
32.5°	2001.6	1986.9	1947.0	1931.9	1921.9
35°	1924.6	1899.7	1859.8	1844.7	1832.3
37.5°	1837.4	1814.9	1775.1	1757.5	1745.1
40°	1747.8	1727.7	1687.9	1665.7	1655.6
42.5°	1660.6	1640.5	1601.0	1575.9	1561.0
45°	1566.1	1548.6	1511.1	1484.0	1473.9
47.5°	1473.9	1456.4	1416.6	1389.1	1374.3
50°	1376.7	1364.3	1329.5	1294.5	1282.1
52.5°	1282.1	1264.7	1232.4	1205.0	1187.6
55°	1185.2	1170.1	1140.3	1110.4	1098.0
57.5°	1088.0	1075.6	1043.1	1013.3	1003.2
60°	990.8	981.0	946.2	918.7	911.3
62.5°	896.2	878.8	853.9	829.1	819.1
65°	799.3	784.3	759.4	736.9	724.5
67.5°	699.7	687.0	664.8	647.4	637.3
70°	607.5	597.5	575.0	557.6	547.8
72.5°	512.9	502.9	490.5	473.1	465.7
75°	418.1	413.4	400.7	385.9	390.9
77.5°	333.6	323.6	318.5	311.2	303.8
80°	249.1	246.4	241.4	234.0	229.0
82.5°	169.3	169.3	166.9	156.9	156.9
85°	101.9	99.6	97.1	89.5	87.2
87.5°	44.9	39.9	34.8	27.5	24.8
90°	1.3	16.2	27.1	33.9	36.5
92.5°	33.9	28.5	32.5	35.3	36.5
95°	87.9	43.3	52.8	59.7	58.2
97.5°	158.4	47.5	69.0	73.2	74.4
100°	239.8	54.2	77.2	87.9	90.7
102.5°	329.0	326.4	80.0	94.7	98.9
105°	411.7	452.4	82.6	97.5	102.9
107.5°	507.8	541.5	85.4	100.1	105.7
110°	600.0	628.2	237.0	101.6	106.9

TEST NUMBER: P912803

CATALOG NUMBER: DFN2DIP-TR4F0-060D050US850-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	686.6	710.9	687.9	104.2	108.3
115°	778.6	801.6	835.5	208.6	111.1
117.5°	858.5	885.5	908.7	714.9	360.2
120°	947.9	968.2	992.6	1008.9	826.0
122.5°	1023.6	1045.3	1072.5	1080.6	1082.1
125°	1100.8	1118.5	1144.3	1153.7	1157.8
127.5°	1171.2	1190.2	1210.7	1224.1	1225.4
130°	1237.6	1259.4	1274.1	1289.1	1287.9
132.5°	1305.4	1323.0	1337.8	1350.1	1348.8
135°	1362.3	1384.0	1396.0	1409.8	1407.0
137.5°	1421.7	1438.0	1451.7	1465.2	1461.2
140°	1480.0	1490.9	1505.7	1517.9	1511.2
142.5°	1528.9	1538.4	1555.9	1566.7	1559.9
145°	1580.3	1578.9	1601.8	1611.4	1604.6
147.5°	1624.9	1620.8	1643.9	1650.6	1645.3
150°	1668.3	1658.8	1680.5	1688.6	1681.8
152.5°	1704.8	1694.0	1714.3	1722.5	1713.0
155°	1740.0	1727.9	1744.1	1752.2	1741.5
157.5°	1768.4	1757.7	1769.9	1779.4	1768.4
160°	1792.9	1784.7	1792.9	1800.9	1791.5
162.5°	1814.4	1806.5	1813.1	1822.6	1810.4
165°	1833.4	1825.4	1829.4	1838.8	1829.4
167.5°	1848.4	1840.2	1844.4	1853.8	1841.6
170°	1860.6	1852.4	1855.1	1864.6	1852.4
172.5°	1868.7	1860.6	1863.3	1872.8	1860.6
175°	1875.4	1865.9	1868.7	1878.1	1864.6
177.5°	1878.1	1868.7	1870.1	1879.5	1867.3
180°	1871.3	1871.3	1871.3	1871.3	1871.3

TEST NUMBER: P912803

CATALOG NUMBER: DFN2DIP-TR4F0-060D050US850-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.18	11.09	11.10	12.02	13.23	9.75	10.66	10.67	11.59	12.80
	3H	11.85	12.66	12.78	13.60	14.83	11.38	12.19	12.30	13.13	14.36
	4H	12.44	13.20	13.38	14.15	15.39	11.96	12.73	12.91	13.68	14.92
	6H	12.84	13.55	13.79	14.50	15.75	12.36	13.07	13.32	14.03	15.28
	8H	12.95	13.62	13.91	14.59	15.84	12.47	13.14	13.43	14.12	15.36
	12H	12.99	13.64	13.96	14.60	15.88	12.51	13.16	13.48	14.12	15.40
4H	2H	10.65	11.42	11.60	12.37	13.61	10.31	11.07	11.26	12.02	13.26
	3H	12.52	13.16	13.48	14.14	15.39	12.13	12.77	13.09	13.75	15.00
	4H	13.24	13.82	14.21	14.80	16.07	12.83	13.42	13.80	14.39	15.67
	6H	13.75	14.26	14.74	15.26	16.53	13.35	13.85	14.33	14.85	16.12
	8H	13.91	14.38	14.89	15.37	16.66	13.49	13.96	14.48	14.96	16.24
	12H	13.98	14.41	14.98	15.41	16.71	13.56	13.98	14.56	14.99	16.29
8H	4H	13.44	13.91	14.42	14.90	16.19	13.08	13.55	14.06	14.54	15.83
	6H	14.07	14.46	15.08	15.49	16.78	13.71	14.10	14.72	15.13	16.42
	8H	14.29	14.64	15.31	15.66	16.96	13.92	14.27	14.94	15.29	16.59
	12H	14.42	14.73	15.45	15.74	17.09	14.04	14.34	15.06	15.36	16.71
12H	4H	13.43	13.85	14.43	14.86	16.15	13.07	13.50	14.08	14.51	15.80
	6H	14.10	14.45	15.12	15.46	16.77	13.75	14.09	14.77	15.11	16.42
	8H	14.34	14.65	15.36	15.66	17.01	13.99	14.29	15.01	15.30	16.66

END OF REPORT