

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P912893

Luminaire Tested: DFN2DIP-TR4F0-080D090US850-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P912893
REPORT IS A COMBINATION OF REPORTS P901988 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-080D090US850-RLLONL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 17422.4 lumens
Efficiency: N/A
Efficacy: 122.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 142.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P912893

CATALOG NUMBER: DFN2DIP-TR4F0-080D090US850-RLLONL

Luminous Intensity Polar Plot

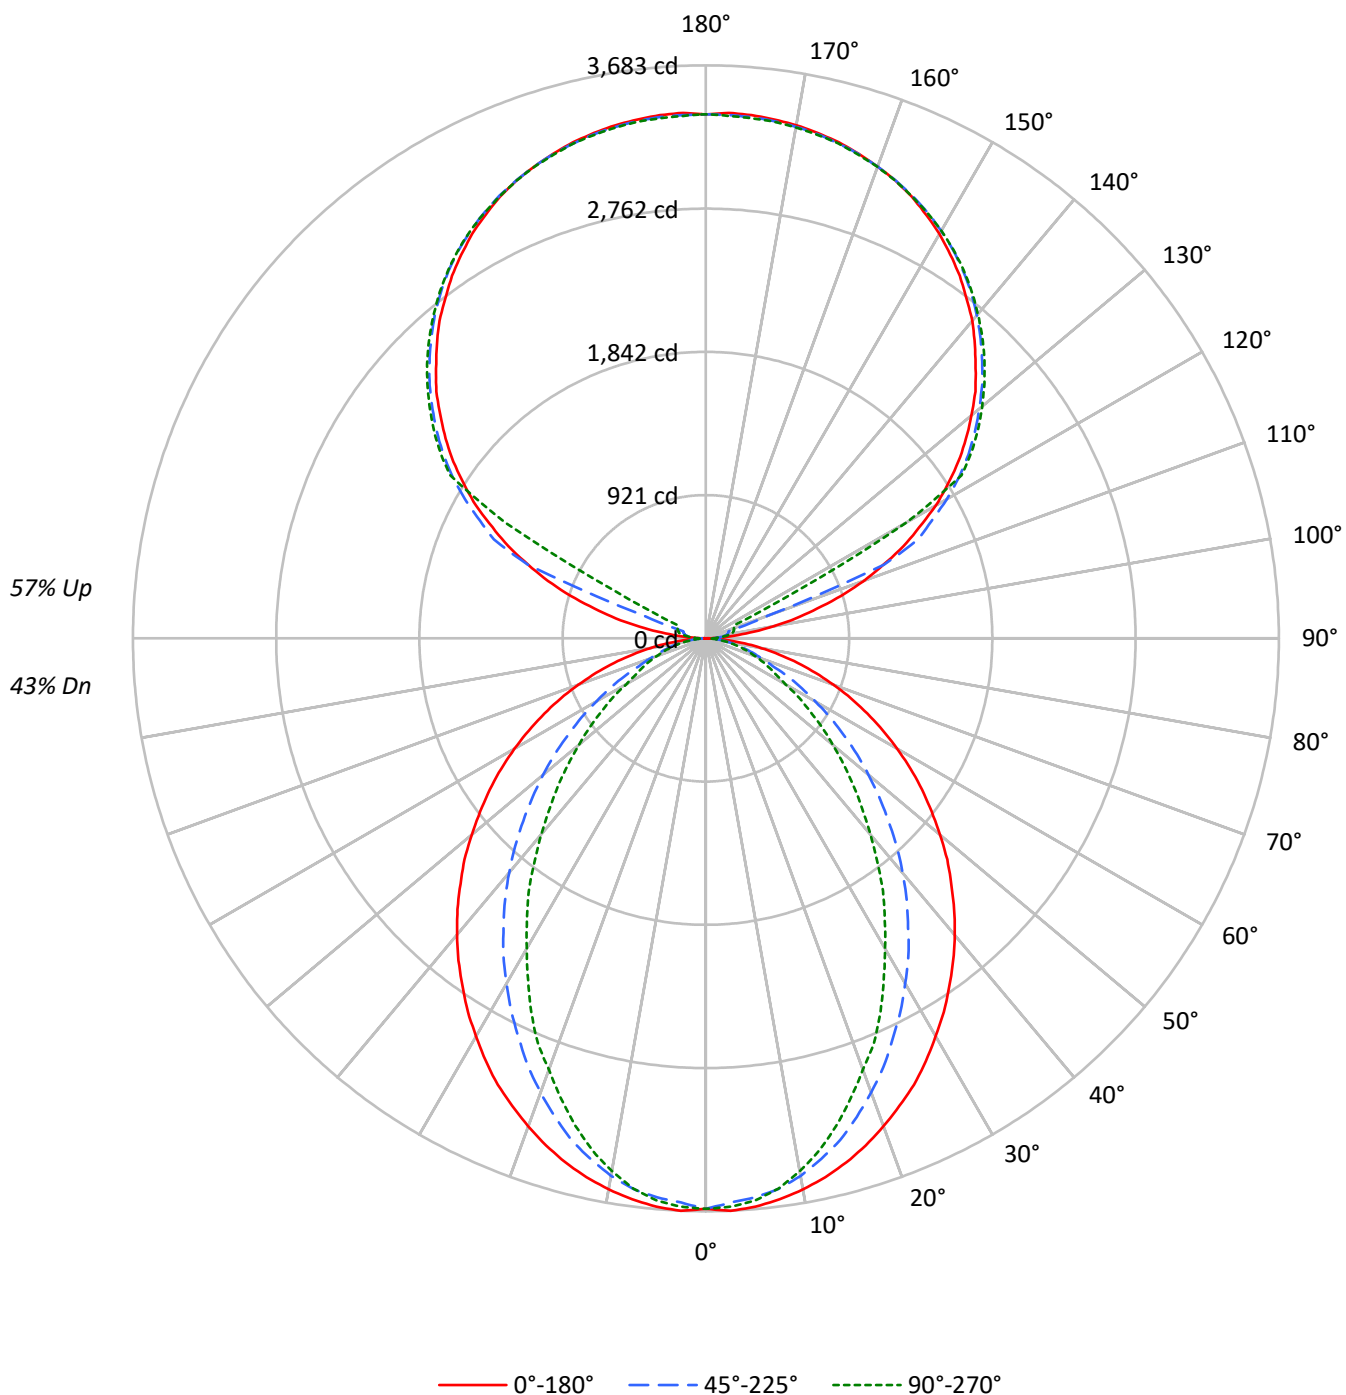

TEST NUMBER: P912893

CATALOG NUMBER: DFN2DIP-TR4F0-080D090US850-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	80	80	80	64	64	64	50	50	50
1	97	93	89	86	88	85	82	79	70	68	66	57	56	54	45	44	43
2	88	81	75	71	81	75	70	65	62	59	55	51	48	46	40	38	37
3	81	72	65	59	74	66	60	55	55	51	47	45	42	39	36	34	32
4	74	64	56	50	68	59	52	47	49	44	40	40	37	34	32	30	28
5	68	57	49	43	62	53	46	41	44	39	35	36	33	30	29	27	24
6	63	51	43	38	57	47	40	35	40	35	31	33	29	26	27	24	22
7	58	46	39	33	53	43	36	31	36	31	27	30	26	23	24	22	19
8	54	42	35	30	49	39	32	28	33	28	24	28	24	21	23	20	18
9	50	39	31	26	46	36	29	25	31	25	22	26	22	19	21	18	16
10	47	35	28	24	43	33	27	22	28	23	20	24	20	17	19	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2913	2913	2913
5°	2918	2867	2885
10°	2889	2811	2791
15°	2849	2718	2646
20°	2797	2590	2468
25°	2743	2446	2296
30°	2670	2299	2077
35°	2599	2140	1886
40°	2527	1977	1666
45°	2444	1795	1467
50°	2357	1612	1272
55°	2267	1416	1086
60°	2162	1211	894
65°	2041	1002	804
70°	1896	808	728
75°	1712	713	662
80°	1446	597	573
85°	1008	399	431

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2444 cd/sqm

TEST NUMBER: P912893

CATALOG NUMBER: DFN2DIP-TR4F0-080D090US850-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	343.7	2.0
10°-20°	943.4	5.4
20°-30°	1324.5	7.6
30°-40°	1443.8	8.3
40°-50°	1327.0	7.6
50°-60°	1042.1	6.0
60°-70°	678.3	3.9
70°-80°	349.2	2.0
80°-90°	95.1	0.5
90°-100°	111.1	0.6
100°-110°	414.0	2.4
110°-120°	1098.2	6.3
120°-130°	1821.4	10.5
130°-140°	1934.7	11.1
140°-150°	1798.1	10.3
150°-160°	1445.6	8.3
160°-170°	931.5	5.3
170°-180°	320.6	1.8
0°-30°	2611.6	15.0
0°-40°	4055.4	23.3
0°-60°	6424.5	36.9
0°-90°	7547.1	43.3
90°-120°	1623.3	9.3
90°-150°	7177.5	41.2
90°-180°	9875.0	56.7
0°-180°	17422.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3667	3667	3667	3667	3667	
5°	3667	3650	3607	3637	3627	348
15°	3488	3451	3338	3275	3242	983
25°	3166	3060	2840	2705	2655	1456
35°	2728	2558	2267	2058	1984	1707
45°	2230	2008	1659	1423	1344	1722
55°	1696	1437	1078	879	816	1515
65°	1145	876	577	465	454	1135
75°	610	378	266	242	239	646
85°	143	73	63	63	63	164
90°	2	29	49	61	66	16
95°	158	78	95	107	105	188
105°	741	814	149	175	185	792
115°	1401	1443	1504	375	200	1380
125°	1982	2013	2060	2077	2084	1767
135°	2452	2491	2513	2538	2533	1894
145°	2845	2842	2883	2900	2888	1779
155°	3132	3110	3140	3154	3135	1443
165°	3300	3286	3293	3310	3293	932
175°	3376	3359	3364	3381	3356	321
180°	3368	3368	3368	3368	3368	

TEST NUMBER: P912893

CATALOG NUMBER: DFN2DIP-TR4F0-080D090US850-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3666.8	3666.8	3666.8	3666.8	3666.8
2.5°	3683.3	3666.8	3630.2	3663.6	3656.9
5°	3666.8	3650.3	3606.9	3636.9	3627.0
7.5°	3636.9	3617.1	3570.6	3583.7	3567.1
10°	3597.0	3573.9	3507.7	3497.5	3477.7
12.5°	3547.5	3517.5	3427.7	3408.0	3371.4
15°	3487.6	3451.0	3338.3	3275.3	3242.2
17.5°	3417.8	3364.7	3225.3	3152.4	3099.2
20°	3338.3	3271.8	3106.0	3023.2	2949.9
22.5°	3252.0	3175.6	2983.1	2870.4	2820.7
25°	3165.8	3059.5	2840.5	2704.6	2654.6
27.5°	3062.9	2949.9	2707.7	2551.8	2475.4
30°	2953.5	2827.1	2561.7	2392.7	2302.8
32.5°	2847.1	2694.4	2422.6	2223.3	2140.3
35°	2727.8	2558.5	2266.6	2057.5	1984.2
37.5°	2611.6	2428.9	2120.5	1891.3	1808.6
40°	2488.8	2289.9	1967.7	1732.1	1645.9
42.5°	2362.7	2150.5	1815.2	1569.6	1486.7
45°	2230.0	2007.5	1659.3	1423.4	1343.9
47.5°	2104.0	1868.4	1510.0	1274.1	1201.3
50°	1964.5	1729.0	1364.0	1134.7	1065.3
52.5°	1828.3	1579.3	1224.4	1005.5	942.5
55°	1695.6	1436.8	1078.4	879.4	816.4
57.5°	1559.7	1294.2	949.2	763.3	710.1
60°	1420.2	1154.8	812.9	643.9	590.8
62.5°	1284.3	1018.8	696.8	537.6	511.2
65°	1144.9	875.9	577.3	464.8	454.5
67.5°	1012.2	743.3	464.8	408.0	398.2
70°	872.8	614.1	384.8	351.7	338.4
72.5°	740.0	494.3	321.8	295.4	288.7
75°	610.5	378.2	265.5	242.2	239.1
77.5°	481.3	268.6	209.2	195.7	189.1
80°	361.5	192.6	159.1	146.1	146.1
82.5°	252.1	129.5	109.5	102.8	102.8
85°	142.6	72.9	63.0	63.0	63.0
87.5°	53.1	26.4	26.4	23.3	23.3
90°	2.3	29.3	48.6	61.1	65.7
92.5°	61.1	51.2	58.4	63.4	65.7
95°	158.4	77.9	94.9	107.4	104.8
97.5°	285.1	85.4	124.2	131.6	134.0
100°	431.5	97.6	139.0	158.4	163.2
102.5°	592.2	587.5	143.8	170.5	178.0
105°	740.9	814.2	148.7	175.4	185.2
107.5°	914.0	974.8	153.7	180.3	190.2
110°	1079.8	1130.8	426.6	182.9	192.5

TEST NUMBER: P912893

CATALOG NUMBER: DFN2DIP-TR4F0-080D090US850-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1235.9	1279.6	1238.2	187.5	195.1
115°	1401.4	1442.8	1503.9	375.4	200.0
117.5°	1545.3	1594.0	1635.6	1286.9	648.3
120°	1706.2	1742.7	1786.7	1815.9	1486.8
122.5°	1842.6	1881.6	1930.5	1945.0	1947.6
125°	1981.5	2013.3	2059.6	2076.7	2083.9
127.5°	2108.2	2142.4	2179.2	2203.5	2205.8
130°	2227.8	2266.9	2293.5	2320.4	2318.1
132.5°	2349.6	2381.5	2408.1	2430.2	2427.8
135°	2452.1	2491.1	2512.9	2537.5	2532.6
137.5°	2559.2	2588.4	2613.0	2637.3	2630.1
140°	2663.9	2683.7	2710.3	2732.2	2720.2
142.5°	2752.0	2769.1	2800.6	2820.0	2807.9
145°	2844.6	2841.9	2883.4	2900.5	2888.3
147.5°	2924.8	2917.6	2958.9	2971.1	2961.5
150°	3003.0	2985.9	3024.9	3039.3	3027.2
152.5°	3068.6	3049.2	3085.7	3100.4	3083.4
155°	3132.0	3110.3	3139.5	3154.0	3134.6
157.5°	3183.3	3163.9	3185.8	3202.9	3183.3
160°	3227.2	3212.4	3227.2	3241.7	3224.6
162.5°	3266.0	3251.5	3263.7	3280.8	3258.8
165°	3300.2	3285.6	3293.0	3310.0	3293.0
167.5°	3327.1	3312.4	3319.8	3336.9	3314.9
170°	3349.1	3334.3	3339.2	3356.3	3334.3
172.5°	3363.6	3349.1	3353.9	3371.0	3349.1
175°	3375.7	3358.6	3363.6	3380.6	3356.3
177.5°	3380.6	3363.6	3366.1	3383.2	3361.3
180°	3368.5	3368.5	3368.5	3368.5	3368.5

TEST NUMBER: P912893

CATALOG NUMBER: DFN2DIP-TR4F0-080D090US850-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.20	10.98	11.22	12.00	13.37	6.17	6.95	7.19	7.97	9.34
	3H	11.87	12.57	12.90	13.60	14.99	7.36	8.05	8.39	9.09	10.47
	4H	12.48	13.14	13.52	14.17	15.57	7.81	8.47	8.85	9.50	10.89
	6H	12.90	13.50	13.95	14.54	15.95	8.13	8.73	9.18	9.77	11.18
	8H	13.02	13.60	14.08	14.65	16.05	8.22	8.79	9.27	9.85	11.25
	12H	13.08	13.63	14.14	14.68	16.10	8.26	8.81	9.32	9.85	11.28
4H	2H	10.21	10.87	11.26	11.90	13.30	6.76	7.42	7.81	8.46	9.85
	3H	12.04	12.58	13.09	13.65	15.05	8.11	8.66	9.16	9.72	11.13
	4H	12.73	13.23	13.79	14.28	15.71	8.65	9.16	9.72	10.21	11.64
	6H	13.24	13.67	14.31	14.75	16.17	9.07	9.50	10.14	10.58	12.00
	8H	13.41	13.81	14.48	14.88	16.32	9.20	9.60	10.27	10.67	12.11
	12H	13.50	13.87	14.59	14.95	16.39	9.26	9.63	10.35	10.71	12.15
8H	4H	12.69	13.09	13.76	14.16	15.60	8.93	9.33	10.00	10.40	11.84
	6H	13.25	13.59	14.35	14.70	16.13	9.45	9.78	10.54	10.89	12.33
	8H	13.47	13.76	14.57	14.86	16.31	9.64	9.93	10.74	11.03	12.48
	12H	13.61	13.86	14.71	14.95	16.45	9.76	10.01	10.86	11.10	12.60
12H	4H	12.64	13.00	13.73	14.09	15.53	8.93	9.30	10.02	10.38	11.82
	6H	13.23	13.52	14.33	14.61	16.07	9.50	9.79	10.60	10.88	12.34
	8H	13.45	13.70	14.55	14.79	16.29	9.71	9.96	10.81	11.05	12.55

END OF REPORT