

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P912913

Luminaire Tested: DFN2DIP-TR4F0-090D050US850-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P912913
REPORT IS A COMBINATION OF REPORTS P901918 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-090D050US850-RLLONL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13973.5 lumens
Efficiency: N/A
Efficacy: 111.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 125.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.099
Total Harmonic Distortion (THDi): 0.979
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P912913

CATALOG NUMBER: DFN2DIP-TR4F0-090D050US850-RLLONL

Luminous Intensity Polar Plot

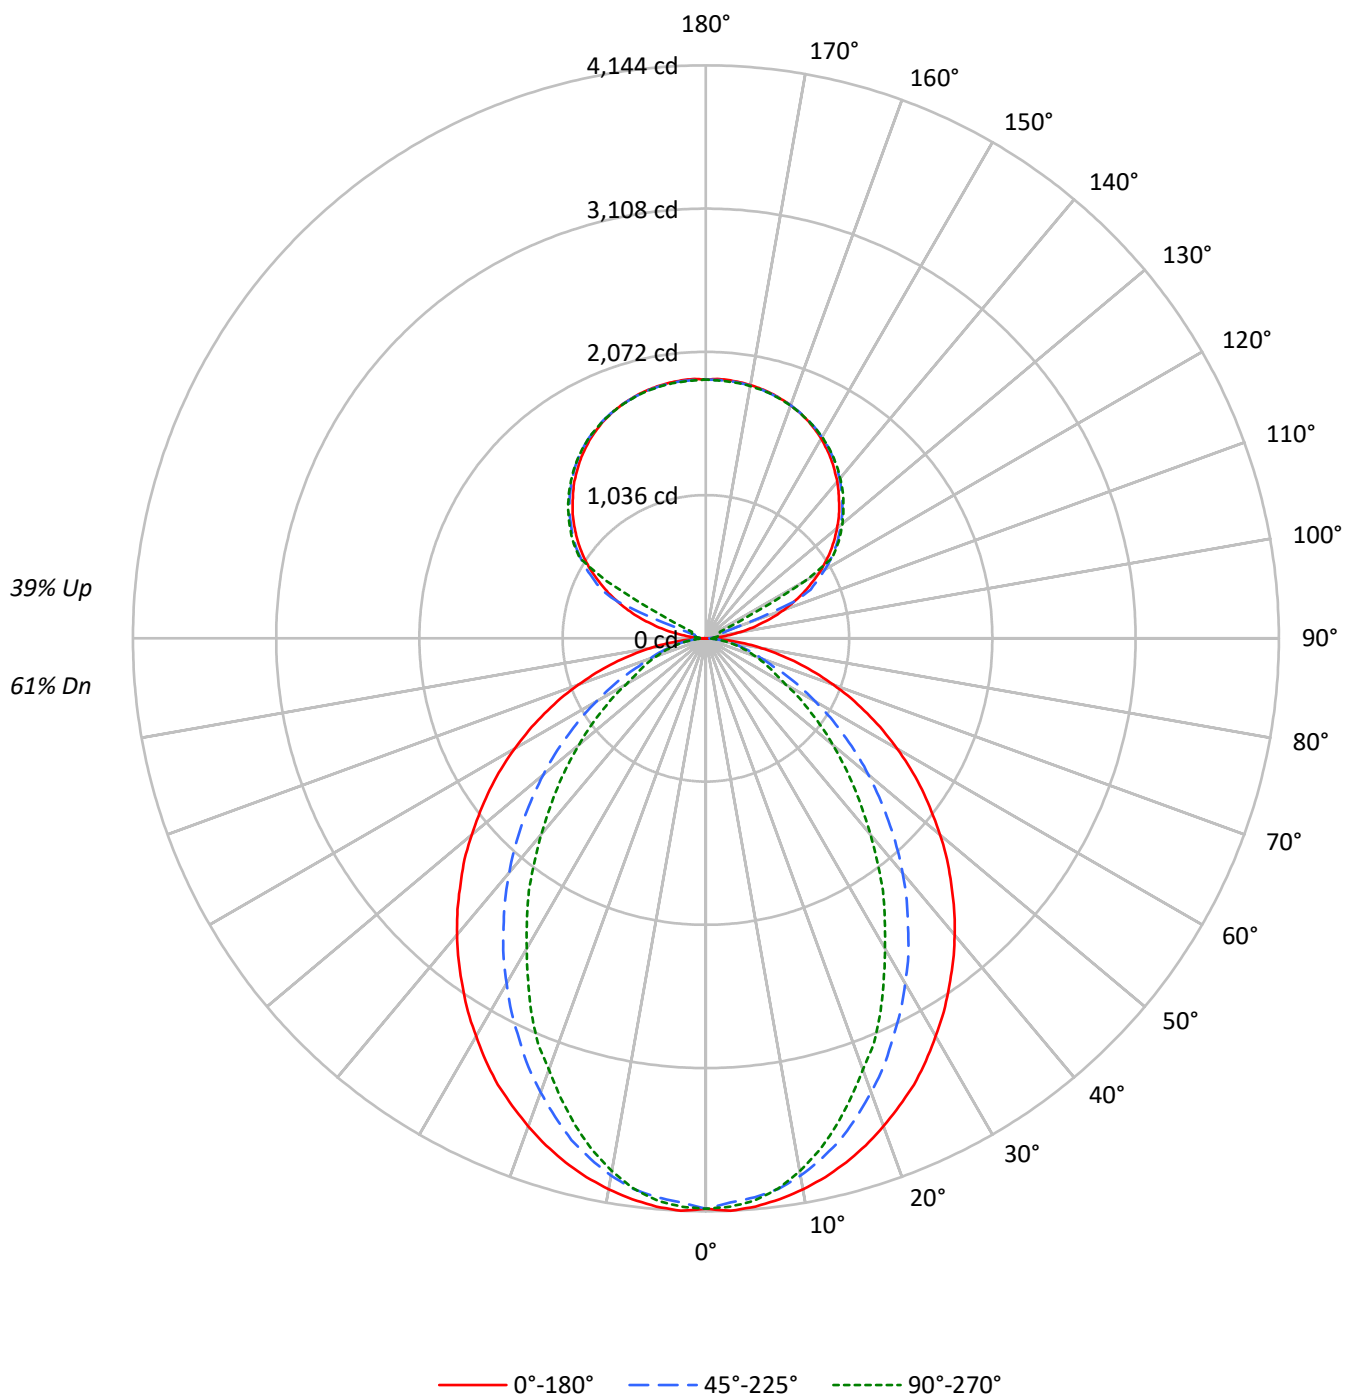

TEST NUMBER: P912913

CATALOG NUMBER: DFN2DIP-TR4F0-090D050US850-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	89	89	89	77	77	77	66	66	66
1	101	97	93	90	94	91	87	84	79	77	75	69	67	65	59	58	57
2	92	85	79	74	86	80	75	70	70	66	63	61	58	56	53	51	49
3	85	75	68	62	79	71	65	59	62	58	53	55	51	48	47	45	42
4	78	67	59	53	73	63	56	51	56	50	46	49	45	41	43	40	37
5	72	60	52	46	67	57	50	44	50	45	40	44	40	36	39	35	33
6	66	54	46	41	62	51	44	39	46	40	35	40	36	32	35	32	29
7	61	49	41	36	57	47	39	34	42	36	32	37	32	29	33	29	26
8	57	45	37	32	53	43	36	31	38	32	28	34	29	26	30	26	23
9	53	41	34	29	50	39	32	28	35	30	26	31	27	23	28	24	21
10	50	38	31	26	47	36	30	25	33	27	23	29	25	21	26	22	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3277	3277	3277
5°	3282	3225	3246
10°	3250	3162	3140
15°	3205	3057	2977
20°	3146	2913	2776
25°	3086	2752	2583
30°	3004	2586	2337
35°	2924	2408	2122
40°	2843	2224	1874
45°	2749	2019	1650
50°	2652	1813	1431
55°	2550	1593	1221
60°	2432	1362	1005
65°	2297	1128	905
70°	2133	910	818
75°	1926	802	744
80°	1628	672	645
85°	1134	449	485

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2749 cd/sqm

TEST NUMBER: P912913

CATALOG NUMBER: DFN2DIP-TR4F0-090D050US850-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	386.6	2.8
10°-20°	1061.3	7.6
20°-30°	1490.1	10.7
30°-40°	1624.3	11.6
40°-50°	1492.9	10.7
50°-60°	1172.4	8.4
60°-70°	763.1	5.5
70°-80°	392.8	2.8
80°-90°	103.6	0.7
90°-100°	61.7	0.4
100°-110°	230.0	1.6
110°-120°	610.1	4.4
120°-130°	1011.9	7.2
130°-140°	1074.8	7.7
140°-150°	999.0	7.1
150°-160°	803.1	5.7
160°-170°	517.5	3.7
170°-180°	178.1	1.3
0°-30°	2938.0	21.0
0°-40°	4562.3	32.6
0°-60°	7227.6	51.7
0°-90°	8487.2	60.7
90°-120°	901.9	6.5
90°-150°	3987.5	28.5
90°-180°	5486.0	39.3
0°-180°	13973.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4125	4125	4125	4125	4125	
5°	4125	4106	4058	4091	4080	391
15°	3924	3882	3756	3685	3648	1106
25°	3562	3442	3196	3043	2986	1638
35°	3069	2878	2550	2315	2232	1921
45°	2509	2258	1867	1601	1512	1937
55°	1908	1616	1213	989	918	1705
65°	1288	986	650	523	511	1277
75°	687	425	299	272	269	726
85°	160	82	71	71	71	184
90°	1	16	27	34	36	13
95°	88	43	53	60	58	104
105°	412	452	83	98	103	440
115°	779	802	836	209	111	767
125°	1101	1118	1144	1154	1158	982
135°	1362	1384	1396	1410	1407	1052
145°	1580	1579	1602	1611	1605	988
155°	1740	1728	1744	1752	1742	802
165°	1833	1825	1829	1839	1829	518
175°	1875	1866	1869	1878	1865	178
180°	1871	1871	1871	1871	1871	

TEST NUMBER: P912913

CATALOG NUMBER: DFN2DIP-TR4F0-090D050US850-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4125.1	4125.1	4125.1	4125.1	4125.1
2.5°	4143.8	4125.1	4083.9	4121.6	4114.1
5°	4125.1	4106.5	4057.8	4091.4	4080.3
7.5°	4091.4	4069.3	4017.0	4031.7	4013.0
10°	4046.7	4020.6	3946.2	3934.6	3912.4
12.5°	3990.8	3957.2	3856.2	3834.0	3792.8
15°	3923.5	3882.4	3755.6	3684.7	3647.5
17.5°	3845.1	3785.3	3628.4	3546.5	3486.7
20°	3755.6	3680.8	3494.1	3401.1	3318.7
22.5°	3658.6	3572.6	3355.9	3229.2	3173.4
25°	3561.6	3441.9	3195.6	3042.7	2986.4
27.5°	3445.9	3318.7	3046.2	2870.8	2784.8
30°	3322.7	3180.5	2881.8	2691.8	2590.7
32.5°	3203.0	3031.1	2725.4	2501.2	2407.7
35°	3068.8	2878.3	2549.9	2314.7	2232.3
37.5°	2938.1	2732.6	2385.6	2127.7	2034.7
40°	2799.9	2576.1	2213.7	1948.7	1851.7
42.5°	2658.1	2419.3	2042.1	1765.7	1672.6
45°	2508.8	2258.5	1866.7	1601.3	1511.8
47.5°	2366.9	2102.0	1698.8	1433.4	1351.4
50°	2210.1	1945.1	1534.4	1276.6	1198.5
52.5°	2056.9	1776.8	1377.6	1131.2	1060.3
55°	1907.5	1616.4	1213.1	989.4	918.5
57.5°	1754.7	1456.0	1067.9	858.7	798.9
60°	1597.7	1299.1	914.6	724.4	664.6
62.5°	1444.9	1146.3	783.8	604.8	575.1
65°	1288.0	985.5	649.5	522.8	511.4
67.5°	1138.7	836.1	522.8	459.0	447.9
70°	981.9	690.8	433.0	395.7	380.6
72.5°	832.5	556.1	362.0	332.3	324.8
75°	686.8	425.4	298.7	272.5	268.9
77.5°	541.4	302.2	235.2	220.2	212.7
80°	406.8	216.7	179.0	164.4	164.4
82.5°	283.6	145.7	123.2	115.7	115.7
85°	160.4	82.0	70.9	70.9	70.9
87.5°	59.8	29.7	29.7	26.2	26.2
90°	1.3	16.2	27.1	33.9	36.5
92.5°	33.9	28.5	32.5	35.3	36.5
95°	87.9	43.3	52.8	59.7	58.2
97.5°	158.4	47.5	69.0	73.2	74.4
100°	239.8	54.2	77.2	87.9	90.7
102.5°	329.0	326.4	80.0	94.7	98.9
105°	411.7	452.4	82.6	97.5	102.9
107.5°	507.8	541.5	85.4	100.1	105.7
110°	600.0	628.2	237.0	101.6	106.9



TEST NUMBER: P912913

CATALOG NUMBER: DFN2DIP-TR4F0-090D050US850-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	686.6	710.9	687.9	104.2	108.3
115°	778.6	801.6	835.5	208.6	111.1
117.5°	858.5	885.5	908.7	714.9	360.2
120°	947.9	968.2	992.6	1008.9	826.0
122.5°	1023.6	1045.3	1072.5	1080.6	1082.1
125°	1100.8	1118.5	1144.3	1153.7	1157.8
127.5°	1171.2	1190.2	1210.7	1224.1	1225.4
130°	1237.6	1259.4	1274.1	1289.1	1287.9
132.5°	1305.4	1323.0	1337.8	1350.1	1348.8
135°	1362.3	1384.0	1396.0	1409.8	1407.0
137.5°	1421.7	1438.0	1451.7	1465.2	1461.2
140°	1480.0	1490.9	1505.7	1517.9	1511.2
142.5°	1528.9	1538.4	1555.9	1566.7	1559.9
145°	1580.3	1578.9	1601.8	1611.4	1604.6
147.5°	1624.9	1620.8	1643.9	1650.6	1645.3
150°	1668.3	1658.8	1680.5	1688.6	1681.8
152.5°	1704.8	1694.0	1714.3	1722.5	1713.0
155°	1740.0	1727.9	1744.1	1752.2	1741.5
157.5°	1768.4	1757.7	1769.9	1779.4	1768.4
160°	1792.9	1784.7	1792.9	1800.9	1791.5
162.5°	1814.4	1806.5	1813.1	1822.6	1810.4
165°	1833.4	1825.4	1829.4	1838.8	1829.4
167.5°	1848.4	1840.2	1844.4	1853.8	1841.6
170°	1860.6	1852.4	1855.1	1864.6	1852.4
172.5°	1868.7	1860.6	1863.3	1872.8	1860.6
175°	1875.4	1865.9	1868.7	1878.1	1864.6
177.5°	1878.1	1868.7	1870.1	1879.5	1867.3
180°	1871.3	1871.3	1871.3	1871.3	1871.3

TEST NUMBER: P912913

CATALOG NUMBER: DFN2DIP-TR4F0-090D050US850-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.21	13.14	13.08	14.02	15.13	8.19	9.11	9.05	10.00	11.11
	3H	13.90	14.73	14.78	15.62	16.76	9.38	10.21	10.26	11.10	12.24
	4H	14.51	15.29	15.41	16.19	17.34	9.84	10.62	10.73	11.52	12.67
	6H	14.94	15.66	15.84	16.56	17.72	10.17	10.89	11.07	11.79	12.95
	8H	15.07	15.75	15.98	16.67	17.83	10.26	10.94	11.17	11.87	13.03
	12H	15.13	15.78	16.05	16.70	17.88	10.31	10.96	11.23	11.87	13.06
4H	2H	12.24	13.03	13.14	13.92	15.07	8.79	9.58	9.69	10.47	11.62
	3H	14.08	14.73	14.99	15.66	16.82	10.15	10.80	11.06	11.73	12.90
	4H	14.78	15.37	15.70	16.29	17.48	10.71	11.30	11.63	12.22	13.41
	6H	15.30	15.81	16.23	16.76	17.95	11.13	11.64	12.07	12.59	13.78
	8H	15.47	15.95	16.41	16.89	18.10	11.26	11.74	12.20	12.68	13.88
	12H	15.57	16.00	16.53	16.96	18.17	11.33	11.76	12.29	12.72	13.93
8H	4H	14.75	15.23	15.69	16.17	17.37	10.99	11.47	11.93	12.41	13.61
	6H	15.32	15.71	16.28	16.70	17.90	11.52	11.91	12.48	12.89	14.10
	8H	15.54	15.89	16.51	16.86	18.08	11.71	12.06	12.68	13.03	14.25
	12H	15.68	15.99	16.66	16.95	18.22	11.83	12.14	12.81	13.11	14.37
12H	4H	14.71	15.14	15.66	16.10	17.31	11.00	11.43	11.96	12.39	13.60
	6H	15.30	15.64	16.27	16.62	17.84	11.57	11.91	12.54	12.89	14.11
	8H	15.52	15.83	16.50	16.80	18.06	11.78	12.09	12.76	13.05	14.32

END OF REPORT