

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P912943

Luminaire Tested: DFN2DIP-TR4F0-100D040US850-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P912943
REPORT IS A COMBINATION OF REPORTS P901901 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-100D040US850-FLLONL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15370.7 lumens
Efficiency: N/A
Efficacy: 117.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 131.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9972
Total Harmonic Distortion (THDi): 0.128
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P912943

CATALOG NUMBER: DFN2DIP-TR4F0-100D040US850-FLLONL

Luminous Intensity Polar Plot

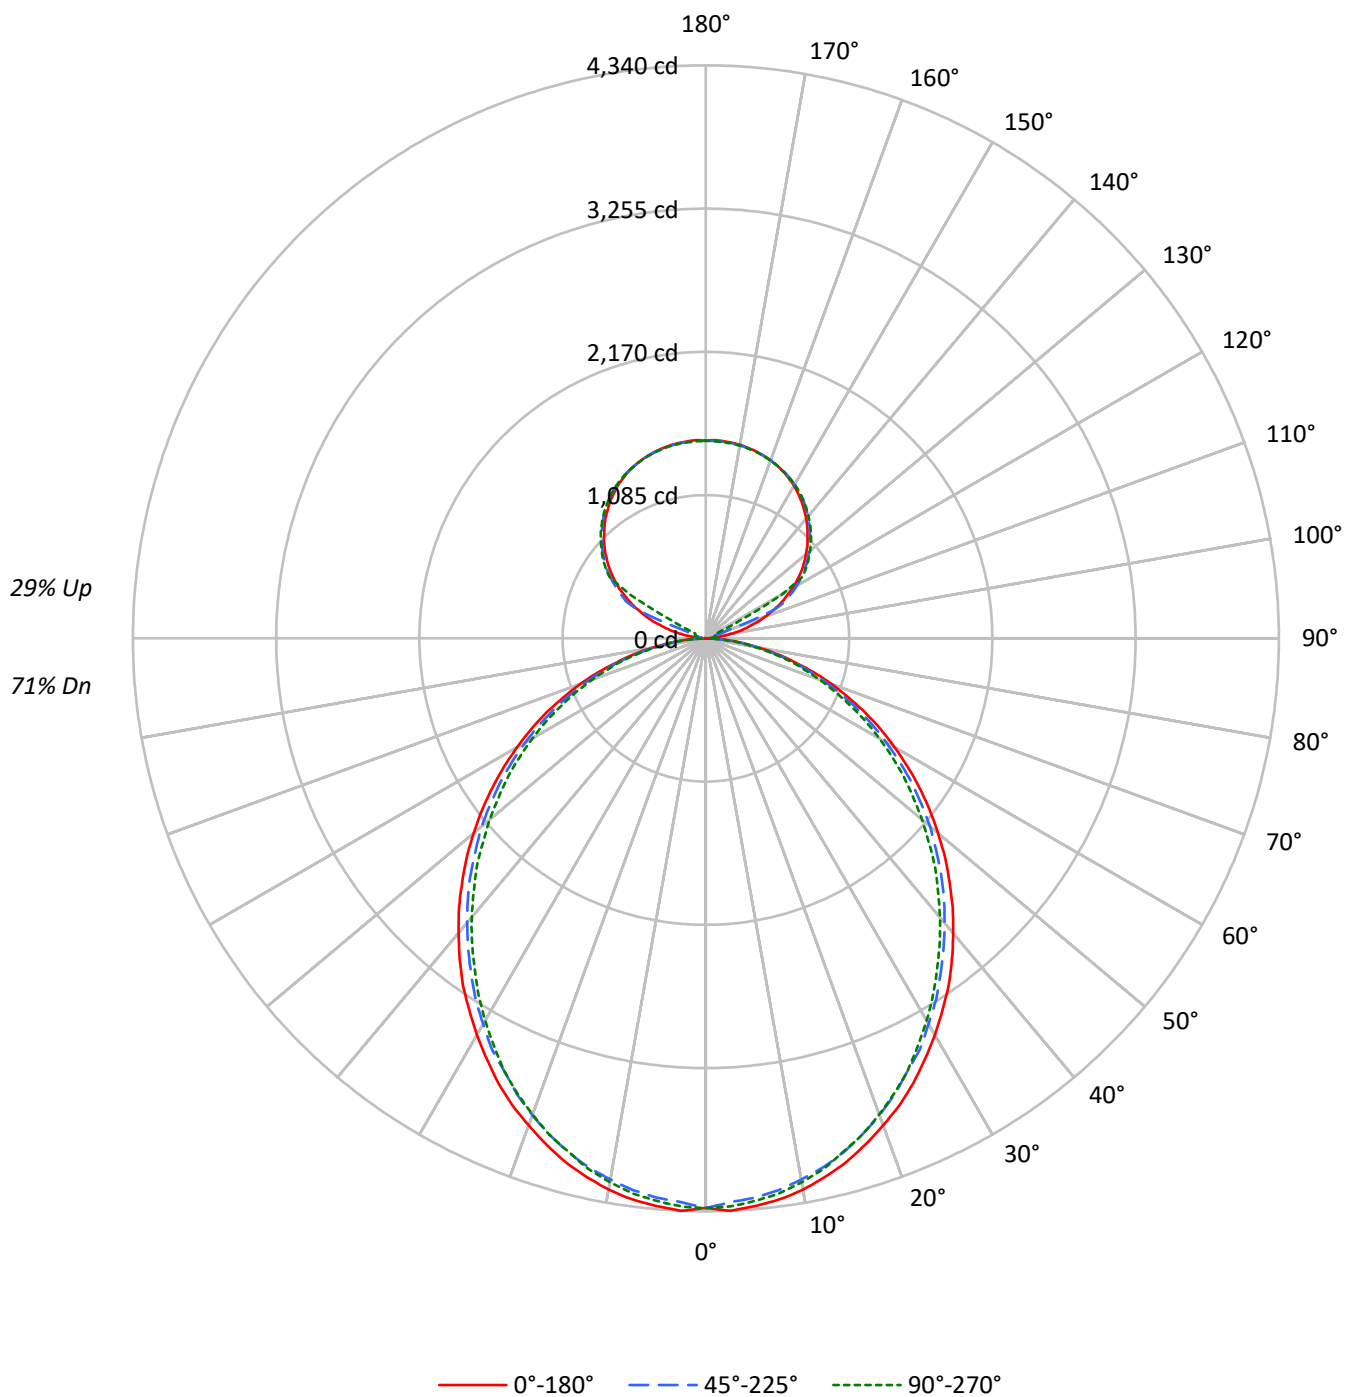

TEST NUMBER: P912943

CATALOG NUMBER: DFN2DIP-TR4F0-100D040US850-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	112	112	112	112	106	106	106	106	95	95	95		85	85	85		76
1	103	98	94	90	97	93	90	86	84	81	78		75	73	71		67
2	93	86	79	74	88	81	76	71	73	69	65		66	62	59		59
3	85	75	68	62	80	72	65	59	65	59	55		58	54	50		52
4	78	67	59	52	74	64	56	50	58	52	47		52	47	43		47
5	72	60	51	45	68	57	49	44	52	45	40		47	42	38		42
6	66	54	45	39	63	51	44	38	47	40	35		42	37	33		38
7	61	49	40	35	58	47	39	34	42	36	31		39	33	29		35
8	57	44	36	31	54	42	35	30	39	33	28		35	30	26		32
9	53	41	33	28	50	39	32	27	36	30	25		33	27	24		30
10	50	37	30	25	47	36	29	24	33	27	23		30	25	21		28

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3428	3428	3428
5°	3434	3380	3403
10°	3406	3335	3357
15°	3356	3280	3285
20°	3288	3204	3211
25°	3221	3112	3126
30°	3137	3027	3017
35°	3057	2927	2902
40°	2958	2826	2793
45°	2860	2725	2682
50°	2753	2618	2552
55°	2641	2495	2433
60°	2514	2349	2297
65°	2375	2198	2136
70°	2199	2013	1963
75°	1955	1792	1803
80°	1661	1511	1498
85°	1201	1025	993

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2860 cd/sqm

TEST NUMBER: P912943

CATALOG NUMBER: DFN2DIP-TR4F0-100D040US850-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	406.1	2.6
10°-20°	1142.7	7.4
20°-30°	1679.4	10.9
30°-40°	1950.5	12.7
40°-50°	1948.1	12.7
50°-60°	1698.7	11.1
60°-70°	1255.7	8.2
70°-80°	710.4	4.6
80°-90°	190.1	1.2
90°-100°	49.4	0.3
100°-110°	184.0	1.2
110°-120°	488.1	3.2
120°-130°	809.5	5.3
130°-140°	859.9	5.6
140°-150°	799.2	5.2
150°-160°	642.5	4.2
160°-170°	414.0	2.7
170°-180°	142.5	0.9
0°-30°	3228.3	21.0
0°-40°	5178.7	33.7
0°-60°	8825.5	57.4
0°-90°	10981.7	71.4
90°-120°	721.5	4.7
90°-150°	3190.0	20.8
90°-180°	4389.0	28.6
0°-180°	15370.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4315	4315	4315	4315	4315	
5°	4315	4299	4253	4286	4278	410
15°	4108	4083	4029	4046	4025	1157
25°	3718	3685	3614	3622	3614	1711
35°	3208	3166	3100	3075	3054	2003
45°	2610	2581	2518	2473	2456	2014
55°	1975	1950	1900	1851	1830	1766
65°	1332	1307	1266	1228	1208	1317
75°	697	689	668	643	652	744
85°	170	166	162	149	145	190
90°	1	13	22	27	29	14
95°	70	35	42	48	47	83
105°	329	362	66	78	82	352
115°	623	641	668	167	89	613
125°	881	895	915	923	926	785
135°	1090	1107	1117	1128	1126	842
145°	1264	1263	1281	1289	1284	791
155°	1392	1382	1395	1402	1393	641
165°	1467	1460	1464	1471	1464	414
175°	1500	1493	1495	1502	1492	143
180°	1497	1497	1497	1497	1497	

TEST NUMBER: P912943

CATALOG NUMBER: DFN2DIP-TR4F0-100D040US850-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4315.2	4315.2	4315.2	4315.2	4315.2
2.5°	4340.3	4319.6	4273.8	4315.2	4307.2
5°	4315.2	4298.9	4253.1	4286.2	4278.2
7.5°	4286.2	4261.4	4215.6	4249.1	4240.8
10°	4240.8	4211.8	4162.0	4195.0	4182.7
12.5°	4178.3	4153.6	4103.9	4124.6	4116.2
15°	4107.8	4083.2	4029.0	4045.7	4025.1
17.5°	4020.7	3996.1	3941.8	3962.6	3941.8
20°	3925.1	3900.5	3842.4	3854.7	3838.4
22.5°	3830.0	3792.7	3738.4	3738.4	3730.1
25°	3717.8	3684.8	3614.3	3622.2	3614.3
27.5°	3593.2	3564.1	3510.4	3498.1	3477.4
30°	3469.1	3435.6	3373.5	3361.2	3344.4
32.5°	3336.1	3311.5	3244.9	3219.9	3203.1
35°	3207.6	3166.2	3099.7	3074.6	3053.9
37.5°	3062.3	3024.8	2958.4	2929.3	2908.6
40°	2913.0	2879.5	2813.1	2776.2	2759.4
42.5°	2767.7	2734.2	2668.3	2626.4	2601.8
45°	2610.1	2581.1	2518.5	2473.2	2456.5
47.5°	2456.5	2427.5	2361.0	2315.1	2290.5
50°	2294.5	2273.8	2215.7	2157.6	2136.9
52.5°	2136.9	2107.9	2054.1	2008.4	1979.3
55°	1975.4	1950.3	1900.5	1850.7	1830.1
57.5°	1813.3	1792.6	1738.5	1688.8	1672.0
60°	1651.3	1635.0	1576.9	1531.1	1518.8
62.5°	1493.7	1464.7	1423.3	1381.9	1365.2
65°	1332.1	1307.1	1265.7	1228.2	1207.6
67.5°	1166.2	1145.0	1108.1	1079.1	1062.3
70°	1012.5	995.8	958.4	929.3	913.0
72.5°	854.9	838.2	817.6	788.5	776.1
75°	696.9	689.0	667.8	643.2	651.5
77.5°	556.1	539.3	530.9	518.6	506.3
80°	415.1	410.8	402.3	390.0	381.7
82.5°	282.2	282.2	278.2	261.5	261.5
85°	169.9	166.0	162.0	149.3	145.3
87.5°	74.9	66.4	58.1	45.8	41.4
90°	1.0	13.0	21.6	27.2	29.2
92.5°	27.2	22.7	26.0	28.2	29.2
95°	70.3	34.6	42.1	47.7	46.6
97.5°	126.8	37.9	55.2	58.6	59.6
100°	191.7	43.4	61.8	70.3	72.5
102.5°	263.2	261.2	63.9	75.7	79.1
105°	329.3	361.9	66.1	78.0	82.3
107.5°	406.2	433.3	68.3	80.2	84.5
110°	480.0	502.6	189.6	81.3	85.5

TEST NUMBER: P912943

CATALOG NUMBER: DFN2DIP-TR4F0-100D040US850-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	549.3	568.7	550.3	83.4	86.7
115°	622.8	641.2	668.4	166.8	88.9
117.5°	686.8	708.4	726.9	571.9	288.1
120°	758.3	774.5	794.0	807.1	660.9
122.5°	818.9	836.3	858.0	864.5	865.6
125°	880.7	894.9	915.4	923.0	926.2
127.5°	937.0	952.2	968.5	979.4	980.4
130°	990.1	1007.5	1019.3	1031.3	1030.3
132.5°	1044.2	1058.4	1070.3	1080.1	1079.1
135°	1089.8	1107.2	1116.9	1127.7	1125.6
137.5°	1137.4	1150.4	1161.3	1172.1	1168.9
140°	1184.0	1192.7	1204.6	1214.4	1208.9
142.5°	1223.1	1230.7	1244.7	1253.3	1248.0
145°	1264.3	1263.2	1281.4	1289.1	1283.7
147.5°	1299.9	1296.6	1315.1	1320.5	1316.3
150°	1334.6	1327.0	1344.4	1350.9	1345.4
152.5°	1363.8	1355.2	1371.4	1377.9	1370.4
155°	1392.0	1382.4	1395.3	1401.8	1393.1
157.5°	1414.8	1406.1	1416.0	1423.5	1414.8
160°	1434.3	1427.7	1434.3	1440.7	1433.2
162.5°	1451.6	1445.1	1450.6	1458.1	1448.4
165°	1466.8	1460.3	1463.5	1471.1	1463.5
167.5°	1478.7	1472.1	1475.5	1483.1	1473.3
170°	1488.5	1482.0	1484.1	1491.7	1482.0
172.5°	1494.9	1488.5	1490.7	1498.3	1488.5
175°	1500.3	1492.7	1494.9	1502.5	1491.7
177.5°	1502.5	1494.9	1496.0	1503.7	1493.9
180°	1497.2	1497.2	1497.2	1497.2	1497.2

TEST NUMBER: P912943

CATALOG NUMBER: DFN2DIP-TR4F0-100D040US850-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.33	14.42	14.07	15.19	16.12	12.90	13.99	13.64	14.76	15.69
	3H	15.00	15.99	15.77	16.77	17.73	14.53	15.51	15.29	16.29	17.25
	4H	15.60	16.53	16.38	17.32	18.29	15.13	16.06	15.91	16.85	17.82
	6H	16.01	16.87	16.81	17.67	18.65	15.54	16.39	16.33	17.19	18.18
	8H	16.12	16.94	16.93	17.76	18.74	15.65	16.47	16.45	17.28	18.27
	12H	16.18	16.96	16.99	17.77	18.78	15.70	16.48	16.51	17.29	18.30
4H	2H	13.82	14.74	14.60	15.53	16.50	13.47	14.40	14.25	15.19	16.16
	3H	15.70	16.48	16.50	17.30	18.29	15.31	16.08	16.11	16.91	17.90
	4H	16.43	17.13	17.24	17.95	18.97	16.02	16.73	16.83	17.55	18.56
	6H	16.95	17.56	17.78	18.41	19.43	16.54	17.16	17.37	18.00	19.02
	8H	17.11	17.68	17.94	18.52	19.56	16.70	17.27	17.53	18.11	19.14
	12H	17.19	17.71	18.04	18.57	19.61	16.77	17.29	17.62	18.15	19.19
8H	4H	16.64	17.21	17.47	18.05	19.09	16.28	16.85	17.11	17.69	18.73
	6H	17.28	17.76	18.14	18.64	19.67	16.92	17.39	17.78	18.28	19.31
	8H	17.51	17.93	18.38	18.81	19.86	17.14	17.56	18.01	18.44	19.49
	12H	17.65	18.02	18.52	18.89	19.99	17.26	17.63	18.14	18.50	19.61
12H	4H	16.64	17.15	17.49	18.02	19.05	16.29	16.80	17.14	17.66	18.70
	6H	17.31	17.73	18.18	18.61	19.67	16.96	17.38	17.83	18.26	19.31
	8H	17.57	17.94	18.44	18.81	19.91	17.21	17.58	18.08	18.45	19.56

END OF REPORT