

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P912955

Luminaire Tested: DFN2DIP-TR4F0-100D070US850-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P912955
REPORT IS A COMBINATION OF REPORTS P901955 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-100D070US850-FLLONL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 18664.5 lumens
Efficiency: N/A
Efficacy: 121.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 153.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9972
Total Harmonic Distortion (THDi): 0.128
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P912955

CATALOG NUMBER: DFN2DIP-TR4F0-100D070US850-FLLONL

Luminous Intensity Polar Plot

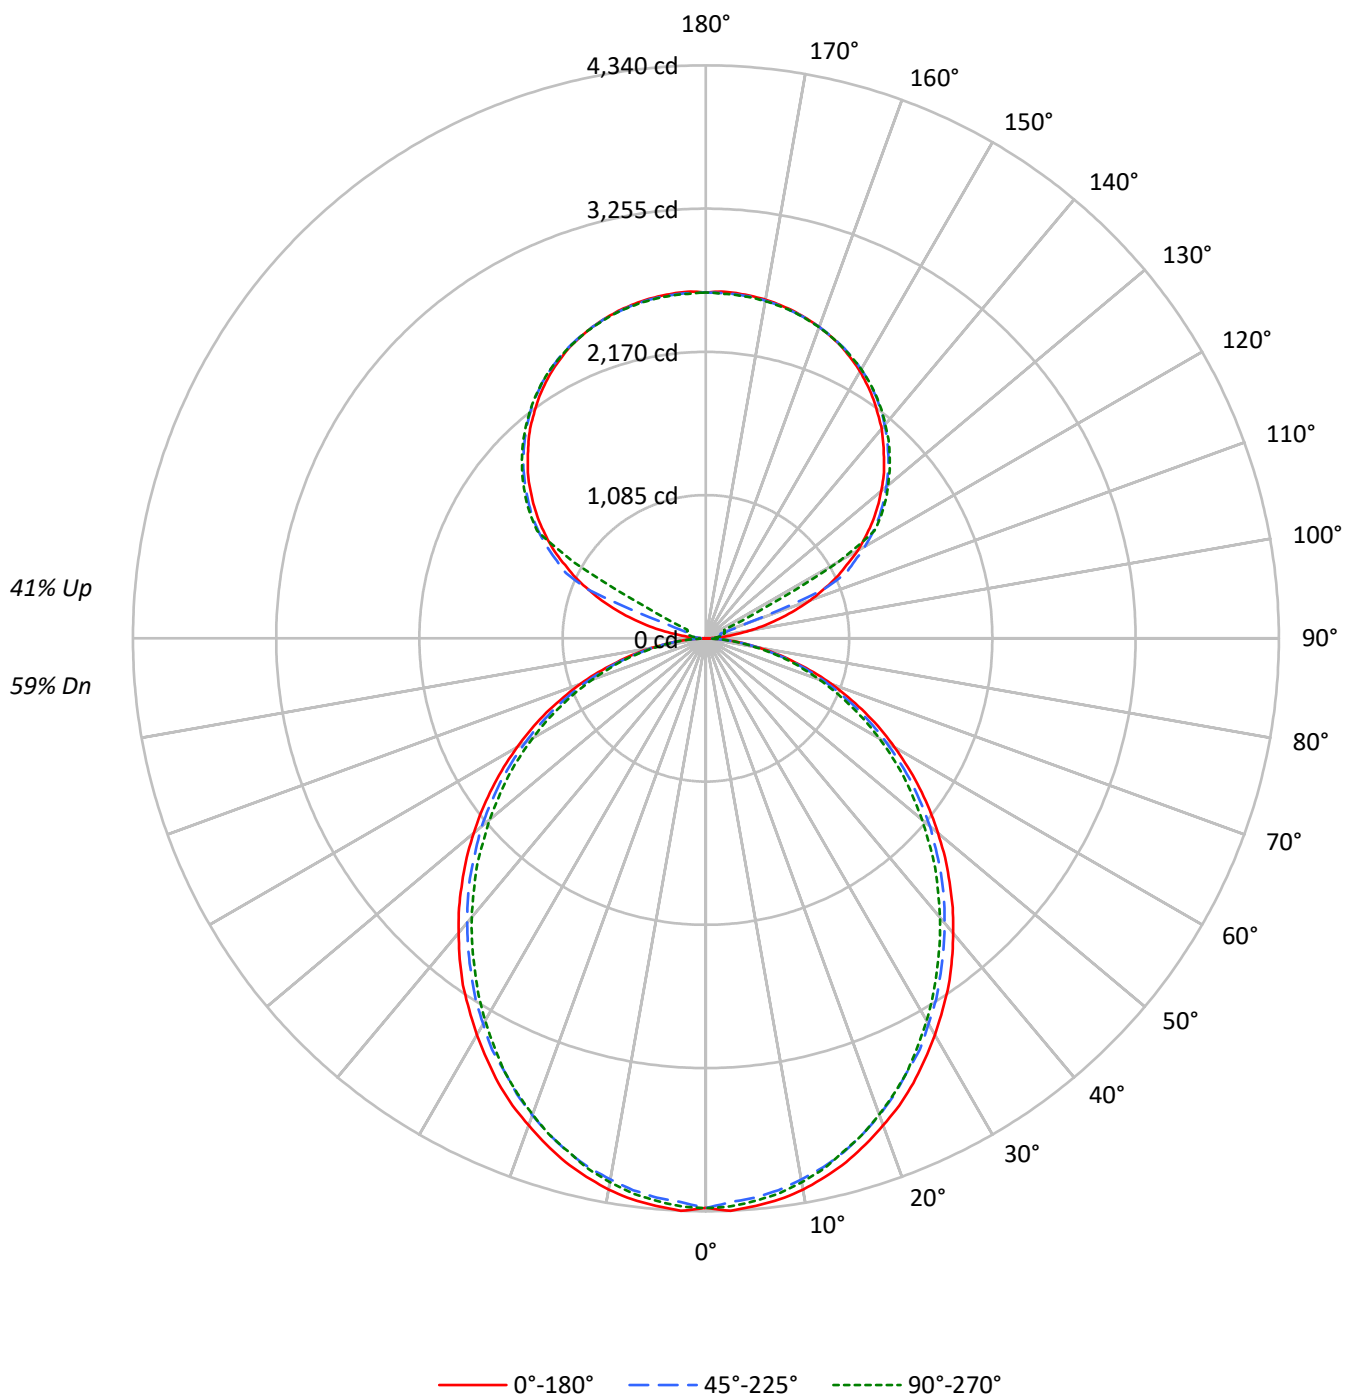

TEST NUMBER: P912955

CATALOG NUMBER: DFN2DIP-TR4F0-100D070US850-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	102	102	102	102	88	88	88	76	76	76	64	64	64
1	100	95	91	88	93	89	86	83	77	75	73	67	65	63	57	56	54
2	91	83	77	72	85	78	72	68	68	64	60	59	55	53	50	48	46
3	83	73	66	60	77	69	62	57	60	55	51	52	48	45	44	41	39
4	76	65	57	51	71	61	54	48	53	48	43	46	42	38	40	36	34
5	70	58	50	44	65	54	47	41	48	42	37	42	37	33	36	32	29
6	64	52	44	38	60	49	41	36	43	37	33	38	33	29	32	29	26
7	59	47	39	33	55	44	37	32	39	33	29	34	29	26	30	26	23
8	55	43	35	29	51	40	33	28	36	30	26	31	27	23	27	23	21
9	51	39	31	26	48	37	30	25	33	27	23	29	24	21	25	21	19
10	48	36	29	24	45	34	27	23	30	25	21	27	22	19	23	20	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3428	3428	3428
5°	3434	3380	3403
10°	3406	3335	3357
15°	3356	3280	3285
20°	3288	3204	3211
25°	3221	3112	3126
30°	3137	3027	3017
35°	3057	2927	2902
40°	2958	2826	2793
45°	2860	2725	2682
50°	2753	2618	2552
55°	2641	2495	2433
60°	2514	2349	2297
65°	2375	2198	2136
70°	2199	2013	1963
75°	1955	1792	1803
80°	1661	1511	1498
85°	1201	1025	993

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2860 cd/sqm

TEST NUMBER: P912955

CATALOG NUMBER: DFN2DIP-TR4F0-100D070US850-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	406.1	2.2
10°-20°	1142.7	6.1
20°-30°	1679.4	9.0
30°-40°	1950.5	10.5
40°-50°	1948.1	10.4
50°-60°	1698.7	9.1
60°-70°	1255.7	6.7
70°-80°	710.4	3.8
80°-90°	192.1	1.0
90°-100°	86.4	0.5
100°-110°	322.1	1.7
110°-120°	854.1	4.6
120°-130°	1416.6	7.6
130°-140°	1504.8	8.1
140°-150°	1398.5	7.5
150°-160°	1124.4	6.0
160°-170°	724.5	3.9
170°-180°	249.4	1.3
0°-30°	3228.3	17.3
0°-40°	5178.7	27.7
0°-60°	8825.5	47.3
0°-90°	10983.7	58.8
90°-120°	1262.6	6.8
90°-150°	5582.5	29.9
90°-180°	7681.0	41.2
0°-180°	18664.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4315	4315	4315	4315	4315	
5°	4315	4299	4253	4286	4278	410
15°	4108	4083	4029	4046	4025	1157
25°	3718	3685	3614	3622	3614	1711
35°	3208	3166	3100	3075	3054	2003
45°	2610	2581	2518	2473	2456	2014
55°	1975	1950	1900	1851	1830	1766
65°	1332	1307	1266	1228	1208	1317
75°	697	689	668	643	652	744
85°	170	166	162	149	145	190
90°	2	23	38	48	51	17
95°	123	61	74	84	82	146
105°	576	633	116	136	144	616
115°	1090	1122	1170	292	156	1073
125°	1541	1566	1602	1615	1621	1375
135°	1907	1938	1954	1974	1970	1473
145°	2212	2210	2243	2256	2246	1384
155°	2436	2419	2442	2453	2438	1123
165°	2567	2556	2561	2574	2561	725
175°	2626	2612	2616	2629	2610	250
180°	2620	2620	2620	2620	2620	

TEST NUMBER: P912955

CATALOG NUMBER: DFN2DIP-TR4F0-100D070US850-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4315.2	4315.2	4315.2	4315.2	4315.2
2.5°	4340.3	4319.6	4273.8	4315.2	4307.2
5°	4315.2	4298.9	4253.1	4286.2	4278.2
7.5°	4286.2	4261.4	4215.6	4249.1	4240.8
10°	4240.8	4211.8	4162.0	4195.0	4182.7
12.5°	4178.3	4153.6	4103.9	4124.6	4116.2
15°	4107.8	4083.2	4029.0	4045.7	4025.1
17.5°	4020.7	3996.1	3941.8	3962.6	3941.8
20°	3925.1	3900.5	3842.4	3854.7	3838.4
22.5°	3830.0	3792.7	3738.4	3738.4	3730.1
25°	3717.8	3684.8	3614.3	3622.2	3614.3
27.5°	3593.2	3564.1	3510.4	3498.1	3477.4
30°	3469.1	3435.6	3373.5	3361.2	3344.4
32.5°	3336.1	3311.5	3244.9	3219.9	3203.1
35°	3207.6	3166.2	3099.7	3074.6	3053.9
37.5°	3062.3	3024.8	2958.4	2929.3	2908.6
40°	2913.0	2879.5	2813.1	2776.2	2759.4
42.5°	2767.7	2734.2	2668.3	2626.4	2601.8
45°	2610.1	2581.1	2518.5	2473.2	2456.5
47.5°	2456.5	2427.5	2361.0	2315.1	2290.5
50°	2294.5	2273.8	2215.7	2157.6	2136.9
52.5°	2136.9	2107.9	2054.1	2008.4	1979.3
55°	1975.4	1950.3	1900.5	1850.7	1830.1
57.5°	1813.3	1792.6	1738.5	1688.8	1672.0
60°	1651.3	1635.0	1576.9	1531.1	1518.8
62.5°	1493.7	1464.7	1423.3	1381.9	1365.2
65°	1332.1	1307.1	1265.7	1228.2	1207.6
67.5°	1166.2	1145.0	1108.1	1079.1	1062.3
70°	1012.5	995.8	958.4	929.3	913.0
72.5°	854.9	838.2	817.6	788.5	776.1
75°	696.9	689.0	667.8	643.2	651.5
77.5°	556.1	539.3	530.9	518.6	506.3
80°	415.1	410.8	402.3	390.0	381.7
82.5°	282.2	282.2	278.2	261.5	261.5
85°	169.9	166.0	162.0	149.3	145.3
87.5°	74.9	66.4	58.1	45.8	41.4
90°	1.8	22.7	37.8	47.5	51.1
92.5°	47.5	39.8	45.5	49.4	51.1
95°	123.1	60.6	73.9	83.5	81.5
97.5°	221.7	66.4	96.6	102.5	104.2
100°	335.7	75.9	108.0	123.1	127.0
102.5°	460.6	457.0	111.9	132.6	138.4
105°	576.3	633.2	115.7	136.4	144.1
107.5°	710.9	758.2	119.6	140.3	147.9
110°	840.0	879.5	331.8	142.3	149.7

TEST NUMBER: P912955

CATALOG NUMBER: DFN2DIP-TR4F0-100D070US850-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	961.3	995.2	963.1	145.8	151.7
115°	1090.0	1122.2	1169.7	292.0	155.6
117.5°	1201.9	1239.8	1272.1	1000.9	504.3
120°	1327.0	1355.4	1389.7	1412.4	1156.5
122.5°	1433.0	1463.4	1501.6	1512.8	1514.8
125°	1541.2	1565.9	1602.0	1615.3	1620.8
127.5°	1639.8	1666.3	1694.9	1713.8	1715.6
130°	1732.7	1763.1	1783.8	1804.8	1803.0
132.5°	1827.5	1852.3	1873.0	1890.1	1888.3
135°	1907.1	1937.5	1954.5	1973.6	1969.8
137.5°	1990.4	2013.3	2032.4	2051.3	2045.7
140°	2071.9	2087.2	2108.0	2125.1	2115.6
142.5°	2140.4	2153.7	2178.2	2193.3	2183.8
145°	2212.5	2210.5	2242.6	2255.9	2246.5
147.5°	2274.8	2269.2	2301.4	2310.8	2303.4
150°	2335.6	2322.4	2352.7	2363.9	2354.5
152.5°	2386.7	2371.6	2400.0	2411.4	2398.2
155°	2436.0	2419.1	2441.8	2453.1	2438.0
157.5°	2475.8	2460.8	2477.8	2491.1	2475.8
160°	2510.1	2498.6	2510.1	2521.3	2508.0
162.5°	2540.3	2529.0	2538.4	2551.7	2534.6
165°	2566.8	2555.6	2561.1	2574.4	2561.1
167.5°	2587.7	2576.2	2582.1	2595.4	2578.3
170°	2604.8	2593.4	2597.2	2610.5	2593.4
172.5°	2616.1	2604.8	2608.7	2621.9	2604.8
175°	2625.6	2612.2	2616.1	2629.3	2610.5
177.5°	2629.3	2616.1	2618.1	2631.4	2614.2
180°	2619.9	2619.9	2619.9	2619.9	2619.9

TEST NUMBER: P912955

CATALOG NUMBER: DFN2DIP-TR4F0-100D070US850-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.33	13.27	13.20	14.17	15.31	11.89	12.84	12.77	13.74	14.88
	3H	13.99	14.84	14.88	15.75	16.91	13.52	14.37	14.41	15.28	16.44
	4H	14.58	15.39	15.49	16.30	17.47	14.11	14.91	15.02	15.83	17.00
	6H	14.99	15.73	15.90	16.65	17.84	14.51	15.25	15.43	16.17	17.36
	8H	15.10	15.80	16.02	16.74	17.92	14.62	15.33	15.54	16.26	17.45
	12H	15.15	15.82	16.08	16.75	17.96	14.67	15.34	15.60	16.27	17.48
4H	2H	12.80	13.60	13.71	14.51	15.69	12.45	13.26	13.36	14.17	15.34
	3H	14.67	15.34	15.59	16.29	17.48	14.28	14.95	15.20	15.89	17.08
	4H	15.39	16.00	16.32	16.94	18.16	14.98	15.60	15.92	16.54	17.75
	6H	15.91	16.44	16.85	17.40	18.62	15.50	16.03	16.45	16.99	18.21
	8H	16.06	16.55	17.01	17.51	18.74	15.65	16.14	16.60	17.10	18.33
	12H	16.14	16.58	17.10	17.56	18.79	15.72	16.16	16.68	17.14	18.37
8H	4H	15.59	16.09	16.54	17.04	18.27	15.23	15.73	16.18	16.68	17.91
	6H	16.23	16.64	17.20	17.64	18.86	15.87	16.27	16.84	17.27	18.50
	8H	16.45	16.81	17.43	17.80	19.04	16.08	16.44	17.06	17.43	18.68
	12H	16.58	16.90	17.57	17.88	19.18	16.20	16.52	17.19	17.50	18.79
12H	4H	15.58	16.03	16.55	17.00	18.24	15.23	15.68	16.20	16.65	17.88
	6H	16.26	16.62	17.24	17.61	18.85	15.91	16.27	16.89	17.26	18.50
	8H	16.50	16.82	17.49	17.80	19.10	16.15	16.47	17.13	17.45	18.74

END OF REPORT