

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P912958

Luminaire Tested: DFN2DIP-TR4F0-100D080US850-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P912958
REPORT IS A COMBINATION OF REPORTS P900453 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-100D080US850-FLLFLL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 18830.8 lumens
Efficiency: N/A
Efficacy: 117.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 160.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9972
Total Harmonic Distortion (THDi): 0.128
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P912958

CATALOG NUMBER: DFN2DIP-TR4F0-100D080US850-FLLFLL

Luminous Intensity Polar Plot

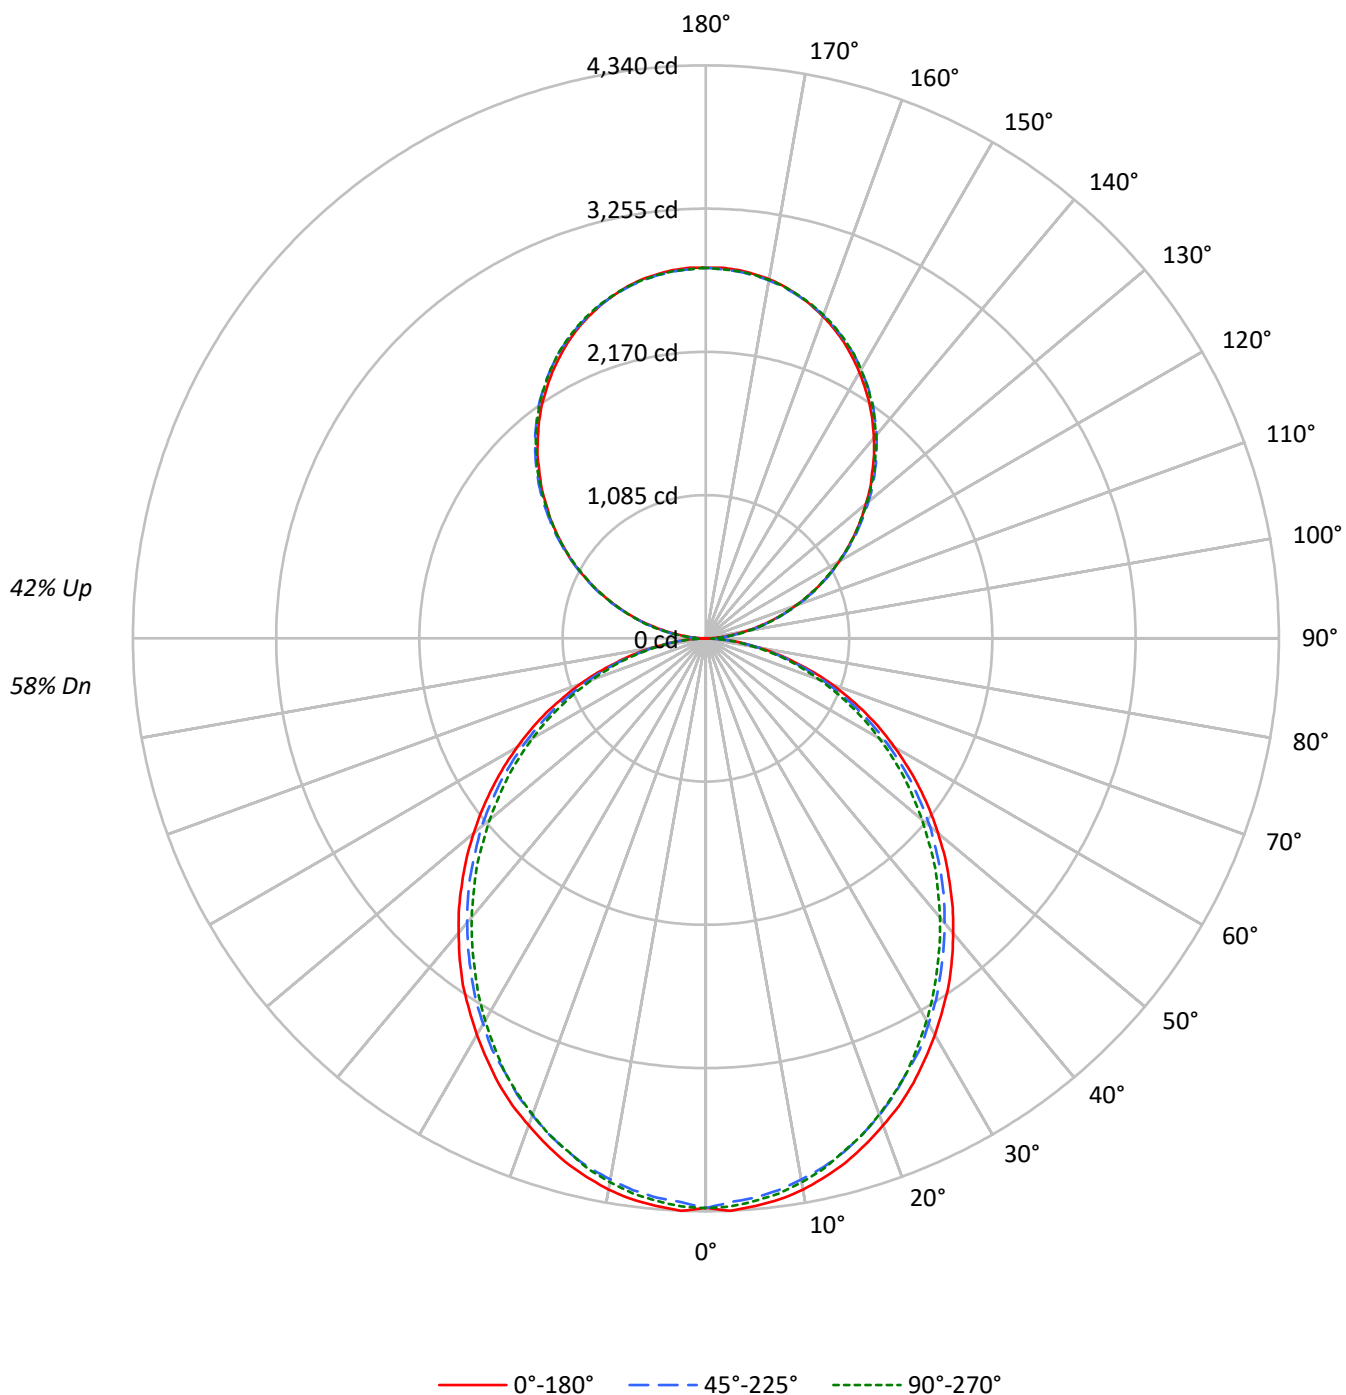

TEST NUMBER: P912958

CATALOG NUMBER: DFN2DIP-TR4F0-100D080US850-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	102	102	102	102	88	88	88	75	75	75	64	64	64
1	100	95	91	88	93	89	86	82	77	75	72	66	65	63	56	55	54
2	91	83	77	72	84	78	72	68	68	64	60	58	55	52	50	47	45
3	83	73	66	60	77	69	62	57	60	55	50	52	48	44	44	41	39
4	76	65	57	51	70	61	54	48	53	47	43	46	42	38	39	36	33
5	70	58	50	43	65	54	47	41	48	42	37	41	37	33	35	32	29
6	64	52	44	38	60	49	41	36	43	37	32	37	33	29	32	29	26
7	59	47	39	33	55	44	37	32	39	33	29	34	29	26	29	26	23
8	55	43	35	29	51	40	33	28	36	30	26	31	26	23	27	23	20
9	51	39	31	26	48	37	30	25	33	27	23	29	24	21	25	21	18
10	48	36	28	24	45	34	27	23	30	25	21	27	22	19	23	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3428	3428	3428
5°	3434	3380	3403
10°	3406	3335	3357
15°	3356	3280	3285
20°	3288	3204	3211
25°	3221	3112	3126
30°	3137	3027	3017
35°	3057	2927	2902
40°	2958	2826	2793
45°	2860	2725	2682
50°	2753	2618	2552
55°	2641	2495	2433
60°	2514	2349	2297
65°	2375	2198	2136
70°	2199	2013	1963
75°	1955	1792	1803
80°	1661	1511	1498
85°	1201	1025	993

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2860 cd/sqm

TEST NUMBER: P912958

CATALOG NUMBER: DFN2DIP-TR4F0-100D080US850-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	406.1	2.2
10°-20°	1142.7	6.1
20°-30°	1679.4	8.9
30°-40°	1950.5	10.4
40°-50°	1948.1	10.3
50°-60°	1698.7	9.0
60°-70°	1255.7	6.7
70°-80°	710.4	3.8
80°-90°	195.5	1.0
90°-100°	173.6	0.9
100°-110°	551.7	2.9
110°-120°	944.1	5.0
120°-130°	1241.6	6.6
130°-140°	1393.7	7.4
140°-150°	1366.6	7.3
150°-160°	1146.4	6.1
160°-170°	760.3	4.0
170°-180°	265.7	1.4
0°-30°	3228.3	17.1
0°-40°	5178.7	27.5
0°-60°	8825.5	46.9
0°-90°	10987.1	58.3
90°-120°	1669.4	8.9
90°-150°	5671.3	30.1
90°-180°	7844.0	41.7
0°-180°	18830.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4315	4315	4315	4315	4315	
5°	4315	4299	4253	4286	4278	410
15°	4108	4083	4029	4046	4025	1157
25°	3718	3685	3614	3622	3614	1711
35°	3208	3166	3100	3075	3054	2003
45°	2610	2581	2518	2473	2456	2014
55°	1975	1950	1900	1851	1830	1766
65°	1332	1307	1266	1228	1208	1317
75°	697	689	668	643	652	744
85°	170	166	162	149	145	190
90°	3	30	83	78	80	18
95°	124	147	151	151	147	137
105°	509	516	521	525	525	537
115°	947	961	957	954	947	937
125°	1378	1399	1392	1385	1382	1231
135°	1782	1809	1814	1811	1804	1378
145°	2164	2181	2194	2197	2188	1352
155°	2474	2481	2489	2500	2493	1139
165°	2692	2689	2689	2706	2694	759
175°	2801	2794	2789	2806	2792	266
180°	2806	2806	2806	2806	2806	

TEST NUMBER: P912958

CATALOG NUMBER: DFN2DIP-TR4F0-100D080US850-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4315.2	4315.2	4315.2	4315.2	4315.2
2.5°	4340.3	4319.6	4273.8	4315.2	4307.2
5°	4315.2	4298.9	4253.1	4286.2	4278.2
7.5°	4286.2	4261.4	4215.6	4249.1	4240.8
10°	4240.8	4211.8	4162.0	4195.0	4182.7
12.5°	4178.3	4153.6	4103.9	4124.6	4116.2
15°	4107.8	4083.2	4029.0	4045.7	4025.1
17.5°	4020.7	3996.1	3941.8	3962.6	3941.8
20°	3925.1	3900.5	3842.4	3854.7	3838.4
22.5°	3830.0	3792.7	3738.4	3738.4	3730.1
25°	3717.8	3684.8	3614.3	3622.2	3614.3
27.5°	3593.2	3564.1	3510.4	3498.1	3477.4
30°	3469.1	3435.6	3373.5	3361.2	3344.4
32.5°	3336.1	3311.5	3244.9	3219.9	3203.1
35°	3207.6	3166.2	3099.7	3074.6	3053.9
37.5°	3062.3	3024.8	2958.4	2929.3	2908.6
40°	2913.0	2879.5	2813.1	2776.2	2759.4
42.5°	2767.7	2734.2	2668.3	2626.4	2601.8
45°	2610.1	2581.1	2518.5	2473.2	2456.5
47.5°	2456.5	2427.5	2361.0	2315.1	2290.5
50°	2294.5	2273.8	2215.7	2157.6	2136.9
52.5°	2136.9	2107.9	2054.1	2008.4	1979.3
55°	1975.4	1950.3	1900.5	1850.7	1830.1
57.5°	1813.3	1792.6	1738.5	1688.8	1672.0
60°	1651.3	1635.0	1576.9	1531.1	1518.8
62.5°	1493.7	1464.7	1423.3	1381.9	1365.2
65°	1332.1	1307.1	1265.7	1228.2	1207.6
67.5°	1166.2	1145.0	1108.1	1079.1	1062.3
70°	1012.5	995.8	958.4	929.3	913.0
72.5°	854.9	838.2	817.6	788.5	776.1
75°	696.9	689.0	667.8	643.2	651.5
77.5°	556.1	539.3	530.9	518.6	506.3
80°	415.1	410.8	402.3	390.0	381.7
82.5°	282.2	282.2	278.2	261.5	261.5
85°	169.9	166.0	162.0	149.3	145.3
87.5°	74.9	66.4	58.1	45.8	41.4
90°	2.6	30.5	83.0	77.9	80.4
92.5°	52.5	71.1	73.6	76.1	76.1
95°	123.5	147.2	151.4	151.4	147.2
97.5°	205.6	227.6	236.9	236.9	236.9
100°	300.3	319.7	326.5	326.5	323.9
102.5°	400.1	414.5	423.7	426.3	423.7
105°	509.3	516.0	521.1	525.3	525.3
107.5°	617.5	627.7	627.7	629.4	617.5
110°	722.4	735.9	735.9	735.9	729.2

TEST NUMBER: P912958

CATALOG NUMBER: DFN2DIP-TR4F0-100D080US850-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	835.7	850.2	847.6	840.8	835.7
115°	947.4	960.9	956.7	954.2	947.4
117.5°	1058.2	1076.8	1065.0	1058.2	1051.4
120°	1169.9	1188.5	1169.9	1169.9	1162.2
122.5°	1271.4	1295.1	1283.2	1276.5	1271.4
125°	1377.9	1399.1	1392.3	1384.7	1382.3
127.5°	1482.1	1508.2	1498.9	1488.8	1482.1
130°	1579.3	1609.7	1605.5	1600.5	1591.2
132.5°	1688.5	1712.1	1713.8	1702.0	1695.2
135°	1782.3	1808.6	1813.7	1811.1	1804.3
137.5°	1887.2	1908.4	1912.6	1910.9	1900.7
140°	1979.5	2000.5	2012.4	2012.4	2003.1
142.5°	2074.2	2095.3	2102.1	2104.7	2095.3
145°	2163.9	2180.7	2194.3	2196.8	2187.5
147.5°	2244.2	2265.4	2275.4	2279.8	2270.5
150°	2327.1	2341.4	2350.7	2358.4	2350.7
152.5°	2400.7	2415.1	2426.9	2436.3	2426.9
155°	2474.3	2481.1	2488.7	2500.5	2492.9
157.5°	2537.7	2542.8	2547.0	2563.9	2552.1
160°	2594.4	2599.5	2602.0	2616.4	2606.3
162.5°	2646.9	2646.9	2649.4	2665.5	2653.6
165°	2691.7	2689.1	2689.1	2706.1	2694.2
167.5°	2732.2	2724.7	2724.7	2741.6	2729.7
170°	2762.7	2756.0	2753.4	2770.4	2756.0
172.5°	2783.9	2777.2	2774.6	2791.5	2777.2
175°	2800.8	2794.0	2788.9	2805.9	2791.5
177.5°	2810.1	2803.3	2798.2	2812.6	2798.2
180°	2805.9	2805.9	2805.9	2805.9	2805.9

TEST NUMBER: P912958

CATALOG NUMBER: DFN2DIP-TR4F0-100D080US850-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.28	13.22	13.16	14.13	15.27	11.85	12.79	12.73	13.70	14.84
	3H	13.95	14.79	14.84	15.71	16.88	13.48	14.32	14.37	15.23	16.41
	4H	14.54	15.34	15.45	16.26	17.44	14.07	14.87	14.98	15.78	16.97
	6H	14.94	15.68	15.86	16.60	17.80	14.47	15.21	15.39	16.13	17.32
	8H	15.05	15.75	15.98	16.69	17.89	14.58	15.28	15.51	16.22	17.41
	12H	15.10	15.77	16.04	16.71	17.92	14.62	15.29	15.56	16.22	17.44
4H	2H	12.75	13.55	13.67	14.47	15.65	12.41	13.21	13.32	14.13	15.31
	3H	14.63	15.29	15.55	16.24	17.44	14.23	14.90	15.16	15.85	17.05
	4H	15.34	15.95	16.28	16.90	18.12	14.94	15.55	15.88	16.49	17.71
	6H	15.86	16.39	16.81	17.36	18.58	15.46	15.98	16.40	16.95	18.17
	8H	16.02	16.51	16.97	17.47	18.70	15.60	16.09	16.56	17.06	18.29
	12H	16.09	16.54	17.06	17.51	18.76	15.67	16.11	16.64	17.09	18.33
8H	4H	15.55	16.04	16.50	17.00	18.24	15.19	15.68	16.14	16.64	17.88
	6H	16.18	16.59	17.16	17.59	18.83	15.82	16.23	16.80	17.23	18.46
	8H	16.40	16.76	17.39	17.76	19.01	16.04	16.39	17.02	17.39	18.64
	12H	16.54	16.86	17.53	17.84	19.14	16.15	16.47	17.15	17.46	18.76
12H	4H	15.54	15.98	16.51	16.96	18.20	15.19	15.63	16.16	16.61	17.85
	6H	16.21	16.57	17.20	17.56	18.82	15.86	16.22	16.85	17.21	18.47
	8H	16.46	16.78	17.45	17.76	19.06	16.10	16.42	17.09	17.40	18.70

END OF REPORT