

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P913041

Luminaire Tested: DFN2DIP-TR4F0-120D100US850-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P913041
REPORT IS A COMBINATION OF REPORTS P902014 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-120D100US850-RLLONL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 22290.9 lumens
Efficiency: N/A
Efficacy: 110.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 202
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9821
Total Harmonic Distortion (THDi): 0.08
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P913041

CATALOG NUMBER: DFN2DIP-TR4F0-120D100US850-RLLONL

Luminous Intensity Polar Plot

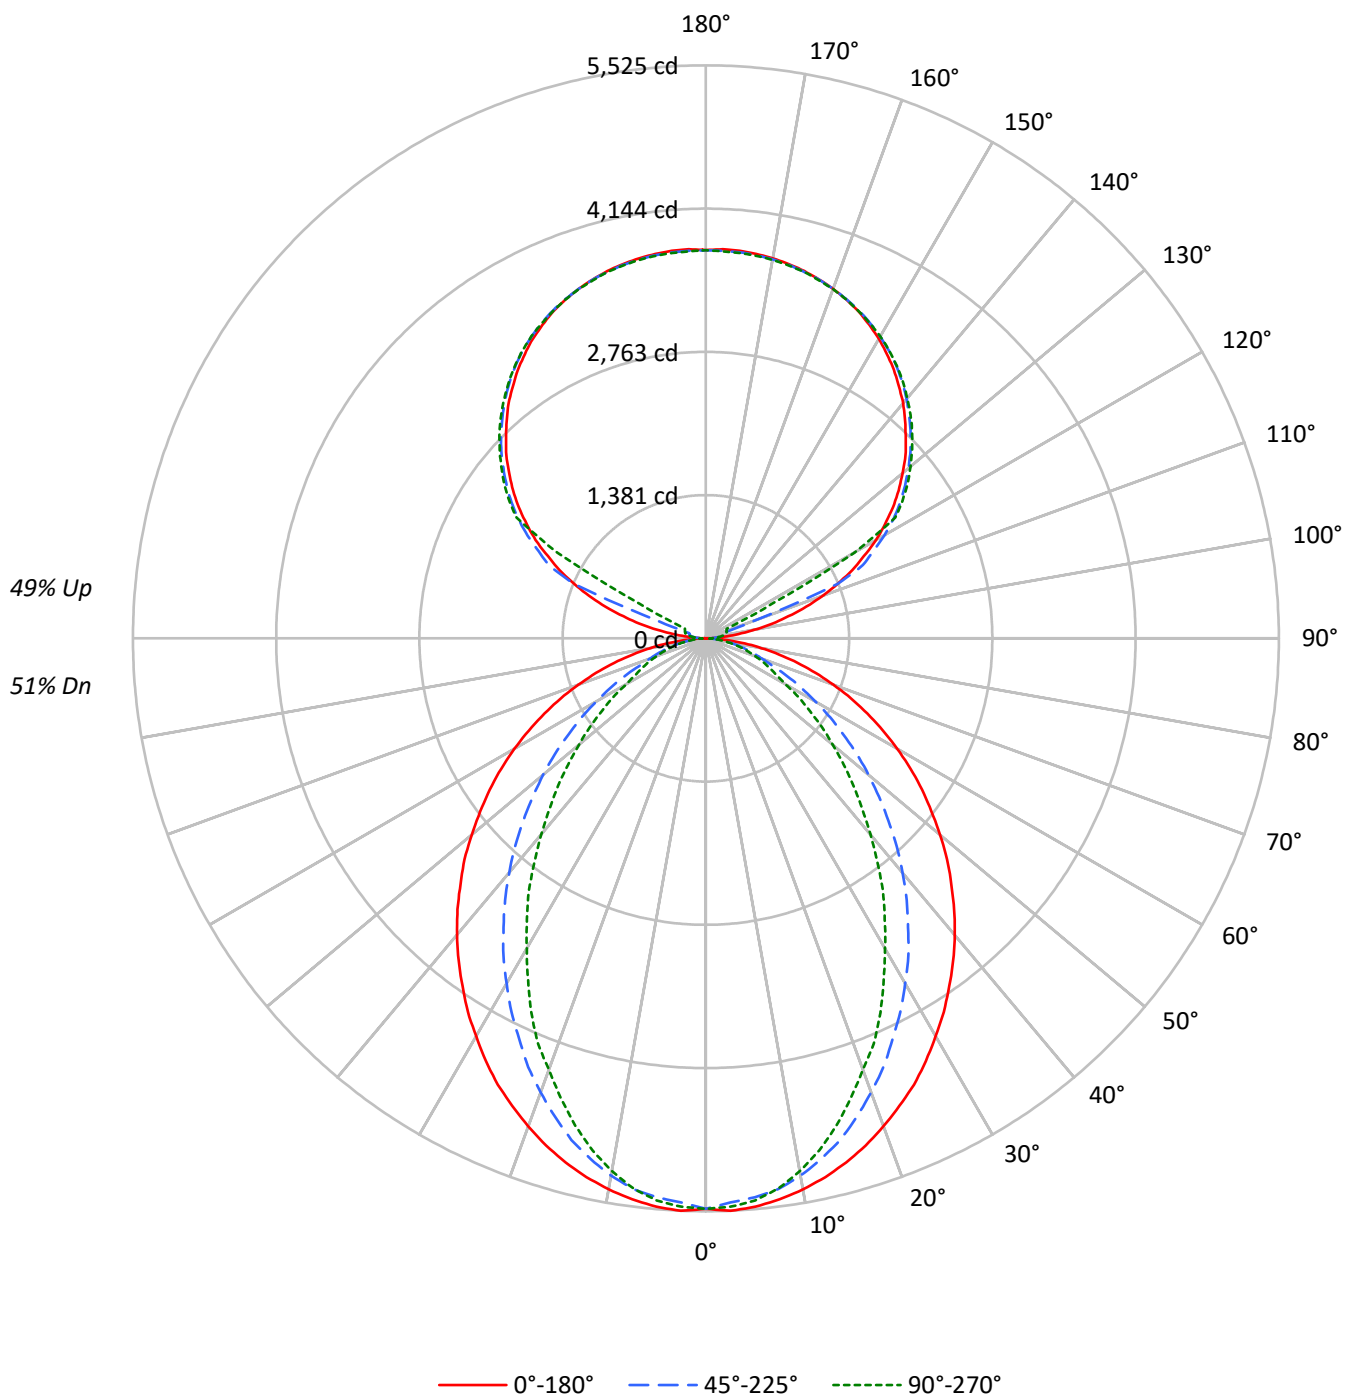

TEST NUMBER: P913041

CATALOG NUMBER: DFN2DIP-TR4F0-120D100US850-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	84	84	84	70	70	70	57	57	57
1	98	94	91	87	91	87	84	81	74	72	70	62	61	59	51	50	49
2	90	83	77	72	83	77	72	67	66	62	59	55	52	50	45	44	42
3	82	73	66	61	76	68	62	57	58	54	50	49	46	43	41	38	36
4	76	65	58	52	70	61	54	49	52	47	43	44	40	37	37	34	32
5	70	58	50	45	64	54	47	42	47	41	37	40	36	33	33	30	28
6	64	53	45	39	59	49	42	37	42	37	33	36	32	29	30	27	25
7	60	48	40	34	55	45	38	33	39	33	29	33	29	26	28	25	22
8	55	43	36	31	51	41	34	29	35	30	26	30	26	23	26	23	20
9	52	40	32	27	48	37	31	26	32	27	23	28	24	21	24	21	18
10	48	36	29	25	45	34	28	24	30	25	21	26	22	19	22	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4370	4370	4370
5°	4377	4300	4328
10°	4333	4216	4187
15°	4274	4076	3969
20°	4195	3884	3702
25°	4114	3669	3444
30°	4005	3448	3116
35°	3899	3211	2829
40°	3791	2965	2499
45°	3665	2693	2200
50°	3535	2418	1909
55°	3400	2124	1628
60°	3243	1816	1340
65°	3062	1504	1206
70°	2843	1212	1091
75°	2568	1069	992
80°	2170	896	860
85°	1513	598	646

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3665 cd/sqm

TEST NUMBER: P913041

CATALOG NUMBER: DFN2DIP-TR4F0-120D100US850-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	515.5	2.3
10°-20°	1415.1	6.3
20°-30°	1986.8	8.9
30°-40°	2165.7	9.7
40°-50°	1990.5	8.9
50°-60°	1563.2	7.0
60°-70°	1017.5	4.6
70°-80°	523.8	2.3
80°-90°	140.3	0.6
90°-100°	123.4	0.6
100°-110°	460.1	2.1
110°-120°	1220.2	5.5
120°-130°	2023.8	9.1
130°-140°	2149.7	9.6
140°-150°	1997.9	9.0
150°-160°	1606.3	7.2
160°-170°	1035.0	4.6
170°-180°	356.2	1.6
0°-30°	3917.3	17.6
0°-40°	6083.0	27.3
0°-60°	9636.8	43.2
0°-90°	11318.4	50.8
90°-120°	1803.7	8.1
90°-150°	7975.0	35.8
90°-180°	10973.0	49.2
0°-180°	22290.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	5500	5500	5500	5500	5500	
5°	5500	5475	5410	5455	5440	522
15°	5231	5176	5008	4913	4863	1474
25°	4749	4589	4261	4057	3982	2184
35°	4092	3838	3400	3086	2976	2561
45°	3345	3011	2489	2135	2016	2583
55°	2543	2155	1618	1319	1225	2273
65°	1717	1314	866	697	682	1703
75°	916	567	398	363	358	969
85°	214	109	94	94	94	246
90°	3	32	54	68	73	21
95°	176	86	106	119	116	208
105°	823	905	165	195	206	880
115°	1557	1603	1671	417	222	1533
125°	2202	2237	2288	2308	2316	1964
135°	2725	2768	2792	2819	2814	2105
145°	3161	3158	3204	3223	3209	1977
155°	3480	3456	3488	3504	3483	1604
165°	3667	3651	3659	3678	3659	1036
175°	3751	3732	3737	3756	3729	357
180°	3743	3743	3743	3743	3743	

TEST NUMBER: P913041

CATALOG NUMBER: DFN2DIP-TR4F0-120D100US850-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	5500.2	5500.2	5500.2	5500.2	5500.2
2.5°	5525.0	5500.2	5445.3	5495.4	5485.3
5°	5500.2	5475.4	5410.4	5455.3	5440.5
7.5°	5455.3	5425.7	5356.0	5375.5	5350.7
10°	5395.6	5360.8	5261.4	5246.1	5216.6
12.5°	5321.1	5276.3	5141.5	5112.0	5057.2
15°	5231.4	5176.5	5007.5	4912.9	4863.3
17.5°	5126.8	5047.1	4837.9	4728.7	4648.9
20°	5007.5	4907.7	4658.9	4534.8	4424.9
22.5°	4878.0	4763.5	4474.6	4305.6	4231.2
25°	4748.7	4589.2	4260.7	4056.8	3981.9
27.5°	4594.5	4424.9	4061.6	3827.7	3713.0
30°	4430.2	4240.7	3842.5	3588.9	3454.3
32.5°	4270.8	4041.5	3633.9	3335.0	3210.3
35°	4091.8	3837.7	3399.9	3086.2	2976.3
37.5°	3917.4	3643.4	3180.7	2836.9	2712.8
40°	3733.1	3434.8	2951.6	2598.3	2468.9
42.5°	3544.0	3225.6	2722.9	2354.3	2230.2
45°	3345.0	3011.3	2488.9	2135.2	2015.7
47.5°	3155.9	2802.7	2265.0	1911.3	1801.9
50°	2946.8	2593.5	2045.9	1702.1	1598.1
52.5°	2742.4	2369.0	1836.7	1508.2	1413.8
55°	2543.4	2155.2	1617.6	1319.2	1224.7
57.5°	2339.4	1941.3	1423.7	1144.9	1065.2
60°	2130.4	1732.1	1219.3	965.9	886.2
62.5°	1926.6	1528.3	1045.1	806.5	766.8
65°	1717.4	1313.9	866.1	697.1	681.8
67.5°	1518.3	1114.8	697.1	612.1	597.3
70°	1309.2	921.0	577.2	527.6	507.5
72.5°	1110.1	741.5	482.6	443.0	433.1
75°	915.7	567.1	398.2	363.3	358.5
77.5°	722.0	402.9	313.7	293.7	283.6
80°	542.4	288.9	238.7	219.1	219.1
82.5°	378.2	194.3	164.2	154.2	154.2
85°	213.9	109.3	94.5	94.5	94.5
87.5°	79.7	39.6	39.6	34.8	34.8
90°	2.6	32.5	54.0	67.9	73.0
92.5°	67.9	56.9	65.0	70.4	73.0
95°	175.9	86.5	105.5	119.3	116.4
97.5°	316.7	94.8	138.0	146.3	148.9
100°	479.5	108.3	154.4	175.9	181.4
102.5°	658.0	652.9	159.8	189.4	197.7
105°	823.3	904.6	165.4	194.9	205.8
107.5°	1015.6	1083.2	170.8	200.4	211.3
110°	1199.8	1256.5	474.0	203.3	213.8



TEST NUMBER: P913041

CATALOG NUMBER: DFN2DIP-TR4F0-120D100US850-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1373.2	1421.7	1375.8	208.4	216.8
115°	1557.1	1603.2	1671.0	417.1	222.2
117.5°	1717.0	1771.1	1817.3	1429.8	720.4
120°	1895.8	1936.3	1985.2	2017.7	1652.1
122.5°	2047.3	2090.7	2145.0	2161.1	2164.0
125°	2201.7	2237.1	2288.5	2307.5	2315.5
127.5°	2342.5	2380.5	2421.3	2448.3	2450.9
130°	2475.3	2518.8	2548.4	2578.2	2575.7
132.5°	2610.7	2646.1	2675.7	2700.1	2697.5
135°	2724.6	2768.0	2792.1	2819.4	2814.0
137.5°	2843.6	2876.1	2903.4	2930.4	2922.3
140°	2959.9	2981.9	3011.4	3035.9	3022.4
142.5°	3057.7	3076.7	3111.7	3133.3	3119.8
145°	3160.6	3157.8	3203.8	3222.8	3209.2
147.5°	3249.7	3241.7	3287.6	3301.2	3290.6
150°	3336.5	3317.6	3361.0	3377.1	3363.6
152.5°	3409.5	3388.0	3428.6	3444.9	3425.9
155°	3480.0	3455.9	3488.4	3504.4	3482.9
157.5°	3536.9	3515.4	3539.8	3558.8	3536.9
160°	3585.8	3569.4	3585.8	3601.9	3583.0
162.5°	3628.9	3612.8	3626.3	3645.3	3620.9
165°	3666.8	3650.7	3658.8	3677.8	3658.8
167.5°	3696.7	3680.3	3688.8	3707.7	3683.2
170°	3721.1	3704.8	3710.3	3729.2	3704.8
172.5°	3737.2	3721.1	3726.7	3745.6	3721.1
175°	3750.7	3731.8	3737.2	3756.3	3729.2
177.5°	3756.3	3737.2	3740.2	3759.2	3734.7
180°	3742.8	3742.8	3742.8	3742.8	3742.8

TEST NUMBER: P913041

CATALOG NUMBER: DFN2DIP-TR4F0-120D100US850-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.34	13.17	13.30	14.14	15.41	8.31	9.15	9.27	10.12	11.38
	3H	14.02	14.76	14.98	15.74	17.03	9.50	10.25	10.47	11.23	12.51
	4H	14.62	15.33	15.61	16.31	17.61	9.95	10.66	10.94	11.64	12.94
	6H	15.05	15.70	16.04	16.68	17.99	10.27	10.93	11.27	11.91	13.22
	8H	15.17	15.79	16.17	16.79	18.10	10.37	10.98	11.37	11.99	13.29
	12H	15.23	15.82	16.24	16.82	18.15	10.41	11.00	11.41	12.00	13.32
4H	2H	12.36	13.06	13.35	14.05	15.34	8.91	9.61	9.90	10.60	11.89
	3H	14.19	14.77	15.18	15.78	17.09	10.26	10.85	11.26	11.86	13.16
	4H	14.88	15.42	15.88	16.42	17.75	10.81	11.34	11.81	12.35	13.68
	6H	15.39	15.86	16.41	16.88	18.21	11.23	11.69	12.25	12.72	14.05
	8H	15.57	16.00	16.59	17.02	18.36	11.36	11.79	12.38	12.81	14.15
	12H	15.66	16.05	16.70	17.09	18.44	11.42	11.81	12.46	12.85	14.20
8H	4H	14.85	15.28	15.87	16.30	17.64	11.09	11.52	12.11	12.54	13.88
	6H	15.41	15.77	16.46	16.83	18.17	11.61	11.96	12.65	13.03	14.37
	8H	15.63	15.94	16.68	16.99	18.35	11.80	12.11	12.85	13.16	14.52
	12H	15.77	16.04	16.82	17.09	18.49	11.92	12.20	12.97	13.24	14.64
12H	4H	14.80	15.19	15.84	16.22	17.57	11.09	11.48	12.13	12.52	13.87
	6H	15.39	15.70	16.44	16.75	18.11	11.66	11.97	12.71	13.02	14.38
	8H	15.61	15.89	16.66	16.93	18.33	11.87	12.14	12.92	13.19	14.59

END OF REPORT