

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P915478

Luminaire Tested: DFN2DIP-TR4F0-040D100US927-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P915478
REPORT IS A COMBINATION OF REPORTS P900477 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-040D100US927-FLLFLL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10147.8 lumens
Efficiency: N/A
Efficacy: 93.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 108.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P915478

CATALOG NUMBER: DFN2DIP-TR4F0-040D100US927-FLLFLL

Luminous Intensity Polar Plot

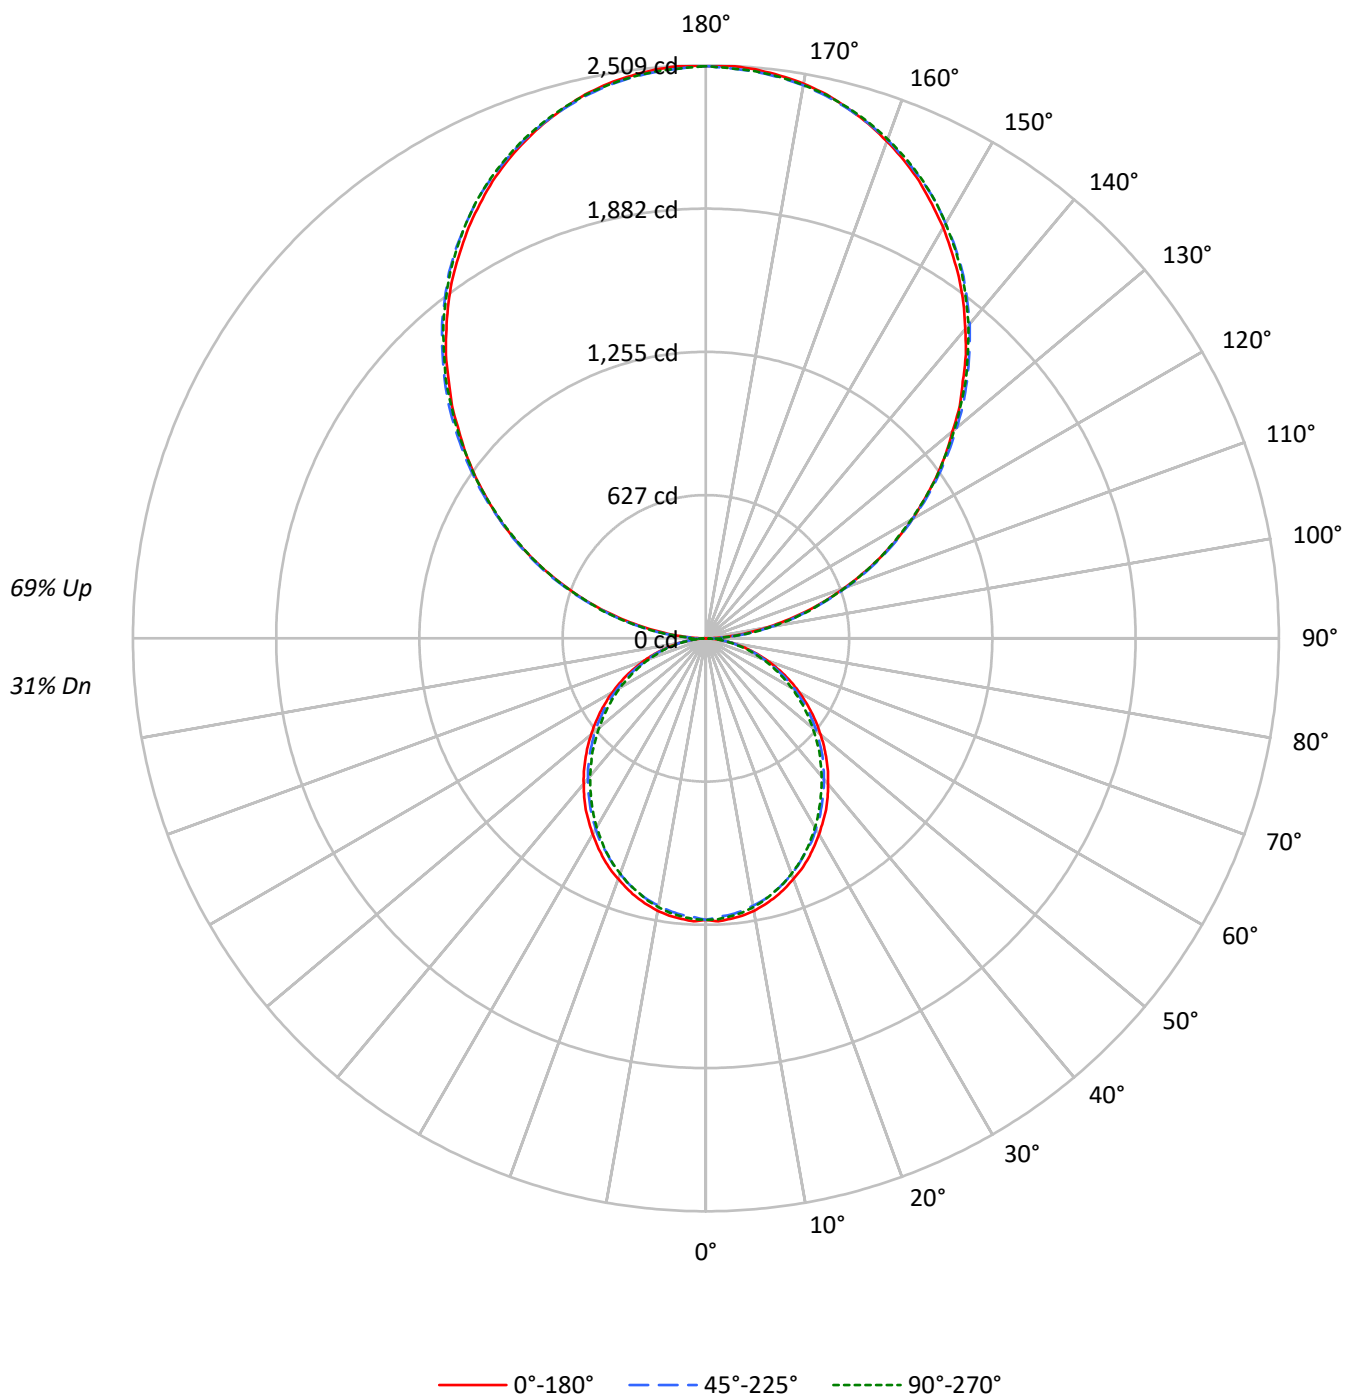

TEST NUMBER: P915478

CATALOG NUMBER: DFN2DIP-TR4F0-040D100US927-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	103	103	103	103	92	92	92	92	73	73	73	55	55	55	39	39	39
1	94	89	86	82	84	80	77	74	64	61	60	48	47	46	34	33	33
2	85	78	72	67	76	70	65	61	56	52	49	42	40	38	30	29	27
3	78	68	61	56	69	62	56	51	49	45	41	37	35	32	27	25	23
4	71	60	53	47	63	55	48	43	44	39	35	33	30	28	24	22	20
5	65	54	46	40	58	49	42	37	39	34	30	30	26	24	21	19	17
6	60	48	40	35	54	44	37	32	35	30	26	27	23	21	19	17	15
7	55	43	36	30	49	39	33	28	32	27	23	24	21	18	18	15	14
8	51	39	32	27	46	36	29	24	29	24	20	22	19	16	16	14	12
9	47	36	28	24	43	32	26	22	26	21	18	20	17	15	15	13	11
10	44	33	26	21	40	30	24	19	24	19	16	19	15	13	14	12	10

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	980	980	980
5°	981	966	972
10°	973	953	959
15°	959	937	939
20°	939	915	918
25°	920	889	893
30°	896	865	862
35°	873	836	829
40°	845	807	798
45°	817	778	766
50°	787	748	729
55°	754	713	695
60°	718	671	656
65°	679	628	610
70°	628	575	561
75°	559	512	515
80°	475	431	428
85°	344	293	284

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1954 cd/sqm

TEST NUMBER: P915478

CATALOG NUMBER: DFN2DIP-TR4F0-040D100US927-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	116.0	1.1
10°-20°	326.5	3.2
20°-30°	479.8	4.7
30°-40°	557.3	5.5
40°-50°	556.6	5.5
50°-60°	485.3	4.8
60°-70°	358.8	3.5
70°-80°	203.0	2.0
80°-90°	60.7	0.6
90°-100°	155.0	1.5
100°-110°	492.6	4.9
110°-120°	843.0	8.3
120°-130°	1108.6	10.9
130°-140°	1244.4	12.3
140°-150°	1220.3	12.0
150°-160°	1023.6	10.1
160°-170°	678.9	6.7
170°-180°	237.3	2.3
0°-30°	922.4	9.1
0°-40°	1479.7	14.6
0°-60°	2521.7	24.8
0°-90°	3144.1	31.0
90°-120°	1490.6	14.7
90°-150°	5063.9	49.9
90°-180°	7004.0	69.0
0°-180°	10147.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1233	1233	1233	1233	1233	
5°	1233	1228	1215	1225	1222	117
15°	1174	1167	1151	1156	1150	331
25°	1062	1053	1033	1035	1033	489
35°	916	905	886	878	873	572
45°	746	738	720	707	702	576
55°	564	557	543	529	523	505
65°	381	373	362	351	345	376
75°	199	197	191	184	186	213
85°	49	48	46	43	42	54
90°	2	27	74	70	72	10
95°	110	131	135	135	131	123
105°	455	461	465	469	469	480
115°	846	858	854	852	846	837
125°	1230	1249	1243	1236	1234	1100
135°	1591	1615	1619	1617	1611	1230
145°	1932	1947	1959	1962	1953	1207
155°	2209	2215	2222	2233	2226	1017
165°	2403	2401	2401	2416	2406	678
175°	2501	2495	2490	2505	2492	238
180°	2505	2505	2505	2505	2505	

TEST NUMBER: P915478

CATALOG NUMBER: DFN2DIP-TR4F0-040D100US927-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1233.0	1233.0	1233.0	1233.0	1233.0
2.5°	1240.2	1234.2	1221.1	1233.0	1230.7
5°	1233.0	1228.3	1215.2	1224.6	1222.4
7.5°	1224.6	1217.6	1204.5	1214.1	1211.7
10°	1211.7	1203.4	1189.2	1198.6	1195.1
12.5°	1193.8	1186.8	1172.6	1178.5	1176.1
15°	1173.7	1166.6	1151.2	1156.0	1150.1
17.5°	1148.8	1141.8	1126.3	1132.2	1126.3
20°	1121.5	1114.4	1097.9	1101.4	1096.8
22.5°	1094.3	1083.6	1068.2	1068.2	1065.8
25°	1062.2	1052.8	1032.7	1035.0	1032.7
27.5°	1026.7	1018.3	1003.1	999.5	993.6
30°	991.2	981.7	963.9	960.4	955.6
32.5°	953.2	946.2	927.2	920.0	915.2
35°	916.5	904.7	885.7	878.5	872.6
37.5°	875.0	864.3	845.3	837.0	831.1
40°	832.3	822.8	803.7	793.2	788.5
42.5°	790.8	781.2	762.4	750.4	743.4
45°	745.8	737.5	719.6	706.7	701.9
47.5°	701.9	693.6	674.6	661.6	654.5
50°	655.6	649.7	633.1	616.5	610.5
52.5°	610.5	602.3	586.9	573.9	565.5
55°	564.4	557.2	543.0	528.8	522.9
57.5°	518.1	512.2	496.7	482.5	477.8
60°	471.8	467.1	450.6	437.5	434.0
62.5°	426.8	418.5	406.7	394.8	390.1
65°	380.6	373.4	361.6	350.9	345.1
67.5°	333.2	327.2	316.6	308.3	303.6
70°	289.3	284.6	273.9	265.5	260.9
72.5°	244.3	239.5	233.6	225.3	221.7
75°	199.2	196.9	190.8	183.8	186.2
77.5°	158.8	154.1	151.7	148.1	144.7
80°	118.6	117.3	114.9	111.5	109.1
82.5°	80.6	80.6	79.5	74.7	74.7
85°	48.6	47.5	46.3	42.6	41.5
87.5°	21.4	19.0	16.6	13.1	11.8
90°	2.3	27.2	74.0	69.5	71.8
92.5°	46.8	63.5	65.8	68.0	68.0
95°	110.3	131.4	135.2	135.2	131.4
97.5°	183.5	203.2	211.5	211.5	211.5
100°	268.2	285.5	291.5	291.5	289.3
102.5°	357.3	370.1	378.4	380.6	378.4
105°	454.7	460.7	465.2	469.1	469.1
107.5°	551.4	560.5	560.5	562.0	551.4
110°	645.1	657.1	657.1	657.1	651.1

TEST NUMBER: P915478

CATALOG NUMBER: DFN2DIP-TR4F0-040D100US927-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	746.2	759.1	756.8	750.8	746.2
115°	846.0	858.0	854.3	852.0	846.0
117.5°	944.9	961.5	950.9	944.9	938.8
120°	1044.6	1061.2	1044.6	1044.6	1037.8
122.5°	1135.2	1156.3	1145.8	1139.8	1135.2
125°	1230.4	1249.3	1243.2	1236.4	1234.2
127.5°	1323.3	1346.7	1338.4	1329.4	1323.3
130°	1410.2	1437.3	1433.6	1429.0	1420.8
132.5°	1507.6	1528.8	1530.3	1519.7	1513.6
135°	1591.4	1614.9	1619.4	1617.2	1611.1
137.5°	1685.1	1704.0	1707.8	1706.3	1697.2
140°	1767.4	1786.3	1796.9	1796.9	1788.6
142.5°	1852.0	1870.9	1876.9	1879.2	1870.9
145°	1932.1	1947.2	1959.3	1961.5	1953.2
147.5°	2003.8	2022.8	2031.8	2035.6	2027.3
150°	2077.9	2090.7	2099.0	2105.8	2099.0
152.5°	2143.6	2156.4	2167.0	2175.3	2167.0
155°	2209.3	2215.3	2222.1	2232.7	2225.9
157.5°	2266.0	2270.5	2274.3	2289.3	2278.8
160°	2316.6	2321.1	2323.3	2336.1	2327.1
162.5°	2363.4	2363.4	2365.6	2379.9	2369.4
165°	2403.4	2401.1	2401.1	2416.2	2405.7
167.5°	2439.7	2432.9	2432.9	2448.0	2437.4
170°	2466.9	2460.8	2458.5	2473.7	2460.8
172.5°	2485.7	2479.7	2477.4	2492.5	2479.7
175°	2500.8	2494.8	2490.3	2505.4	2492.5
177.5°	2509.2	2503.1	2498.5	2511.4	2498.5
180°	2505.4	2505.4	2505.4	2505.4	2505.4

TEST NUMBER: P915478

CATALOG NUMBER: DFN2DIP-TR4F0-040D100US927-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	5.11	5.82	6.22	6.92	8.44	4.68	5.39	5.78	6.49	8.01
	3H	6.76	7.40	7.87	8.51	10.04	6.29	6.93	7.40	8.03	9.57
	4H	7.34	7.95	8.46	9.06	10.60	6.87	7.47	7.99	8.58	10.12
	6H	7.73	8.29	8.86	9.40	10.96	7.26	7.81	8.39	8.93	10.48
	8H	7.83	8.36	8.97	9.49	11.04	7.36	7.89	8.49	9.02	10.56
	12H	7.87	8.38	9.01	9.50	11.07	7.39	7.90	8.53	9.02	10.59
4H	2H	5.55	6.16	6.68	7.27	8.81	5.21	5.82	6.34	6.93	8.47
	3H	7.41	7.91	8.54	9.05	10.60	7.01	7.52	8.15	8.66	10.21
	4H	8.11	8.58	9.25	9.71	11.28	7.71	8.17	8.85	9.30	10.87
	6H	8.62	9.02	9.77	10.17	11.73	8.21	8.61	9.36	9.76	11.32
	8H	8.77	9.14	9.91	10.28	11.86	8.35	8.73	9.50	9.87	11.45
	12H	8.83	9.17	9.99	10.32	11.91	8.41	8.75	9.57	9.90	11.49
8H	4H	8.30	8.67	9.44	9.81	11.39	7.94	8.31	9.08	9.45	11.03
	6H	8.92	9.23	10.09	10.41	11.99	8.56	8.87	9.73	10.05	11.63
	8H	9.14	9.41	10.31	10.57	12.17	8.77	9.04	9.95	10.20	11.80
	12H	9.27	9.50	10.44	10.66	12.29	8.88	9.12	10.06	10.28	11.91
12H	4H	8.28	8.61	9.44	9.77	11.35	7.92	8.26	9.09	9.41	11.00
	6H	8.95	9.22	10.12	10.38	11.98	8.60	8.87	9.77	10.03	11.63
	8H	9.19	9.42	10.36	10.58	12.21	8.83	9.07	10.01	10.22	11.86

END OF REPORT