

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P915480

Luminaire Tested: DFN2DIP-TR4F0-040D100US927-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P915480
REPORT IS A COMBINATION OF REPORTS P900478 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-040D100US927-RLLFLL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9704.2 lumens
Efficiency: N/A
Efficacy: 89.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 108.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P915480

CATALOG NUMBER: DFN2DIP-TR4F0-040D100US927-RLLFLL

Luminous Intensity Polar Plot

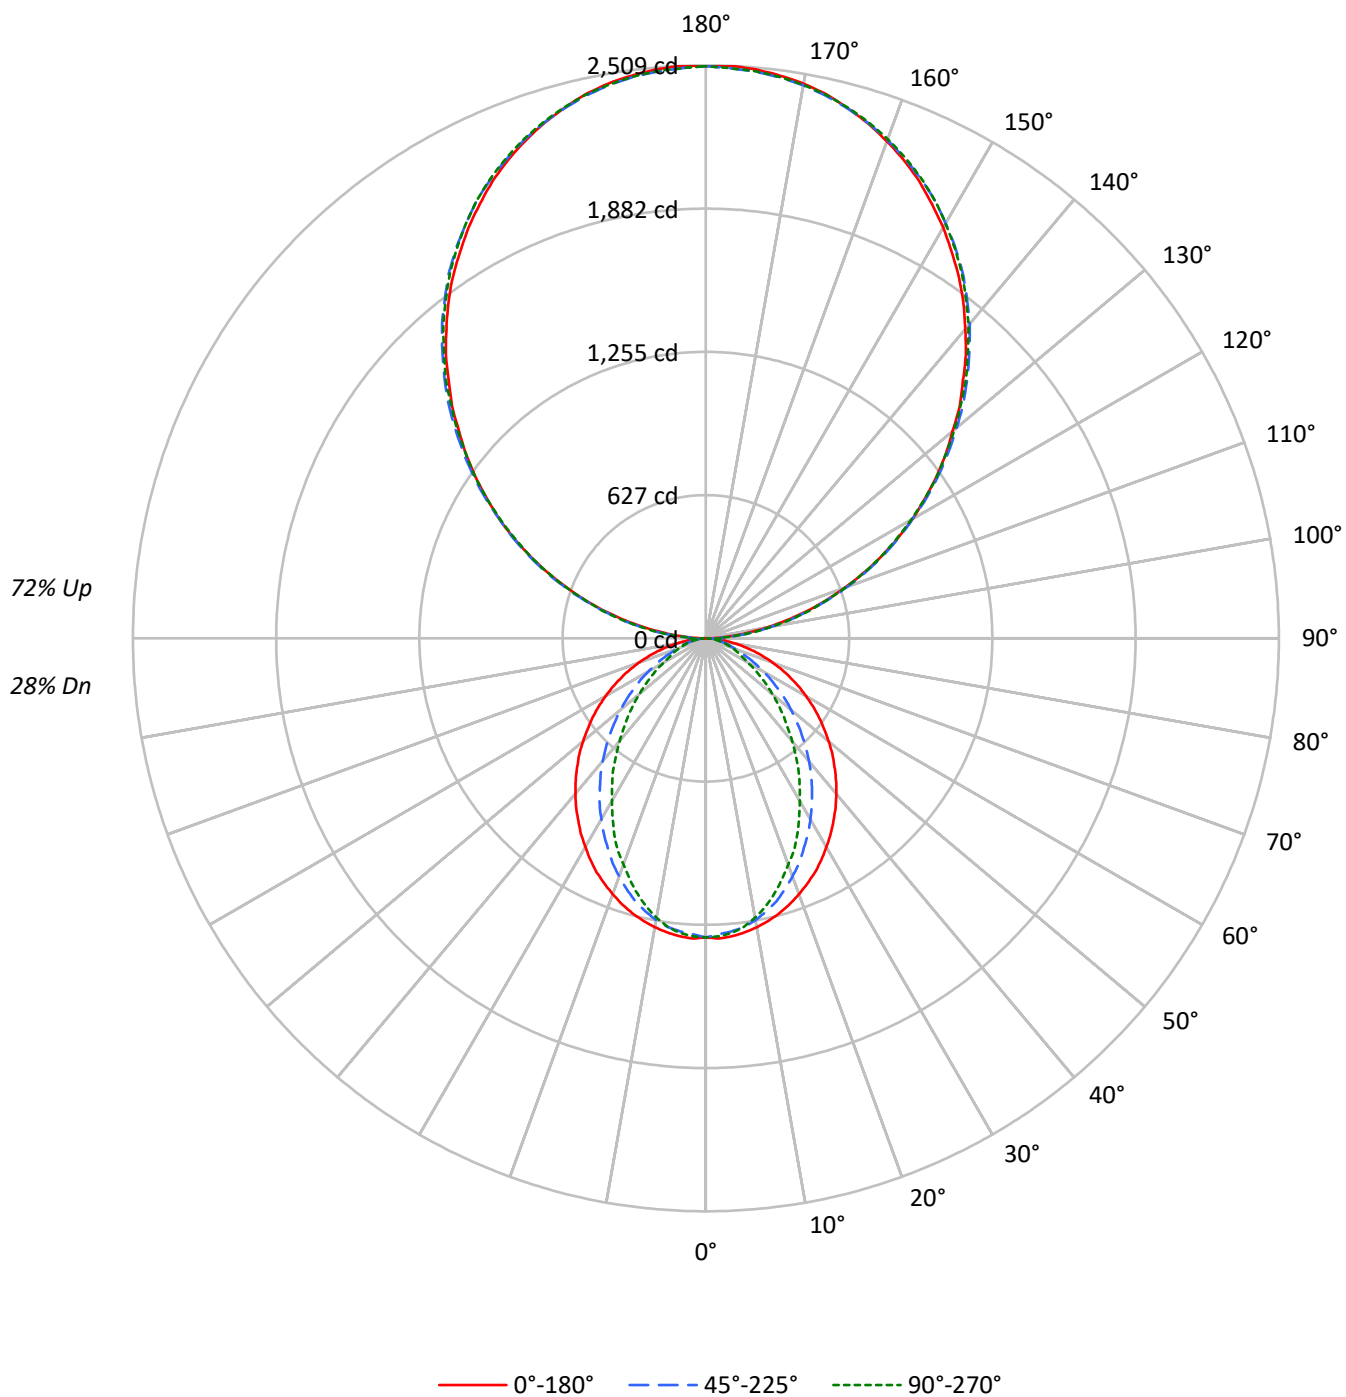

TEST NUMBER: P915480

CATALOG NUMBER: DFN2DIP-TR4F0-040D100US927-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	102	102	102	102	91	91	91	91	71	71	71	53	53	53	36	36	36
1	93	89	85	82	83	80	77	74	62	60	59	47	45	44	32	31	31
2	85	78	72	67	76	70	65	61	55	52	49	41	39	37	28	27	26
3	78	69	62	56	69	62	56	51	49	45	41	37	34	32	25	24	23
4	71	61	53	48	63	55	48	44	43	39	35	33	30	27	23	21	20
5	65	54	47	41	58	49	42	37	39	34	31	29	26	24	21	19	17
6	60	49	41	35	54	44	37	32	35	30	27	27	23	21	19	17	15
7	55	44	36	31	50	40	33	28	32	27	23	24	21	19	17	15	14
8	51	40	32	27	46	36	30	25	29	24	21	22	19	16	16	14	12
9	48	36	29	24	43	33	27	22	26	22	19	20	17	15	15	13	11
10	45	33	26	22	40	30	24	20	24	20	17	19	16	13	14	12	10

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1040	1040	1040
5°	1042	1024	1030
10°	1032	1004	997
15°	1018	971	945
20°	999	925	881
25°	980	874	820
30°	954	821	742
35°	928	764	674
40°	903	706	595
45°	873	641	524
50°	842	576	454
55°	810	506	388
60°	772	432	319
65°	729	358	287
70°	677	289	260
75°	611	254	236
80°	517	213	205
85°	360	142	154

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1954 cd/sqm

TEST NUMBER: P915480

CATALOG NUMBER: DFN2DIP-TR4F0-040D100US927-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	122.7	1.3
10°-20°	336.9	3.5
20°-30°	473.1	4.9
30°-40°	515.7	5.3
40°-50°	473.9	4.9
50°-60°	372.2	3.8
60°-70°	242.3	2.5
70°-80°	124.7	1.3
80°-90°	39.0	0.4
90°-100°	155.0	1.6
100°-110°	492.6	5.1
110°-120°	843.0	8.7
120°-130°	1108.6	11.4
130°-140°	1244.4	12.8
140°-150°	1220.3	12.6
150°-160°	1023.6	10.5
160°-170°	678.9	7.0
170°-180°	237.3	2.4
0°-30°	932.7	9.6
0°-40°	1448.4	14.9
0°-60°	2294.6	23.6
0°-90°	2700.5	27.8
90°-120°	1490.6	15.4
90°-150°	5063.9	52.2
90°-180°	7004.0	72.2
0°-180°	9704.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1310	1310	1310	1310	1310	
5°	1310	1304	1288	1299	1296	124
15°	1246	1233	1192	1170	1158	351
25°	1131	1093	1014	966	948	520
35°	974	914	810	735	709	610
45°	796	717	593	508	480	615
55°	606	513	385	314	292	541
65°	409	313	206	166	162	405
75°	218	135	95	86	85	231
85°	51	26	22	22	22	58
90°	2	27	74	70	72	10
95°	110	131	135	135	131	123
105°	455	461	465	469	469	480
115°	846	858	854	852	846	837
125°	1230	1249	1243	1236	1234	1100
135°	1591	1615	1619	1617	1611	1230
145°	1932	1947	1959	1962	1953	1207
155°	2209	2215	2222	2233	2226	1017
165°	2403	2401	2401	2416	2406	678
175°	2501	2495	2490	2505	2492	238
180°	2505	2505	2505	2505	2505	

TEST NUMBER: P915480

CATALOG NUMBER: DFN2DIP-TR4F0-040D100US927-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1309.6	1309.6	1309.6	1309.6	1309.6
2.5°	1315.6	1309.6	1296.6	1308.5	1306.1
5°	1309.6	1303.7	1288.2	1298.9	1295.5
7.5°	1298.9	1291.9	1275.3	1279.9	1274.1
10°	1284.8	1276.4	1252.8	1249.1	1242.1
12.5°	1267.0	1256.3	1224.2	1217.2	1204.1
15°	1245.6	1232.6	1192.3	1169.8	1158.0
17.5°	1220.8	1201.7	1151.9	1125.9	1106.9
20°	1192.3	1168.5	1109.3	1079.7	1053.6
22.5°	1161.5	1134.2	1065.4	1025.2	1007.5
25°	1130.7	1092.7	1014.5	966.0	948.1
27.5°	1094.0	1053.6	967.1	911.4	884.1
30°	1054.9	1009.7	914.9	854.5	822.5
32.5°	1016.9	962.3	865.2	794.1	764.4
35°	974.3	913.8	809.5	734.8	708.7
37.5°	932.8	867.5	757.3	675.5	645.9
40°	888.9	817.8	702.8	618.7	587.9
42.5°	843.8	768.0	648.3	560.5	531.0
45°	796.5	717.0	592.6	508.4	480.0
47.5°	751.5	667.3	539.3	455.1	429.0
50°	701.6	617.5	487.1	405.3	380.5
52.5°	653.0	564.1	437.4	359.1	336.6
55°	605.6	513.2	385.2	314.1	291.6
57.5°	557.1	462.2	339.0	272.6	253.7
60°	507.2	412.4	290.3	230.0	211.0
62.5°	458.8	363.9	248.8	192.0	182.6
65°	408.9	312.8	206.2	166.0	162.3
67.5°	361.6	265.5	166.0	145.8	142.2
70°	311.7	219.3	137.4	125.6	120.8
72.5°	264.4	176.6	114.9	105.5	103.1
75°	218.0	135.1	94.8	86.5	85.4
77.5°	171.9	95.9	74.7	69.9	67.5
80°	129.1	68.8	56.8	52.2	52.2
82.5°	90.1	46.3	39.1	36.7	36.7
85°	50.9	26.1	22.5	22.5	22.5
87.5°	19.0	9.4	9.4	8.3	8.3
90°	2.3	27.2	74.0	69.5	71.8
92.5°	46.8	63.5	65.8	68.0	68.0
95°	110.3	131.4	135.2	135.2	131.4
97.5°	183.5	203.2	211.5	211.5	211.5
100°	268.2	285.5	291.5	291.5	289.3
102.5°	357.3	370.1	378.4	380.6	378.4
105°	454.7	460.7	465.2	469.1	469.1
107.5°	551.4	560.5	560.5	562.0	551.4
110°	645.1	657.1	657.1	657.1	651.1

TEST NUMBER: P915480

CATALOG NUMBER: DFN2DIP-TR4F0-040D100US927-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	746.2	759.1	756.8	750.8	746.2
115°	846.0	858.0	854.3	852.0	846.0
117.5°	944.9	961.5	950.9	944.9	938.8
120°	1044.6	1061.2	1044.6	1044.6	1037.8
122.5°	1135.2	1156.3	1145.8	1139.8	1135.2
125°	1230.4	1249.3	1243.2	1236.4	1234.2
127.5°	1323.3	1346.7	1338.4	1329.4	1323.3
130°	1410.2	1437.3	1433.6	1429.0	1420.8
132.5°	1507.6	1528.8	1530.3	1519.7	1513.6
135°	1591.4	1614.9	1619.4	1617.2	1611.1
137.5°	1685.1	1704.0	1707.8	1706.3	1697.2
140°	1767.4	1786.3	1796.9	1796.9	1788.6
142.5°	1852.0	1870.9	1876.9	1879.2	1870.9
145°	1932.1	1947.2	1959.3	1961.5	1953.2
147.5°	2003.8	2022.8	2031.8	2035.6	2027.3
150°	2077.9	2090.7	2099.0	2105.8	2099.0
152.5°	2143.6	2156.4	2167.0	2175.3	2167.0
155°	2209.3	2215.3	2222.1	2232.7	2225.9
157.5°	2266.0	2270.5	2274.3	2289.3	2278.8
160°	2316.6	2321.1	2323.3	2336.1	2327.1
162.5°	2363.4	2363.4	2365.6	2379.9	2369.4
165°	2403.4	2401.1	2401.1	2416.2	2405.7
167.5°	2439.7	2432.9	2432.9	2448.0	2437.4
170°	2466.9	2460.8	2458.5	2473.7	2460.8
172.5°	2485.7	2479.7	2477.4	2492.5	2479.7
175°	2500.8	2494.8	2490.3	2505.4	2492.5
177.5°	2509.2	2503.1	2498.5	2511.4	2498.5
180°	2505.4	2505.4	2505.4	2505.4	2505.4

TEST NUMBER: P915480

CATALOG NUMBER: DFN2DIP-TR4F0-040D100US927-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	4.74	5.41	5.87	6.53	8.09	0.71	1.39	1.84	2.51	4.07
	3H	6.40	7.01	7.54	8.14	9.71	1.89	2.49	3.03	3.62	5.19
	4H	7.00	7.58	8.15	8.71	10.29	2.33	2.91	3.48	4.03	5.61
	6H	7.42	7.94	8.57	9.08	10.67	2.65	3.17	3.80	4.30	5.89
	8H	7.54	8.04	8.70	9.19	10.77	2.73	3.23	3.89	4.38	5.96
	12H	7.60	8.07	8.76	9.21	10.82	2.77	3.25	3.93	4.39	5.99
4H	2H	4.73	5.31	5.89	6.44	8.02	1.29	1.86	2.44	2.99	4.57
	3H	6.55	7.03	7.71	8.18	9.77	2.62	3.10	3.78	4.26	5.85
	4H	7.24	7.68	8.40	8.82	10.43	3.17	3.61	4.33	4.75	6.36
	6H	7.74	8.12	8.91	9.29	10.89	3.58	3.95	4.75	5.12	6.72
	8H	7.92	8.27	9.08	9.42	11.04	3.70	4.05	4.87	5.21	6.83
	12H	8.00	8.32	9.19	9.49	11.11	3.76	4.08	4.95	5.25	6.87
8H	4H	7.19	7.54	8.36	8.70	10.32	3.43	3.79	4.60	4.94	6.56
	6H	7.75	8.04	8.94	9.24	10.86	3.95	4.24	5.13	5.44	7.05
	8H	7.97	8.22	9.16	9.40	11.03	4.14	4.39	5.33	5.57	7.20
	12H	8.10	8.32	9.30	9.50	11.16	4.25	4.47	5.45	5.65	7.32
12H	4H	7.14	7.46	8.32	8.62	10.25	3.43	3.75	4.61	4.92	6.54
	6H	7.73	7.98	8.92	9.16	10.79	4.00	4.25	5.19	5.43	7.06
	8H	7.94	8.16	9.14	9.34	11.01	4.20	4.42	5.40	5.60	7.26

END OF REPORT