

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P915519

Luminaire Tested: DFN2DIP-TR4F0-050D110US927-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P915519
REPORT IS A COMBINATION OF REPORTS P902017 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-050D110US927-FLLONL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12548.1 lumens
Efficiency: N/A
Efficacy: 99.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 126.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P915519

CATALOG NUMBER: DFN2DIP-TR4F0-050D110US927-FLLONL

Luminous Intensity Polar Plot

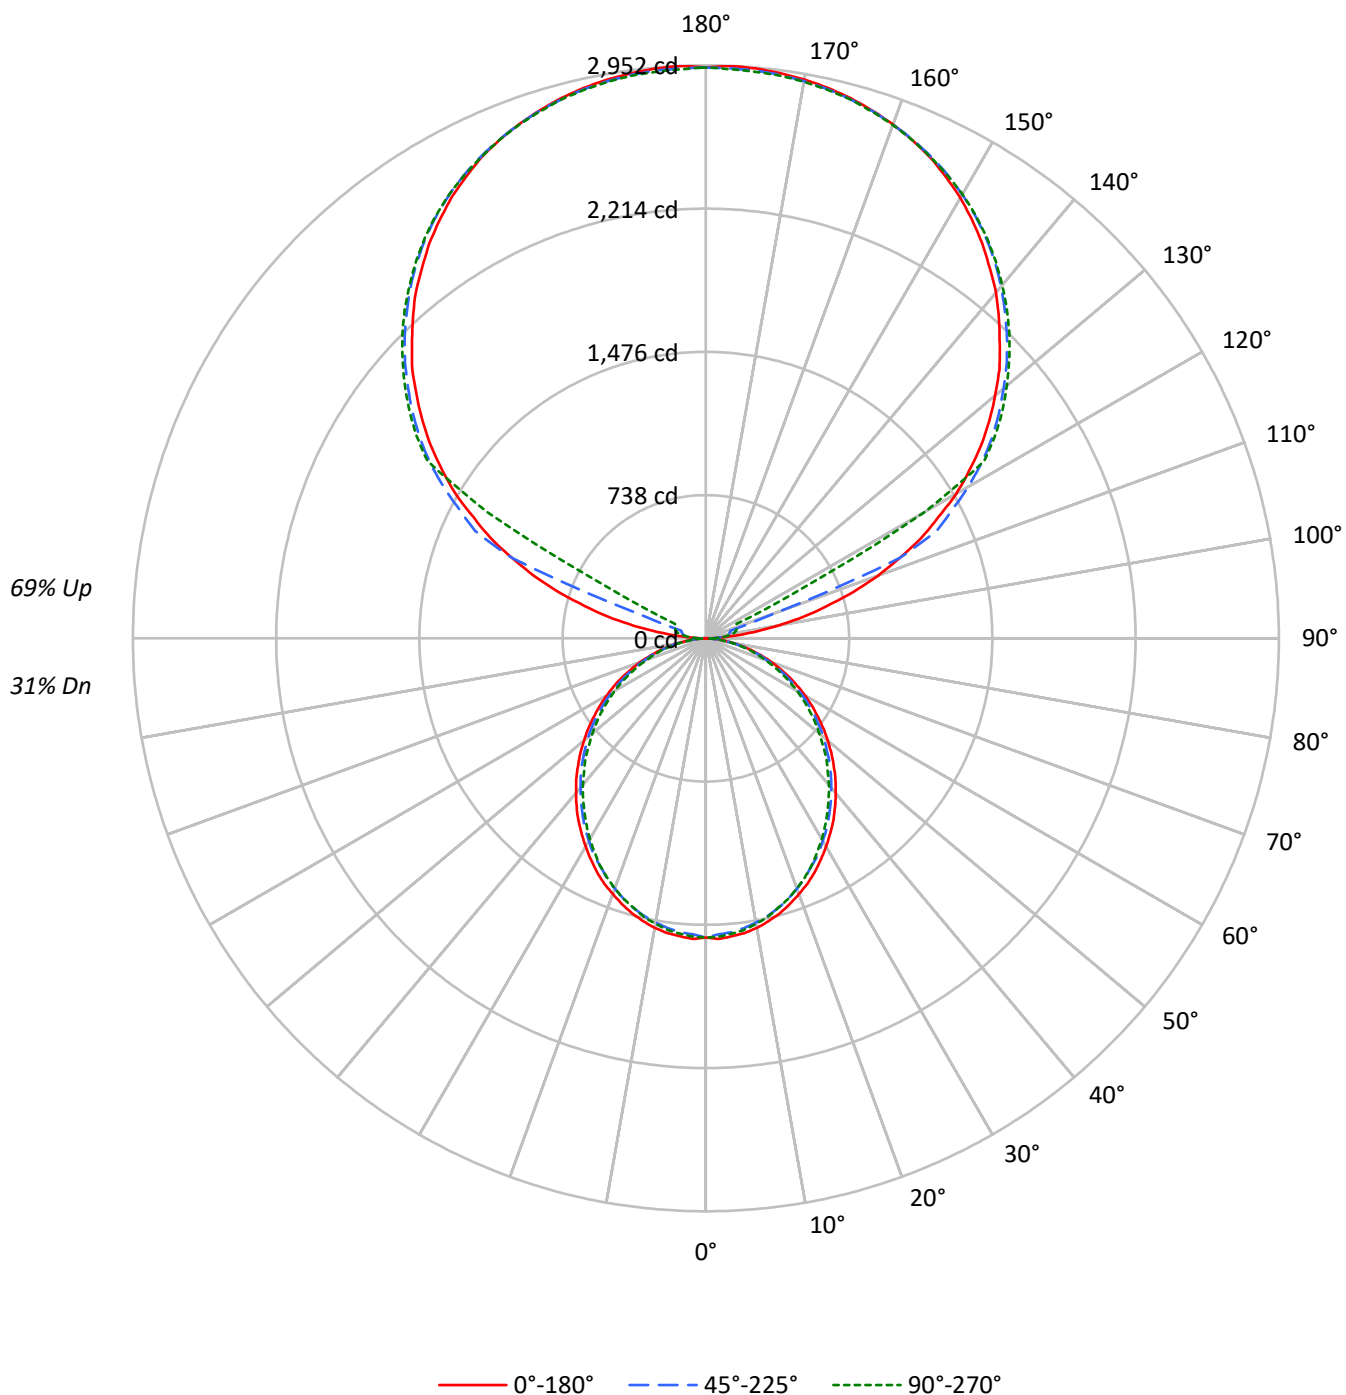

TEST NUMBER: P915519

CATALOG NUMBER: DFN2DIP-TR4F0-050D110US927-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	103	103	103	103	92	92	92	92	73	73	73	55	55	55	39	39	39
1	94	89	86	82	84	80	77	74	64	62	60	48	47	46	34	34	33
2	85	78	72	67	76	70	65	61	56	52	49	43	40	38	30	29	28
3	78	69	61	56	70	62	56	51	49	45	41	38	35	32	27	25	24
4	71	61	53	47	64	55	48	43	44	39	35	33	30	28	24	22	20
5	65	54	46	40	58	49	42	37	39	34	30	30	27	24	22	19	18
6	60	48	40	35	54	44	37	32	35	30	26	27	24	21	20	17	15
7	55	43	36	30	50	39	33	28	32	27	23	25	21	18	18	15	14
8	51	39	32	27	46	36	29	24	29	24	20	22	19	16	16	14	12
9	48	36	28	24	43	32	26	22	26	22	18	21	17	15	15	13	11
10	44	33	26	21	40	30	24	19	24	19	16	19	16	13	14	12	10

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1224	1224	1224
5°	1226	1207	1215
10°	1216	1191	1199
15°	1199	1171	1173
20°	1174	1144	1147
25°	1150	1112	1116
30°	1120	1081	1078
35°	1092	1045	1037
40°	1057	1009	998
45°	1021	973	958
50°	983	935	912
55°	943	891	869
60°	898	839	820
65°	848	785	763
70°	785	719	701
75°	698	640	644
80°	593	540	535
85°	429	366	355

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1562 cd/sqm

TEST NUMBER: P915519

CATALOG NUMBER: DFN2DIP-TR4F0-050D110US927-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	145.1	1.2
10°-20°	408.1	3.3
20°-30°	599.8	4.8
30°-40°	696.6	5.6
40°-50°	695.8	5.5
50°-60°	606.7	4.8
60°-70°	448.5	3.6
70°-80°	253.7	2.0
80°-90°	72.1	0.6
90°-100°	97.0	0.8
100°-110°	361.5	2.9
110°-120°	958.7	7.6
120°-130°	1590.2	12.7
130°-140°	1689.1	13.5
140°-150°	1569.9	12.5
150°-160°	1262.1	10.1
160°-170°	813.3	6.5
170°-180°	279.9	2.2
0°-30°	1153.0	9.2
0°-40°	1849.6	14.7
0°-60°	3152.1	25.1
0°-90°	3926.5	31.3
90°-120°	1417.2	11.3
90°-150°	6266.3	49.9
90°-180°	8622.0	68.7
0°-180°	12548.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1541	1541	1541	1541	1541	
5°	1541	1535	1519	1531	1528	146
15°	1467	1458	1439	1445	1438	413
25°	1328	1316	1291	1294	1291	611
35°	1146	1131	1107	1098	1091	715
45°	932	922	900	883	877	719
55°	706	697	679	661	654	631
65°	476	467	452	439	431	470
75°	249	246	238	230	233	266
85°	61	59	58	53	52	68
90°	2	26	42	53	57	12
95°	138	68	83	94	92	164
105°	647	711	130	153	162	691
115°	1224	1260	1313	328	175	1205
125°	1730	1758	1798	1813	1819	1543
135°	2141	2175	2194	2215	2211	1654
145°	2484	2481	2517	2532	2522	1553
155°	2734	2715	2741	2754	2737	1260
165°	2881	2869	2875	2890	2875	814
175°	2947	2932	2936	2952	2930	280
180°	2941	2941	2941	2941	2941	

TEST NUMBER: P915519

CATALOG NUMBER: DFN2DIP-TR4F0-050D110US927-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1541.2	1541.2	1541.2	1541.2	1541.2
2.5°	1550.1	1542.8	1526.5	1541.2	1538.4
5°	1541.2	1535.4	1519.0	1530.8	1528.0
7.5°	1530.8	1522.0	1505.7	1517.7	1514.7
10°	1514.7	1504.3	1486.5	1498.3	1493.9
12.5°	1492.3	1483.5	1465.8	1473.1	1470.1
15°	1467.1	1458.3	1439.0	1445.0	1437.6
17.5°	1436.0	1427.2	1407.9	1415.2	1407.9
20°	1401.9	1393.1	1372.4	1376.7	1370.9
22.5°	1367.9	1354.6	1335.2	1335.2	1332.2
25°	1327.9	1316.1	1290.9	1293.7	1290.9
27.5°	1283.3	1273.0	1253.8	1249.3	1242.0
30°	1239.0	1227.1	1204.9	1200.5	1194.5
32.5°	1191.5	1182.7	1159.0	1150.0	1144.1
35°	1145.6	1130.8	1107.1	1098.1	1090.8
37.5°	1093.7	1080.4	1056.6	1046.2	1038.9
40°	1040.5	1028.5	1004.7	991.5	985.6
42.5°	988.6	976.6	953.0	938.0	929.2
45°	932.2	921.9	899.5	883.4	877.3
47.5°	877.3	867.0	843.3	826.9	818.1
50°	819.5	812.1	791.4	770.6	763.2
52.5°	763.2	752.8	733.6	717.3	706.9
55°	705.5	696.6	678.7	661.0	653.6
57.5°	647.6	640.2	620.9	603.2	597.1
60°	589.8	584.0	563.2	546.8	542.5
62.5°	533.5	523.2	508.3	493.5	487.6
65°	475.8	466.8	452.0	438.7	431.3
67.5°	416.5	409.0	395.8	385.4	379.4
70°	361.6	355.7	342.3	331.9	326.1
72.5°	305.4	299.4	292.0	281.6	277.2
75°	248.9	246.1	238.5	229.7	232.7
77.5°	198.6	192.6	189.6	185.2	180.9
80°	148.3	146.7	143.7	139.3	136.3
82.5°	100.8	100.8	99.3	93.4	93.4
85°	60.7	59.3	57.8	53.3	51.9
87.5°	26.7	23.8	20.8	16.3	14.8
90°	2.1	25.5	42.5	53.3	57.4
92.5°	53.3	44.8	51.0	55.4	57.4
95°	138.2	68.0	82.9	93.7	91.5
97.5°	248.9	74.5	108.4	114.9	117.0
100°	376.8	85.2	121.3	138.2	142.5
102.5°	517.0	512.9	125.6	148.9	155.4
105°	646.9	710.8	129.9	153.1	161.8
107.5°	798.0	851.0	134.2	157.4	166.0
110°	942.8	987.3	372.5	159.7	168.0

TEST NUMBER: P915519

CATALOG NUMBER: DFN2DIP-TR4F0-050D110US927-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1079.0	1117.1	1081.0	163.7	170.3
115°	1223.5	1259.6	1313.0	327.7	174.6
117.5°	1349.2	1391.6	1428.0	1123.5	566.0
120°	1489.6	1521.5	1559.9	1585.4	1298.1
122.5°	1608.7	1642.7	1685.4	1698.1	1700.4
125°	1730.0	1757.8	1798.2	1813.1	1819.4
127.5°	1840.6	1870.4	1902.5	1923.7	1925.8
130°	1945.0	1979.1	2002.3	2025.8	2023.9
132.5°	2051.4	2079.2	2102.4	2121.6	2119.6
135°	2140.9	2174.9	2193.9	2215.4	2211.1
137.5°	2234.3	2259.9	2281.3	2302.6	2296.2
140°	2325.8	2343.0	2366.2	2385.4	2374.8
142.5°	2402.6	2417.5	2445.1	2462.0	2451.4
145°	2483.5	2481.2	2517.3	2532.3	2521.7
147.5°	2553.5	2547.2	2583.3	2593.9	2585.6
150°	2621.7	2606.8	2640.9	2653.6	2643.0
152.5°	2679.1	2662.1	2694.0	2706.9	2692.0
155°	2734.5	2715.4	2740.9	2753.6	2736.7
157.5°	2779.1	2762.2	2781.4	2796.3	2779.1
160°	2817.6	2804.6	2817.6	2830.1	2815.3
162.5°	2851.4	2838.8	2849.4	2864.3	2845.1
165°	2881.2	2868.6	2874.9	2889.8	2874.9
167.5°	2904.7	2891.9	2898.4	2913.3	2894.2
170°	2923.9	2911.0	2915.3	2930.3	2911.0
172.5°	2936.5	2923.9	2928.2	2943.1	2923.9
175°	2947.2	2932.3	2936.5	2951.5	2930.3
177.5°	2951.5	2936.5	2938.8	2953.7	2934.6
180°	2940.9	2940.9	2940.9	2940.9	2940.9



TEST NUMBER: P915519

CATALOG NUMBER: DFN2DIP-TR4F0-050D110US927-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	5.93	6.64	7.03	7.74	9.26	5.50	6.21	6.60	7.31	8.83
	3H	7.58	8.22	8.69	9.33	10.86	7.11	7.75	8.22	8.85	10.39
	4H	8.16	8.77	9.28	9.88	11.41	7.69	8.29	8.81	9.40	10.94
	6H	8.55	9.11	9.68	10.22	11.77	8.08	8.64	9.21	9.75	11.30
	8H	8.65	9.18	9.78	10.31	11.85	8.18	8.71	9.31	9.84	11.38
	12H	8.69	9.20	9.83	10.32	11.89	8.21	8.72	9.35	9.84	11.41
4H	2H	6.37	6.98	7.50	8.09	9.63	6.03	6.64	7.16	7.75	9.28
	3H	8.23	8.73	9.36	9.87	11.42	7.83	8.34	8.97	9.48	11.03
	4H	8.93	9.40	10.07	10.52	12.09	8.53	8.99	9.67	10.12	11.69
	6H	9.44	9.84	10.58	10.99	12.55	9.03	9.43	10.18	10.58	12.14
	8H	9.59	9.96	10.73	11.10	12.68	9.17	9.55	10.32	10.69	12.26
	12H	9.65	9.99	10.81	11.14	12.72	9.23	9.57	10.39	10.72	12.30
8H	4H	9.12	9.49	10.26	10.63	12.21	8.76	9.13	9.90	10.27	11.85
	6H	9.74	10.05	10.91	11.23	12.81	9.38	9.69	10.55	10.87	12.44
	8H	9.96	10.23	11.13	11.39	12.99	9.59	9.86	10.76	11.02	12.62
	12H	10.09	10.32	11.26	11.48	13.11	9.70	9.94	10.88	11.10	12.73
12H	4H	9.10	9.44	10.26	10.59	12.17	8.75	9.08	9.91	10.23	11.82
	6H	9.77	10.04	10.94	11.20	12.80	9.42	9.69	10.59	10.85	12.44
	8H	10.01	10.24	11.18	11.40	13.03	9.65	9.89	10.82	11.04	12.67

END OF REPORT