

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P915557

Luminaire Tested: DFN2DIP-TR4F0-060D110US927-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P915557
REPORT IS A COMBINATION OF REPORTS P902020 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-060D110US927-RLLONL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12666.9 lumens
Efficiency: N/A
Efficacy: 91.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 138.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P915557

CATALOG NUMBER: DFN2DIP-TR4F0-060D110US927-RLLONL

Luminous Intensity Polar Plot

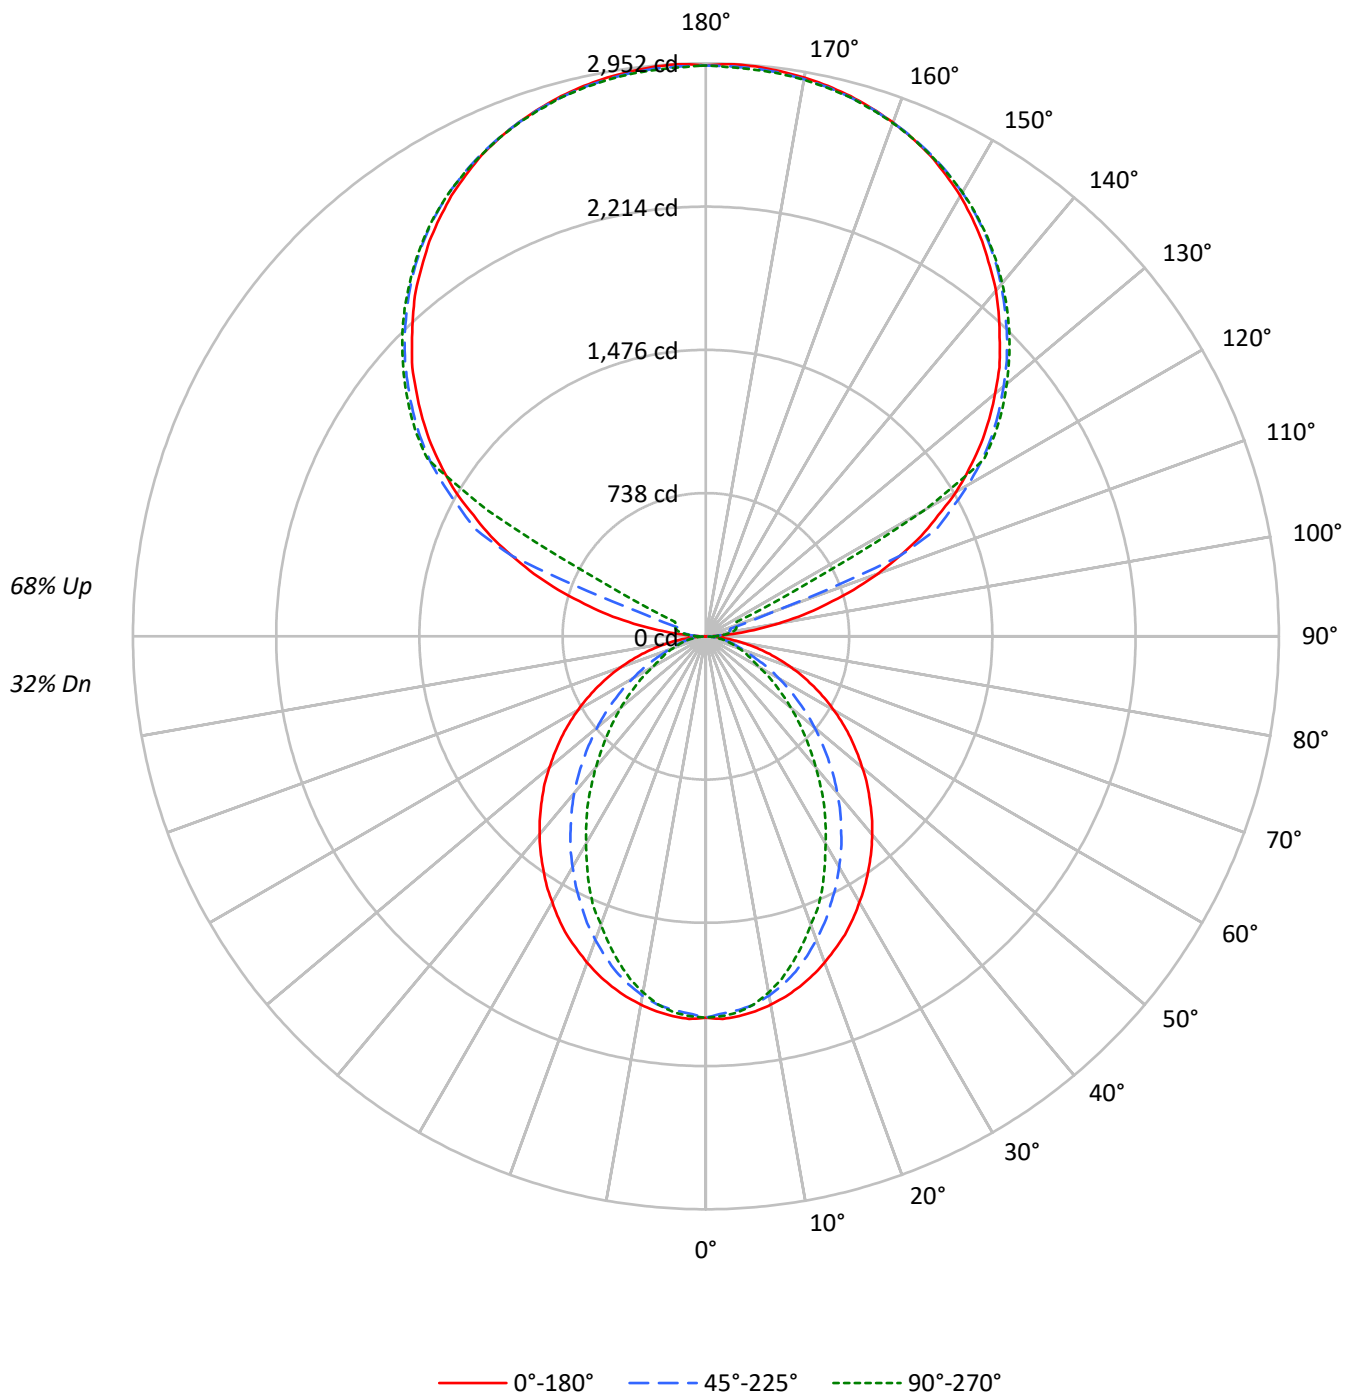

TEST NUMBER: P915557

CATALOG NUMBER: DFN2DIP-TR4F0-060D110US927-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	103	103	103	103	93	93	93	93	73	73	73	56	56	56	40	40	40
1	94	90	86	83	85	81	78	75	65	63	61	49	48	47	35	35	34
2	86	79	73	68	77	71	66	62	57	54	51	44	42	40	31	30	29
3	78	70	63	57	70	63	57	52	50	46	43	39	36	34	28	26	25
4	72	62	54	48	64	56	49	44	45	40	37	35	32	29	25	23	22
5	66	55	47	42	59	50	43	38	40	35	32	31	28	25	23	21	19
6	61	49	42	36	55	45	38	33	36	31	28	28	25	22	21	19	17
7	56	44	37	32	51	41	34	29	33	28	24	26	22	20	19	17	15
8	52	40	33	28	47	37	30	26	30	25	22	24	20	18	18	15	14
9	48	37	30	25	44	34	27	23	27	23	19	22	18	16	16	14	12
10	45	34	27	22	41	31	25	21	25	21	17	20	17	14	15	13	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1561	1561	1561
5°	1563	1536	1546
10°	1548	1506	1495
15°	1526	1456	1417
20°	1498	1387	1322
25°	1469	1310	1230
30°	1431	1232	1113
35°	1393	1147	1010
40°	1354	1059	893
45°	1309	962	786
50°	1263	863	682
55°	1214	758	582
60°	1158	649	479
65°	1094	537	431
70°	1015	433	390
75°	917	382	355
80°	775	320	307
85°	540	213	230

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1562 cd/sqm

TEST NUMBER: P915557

CATALOG NUMBER: DFN2DIP-TR4F0-060D110US927-RLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	184.1	1.5
10°-20°	505.4	4.0
20°-30°	709.6	5.6
30°-40°	773.5	6.1
40°-50°	710.9	5.6
50°-60°	558.3	4.4
60°-70°	363.4	2.9
70°-80°	187.1	1.5
80°-90°	52.9	0.4
90°-100°	97.0	0.8
100°-110°	361.5	2.9
110°-120°	958.7	7.6
120°-130°	1590.2	12.6
130°-140°	1689.1	13.3
140°-150°	1569.9	12.4
150°-160°	1262.1	10.0
160°-170°	813.3	6.4
170°-180°	279.9	2.2
0°-30°	1399.1	11.0
0°-40°	2172.6	17.2
0°-60°	3441.9	27.2
0°-90°	4045.3	31.9
90°-120°	1417.2	11.2
90°-150°	6266.3	49.5
90°-180°	8622.0	68.1
0°-180°	12666.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1964	1964	1964	1964	1964	
5°	1964	1956	1932	1948	1943	186
15°	1868	1849	1788	1755	1737	527
25°	1696	1639	1522	1449	1422	780
35°	1461	1371	1214	1102	1063	915
45°	1195	1076	889	763	720	923
55°	908	770	578	471	437	812
65°	613	469	309	249	244	608
75°	327	203	142	130	128	346
85°	76	39	34	34	34	88
90°	2	26	42	53	57	12
95°	138	68	83	94	92	164
105°	647	711	130	153	162	691
115°	1224	1260	1313	328	175	1205
125°	1730	1758	1798	1813	1819	1543
135°	2141	2175	2194	2215	2211	1654
145°	2484	2481	2517	2532	2522	1553
155°	2734	2715	2741	2754	2737	1260
165°	2881	2869	2875	2890	2875	814
175°	2947	2932	2936	2952	2930	280
180°	2941	2941	2941	2941	2941	

TEST NUMBER: P915557

CATALOG NUMBER: DFN2DIP-TR4F0-060D110US927-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1964.5	1964.5	1964.5	1964.5	1964.5
2.5°	1973.3	1964.5	1944.8	1962.7	1959.1
5°	1964.5	1955.6	1932.4	1948.4	1943.1
7.5°	1948.4	1937.8	1913.0	1919.9	1911.1
10°	1927.1	1914.6	1879.2	1873.7	1863.1
12.5°	1900.5	1884.4	1836.4	1825.8	1806.2
15°	1868.4	1848.8	1788.4	1754.7	1736.9
17.5°	1831.1	1802.6	1727.9	1688.9	1660.4
20°	1788.4	1752.8	1664.0	1619.6	1580.4
22.5°	1742.2	1701.3	1598.1	1537.8	1511.2
25°	1696.1	1639.1	1521.8	1449.0	1422.2
27.5°	1641.0	1580.4	1450.6	1367.1	1326.2
30°	1582.3	1514.6	1372.4	1281.8	1233.7
32.5°	1525.3	1443.5	1297.9	1191.1	1146.6
35°	1461.4	1370.7	1214.3	1102.2	1063.0
37.5°	1399.2	1301.2	1136.1	1013.3	968.9
40°	1333.3	1226.8	1054.2	928.0	881.8
42.5°	1265.8	1152.1	972.5	840.8	796.5
45°	1194.7	1075.5	889.0	762.6	719.9
47.5°	1127.2	1001.0	809.0	682.6	643.6
50°	1052.5	926.3	730.7	607.9	570.8
52.5°	979.5	846.1	656.0	538.7	504.9
55°	908.4	769.8	577.7	471.2	437.4
57.5°	835.6	693.3	508.5	408.9	380.4
60°	760.9	618.7	435.5	345.0	316.5
62.5°	688.1	545.9	373.3	288.0	273.9
65°	613.4	469.3	309.3	249.0	243.5
67.5°	542.2	398.2	249.0	218.6	213.3
70°	467.5	328.9	206.1	188.5	181.3
72.5°	396.5	264.8	172.4	158.3	154.6
75°	327.1	202.6	142.2	129.8	128.1
77.5°	257.9	143.9	112.0	104.9	101.3
80°	193.7	103.1	85.2	78.3	78.3
82.5°	135.1	69.4	58.6	55.1	55.1
85°	76.4	39.1	33.7	33.7	33.7
87.5°	28.5	14.2	14.2	12.4	12.4
90°	2.1	25.5	42.5	53.3	57.4
92.5°	53.3	44.8	51.0	55.4	57.4
95°	138.2	68.0	82.9	93.7	91.5
97.5°	248.9	74.5	108.4	114.9	117.0
100°	376.8	85.2	121.3	138.2	142.5
102.5°	517.0	512.9	125.6	148.9	155.4
105°	646.9	710.8	129.9	153.1	161.8
107.5°	798.0	851.0	134.2	157.4	166.0
110°	942.8	987.3	372.5	159.7	168.0

TEST NUMBER: P915557

CATALOG NUMBER: DFN2DIP-TR4F0-060D110US927-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1079.0	1117.1	1081.0	163.7	170.3
115°	1223.5	1259.6	1313.0	327.7	174.6
117.5°	1349.2	1391.6	1428.0	1123.5	566.0
120°	1489.6	1521.5	1559.9	1585.4	1298.1
122.5°	1608.7	1642.7	1685.4	1698.1	1700.4
125°	1730.0	1757.8	1798.2	1813.1	1819.4
127.5°	1840.6	1870.4	1902.5	1923.7	1925.8
130°	1945.0	1979.1	2002.3	2025.8	2023.9
132.5°	2051.4	2079.2	2102.4	2121.6	2119.6
135°	2140.9	2174.9	2193.9	2215.4	2211.1
137.5°	2234.3	2259.9	2281.3	2302.6	2296.2
140°	2325.8	2343.0	2366.2	2385.4	2374.8
142.5°	2402.6	2417.5	2445.1	2462.0	2451.4
145°	2483.5	2481.2	2517.3	2532.3	2521.7
147.5°	2553.5	2547.2	2583.3	2593.9	2585.6
150°	2621.7	2606.8	2640.9	2653.6	2643.0
152.5°	2679.1	2662.1	2694.0	2706.9	2692.0
155°	2734.5	2715.4	2740.9	2753.6	2736.7
157.5°	2779.1	2762.2	2781.4	2796.3	2779.1
160°	2817.6	2804.6	2817.6	2830.1	2815.3
162.5°	2851.4	2838.8	2849.4	2864.3	2845.1
165°	2881.2	2868.6	2874.9	2889.8	2874.9
167.5°	2904.7	2891.9	2898.4	2913.3	2894.2
170°	2923.9	2911.0	2915.3	2930.3	2911.0
172.5°	2936.5	2923.9	2928.2	2943.1	2923.9
175°	2947.2	2932.3	2936.5	2951.5	2930.3
177.5°	2951.5	2936.5	2938.8	2953.7	2934.6
180°	2940.9	2940.9	2940.9	2940.9	2940.9

TEST NUMBER: P915557

CATALOG NUMBER: DFN2DIP-TR4F0-060D110US927-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.72	7.42	7.82	8.51	10.02	2.69	3.39	3.79	4.49	6.00
	3H	8.38	9.01	9.49	10.11	11.64	3.87	4.50	4.98	5.60	7.13
	4H	8.98	9.58	10.11	10.69	12.22	4.31	4.91	5.44	6.01	7.55
	6H	9.40	9.95	10.53	11.06	12.60	4.63	5.18	5.76	6.29	7.83
	8H	9.52	10.04	10.66	11.17	12.70	4.72	5.24	5.85	6.36	7.90
	12H	9.58	10.07	10.72	11.19	12.75	4.76	5.25	5.89	6.37	7.93
4H	2H	6.72	7.31	7.85	8.42	9.95	3.27	3.86	4.40	4.97	6.50
	3H	8.53	9.03	9.67	10.16	11.71	4.61	5.10	5.74	6.23	7.78
	4H	9.22	9.68	10.36	10.80	12.36	5.15	5.61	6.29	6.73	8.29
	6H	9.73	10.12	10.87	11.26	12.82	5.56	5.95	6.71	7.10	8.65
	8H	9.90	10.27	11.05	11.40	12.97	5.69	6.06	6.84	7.19	8.76
	12H	9.99	10.32	11.15	11.47	13.05	5.75	6.08	6.91	7.23	8.81
8H	4H	9.18	9.54	10.32	10.68	12.25	5.42	5.79	6.57	6.92	8.49
	6H	9.74	10.04	10.91	11.22	12.79	5.94	6.24	7.10	7.41	8.98
	8H	9.96	10.22	11.13	11.38	12.97	6.13	6.39	7.30	7.55	9.14
	12H	10.09	10.32	11.26	11.47	13.10	6.24	6.47	7.42	7.63	9.25
12H	4H	9.13	9.46	10.29	10.60	12.18	5.42	5.75	6.58	6.90	8.47
	6H	9.72	9.98	10.89	11.14	12.72	5.99	6.25	7.16	7.40	8.99
	8H	9.93	10.16	11.10	11.32	12.94	6.19	6.42	7.36	7.58	9.20

END OF REPORT