

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P915563

Luminaire Tested: DFN2DIP-TR4F0-070D040US927-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P915563
REPORT IS A COMBINATION OF REPORTS P901895 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-070D040US927-FLLONL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8626.9 lumens
Efficiency: N/A
Efficacy: 90.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 95.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9977
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P915563

CATALOG NUMBER: DFN2DIP-TR4F0-070D040US927-FLLONL

Luminous Intensity Polar Plot

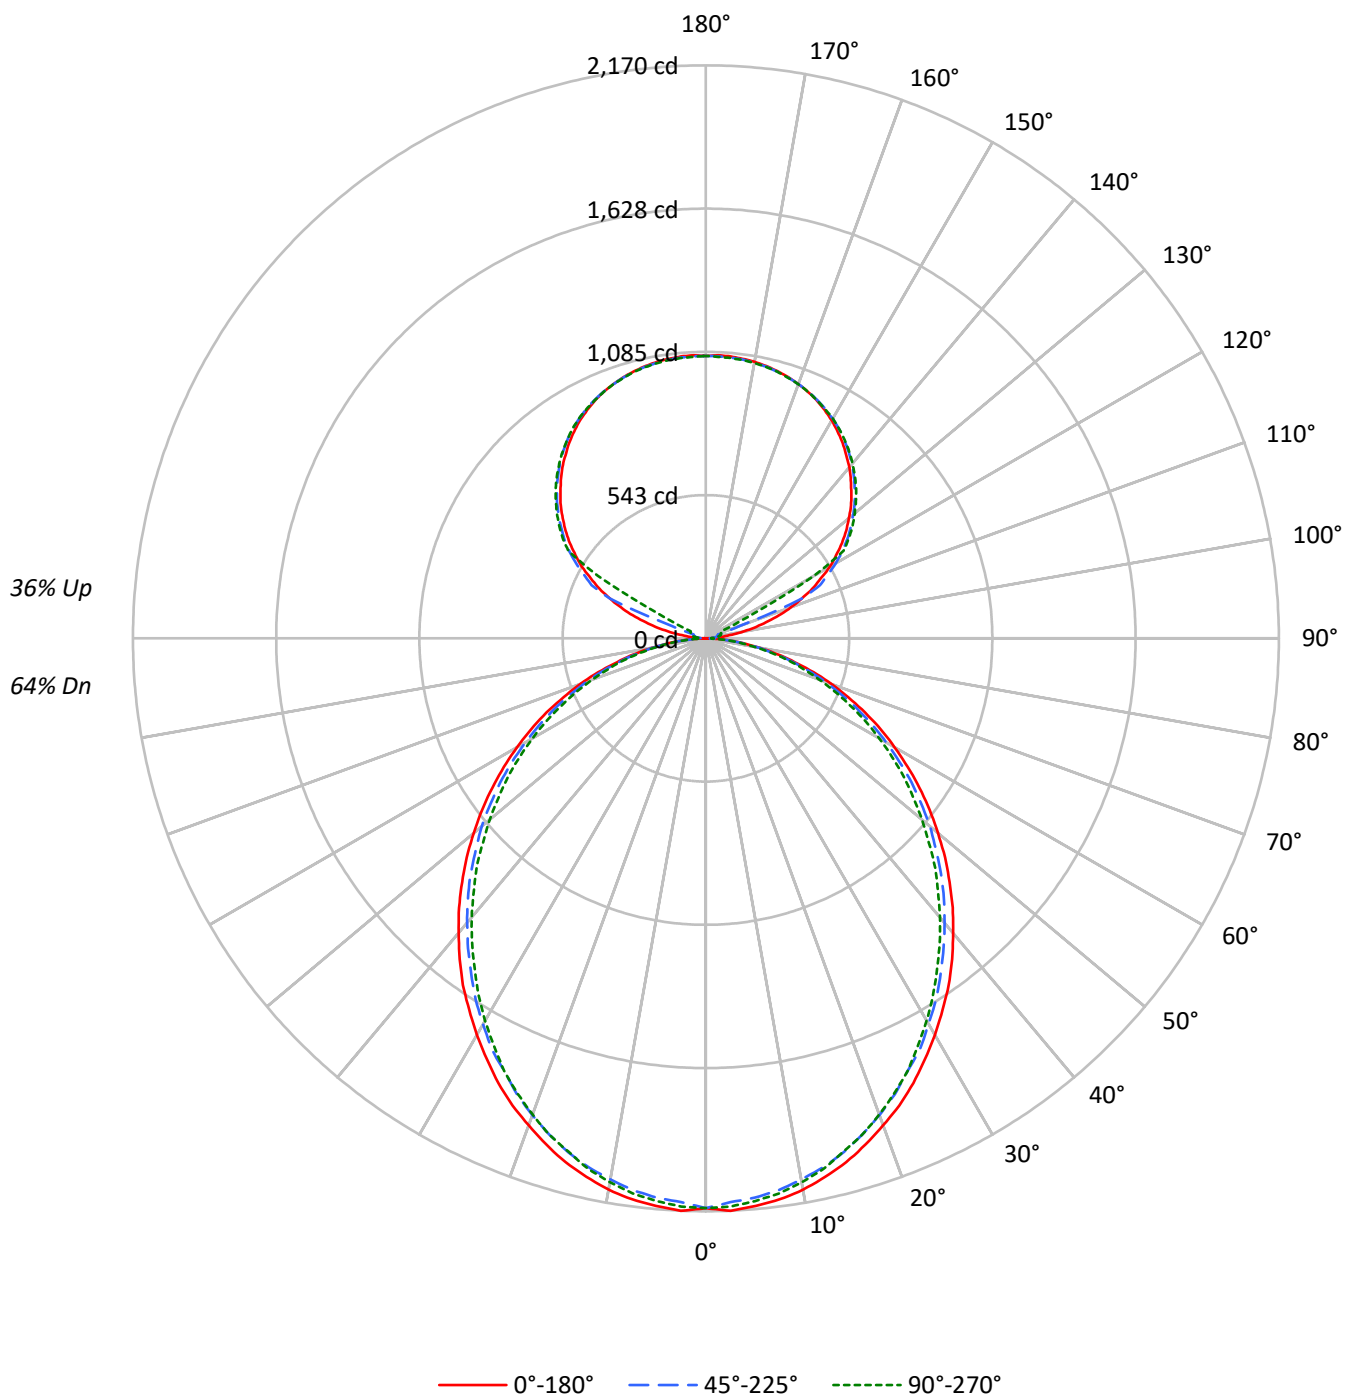

TEST NUMBER: P915563

CATALOG NUMBER: DFN2DIP-TR4F0-070D040US927-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	104	104	104	104	91	91	91	79	79	79	69	69	69
1	101	96	92	89	94	91	87	84	80	77	75	70	68	66	61	59	58
2	92	84	78	73	86	79	74	69	70	66	62	61	58	55	53	51	49
3	84	74	67	61	78	70	63	58	62	57	52	54	50	47	47	44	42
4	77	66	58	51	72	62	55	49	55	49	45	48	44	40	42	39	36
5	71	59	50	44	66	55	48	42	49	43	39	44	39	35	38	34	31
6	65	53	44	38	61	50	42	37	44	38	34	39	34	31	35	31	28
7	60	48	39	34	56	45	38	32	40	34	30	36	31	27	32	28	25
8	56	43	35	30	52	41	34	29	37	31	27	33	28	24	29	25	22
9	52	40	32	27	49	38	31	26	34	28	24	30	25	22	27	23	20
10	49	36	29	24	46	35	28	23	31	26	22	28	23	20	25	21	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1714	1714	1714
5°	1717	1690	1702
10°	1703	1667	1678
15°	1678	1640	1642
20°	1644	1602	1606
25°	1611	1556	1563
30°	1568	1514	1509
35°	1528	1464	1451
40°	1479	1413	1397
45°	1430	1362	1341
50°	1376	1309	1276
55°	1320	1248	1217
60°	1257	1174	1149
65°	1188	1099	1068
70°	1100	1007	982
75°	977	896	902
80°	831	755	749
85°	601	513	496

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 1430 cd/sqm

TEST NUMBER: P915563

CATALOG NUMBER: DFN2DIP-TR4F0-070D040US927-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	203.1	2.4
10°-20°	571.4	6.6
20°-30°	839.7	9.7
30°-40°	975.3	11.3
40°-50°	974.1	11.3
50°-60°	849.4	9.8
60°-70°	627.9	7.3
70°-80°	355.2	4.1
80°-90°	95.6	1.1
90°-100°	35.2	0.4
100°-110°	131.5	1.5
110°-120°	348.6	4.0
120°-130°	578.2	6.7
130°-140°	614.2	7.1
140°-150°	570.9	6.6
150°-160°	458.9	5.3
160°-170°	295.7	3.4
170°-180°	101.8	1.2
0°-30°	1614.2	18.7
0°-40°	2589.5	30.0
0°-60°	4412.9	51.2
0°-90°	5491.7	63.7
90°-120°	515.3	6.0
90°-150°	2278.7	26.4
90°-180°	3135.0	36.3
0°-180°	8626.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2158	2158	2158	2158	2158	
5°	2158	2150	2127	2143	2139	205
15°	2054	2042	2015	2023	2013	578
25°	1859	1842	1807	1811	1807	855
35°	1604	1583	1550	1537	1527	1002
45°	1305	1291	1259	1237	1228	1007
55°	988	975	950	925	915	883
65°	666	654	633	614	604	659
75°	348	344	334	322	326	372
85°	85	83	81	75	73	95
90°	1	9	15	19	21	8
95°	50	25	30	34	33	60
105°	235	258	47	56	59	251
115°	445	458	477	119	64	438
125°	629	639	654	659	662	561
135°	778	791	798	806	804	601
145°	903	902	915	921	917	565
155°	994	988	997	1001	995	458
165°	1048	1043	1045	1051	1045	296
175°	1072	1066	1068	1073	1066	102
180°	1069	1069	1069	1069	1069	

TEST NUMBER: P915563

CATALOG NUMBER: DFN2DIP-TR4F0-070D040US927-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2157.7	2157.7	2157.7	2157.7	2157.7
2.5°	2170.3	2159.9	2137.0	2157.7	2153.7
5°	2157.7	2149.6	2126.7	2143.2	2139.2
7.5°	2143.2	2130.8	2107.9	2124.7	2120.5
10°	2120.5	2105.9	2081.1	2097.6	2091.4
12.5°	2089.2	2076.9	2052.1	2062.4	2058.2
15°	2054.0	2041.7	2014.6	2023.0	2012.6
17.5°	2010.4	1998.1	1971.0	1981.4	1971.0
20°	1962.6	1950.4	1921.3	1927.5	1919.3
22.5°	1915.1	1896.4	1869.3	1869.3	1865.1
25°	1859.0	1842.5	1807.3	1811.2	1807.3
27.5°	1796.7	1782.2	1755.3	1749.1	1738.8
30°	1734.6	1717.8	1686.9	1680.7	1672.3
32.5°	1668.1	1655.8	1622.5	1610.0	1601.6
35°	1603.8	1583.2	1549.9	1537.4	1527.0
37.5°	1531.2	1512.5	1479.2	1464.7	1454.4
40°	1456.6	1439.9	1406.6	1388.1	1379.7
42.5°	1383.9	1367.2	1334.2	1313.3	1300.9
45°	1305.1	1290.6	1259.3	1236.7	1228.3
47.5°	1228.3	1213.8	1180.5	1157.6	1145.3
50°	1147.3	1136.9	1107.9	1078.9	1068.5
52.5°	1068.5	1054.0	1027.1	1004.2	989.7
55°	987.7	975.2	950.3	925.4	915.0
57.5°	906.7	896.4	869.3	844.4	836.1
60°	825.7	817.5	788.5	765.6	759.5
62.5°	746.9	732.4	711.7	691.0	682.6
65°	666.1	653.5	632.9	614.2	603.8
67.5°	583.1	572.6	554.1	539.6	531.2
70°	506.3	498.0	479.2	464.7	456.5
72.5°	427.5	419.1	408.8	394.3	388.1
75°	348.5	344.5	333.9	321.6	325.8
77.5°	278.1	269.7	265.5	259.3	253.2
80°	207.6	205.4	201.2	195.0	190.8
82.5°	141.1	141.1	139.1	130.8	130.8
85°	85.0	83.0	81.0	74.6	72.6
87.5°	37.4	33.3	29.1	22.9	20.7
90°	0.7	9.3	15.4	19.4	20.8
92.5°	19.4	16.2	18.5	20.1	20.8
95°	50.2	24.7	30.1	34.1	33.3
97.5°	90.5	27.1	39.5	41.8	42.5
100°	137.0	31.0	44.1	50.2	51.8
102.5°	188.0	186.6	45.6	54.1	56.5
105°	235.2	258.5	47.2	55.7	58.8
107.5°	290.2	309.5	48.8	57.3	60.4
110°	342.9	359.0	135.5	58.1	61.1



TEST NUMBER: P915563

CATALOG NUMBER: DFN2DIP-TR4F0-070D040US927-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	392.4	406.2	393.1	59.6	61.9
115°	444.9	458.0	477.4	119.1	63.5
117.5°	490.6	506.0	519.3	408.5	205.8
120°	541.7	553.3	567.2	576.5	472.1
122.5°	584.9	597.4	612.9	617.5	618.3
125°	629.1	639.2	653.9	659.3	661.6
127.5°	669.3	680.2	691.8	699.6	700.3
130°	707.3	719.7	728.1	736.6	735.9
132.5°	745.9	756.1	764.5	771.5	770.8
135°	778.5	790.9	797.8	805.6	804.1
137.5°	812.5	821.7	829.6	837.3	835.0
140°	845.7	852.0	860.5	867.4	863.6
142.5°	873.7	879.1	889.1	895.2	891.4
145°	903.1	902.3	915.4	920.8	916.9
147.5°	928.5	926.2	939.4	943.3	940.2
150°	953.3	947.9	960.4	965.0	961.1
152.5°	974.2	968.0	979.6	984.3	978.9
155°	994.3	987.5	996.7	1001.3	995.1
157.5°	1010.6	1004.4	1011.5	1016.8	1010.6
160°	1024.5	1019.9	1024.5	1029.1	1023.7
162.5°	1036.9	1032.3	1036.2	1041.6	1034.6
165°	1047.7	1043.1	1045.4	1050.8	1045.4
167.5°	1056.3	1051.5	1054.0	1059.4	1052.4
170°	1063.3	1058.6	1060.1	1065.6	1058.6
172.5°	1067.9	1063.3	1064.8	1070.2	1063.3
175°	1071.7	1066.3	1067.9	1073.2	1065.6
177.5°	1073.2	1067.9	1068.7	1074.1	1067.1
180°	1069.4	1069.4	1069.4	1069.4	1069.4

TEST NUMBER: P915563

CATALOG NUMBER: DFN2DIP-TR4F0-070D040US927-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.31	11.31	11.14	12.16	13.23	9.88	10.88	10.71	11.73	12.79
	3H	11.98	12.88	12.83	13.74	14.83	11.51	12.41	12.35	13.27	14.36
	4H	12.58	13.42	13.44	14.29	15.39	12.10	12.95	12.96	13.82	14.92
	6H	12.98	13.77	13.85	14.64	15.75	12.51	13.29	13.38	14.17	15.28
	8H	13.09	13.84	13.97	14.73	15.84	12.62	13.36	13.50	14.26	15.37
	12H	13.14	13.85	14.03	14.74	15.88	12.66	13.37	13.55	14.26	15.40
4H	2H	10.79	11.64	11.65	12.51	13.61	10.45	11.29	11.31	12.16	13.26
	3H	12.67	13.38	13.54	14.28	15.39	12.28	12.98	13.15	13.89	15.00
	4H	13.39	14.03	14.28	14.93	16.07	12.98	13.63	13.87	14.53	15.67
	6H	13.91	14.47	14.81	15.39	16.53	13.50	14.06	14.40	14.98	16.13
	8H	14.06	14.59	14.97	15.50	16.66	13.65	14.17	14.56	15.09	16.25
	12H	14.14	14.61	15.07	15.55	16.71	13.72	14.19	14.65	15.13	16.29
8H	4H	13.60	14.12	14.50	15.03	16.19	13.24	13.76	14.14	14.67	15.83
	6H	14.23	14.66	15.17	15.62	16.78	13.87	14.30	14.80	15.26	16.42
	8H	14.46	14.84	15.40	15.79	16.96	14.09	14.47	15.03	15.42	16.59
	12H	14.59	14.93	15.54	15.87	17.10	14.21	14.55	15.15	15.49	16.71
12H	4H	13.59	14.06	14.51	14.99	16.16	13.24	13.71	14.16	14.64	15.80
	6H	14.26	14.65	15.21	15.60	16.77	13.91	14.30	14.85	15.24	16.42
	8H	14.51	14.85	15.46	15.79	17.02	14.16	14.49	15.10	15.43	16.66

END OF REPORT