

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P915570

Luminaire Tested: DFN2DIP-TR4F0-070D060US927-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P915570
REPORT IS A COMBINATION OF REPORTS P900411 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-070D060US927-FLLFLL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9696.3 lumens
Efficiency: N/A
Efficacy: 87.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 110.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9977
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P915570

CATALOG NUMBER: DFN2DIP-TR4F0-070D060US927-FLLFLL

Luminous Intensity Polar Plot

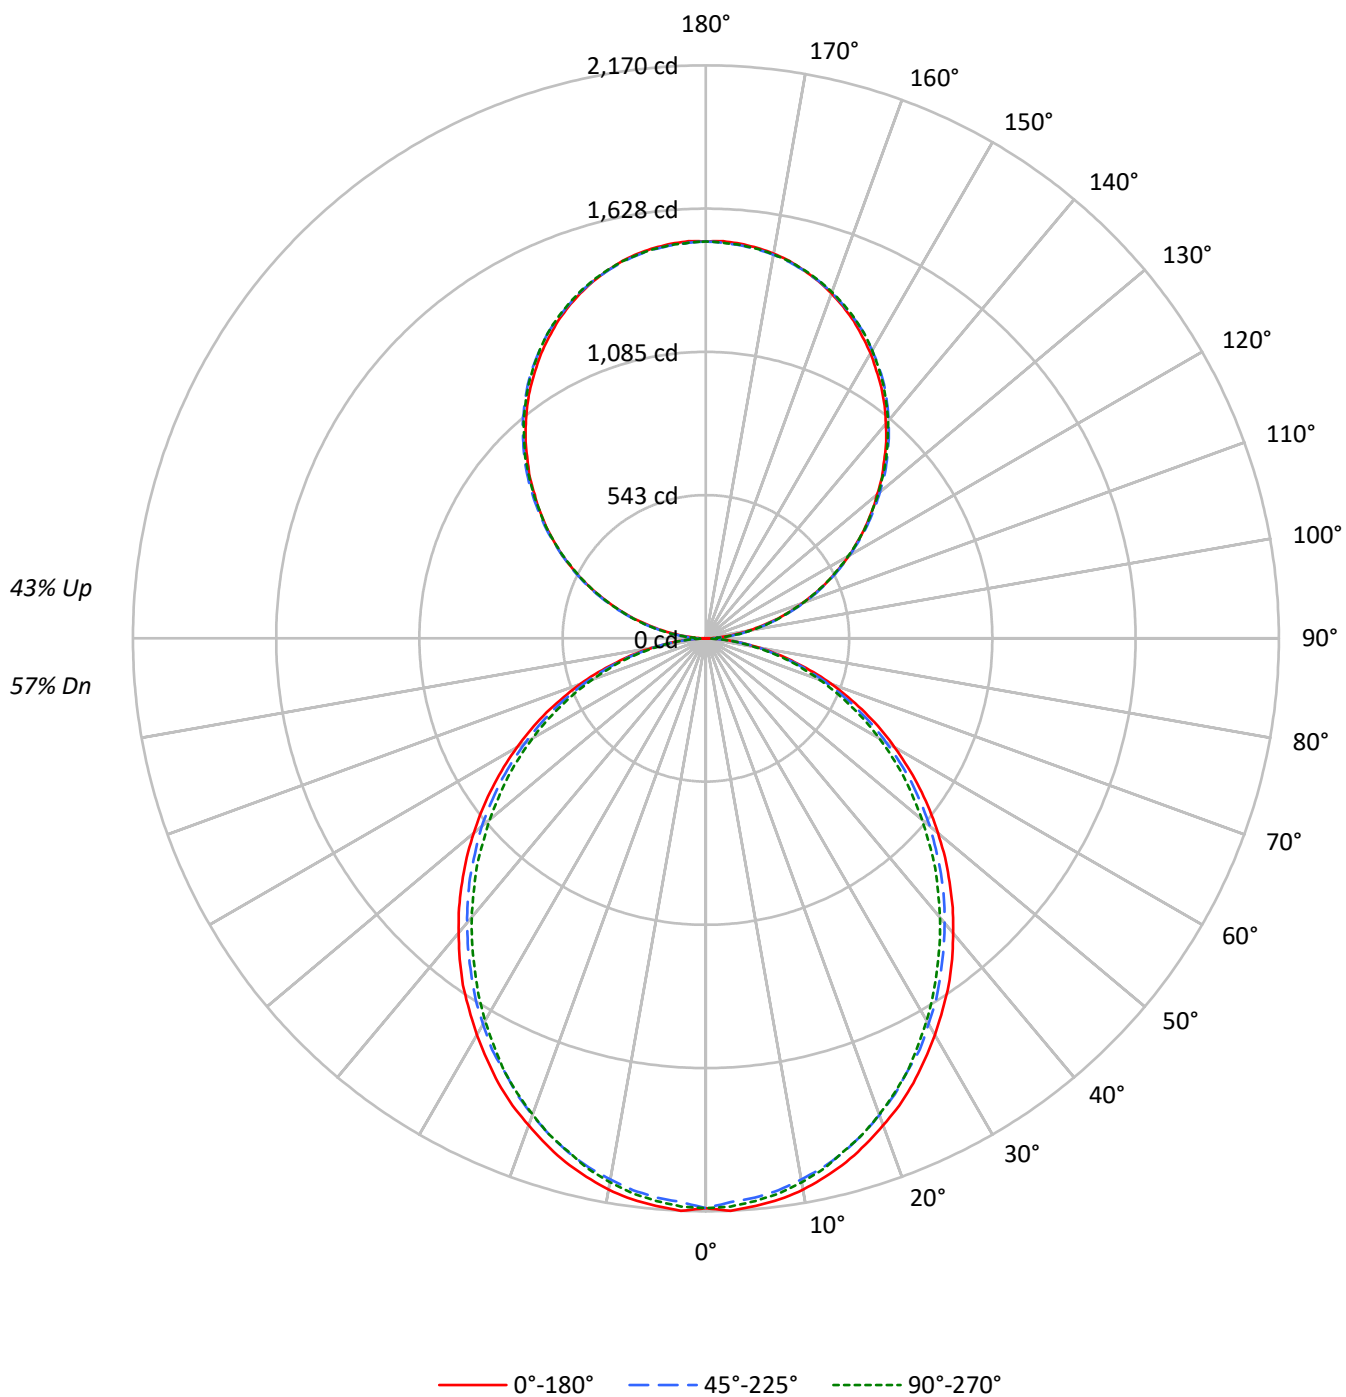

TEST NUMBER: P915570

CATALOG NUMBER: DFN2DIP-TR4F0-070D060US927-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	101	101	101	101	87	87	87	74	74	74	62	62	62
1	99	95	91	87	92	88	85	82	76	74	72	65	63	62	55	54	53
2	90	83	77	71	84	77	72	67	67	63	59	57	54	52	48	46	44
3	82	73	65	60	76	68	62	56	59	54	50	51	47	44	43	40	38
4	75	65	57	50	70	60	53	48	53	47	43	45	41	37	38	35	33
5	69	58	49	43	64	54	47	41	47	41	37	41	36	32	35	31	28
6	64	52	43	38	59	48	41	36	42	36	32	37	32	28	31	28	25
7	59	47	39	33	55	44	37	31	38	33	28	33	29	25	29	25	22
8	55	42	35	29	51	40	33	28	35	29	25	31	26	23	26	23	20
9	51	39	31	26	48	37	30	25	32	27	23	28	24	20	24	21	18
10	48	36	28	23	45	34	27	22	30	24	20	26	22	18	23	19	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1714	1714	1714
5°	1717	1690	1702
10°	1703	1667	1678
15°	1678	1640	1642
20°	1644	1602	1606
25°	1611	1556	1563
30°	1568	1514	1509
35°	1528	1464	1451
40°	1479	1413	1397
45°	1430	1362	1341
50°	1376	1309	1276
55°	1320	1248	1217
60°	1257	1174	1149
65°	1188	1099	1068
70°	1100	1007	982
75°	977	896	902
80°	831	755	749
85°	601	513	496

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1430 cd/sqm

TEST NUMBER: P915570

CATALOG NUMBER: DFN2DIP-TR4F0-070D060US927-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	203.1	2.1
10°-20°	571.4	5.9
20°-30°	839.7	8.7
30°-40°	975.3	10.1
40°-50°	974.1	10.0
50°-60°	849.4	8.8
60°-70°	627.9	6.5
70°-80°	355.2	3.7
80°-90°	98.0	1.0
90°-100°	93.0	1.0
100°-110°	295.6	3.0
110°-120°	505.8	5.2
120°-130°	665.2	6.9
130°-140°	746.6	7.7
140°-150°	732.2	7.6
150°-160°	614.2	6.3
160°-170°	407.3	4.2
170°-180°	142.4	1.5
0°-30°	1614.2	16.6
0°-40°	2589.5	26.7
0°-60°	4412.9	45.5
0°-90°	5494.1	56.7
90°-120°	894.4	9.2
90°-150°	3038.4	31.3
90°-180°	4202.0	43.3
0°-180°	9696.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2158	2158	2158	2158	2158	
5°	2158	2150	2127	2143	2139	205
15°	2054	2042	2015	2023	2013	578
25°	1859	1842	1807	1811	1807	855
35°	1604	1583	1550	1537	1527	1002
45°	1305	1291	1259	1237	1228	1007
55°	988	975	950	925	915	883
65°	666	654	633	614	604	659
75°	348	344	334	322	326	372
85°	85	83	81	75	73	95
90°	1	16	44	42	43	9
95°	66	79	81	81	79	74
105°	273	276	279	282	282	288
115°	508	515	512	511	508	502
125°	738	750	746	742	740	660
135°	955	969	972	970	967	738
145°	1159	1168	1176	1177	1172	724
155°	1326	1329	1333	1340	1336	610
165°	1442	1441	1441	1450	1443	407
175°	1500	1497	1494	1503	1496	143
180°	1503	1503	1503	1503	1503	

TEST NUMBER: P915570

CATALOG NUMBER: DFN2DIP-TR4F0-070D060US927-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2157.7	2157.7	2157.7	2157.7	2157.7
2.5°	2170.3	2159.9	2137.0	2157.7	2153.7
5°	2157.7	2149.6	2126.7	2143.2	2139.2
7.5°	2143.2	2130.8	2107.9	2124.7	2120.5
10°	2120.5	2105.9	2081.1	2097.6	2091.4
12.5°	2089.2	2076.9	2052.1	2062.4	2058.2
15°	2054.0	2041.7	2014.6	2023.0	2012.6
17.5°	2010.4	1998.1	1971.0	1981.4	1971.0
20°	1962.6	1950.4	1921.3	1927.5	1919.3
22.5°	1915.1	1896.4	1869.3	1869.3	1865.1
25°	1859.0	1842.5	1807.3	1811.2	1807.3
27.5°	1796.7	1782.2	1755.3	1749.1	1738.8
30°	1734.6	1717.8	1686.9	1680.7	1672.3
32.5°	1668.1	1655.8	1622.5	1610.0	1601.6
35°	1603.8	1583.2	1549.9	1537.4	1527.0
37.5°	1531.2	1512.5	1479.2	1464.7	1454.4
40°	1456.6	1439.9	1406.6	1388.1	1379.7
42.5°	1383.9	1367.2	1334.2	1313.3	1300.9
45°	1305.1	1290.6	1259.3	1236.7	1228.3
47.5°	1228.3	1213.8	1180.5	1157.6	1145.3
50°	1147.3	1136.9	1107.9	1078.9	1068.5
52.5°	1068.5	1054.0	1027.1	1004.2	989.7
55°	987.7	975.2	950.3	925.4	915.0
57.5°	906.7	896.4	869.3	844.4	836.1
60°	825.7	817.5	788.5	765.6	759.5
62.5°	746.9	732.4	711.7	691.0	682.6
65°	666.1	653.5	632.9	614.2	603.8
67.5°	583.1	572.6	554.1	539.6	531.2
70°	506.3	498.0	479.2	464.7	456.5
72.5°	427.5	419.1	408.8	394.3	388.1
75°	348.5	344.5	333.9	321.6	325.8
77.5°	278.1	269.7	265.5	259.3	253.2
80°	207.6	205.4	201.2	195.0	190.8
82.5°	141.1	141.1	139.1	130.8	130.8
85°	85.0	83.0	81.0	74.6	72.6
87.5°	37.4	33.3	29.1	22.9	20.7
90°	1.3	16.3	44.4	41.7	43.0
92.5°	28.1	38.1	39.5	40.8	40.8
95°	66.1	78.8	81.1	81.1	78.8
97.5°	110.1	121.9	126.9	126.9	126.9
100°	160.9	171.3	174.9	174.9	173.6
102.5°	214.4	222.0	227.0	228.4	227.0
105°	272.8	276.5	279.2	281.5	281.5
107.5°	330.8	336.3	336.3	337.2	330.8
110°	387.1	394.3	394.3	394.3	390.6

TEST NUMBER: P915570

CATALOG NUMBER: DFN2DIP-TR4F0-070D060US927-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	447.7	455.4	454.1	450.4	447.7
115°	507.6	514.8	512.5	511.2	507.6
117.5°	567.0	576.9	570.5	567.0	563.3
120°	626.8	636.8	626.8	626.8	622.7
122.5°	681.1	693.8	687.5	683.9	681.1
125°	738.2	749.6	745.9	741.9	740.5
127.5°	794.0	808.0	803.0	797.6	794.0
130°	846.1	862.4	860.2	857.5	852.5
132.5°	904.6	917.3	918.1	911.8	908.2
135°	954.9	968.9	971.6	970.3	966.6
137.5°	1011.1	1022.4	1024.7	1023.7	1018.3
140°	1060.5	1071.8	1078.2	1078.2	1073.2
142.5°	1111.2	1122.5	1126.2	1127.5	1122.5
145°	1159.3	1168.3	1175.6	1176.9	1172.0
147.5°	1202.3	1213.6	1219.1	1221.3	1216.3
150°	1246.7	1254.4	1259.4	1263.4	1259.4
152.5°	1286.1	1293.9	1300.2	1305.2	1300.2
155°	1325.6	1329.2	1333.2	1339.7	1335.5
157.5°	1359.5	1362.3	1364.5	1373.6	1367.3
160°	1390.0	1392.7	1394.0	1401.7	1396.3
162.5°	1418.0	1418.0	1419.4	1428.0	1421.6
165°	1442.0	1440.7	1440.7	1449.8	1443.4
167.5°	1463.8	1459.8	1459.8	1468.8	1462.4
170°	1480.1	1476.5	1475.1	1484.2	1476.5
172.5°	1491.4	1487.8	1486.4	1495.5	1487.8
175°	1500.5	1496.9	1494.1	1503.2	1495.5
177.5°	1505.5	1501.9	1499.1	1506.8	1499.1
180°	1503.2	1503.2	1503.2	1503.2	1503.2

TEST NUMBER: P915570

CATALOG NUMBER: DFN2DIP-TR4F0-070D060US927-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.73	10.66	10.63	11.57	12.75	9.30	10.22	10.20	11.14	12.32
	3H	11.40	12.23	12.31	13.15	14.35	10.92	11.75	11.83	12.68	13.88
	4H	11.99	12.77	12.91	13.70	14.91	11.51	12.30	12.44	13.23	14.44
	6H	12.39	13.11	13.33	14.05	15.27	11.91	12.64	12.85	13.58	14.80
	8H	12.50	13.19	13.44	14.14	15.36	12.02	12.71	12.97	13.67	14.88
	12H	12.55	13.20	13.50	14.15	15.40	12.07	12.72	13.02	13.67	14.91
4H	2H	10.20	10.99	11.13	11.92	13.12	9.86	10.64	10.79	11.57	12.78
	3H	12.07	12.73	13.01	13.69	14.91	11.68	12.33	12.62	13.30	14.52
	4H	12.79	13.39	13.74	14.34	15.59	12.38	12.98	13.33	13.94	15.19
	6H	13.31	13.82	14.27	14.81	16.05	12.90	13.41	13.86	14.40	15.64
	8H	13.46	13.94	14.42	14.92	16.18	13.05	13.53	14.01	14.50	15.76
	12H	13.54	13.97	14.52	14.96	16.23	13.11	13.55	14.10	14.54	15.81
8H	4H	12.99	13.47	13.96	14.45	15.71	12.63	13.11	13.60	14.09	15.35
	6H	13.63	14.02	14.62	15.04	16.30	13.26	13.66	14.25	14.68	15.94
	8H	13.85	14.20	14.85	15.20	16.48	13.48	13.83	14.48	14.83	16.11
	12H	13.98	14.29	14.98	15.29	16.61	13.60	13.91	14.60	14.90	16.23
12H	4H	12.98	13.42	13.96	14.41	15.67	12.63	13.06	13.61	14.05	15.32
	6H	13.66	14.01	14.66	15.01	16.29	13.30	13.66	14.30	14.66	15.94
	8H	13.90	14.21	14.90	15.21	16.53	13.54	13.85	14.55	14.85	16.17