

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P915599

Luminaire Tested: DFN2DIP-TR4F0-080D040US927-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P915599
REPORT IS A COMBINATION OF REPORTS P901897 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-080D040US927-FLLONL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9411.1 lumens
Efficiency: N/A
Efficacy: 89.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 105.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P915599

CATALOG NUMBER: DFN2DIP-TR4F0-080D040US927-FLLONL

Luminous Intensity Polar Plot

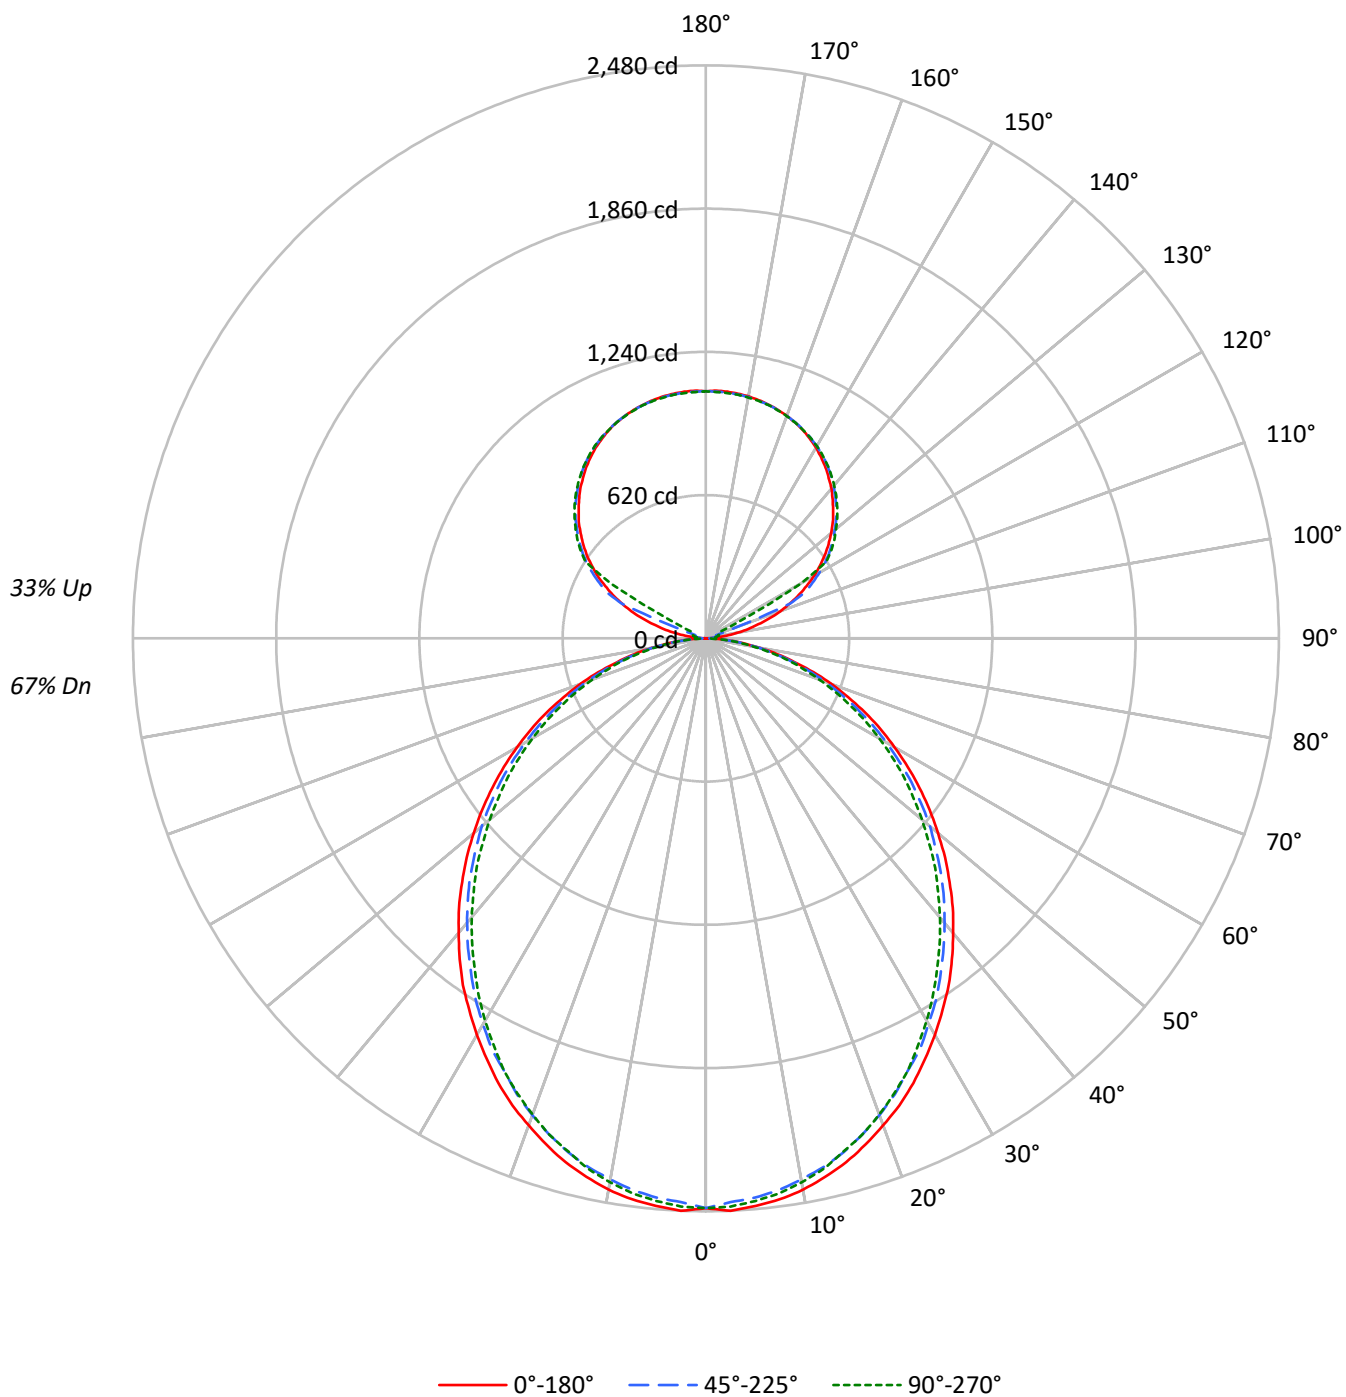

TEST NUMBER: P915599

CATALOG NUMBER: DFN2DIP-TR4F0-080D040US927-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	111	111	111	111	105	105	105	105	93	93	93	82	82	82	71	71	71
1	102	97	93	90	95	92	88	85	81	79	76	72	70	68	63	62	60
2	92	85	79	73	87	80	75	70	71	67	63	63	60	57	56	53	51
3	84	75	67	61	79	71	64	58	63	58	53	56	52	48	49	46	43
4	77	66	58	52	72	63	55	50	56	50	45	50	45	41	44	40	37
5	71	59	51	44	67	56	48	43	50	44	39	45	40	36	40	36	33
6	66	53	45	39	62	50	43	37	45	39	34	41	35	32	36	32	29
7	61	48	40	34	57	46	38	33	41	35	30	37	32	28	33	29	26
8	56	44	36	30	53	42	34	29	38	31	27	34	29	25	30	26	23
9	53	40	32	27	50	38	31	26	35	29	24	31	26	23	28	24	21
10	49	37	29	24	46	35	28	24	32	26	22	29	24	20	26	22	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1959	1959	1959
5°	1962	1932	1945
10°	1946	1906	1918
15°	1918	1874	1877
20°	1879	1831	1835
25°	1841	1779	1786
30°	1792	1730	1724
35°	1747	1673	1659
40°	1691	1615	1596
45°	1634	1557	1532
50°	1573	1496	1458
55°	1509	1426	1391
60°	1436	1342	1313
65°	1357	1256	1221
70°	1257	1150	1122
75°	1117	1024	1030
80°	949	864	856
85°	687	586	567

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1634 cd/sqm

TEST NUMBER: P915599

CATALOG NUMBER: DFN2DIP-TR4F0-080D040US927-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	232.1	2.5
10°-20°	653.0	6.9
20°-30°	959.7	10.2
30°-40°	1114.6	11.8
40°-50°	1113.2	11.8
50°-60°	970.7	10.3
60°-70°	717.6	7.6
70°-80°	406.0	4.3
80°-90°	109.0	1.2
90°-100°	35.2	0.4
100°-110°	131.5	1.4
110°-120°	348.6	3.7
120°-130°	578.2	6.1
130°-140°	614.2	6.5
140°-150°	570.9	6.1
150°-160°	458.9	4.9
160°-170°	295.7	3.1
170°-180°	101.8	1.1
0°-30°	1844.8	19.6
0°-40°	2959.4	31.4
0°-60°	5043.4	53.6
0°-90°	6275.9	66.7
90°-120°	515.3	5.5
90°-150°	2278.7	24.2
90°-180°	3135.0	33.3
0°-180°	9411.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2466	2466	2466	2466	2466	
5°	2466	2457	2430	2449	2445	234
15°	2348	2333	2302	2312	2300	661
25°	2125	2106	2066	2070	2066	978
35°	1833	1809	1771	1757	1745	1145
45°	1492	1475	1439	1413	1404	1151
55°	1129	1114	1086	1058	1046	1009
65°	761	747	723	702	690	753
75°	398	394	382	368	372	425
85°	97	95	93	85	83	108
90°	1	9	15	19	21	9
95°	50	25	30	34	33	60
105°	235	258	47	56	59	251
115°	445	458	477	119	64	438
125°	629	639	654	659	662	561
135°	778	791	798	806	804	601
145°	903	902	915	921	917	565
155°	994	988	997	1001	995	458
165°	1048	1043	1045	1051	1045	296
175°	1072	1066	1068	1073	1066	102
180°	1069	1069	1069	1069	1069	

TEST NUMBER: P915599

CATALOG NUMBER: DFN2DIP-TR4F0-080D040US927-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2465.9	2465.9	2465.9	2465.9	2465.9
2.5°	2480.2	2468.4	2442.3	2465.9	2461.4
5°	2465.9	2456.6	2430.5	2449.3	2444.8
7.5°	2449.3	2435.2	2409.1	2428.2	2423.4
10°	2423.4	2406.8	2378.4	2397.2	2390.2
12.5°	2387.7	2373.6	2345.2	2357.0	2352.2
15°	2347.5	2333.4	2302.4	2312.0	2300.2
17.5°	2297.6	2283.5	2252.6	2264.4	2252.6
20°	2243.1	2229.0	2195.8	2202.8	2193.5
22.5°	2188.7	2167.3	2136.4	2136.4	2131.6
25°	2124.6	2105.7	2065.5	2070.0	2065.5
27.5°	2053.3	2036.8	2006.0	1999.0	1987.2
30°	1982.4	1963.3	1927.9	1920.8	1911.2
32.5°	1906.5	1892.4	1854.3	1840.0	1830.5
35°	1832.9	1809.3	1771.3	1757.0	1745.2
37.5°	1749.9	1728.5	1690.6	1674.0	1662.2
40°	1664.7	1645.5	1607.6	1586.4	1576.8
42.5°	1581.7	1562.5	1524.8	1500.9	1486.8
45°	1491.6	1475.0	1439.2	1413.3	1403.8
47.5°	1403.8	1387.2	1349.2	1323.0	1308.9
50°	1311.2	1299.4	1266.1	1233.0	1221.1
52.5°	1221.1	1204.5	1173.9	1147.7	1131.1
55°	1128.8	1114.4	1086.1	1057.6	1045.8
57.5°	1036.3	1024.4	993.5	965.0	955.4
60°	943.6	934.4	901.1	875.0	867.9
62.5°	853.6	837.0	813.3	789.7	780.1
65°	761.3	746.9	723.3	701.9	690.1
67.5°	666.4	654.3	633.2	616.6	607.0
70°	578.6	569.0	547.7	531.1	521.7
72.5°	488.5	479.0	467.1	450.6	443.5
75°	398.2	393.7	381.7	367.6	372.3
77.5°	317.7	308.2	303.4	296.4	289.3
80°	237.3	234.7	230.0	222.9	218.1
82.5°	161.3	161.3	159.0	149.4	149.4
85°	97.1	94.8	92.6	85.3	83.0
87.5°	42.8	38.0	33.2	26.1	23.7
90°	0.7	9.3	15.4	19.4	20.8
92.5°	19.4	16.2	18.5	20.1	20.8
95°	50.2	24.7	30.1	34.1	33.3
97.5°	90.5	27.1	39.5	41.8	42.5
100°	137.0	31.0	44.1	50.2	51.8
102.5°	188.0	186.6	45.6	54.1	56.5
105°	235.2	258.5	47.2	55.7	58.8
107.5°	290.2	309.5	48.8	57.3	60.4
110°	342.9	359.0	135.5	58.1	61.1

TEST NUMBER: P915599

CATALOG NUMBER: DFN2DIP-TR4F0-080D040US927-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	392.4	406.2	393.1	59.6	61.9
115°	444.9	458.0	477.4	119.1	63.5
117.5°	490.6	506.0	519.3	408.5	205.8
120°	541.7	553.3	567.2	576.5	472.1
122.5°	584.9	597.4	612.9	617.5	618.3
125°	629.1	639.2	653.9	659.3	661.6
127.5°	669.3	680.2	691.8	699.6	700.3
130°	707.3	719.7	728.1	736.6	735.9
132.5°	745.9	756.1	764.5	771.5	770.8
135°	778.5	790.9	797.8	805.6	804.1
137.5°	812.5	821.7	829.6	837.3	835.0
140°	845.7	852.0	860.5	867.4	863.6
142.5°	873.7	879.1	889.1	895.2	891.4
145°	903.1	902.3	915.4	920.8	916.9
147.5°	928.5	926.2	939.4	943.3	940.2
150°	953.3	947.9	960.4	965.0	961.1
152.5°	974.2	968.0	979.6	984.3	978.9
155°	994.3	987.5	996.7	1001.3	995.1
157.5°	1010.6	1004.4	1011.5	1016.8	1010.6
160°	1024.5	1019.9	1024.5	1029.1	1023.7
162.5°	1036.9	1032.3	1036.2	1041.6	1034.6
165°	1047.7	1043.1	1045.4	1050.8	1045.4
167.5°	1056.3	1051.5	1054.0	1059.4	1052.4
170°	1063.3	1058.6	1060.1	1065.6	1058.6
172.5°	1067.9	1063.3	1064.8	1070.2	1063.3
175°	1071.7	1066.3	1067.9	1073.2	1065.6
177.5°	1073.2	1067.9	1068.7	1074.1	1067.1
180°	1069.4	1069.4	1069.4	1069.4	1069.4

TEST NUMBER: P915599

CATALOG NUMBER: DFN2DIP-TR4F0-080D040US927-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.02	12.05	11.82	12.87	13.88	10.58	11.62	11.38	12.44	13.45
	3H	12.69	13.62	13.50	14.45	15.49	12.22	13.14	13.03	13.98	15.02
	4H	13.28	14.16	14.11	15.00	16.05	12.81	13.69	13.64	14.53	15.58
	6H	13.69	14.50	14.53	15.35	16.41	13.22	14.03	14.06	14.87	15.94
	8H	13.80	14.57	14.65	15.44	16.50	13.33	14.10	14.18	14.96	16.03
	12H	13.86	14.59	14.71	15.45	16.54	13.38	14.11	14.23	14.97	16.06
4H	2H	11.50	12.38	12.33	13.22	14.27	11.15	12.03	11.99	12.87	13.92
	3H	13.38	14.11	14.22	14.98	16.05	12.99	13.72	13.83	14.59	15.66
	4H	14.10	14.77	14.96	15.64	16.73	13.70	14.36	14.55	15.23	16.33
	6H	14.63	15.20	15.50	16.10	17.19	14.22	14.79	15.09	15.69	16.78
	8H	14.78	15.32	15.66	16.21	17.32	14.37	14.91	15.24	15.80	16.91
	12H	14.86	15.35	15.76	16.26	17.37	14.44	14.92	15.34	15.83	16.95
8H	4H	14.31	14.85	15.19	15.74	16.85	13.95	14.49	14.83	15.38	16.49
	6H	14.95	15.40	15.85	16.33	17.44	14.59	15.03	15.49	15.96	17.07
	8H	15.17	15.57	16.09	16.49	17.62	14.80	15.20	15.72	16.12	17.25
	12H	15.31	15.66	16.23	16.58	17.76	14.93	15.28	15.85	16.19	17.37
12H	4H	14.31	14.79	15.20	15.70	16.82	13.95	14.44	14.85	15.35	16.46
	6H	14.98	15.38	15.90	16.30	17.43	14.63	15.03	15.54	15.95	17.08
	8H	15.23	15.58	16.15	16.50	17.68	14.87	15.22	15.79	16.14	17.32

END OF REPORT