

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P915618

Luminaire Tested: DFN2DIP-TR4F0-080D090US927-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P915618
REPORT IS A COMBINATION OF REPORTS P900467 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-080D090US927-FLLFLL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 12583.8 lumens
Efficiency: N/A
Efficacy: 88.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 142.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P915618
CATALOG NUMBER: DFN2DIP-TR4F0-080D090US927-FLLFL

Luminous Intensity Polar Plot

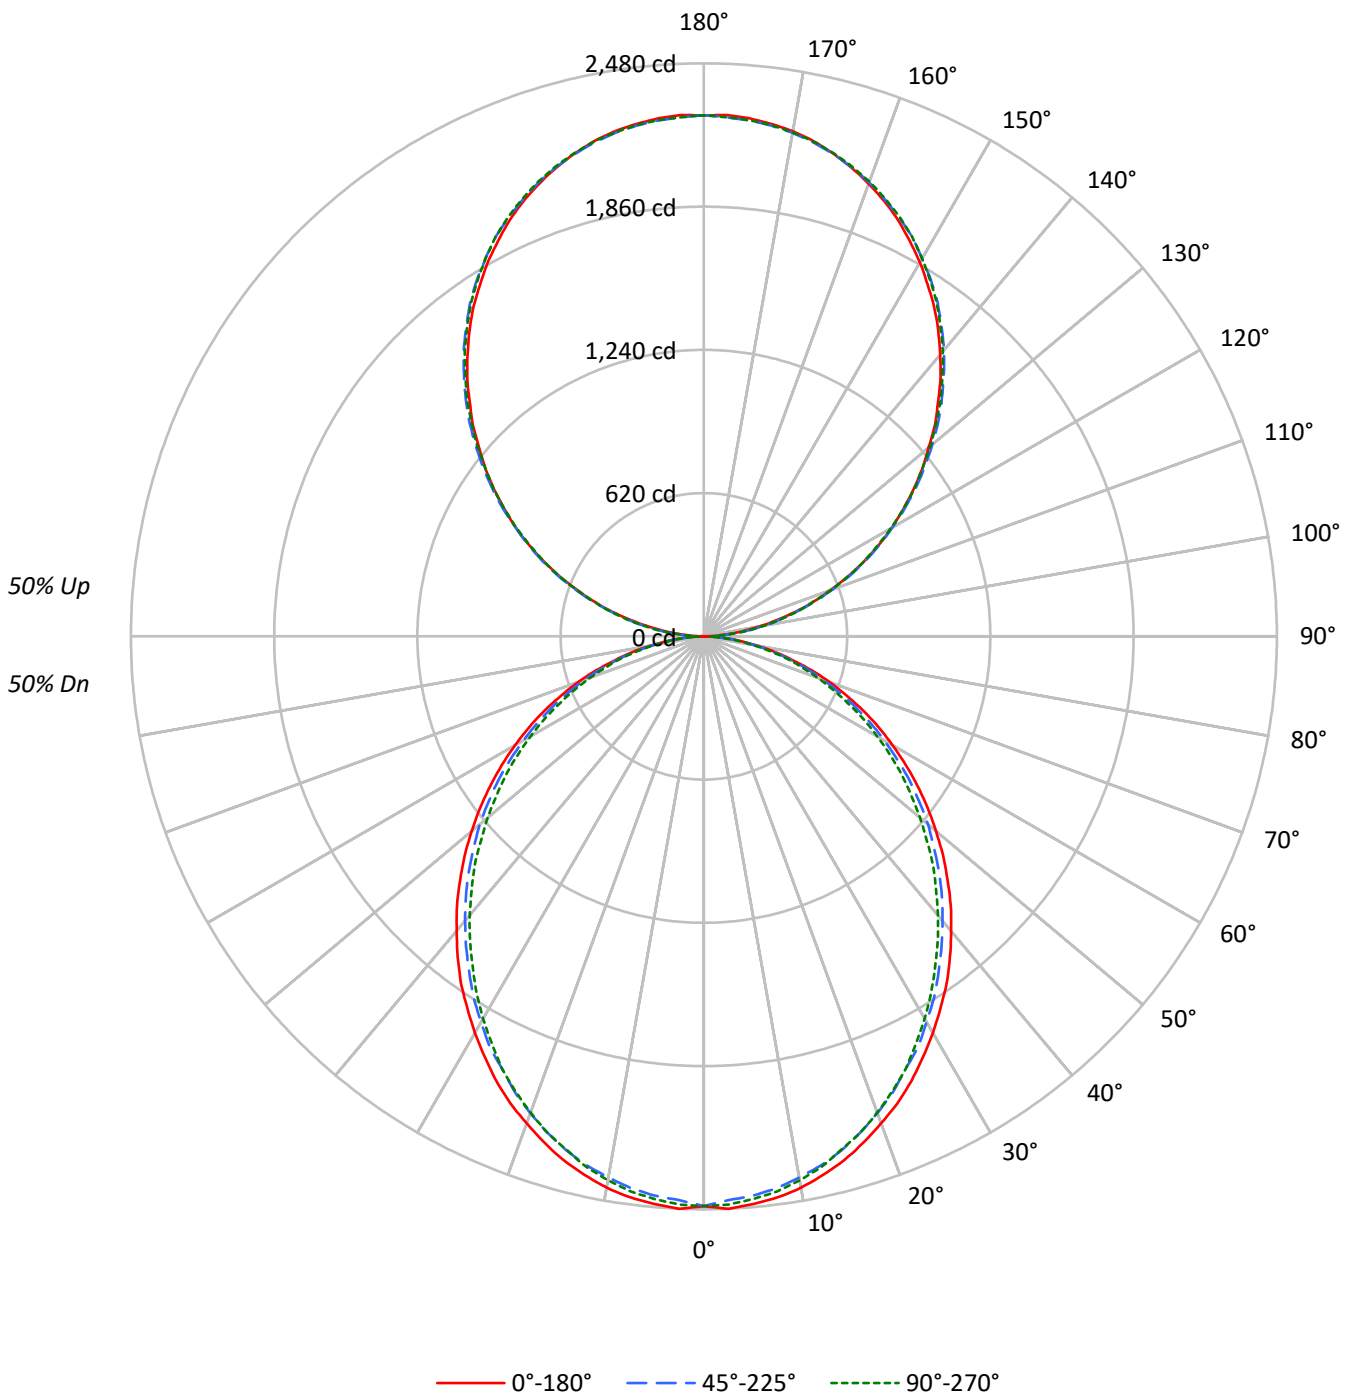



TEST NUMBER: P915618

CATALOG NUMBER: DFN2DIP-TR4F0-080D090US927-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				20
RC	80				70				50				30				10				0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56	56	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47	50	48	47	42
2	89	82	75	70	82	75	70	66	64	60	57	53	51	48	44	42	40	44	42	40	35
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34	39	36	34	30
4	74	63	56	50	68	59	52	46	50	45	41	42	38	35	35	32	29	35	32	29	26
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	25	31	28	25	22
6	63	51	43	37	58	47	40	35	40	35	31	34	30	26	28	25	22	28	25	22	20
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	22	20	26	22	20	17
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18	24	20	18	16
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16	22	19	16	14
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15	20	17	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1959	1959	1959
5°	1962	1932	1945
10°	1946	1906	1918
15°	1918	1874	1877
20°	1879	1831	1835
25°	1841	1779	1786
30°	1792	1730	1724
35°	1747	1673	1659
40°	1691	1615	1596
45°	1634	1557	1532
50°	1573	1496	1458
55°	1509	1426	1391
60°	1436	1342	1313
65°	1357	1256	1221
70°	1257	1150	1122
75°	1117	1024	1030
80°	949	864	856
85°	687	586	567

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°
 Vertical Angle: 90°
 Luminance: 1758 cd/sqm



TEST NUMBER: P915618

CATALOG NUMBER: DFN2DIP-TR4F0-080D090US927-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	232.1	1.8
10°-20°	653.0	5.2
20°-30°	959.7	7.6
30°-40°	1114.6	8.9
40°-50°	1113.2	8.8
50°-60°	970.7	7.7
60°-70°	717.6	5.7
70°-80°	406.0	3.2
80°-90°	113.6	0.9
90°-100°	139.5	1.1
100°-110°	443.3	3.5
110°-120°	758.7	6.0
120°-130°	997.8	7.9
130°-140°	1120.0	8.9
140°-150°	1098.2	8.7
150°-160°	921.3	7.3
160°-170°	611.0	4.9
170°-180°	213.5	1.7
0°-30°	1844.8	14.7
0°-40°	2959.4	23.5
0°-60°	5043.4	40.1
0°-90°	6280.5	49.9
90°-120°	1341.5	10.7
90°-150°	4557.5	36.2
90°-180°	6303.0	50.1
0°-180°	12583.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2466	2466	2466	2466	2466	
5°	2466	2457	2430	2449	2445	234
15°	2348	2333	2302	2312	2300	661
25°	2125	2106	2066	2070	2066	978
35°	1833	1809	1771	1757	1745	1145
45°	1492	1475	1439	1413	1404	1151
55°	1129	1114	1086	1058	1046	1009
65°	761	747	723	702	690	753
75°	398	394	382	368	372	425
85°	97	95	93	85	83	108
90°	2	24	67	62	65	12
95°	99	118	122	122	118	110
105°	409	415	419	422	422	432
115°	761	772	769	767	761	753
125°	1107	1124	1119	1113	1111	990
135°	1432	1453	1458	1455	1450	1107
145°	1739	1752	1763	1765	1758	1086
155°	1988	1994	2000	2009	2003	915
165°	2163	2161	2161	2175	2165	610
175°	2251	2245	2241	2255	2243	214
180°	2255	2255	2255	2255	2255	



TEST NUMBER: P915618

CATALOG NUMBER: DFN2DIP-TR4F0-080D090US927-FLLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2465.9	2465.9	2465.9	2465.9	2465.9
2.5°	2480.2	2468.4	2442.3	2465.9	2461.4
5°	2465.9	2456.6	2430.5	2449.3	2444.8
7.5°	2449.3	2435.2	2409.1	2428.2	2423.4
10°	2423.4	2406.8	2378.4	2397.2	2390.2
12.5°	2387.7	2373.6	2345.2	2357.0	2352.2
15°	2347.5	2333.4	2302.4	2312.0	2300.2
17.5°	2297.6	2283.5	2252.6	2264.4	2252.6
20°	2243.1	2229.0	2195.8	2202.8	2193.5
22.5°	2188.7	2167.3	2136.4	2136.4	2131.6
25°	2124.6	2105.7	2065.5	2070.0	2065.5
27.5°	2053.3	2036.8	2006.0	1999.0	1987.2
30°	1982.4	1963.3	1927.9	1920.8	1911.2
32.5°	1906.5	1892.4	1854.3	1840.0	1830.5
35°	1832.9	1809.3	1771.3	1757.0	1745.2
37.5°	1749.9	1728.5	1690.6	1674.0	1662.2
40°	1664.7	1645.5	1607.6	1586.4	1576.8
42.5°	1581.7	1562.5	1524.8	1500.9	1486.8
45°	1491.6	1475.0	1439.2	1413.3	1403.8
47.5°	1403.8	1387.2	1349.2	1323.0	1308.9
50°	1311.2	1299.4	1266.1	1233.0	1221.1
52.5°	1221.1	1204.5	1173.9	1147.7	1131.1
55°	1128.8	1114.4	1086.1	1057.6	1045.8
57.5°	1036.3	1024.4	993.5	965.0	955.4
60°	943.6	934.4	901.1	875.0	867.9
62.5°	853.6	837.0	813.3	789.7	780.1
65°	761.3	746.9	723.3	701.9	690.1
67.5°	666.4	654.3	633.2	616.6	607.0
70°	578.6	569.0	547.7	531.1	521.7
72.5°	488.5	479.0	467.1	450.6	443.5
75°	398.2	393.7	381.7	367.6	372.3
77.5°	317.7	308.2	303.4	296.4	289.3
80°	237.3	234.7	230.0	222.9	218.1
82.5°	161.3	161.3	159.0	149.4	149.4
85°	97.1	94.8	92.6	85.3	83.0
87.5°	42.8	38.0	33.2	26.1	23.7
90°	2.1	24.5	66.6	62.5	64.6
92.5°	42.1	57.1	59.2	61.2	61.2
95°	99.3	118.3	121.7	121.7	118.3
97.5°	165.2	182.8	190.4	190.4	190.4
100°	241.3	257.0	262.4	262.4	260.4
102.5°	321.5	333.1	340.6	342.6	340.6
105°	409.2	414.6	418.7	422.2	422.2
107.5°	496.2	504.4	504.4	505.7	496.2
110°	580.5	591.4	591.4	591.4	586.0



TEST NUMBER: P915618

CATALOG NUMBER: DFN2DIP-TR4F0-080D090US927-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	671.6	683.2	681.1	675.7	671.6
115°	761.4	772.2	768.8	766.8	761.4
117.5°	850.4	865.4	855.9	850.4	844.9
120°	940.2	955.1	940.2	940.2	934.0
122.5°	1021.7	1040.8	1031.3	1025.8	1021.7
125°	1107.4	1124.3	1119.0	1112.8	1110.8
127.5°	1191.0	1212.0	1204.6	1196.4	1191.0
130°	1269.2	1293.6	1290.2	1286.1	1278.7
132.5°	1356.8	1375.9	1377.2	1367.7	1362.3
135°	1432.3	1453.3	1457.5	1455.4	1450.0
137.5°	1516.6	1533.6	1537.0	1535.6	1527.5
140°	1590.7	1607.7	1617.2	1617.2	1609.7
142.5°	1666.8	1683.8	1689.2	1691.3	1683.8
145°	1738.9	1752.5	1763.3	1765.4	1757.9
147.5°	1803.5	1820.4	1828.6	1832.0	1824.6
150°	1870.1	1881.7	1889.1	1895.2	1889.1
152.5°	1929.2	1940.8	1950.3	1957.8	1950.3
155°	1988.4	1993.8	1999.9	2009.4	2003.3
157.5°	2039.3	2043.4	2046.8	2060.4	2050.9
160°	2084.9	2089.0	2091.0	2102.5	2094.4
162.5°	2127.0	2127.0	2129.1	2142.0	2132.5
165°	2163.1	2161.0	2161.0	2174.6	2165.1
167.5°	2195.7	2189.6	2189.6	2203.1	2193.6
170°	2220.2	2214.7	2212.7	2226.3	2214.7
172.5°	2237.1	2231.7	2229.7	2243.3	2231.7
175°	2250.7	2245.3	2241.2	2254.9	2243.3
177.5°	2258.2	2252.8	2248.7	2260.3	2248.7
180°	2254.9	2254.9	2254.9	2254.9	2254.9



TEST NUMBER: P915618
 CATALOG NUMBER: DFN2DIP-TR4F0-080D090US927-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.59	10.45	10.55	11.43	12.70	9.16	10.02	10.12	11.00	12.27
	3H	11.25	12.02	12.22	13.01	14.30	10.78	11.55	11.75	12.53	13.83
	4H	11.84	12.57	12.82	13.56	14.86	11.37	12.10	12.35	13.08	14.39
	6H	12.24	12.91	13.23	13.90	15.22	11.76	12.44	12.76	13.43	14.75
	8H	12.34	12.99	13.34	13.99	15.31	11.87	12.51	12.87	13.52	14.83
	12H	12.39	13.00	13.40	14.00	15.34	11.91	12.52	12.92	13.52	14.86
4H	2H	10.05	10.79	11.04	11.77	13.08	9.71	10.44	10.70	11.43	12.73
	3H	11.92	12.53	12.92	13.55	14.86	11.53	12.14	12.53	13.15	14.47
	4H	12.63	13.19	13.64	14.20	15.54	12.23	12.79	13.24	13.80	15.14
	6H	13.15	13.63	14.17	14.66	16.00	12.74	13.22	13.76	14.25	15.59
	8H	13.30	13.75	14.32	14.77	16.13	12.89	13.34	13.91	14.36	15.71
	12H	13.37	13.78	14.41	14.82	16.18	12.95	13.36	13.99	14.40	15.75
8H	4H	12.83	13.28	13.85	14.30	15.66	12.47	12.92	13.49	13.94	15.30
	6H	13.46	13.83	14.51	14.90	16.25	13.10	13.47	14.14	14.54	15.89
	8H	13.68	14.01	14.73	15.06	16.43	13.31	13.64	14.37	14.69	16.06
	12H	13.81	14.10	14.87	15.15	16.56	13.43	13.72	14.49	14.76	16.18
12H	4H	12.82	13.22	13.85	14.26	15.62	12.47	12.87	13.50	13.91	15.27
	6H	13.49	13.82	14.54	14.87	16.24	13.14	13.47	14.19	14.52	15.89
	8H	13.73	14.02	14.79	15.07	16.48	13.38	13.66	14.43	14.71	16.12