

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P915628

Luminaire Tested: DFN2DIP-TR4F0-080D110US927-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P915628
REPORT IS A COMBINATION OF REPORTS P900504 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-080D110US927-RLLFLL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13098.7 lumens
Efficiency: N/A
Efficacy: 82.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 159.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P915628

CATALOG NUMBER: DFN2DIP-TR4F0-080D110US927-RLLFLL

Luminous Intensity Polar Plot

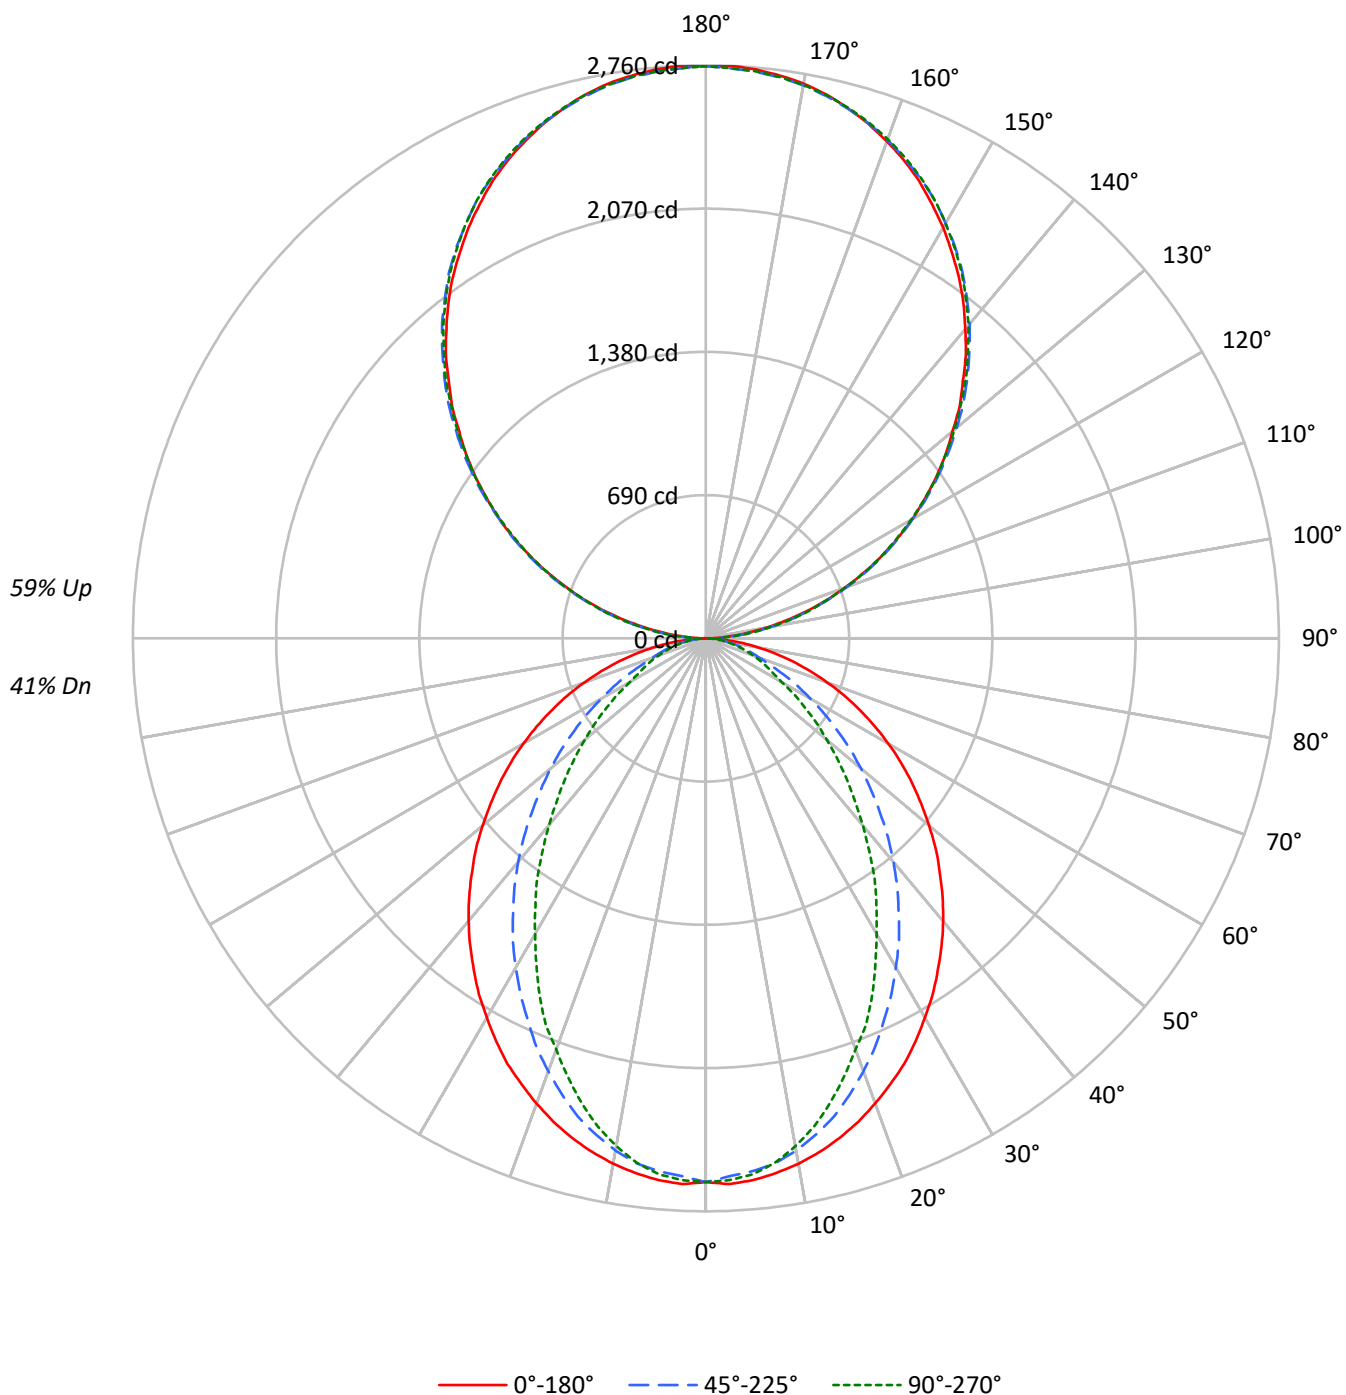

TEST NUMBER: P915628

CATALOG NUMBER: DFN2DIP-TR4F0-080D110US927-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	78	78	78	63	63	63	48	48	48
1	96	92	88	85	88	84	81	78	69	67	65	56	54	53	43	42	41
2	88	81	75	70	80	74	69	65	61	58	55	49	47	45	38	37	35
3	80	71	64	59	73	65	59	55	54	50	46	44	41	38	34	32	31
4	74	63	56	50	67	58	52	47	48	44	40	39	36	33	31	29	27
5	68	57	49	43	62	52	45	40	43	38	34	36	32	29	28	26	23
6	63	51	43	37	57	47	40	35	39	34	30	32	28	25	26	23	21
7	58	46	38	33	53	42	36	31	36	31	27	29	26	23	23	21	19
8	54	42	34	29	49	39	32	27	33	27	24	27	23	20	22	19	17
9	50	38	31	26	46	35	29	24	30	25	21	25	21	18	20	17	15
10	47	35	28	23	43	32	26	22	28	23	19	23	19	17	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2081	2081	2081
5°	2084	2048	2061
10°	2064	2008	1994
15°	2035	1941	1890
20°	1998	1850	1763
25°	1959	1747	1640
30°	1907	1642	1484
35°	1857	1529	1347
40°	1805	1412	1190
45°	1745	1282	1048
50°	1684	1151	909
55°	1619	1011	775
60°	1544	865	638
65°	1458	716	574
70°	1354	577	520
75°	1223	509	473
80°	1034	427	409
85°	721	285	308

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2147 cd/sqm

TEST NUMBER: P915628

CATALOG NUMBER: DFN2DIP-TR4F0-080D110US927-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	245.5	1.9
10°-20°	673.9	5.1
20°-30°	946.1	7.2
30°-40°	1031.3	7.9
40°-50°	947.9	7.2
50°-60°	744.4	5.7
60°-70°	484.5	3.7
70°-80°	249.4	1.9
80°-90°	71.5	0.5
90°-100°	170.5	1.3
100°-110°	541.8	4.1
110°-120°	927.3	7.1
120°-130°	1219.5	9.3
130°-140°	1368.8	10.5
140°-150°	1342.3	10.2
150°-160°	1126.0	8.6
160°-170°	746.7	5.7
170°-180°	261.0	2.0
0°-30°	1865.5	14.2
0°-40°	2896.8	22.1
0°-60°	4589.2	35.0
0°-90°	5394.7	41.2
90°-120°	1639.7	12.5
90°-150°	5570.3	42.5
90°-180°	7704.0	58.8
0°-180°	13098.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2619	2619	2619	2619	2619	
5°	2619	2608	2576	2598	2591	248
15°	2491	2465	2385	2340	2316	702
25°	2261	2186	2029	1932	1896	1040
35°	1948	1828	1619	1470	1417	1220
45°	1593	1434	1185	1017	960	1230
55°	1211	1026	770	628	583	1082
65°	818	626	412	332	325	811
75°	436	270	190	173	171	461
85°	102	52	45	45	45	117
90°	2	30	81	76	79	13
95°	121	145	149	149	145	135
105°	500	507	512	516	516	528
115°	931	944	940	937	931	920
125°	1353	1374	1368	1360	1358	1209
135°	1751	1776	1781	1779	1772	1353
145°	2125	2142	2155	2158	2149	1328
155°	2430	2437	2444	2456	2448	1119
165°	2644	2641	2641	2658	2646	746
175°	2751	2744	2739	2756	2742	261
180°	2756	2756	2756	2756	2756	

TEST NUMBER: P915628

CATALOG NUMBER: DFN2DIP-TR4F0-080D110US927-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2619.3	2619.3	2619.3	2619.3	2619.3
2.5°	2631.1	2619.3	2593.1	2617.0	2612.2
5°	2619.3	2607.5	2576.5	2597.9	2590.8
7.5°	2597.9	2583.8	2550.6	2559.9	2548.1
10°	2569.4	2552.9	2505.6	2498.3	2484.2
12.5°	2534.0	2512.6	2448.5	2434.4	2408.2
15°	2491.3	2465.1	2384.6	2339.6	2315.9
17.5°	2441.4	2403.5	2303.9	2251.9	2213.8
20°	2384.6	2337.1	2218.7	2159.6	2107.2
22.5°	2323.0	2268.4	2130.9	2050.4	2014.9
25°	2261.4	2185.5	2029.0	1932.0	1896.2
27.5°	2187.9	2107.2	1934.2	1822.8	1768.2
30°	2109.7	2019.4	1829.9	1709.1	1645.0
32.5°	2033.8	1924.7	1730.5	1588.2	1528.8
35°	1948.5	1827.6	1619.1	1469.7	1417.4
37.5°	1865.5	1735.0	1514.7	1351.0	1291.9
40°	1777.8	1635.7	1405.6	1237.3	1175.7
42.5°	1687.7	1536.1	1296.6	1121.2	1062.0
45°	1592.9	1434.0	1185.3	1016.8	960.0
47.5°	1502.9	1334.7	1078.6	910.1	858.1
50°	1403.3	1235.1	974.3	810.6	761.0
52.5°	1306.0	1128.1	874.6	718.3	673.3
55°	1211.2	1026.3	770.3	628.2	583.2
57.5°	1114.1	924.5	678.0	545.3	507.2
60°	1014.5	824.9	580.7	459.9	422.0
62.5°	917.4	727.8	497.7	384.0	365.2
65°	817.8	625.7	412.4	332.0	324.6
67.5°	723.0	530.9	332.0	291.4	284.5
70°	623.4	438.6	274.9	251.2	241.7
72.5°	528.6	353.1	229.9	211.0	206.2
75°	436.1	270.1	189.6	173.0	170.8
77.5°	343.8	191.9	149.4	139.8	135.1
80°	258.3	137.6	113.7	104.3	104.3
82.5°	180.1	92.5	78.2	73.4	73.4
85°	101.9	52.0	45.0	45.0	45.0
87.5°	37.9	18.9	18.9	16.6	16.6
90°	2.5	29.9	81.4	76.4	78.9
92.5°	51.5	69.8	72.2	74.8	74.8
95°	121.3	144.6	148.7	148.7	144.6
97.5°	201.9	223.5	232.7	232.7	232.7
100°	294.9	314.0	320.7	320.7	318.2
102.5°	393.0	407.1	416.3	418.7	416.3
105°	500.2	506.8	511.8	515.9	515.9
107.5°	606.5	616.5	616.5	618.1	606.5
110°	709.6	722.9	722.9	722.9	716.2

TEST NUMBER: P915628

CATALOG NUMBER: DFN2DIP-TR4F0-080D110US927-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	820.9	835.0	832.5	825.8	820.9
115°	930.6	943.8	939.7	937.2	930.6
117.5°	1039.4	1057.6	1046.0	1039.4	1032.8
120°	1149.1	1167.4	1149.1	1149.1	1141.6
122.5°	1248.8	1272.0	1260.4	1253.7	1248.8
125°	1353.4	1374.2	1367.5	1360.1	1357.6
127.5°	1455.6	1481.4	1472.3	1462.3	1455.6
130°	1551.2	1581.1	1576.9	1571.9	1562.8
132.5°	1658.4	1681.6	1683.3	1671.7	1665.0
135°	1750.6	1776.3	1781.3	1778.8	1772.2
137.5°	1853.6	1874.4	1878.5	1876.8	1866.9
140°	1944.2	1964.9	1976.6	1976.6	1967.5
142.5°	2037.3	2058.0	2064.7	2067.1	2058.0
145°	2125.3	2141.9	2155.2	2157.7	2148.6
147.5°	2204.2	2225.0	2235.0	2239.1	2230.0
150°	2285.7	2299.8	2308.9	2316.4	2308.9
152.5°	2357.9	2372.0	2383.7	2392.9	2383.7
155°	2430.3	2436.8	2444.4	2456.0	2448.5
157.5°	2492.5	2497.5	2501.6	2518.3	2506.6
160°	2548.2	2553.2	2555.7	2569.8	2559.9
162.5°	2599.7	2599.7	2602.2	2618.0	2606.4
165°	2643.7	2641.2	2641.2	2657.8	2646.2
167.5°	2683.6	2676.1	2676.1	2692.8	2681.1
170°	2713.5	2706.9	2704.4	2721.0	2706.9
172.5°	2734.3	2727.6	2725.2	2741.8	2727.6
175°	2750.9	2744.3	2739.3	2755.9	2741.8
177.5°	2760.0	2753.4	2748.4	2762.6	2748.4
180°	2755.9	2755.9	2755.9	2755.9	2755.9

TEST NUMBER: P915628

CATALOG NUMBER: DFN2DIP-TR4F0-080D110US927-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.80	9.57	9.84	10.60	12.00	4.78	5.54	5.81	6.58	7.97
	3H	10.48	11.16	11.52	12.20	13.62	5.96	6.64	7.01	7.69	9.10
	4H	11.08	11.73	12.14	12.78	14.20	6.41	7.06	7.47	8.10	9.53
	6H	11.50	12.09	12.57	13.15	14.58	6.73	7.32	7.79	8.38	9.81
	8H	11.62	12.19	12.69	13.26	14.68	6.82	7.38	7.89	8.45	9.88
	12H	11.68	12.22	12.76	13.28	14.73	6.86	7.40	7.93	8.46	9.91
4H	2H	8.81	9.46	9.88	10.51	11.93	5.36	6.01	6.43	7.06	8.48
	3H	10.64	11.17	11.71	12.25	13.68	6.71	7.25	7.78	8.32	9.76
	4H	11.33	11.82	12.40	12.89	14.34	7.25	7.75	8.33	8.81	10.27
	6H	11.84	12.26	12.92	13.35	14.80	7.67	8.09	8.76	9.18	10.63
	8H	12.01	12.40	13.10	13.49	14.95	7.80	8.19	8.88	9.28	10.74
	12H	12.10	12.46	13.21	13.56	15.03	7.86	8.22	8.96	9.31	10.78
8H	4H	11.29	11.68	12.37	12.77	14.23	7.53	7.92	8.62	9.01	10.47
	6H	11.85	12.18	12.96	13.30	14.76	8.05	8.37	9.15	9.50	10.96
	8H	12.07	12.35	13.18	13.46	14.94	8.24	8.52	9.35	9.63	11.11
	12H	12.20	12.45	13.32	13.56	15.08	8.35	8.61	9.47	9.71	11.23
12H	4H	11.24	11.59	12.34	12.69	14.16	7.53	7.89	8.63	8.98	10.45
	6H	11.83	12.11	12.94	13.22	14.70	8.10	8.38	9.21	9.49	10.97
	8H	12.05	12.30	13.16	13.40	14.92	8.30	8.55	9.42	9.66	11.18

END OF REPORT