

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P915641

Luminaire Tested: DFN2DIP-TR4F0-090D050US927-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P915641
REPORT IS A COMBINATION OF REPORTS P901918 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-090D050US927-RLLONL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9981.5 lumens
Efficiency: N/A
Efficacy: 79.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 125.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.099
Total Harmonic Distortion (THDi): 0.979
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P915641

CATALOG NUMBER: DFN2DIP-TR4F0-090D050US927-RLLONL

Luminous Intensity Polar Plot

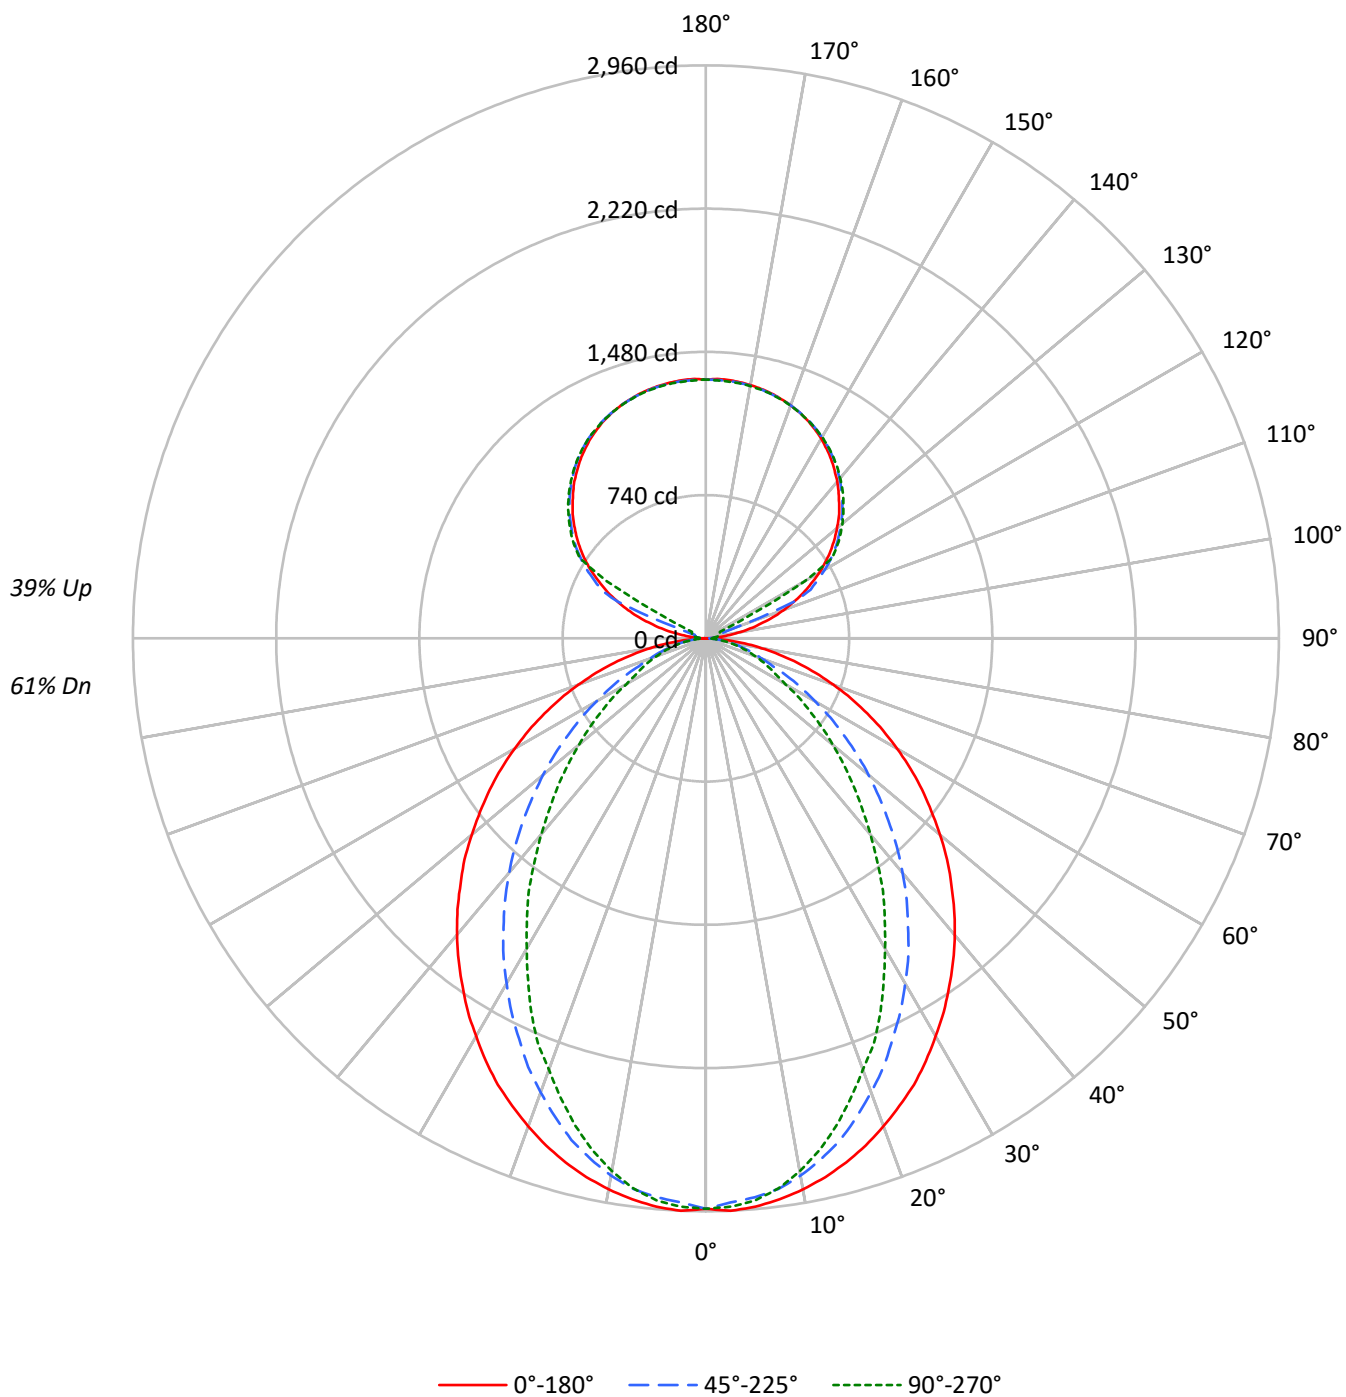

TEST NUMBER: P915641

CATALOG NUMBER: DFN2DIP-TR4F0-090D050US927-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	89	89	89	77	77	77	66	66	66
1	101	97	93	90	94	91	87	84	79	77	75	69	67	65	59	58	57
2	92	85	79	74	86	80	75	70	70	66	63	61	58	56	53	51	49
3	85	75	68	62	79	71	65	59	62	58	53	55	51	48	47	45	42
4	78	67	59	53	73	63	56	51	56	50	46	49	45	41	43	40	37
5	72	60	52	46	67	57	50	44	50	45	40	44	40	36	39	35	33
6	66	54	46	41	62	51	44	39	46	40	35	40	36	32	35	32	29
7	61	49	41	36	57	47	39	34	42	36	32	37	32	29	33	29	26
8	57	45	37	32	53	43	36	31	38	32	28	34	29	26	30	26	23
9	53	41	34	29	50	39	32	28	35	30	26	31	27	23	28	24	21
10	50	38	31	26	47	36	30	25	33	27	23	29	25	21	26	22	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2341	2341	2341
5°	2345	2304	2318
10°	2322	2259	2243
15°	2290	2184	2126
20°	2247	2081	1983
25°	2204	1966	1845
30°	2146	1847	1669
35°	2089	1720	1516
40°	2031	1589	1339
45°	1964	1443	1179
50°	1894	1295	1023
55°	1821	1138	872
60°	1737	973	718
65°	1640	806	646
70°	1523	650	585
75°	1376	572	532
80°	1163	480	461
85°	810	320	346

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1964 cd/sqm

TEST NUMBER: P915641

CATALOG NUMBER: DFN2DIP-TR4F0-090D050US927-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	276.2	2.8
10°-20°	758.1	7.6
20°-30°	1064.4	10.7
30°-40°	1160.3	11.6
40°-50°	1066.4	10.7
50°-60°	837.5	8.4
60°-70°	545.1	5.5
70°-80°	280.6	2.8
80°-90°	74.0	0.7
90°-100°	44.1	0.4
100°-110°	164.3	1.6
110°-120°	435.8	4.4
120°-130°	722.8	7.2
130°-140°	767.8	7.7
140°-150°	713.6	7.1
150°-160°	573.7	5.7
160°-170°	369.7	3.7
170°-180°	127.2	1.3
0°-30°	2098.7	21.0
0°-40°	3258.9	32.6
0°-60°	5162.8	51.7
0°-90°	6062.5	60.7
90°-120°	644.2	6.5
90°-150°	2848.4	28.5
90°-180°	3919.0	39.3
0°-180°	9981.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2947	2947	2947	2947	2947	
5°	2947	2933	2899	2923	2915	279
15°	2803	2773	2683	2632	2606	790
25°	2544	2459	2283	2173	2133	1170
35°	2192	2056	1822	1653	1595	1372
45°	1792	1613	1333	1144	1080	1384
55°	1363	1155	867	707	656	1218
65°	920	704	464	373	365	912
75°	491	304	213	195	192	519
85°	114	58	51	51	51	132
90°	1	12	19	24	26	9
95°	63	31	38	43	42	74
105°	294	323	59	70	74	314
115°	556	573	597	149	79	548
125°	786	799	817	824	827	701
135°	973	989	997	1007	1005	752
145°	1129	1128	1144	1151	1146	706
155°	1243	1234	1246	1252	1244	573
165°	1310	1304	1307	1314	1307	370
175°	1340	1333	1335	1342	1332	127
180°	1337	1337	1337	1337	1337	

TEST NUMBER: P915641

CATALOG NUMBER: DFN2DIP-TR4F0-090D050US927-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2946.7	2946.7	2946.7	2946.7	2946.7
2.5°	2960.0	2946.7	2917.2	2944.1	2938.8
5°	2946.7	2933.4	2898.6	2922.6	2914.7
7.5°	2922.6	2906.8	2869.4	2879.9	2866.6
10°	2890.7	2872.0	2818.8	2810.6	2794.7
12.5°	2850.7	2826.7	2754.6	2738.7	2709.3
15°	2802.7	2773.3	2682.7	2632.0	2605.5
17.5°	2746.7	2704.0	2591.9	2533.3	2490.6
20°	2682.7	2629.2	2495.9	2429.5	2370.6
22.5°	2613.4	2552.0	2397.2	2306.7	2266.8
25°	2544.1	2458.6	2282.7	2173.4	2133.3
27.5°	2461.5	2370.6	2176.0	2050.6	1989.2
30°	2373.5	2271.9	2058.6	1922.8	1850.6
32.5°	2288.0	2165.2	1946.8	1786.7	1719.9
35°	2192.1	2056.0	1821.5	1653.4	1594.6
37.5°	2098.7	1951.9	1704.1	1519.9	1453.4
40°	2000.0	1840.2	1581.3	1392.0	1322.7
42.5°	1898.7	1728.1	1458.7	1261.3	1194.8
45°	1792.1	1613.3	1333.4	1143.8	1079.9
47.5°	1690.8	1501.5	1213.5	1023.9	965.4
50°	1578.7	1389.4	1096.1	911.9	856.1
52.5°	1469.3	1269.2	984.0	808.0	757.4
55°	1362.6	1154.6	866.6	706.8	656.1
57.5°	1253.4	1040.1	762.8	613.4	570.7
60°	1141.3	928.0	653.3	517.5	474.8
62.5°	1032.1	818.8	559.9	432.1	410.8
65°	920.0	703.9	464.0	373.4	365.3
67.5°	813.4	597.2	373.4	327.9	320.0
70°	701.4	493.4	309.3	282.7	271.9
72.5°	594.7	397.2	258.6	237.3	232.0
75°	490.6	303.9	213.3	194.6	192.1
77.5°	386.7	215.9	168.0	157.3	151.9
80°	290.6	154.8	127.9	117.4	117.4
82.5°	202.6	104.1	88.0	82.6	82.6
85°	114.5	58.5	50.6	50.6	50.6
87.5°	42.7	21.2	21.2	18.7	18.7
90°	1.0	11.6	19.3	24.2	26.1
92.5°	24.2	20.4	23.2	25.2	26.1
95°	62.8	30.9	37.7	42.6	41.6
97.5°	113.1	33.9	49.3	52.3	53.2
100°	171.3	38.7	55.1	62.8	64.8
102.5°	235.0	233.1	57.1	67.7	70.7
105°	294.1	323.1	59.0	69.6	73.5
107.5°	362.7	386.8	61.0	71.5	75.5
110°	428.6	448.8	169.3	72.6	76.4

TEST NUMBER: P915641

CATALOG NUMBER: DFN2DIP-TR4F0-090D050US927-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	490.4	507.8	491.4	74.5	77.4
115°	556.2	572.6	596.8	149.0	79.4
117.5°	613.2	632.6	649.1	510.6	257.3
120°	677.1	691.6	709.0	720.6	590.0
122.5°	731.2	746.7	766.1	771.9	772.9
125°	786.3	799.0	817.4	824.1	827.0
127.5°	836.6	850.2	864.8	874.4	875.4
130°	884.1	899.6	910.1	920.8	920.0
132.5°	932.5	945.1	955.6	964.4	963.5
135°	973.1	988.6	997.2	1007.0	1005.0
137.5°	1015.6	1027.2	1037.0	1046.6	1043.8
140°	1057.2	1065.0	1075.5	1084.3	1079.5
142.5°	1092.1	1098.9	1111.4	1119.1	1114.3
145°	1128.9	1127.8	1144.2	1151.0	1146.2
147.5°	1160.7	1157.8	1174.3	1179.1	1175.3
150°	1191.7	1184.9	1200.4	1206.2	1201.3
152.5°	1217.7	1210.1	1224.6	1230.4	1223.6
155°	1242.9	1234.3	1245.9	1251.6	1244.0
157.5°	1263.2	1255.5	1264.2	1271.1	1263.2
160°	1280.7	1274.9	1280.7	1286.4	1279.7
162.5°	1296.1	1290.4	1295.1	1301.9	1293.2
165°	1309.6	1303.9	1306.8	1313.5	1306.8
167.5°	1320.3	1314.5	1317.5	1324.2	1315.5
170°	1329.0	1323.2	1325.2	1331.9	1323.2
172.5°	1334.8	1329.0	1331.0	1337.8	1329.0
175°	1339.7	1332.8	1334.8	1341.6	1331.9
177.5°	1341.6	1334.8	1335.9	1342.6	1333.9
180°	1336.7	1336.7	1336.7	1336.7	1336.7

TEST NUMBER: P915641

CATALOG NUMBER: DFN2DIP-TR4F0-090D050US927-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.04	11.97	11.91	12.85	13.97	7.02	7.94	7.88	8.83	9.94
	3H	12.73	13.56	13.61	14.45	15.59	8.22	9.04	9.09	9.94	11.07
	4H	13.34	14.12	14.24	15.02	16.17	8.67	9.45	9.57	10.35	11.50
	6H	13.77	14.49	14.67	15.39	16.55	9.00	9.72	9.90	10.62	11.78
	8H	13.90	14.58	14.81	15.50	16.66	9.09	9.78	10.01	10.70	11.86
	12H	13.96	14.61	14.88	15.53	16.71	9.14	9.79	10.06	10.71	11.89
4H	2H	11.07	11.86	11.97	12.75	13.90	7.63	8.41	8.53	9.31	10.45
	3H	12.91	13.56	13.82	14.49	15.65	8.99	9.63	9.90	10.56	11.73
	4H	13.61	14.20	14.53	15.12	16.31	9.54	10.13	10.46	11.05	12.24
	6H	14.13	14.64	15.06	15.59	16.78	9.96	10.47	10.90	11.42	12.61
	8H	14.31	14.78	15.24	15.72	16.93	10.09	10.57	11.03	11.51	12.72
	12H	14.40	14.83	15.36	15.79	17.00	10.16	10.59	11.12	11.55	12.76
8H	4H	13.58	14.06	14.52	15.00	16.21	9.82	10.30	10.76	11.24	12.45
	6H	14.15	14.55	15.12	15.53	16.73	10.35	10.74	11.31	11.72	12.93
	8H	14.37	14.72	15.34	15.69	16.91	10.54	10.89	11.51	11.86	13.08
	12H	14.51	14.82	15.49	15.79	17.05	10.66	10.97	11.64	11.94	13.21
12H	4H	13.54	13.97	14.50	14.93	16.14	9.83	10.26	10.79	11.22	12.43
	6H	14.13	14.48	15.10	15.45	16.67	10.40	10.74	11.37	11.72	12.94
	8H	14.35	14.66	15.33	15.63	16.90	10.61	10.92	11.59	11.89	13.15

END OF REPORT