

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P915667

Luminaire Tested: DFN2DIP-TR4F0-090D120US927-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P915667
REPORT IS A COMBINATION OF REPORTS P902043 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-090D120US927-FLLONL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16469.4 lumens
Efficiency: N/A
Efficacy: 92.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 178.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.099
Total Harmonic Distortion (THDi): 0.979
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P915667

CATALOG NUMBER: DFN2DIP-TR4F0-090D120US927-FLLONL

Luminous Intensity Polar Plot

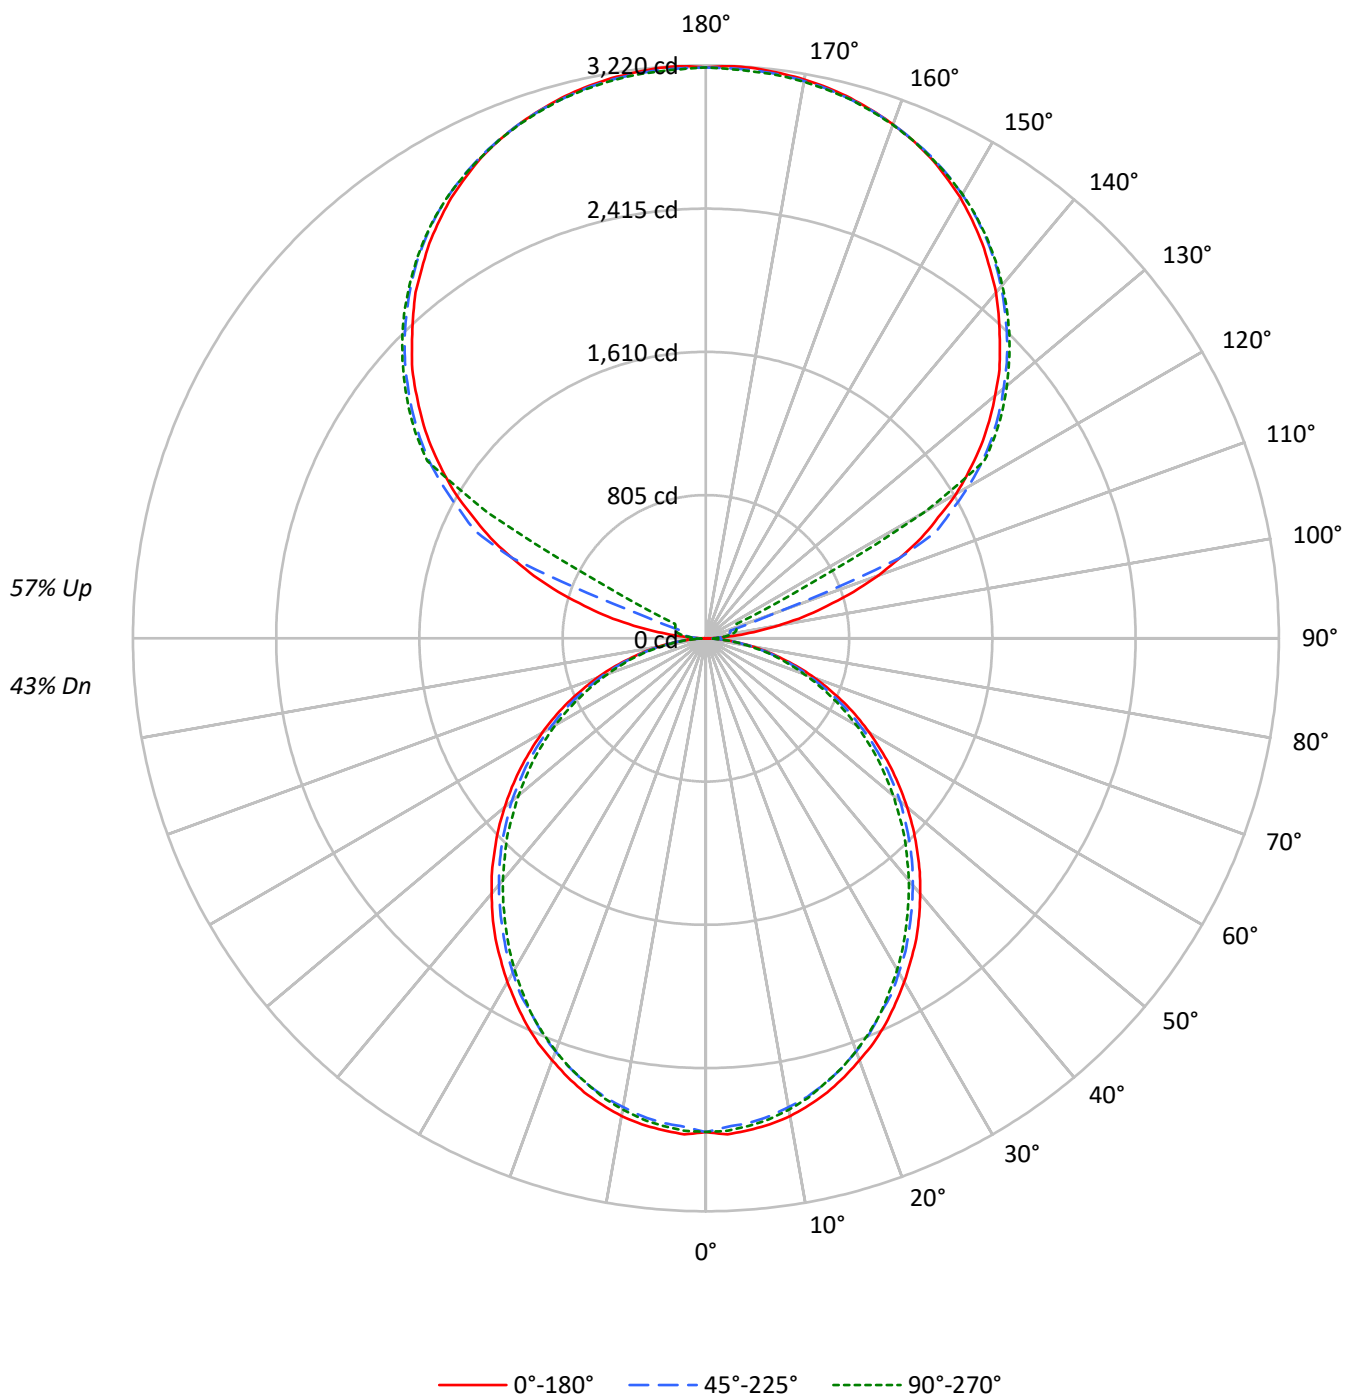

TEST NUMBER: P915667

CATALOG NUMBER: DFN2DIP-TR4F0-090D120US927-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	64	64	64	50	50	50
1	96	92	88	85	88	84	81	78	70	67	65	56	55	53	44	43	42
2	88	80	74	69	80	74	68	64	61	57	54	49	47	44	39	37	35
3	80	71	63	58	73	65	58	53	54	49	45	44	40	38	34	32	30
4	73	62	55	49	66	57	50	45	48	43	39	39	35	32	31	28	26
5	67	56	48	42	61	51	44	39	43	37	33	35	31	28	28	25	23
6	62	50	42	36	56	46	39	34	38	33	29	31	27	24	25	22	20
7	57	45	37	32	52	41	34	29	35	29	25	29	25	22	23	20	18
8	53	41	33	28	48	38	31	26	32	26	23	26	22	19	21	18	16
9	49	37	30	25	45	34	28	23	29	24	20	24	20	17	19	16	14
10	46	34	27	22	42	31	25	21	27	22	18	22	18	16	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2204	2204	2204
5°	2207	2173	2188
10°	2190	2144	2158
15°	2157	2109	2112
20°	2114	2059	2064
25°	2071	2001	2009
30°	2016	1946	1940
35°	1965	1882	1866
40°	1902	1817	1796
45°	1839	1752	1724
50°	1770	1683	1641
55°	1698	1604	1564
60°	1616	1510	1477
65°	1527	1413	1373
70°	1414	1294	1262
75°	1257	1152	1159
80°	1068	971	963
85°	772	659	638

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1839 cd/sqm

TEST NUMBER: P915667

CATALOG NUMBER: DFN2DIP-TR4F0-090D120US927-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	261.1	1.6
10°-20°	734.7	4.5
20°-30°	1079.6	6.6
30°-40°	1253.9	7.6
40°-50°	1252.4	7.6
50°-60°	1092.1	6.6
60°-70°	807.3	4.9
70°-80°	456.7	2.8
80°-90°	126.2	0.8
90°-100°	105.8	0.6
100°-110°	394.4	2.4
110°-120°	1045.9	6.4
120°-130°	1734.7	10.5
130°-140°	1842.7	11.2
140°-150°	1712.6	10.4
150°-160°	1376.9	8.4
160°-170°	887.2	5.4
170°-180°	305.4	1.9
0°-30°	2075.4	12.6
0°-40°	3329.4	20.2
0°-60°	5673.8	34.5
0°-90°	7064.0	42.9
90°-120°	1546.1	9.4
90°-150°	6836.0	41.5
90°-180°	9405.0	57.1
0°-180°	16469.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2774	2774	2774	2774	2774	
5°	2774	2764	2734	2756	2750	263
15°	2641	2625	2590	2601	2588	744
25°	2390	2369	2324	2329	2324	1100
35°	2062	2036	1993	1977	1963	1288
45°	1678	1659	1619	1590	1579	1295
55°	1270	1254	1222	1190	1176	1135
65°	856	840	814	790	776	847
75°	448	443	429	414	419	478
85°	109	107	104	96	93	122
90°	2	28	46	58	63	15
95°	151	74	90	102	100	179
105°	706	776	142	167	176	754
115°	1335	1374	1432	358	190	1314
125°	1887	1918	1962	1978	1985	1683
135°	2335	2373	2393	2417	2412	1804
145°	2709	2707	2746	2762	2751	1694
155°	2983	2962	2990	3004	2986	1375
165°	3143	3129	3136	3153	3136	888
175°	3215	3199	3204	3220	3197	306
180°	3208	3208	3208	3208	3208	

TEST NUMBER: P915667

CATALOG NUMBER: DFN2DIP-TR4F0-090D120US927-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2774.1	2774.1	2774.1	2774.1	2774.1
2.5°	2790.3	2777.0	2747.6	2774.1	2769.1
5°	2774.1	2763.7	2734.3	2755.5	2750.4
7.5°	2755.5	2739.7	2710.2	2731.8	2726.4
10°	2726.4	2707.7	2675.7	2696.9	2689.0
12.5°	2686.1	2670.3	2638.4	2651.6	2646.3
15°	2640.9	2625.1	2590.2	2601.0	2587.7
17.5°	2584.8	2569.0	2534.2	2547.5	2534.2
20°	2523.4	2507.6	2470.2	2478.1	2467.6
22.5°	2462.3	2438.3	2403.4	2403.4	2398.0
25°	2390.1	2368.9	2323.6	2328.7	2323.6
27.5°	2310.0	2291.3	2256.8	2248.9	2235.6
30°	2230.2	2208.7	2168.8	2160.8	2150.1
32.5°	2144.8	2128.9	2086.1	2070.0	2059.3
35°	2062.1	2035.5	1992.7	1976.7	1963.3
37.5°	1968.7	1944.6	1901.9	1883.3	1869.9
40°	1872.7	1851.2	1808.5	1784.7	1774.0
42.5°	1779.3	1757.8	1715.4	1688.5	1672.7
45°	1678.0	1659.4	1619.1	1590.0	1579.3
47.5°	1579.3	1560.6	1517.8	1488.4	1472.6
50°	1475.1	1461.8	1424.4	1387.1	1373.8
52.5°	1373.8	1355.1	1320.6	1291.2	1272.5
55°	1269.9	1253.8	1221.8	1189.9	1176.5
57.5°	1165.8	1152.5	1117.7	1085.7	1074.9
60°	1061.6	1051.1	1013.8	984.4	976.4
62.5°	960.3	941.6	915.0	888.4	877.7
65°	856.4	840.3	813.6	789.6	776.3
67.5°	749.7	736.2	712.3	693.7	682.9
70°	650.9	640.2	616.2	597.5	587.0
72.5°	549.6	538.8	525.5	506.9	499.0
75°	448.1	442.9	429.4	413.5	418.9
77.5°	357.4	346.7	341.4	333.4	325.5
80°	266.9	264.0	258.6	250.7	245.4
82.5°	181.4	181.4	178.9	168.1	168.1
85°	109.2	106.7	104.2	95.9	93.4
87.5°	48.1	42.7	37.4	29.5	26.6
90°	2.2	27.8	46.3	58.1	62.6
92.5°	58.1	48.8	55.7	60.4	62.6
95°	150.8	74.1	90.4	102.3	99.8
97.5°	271.6	81.4	118.3	125.4	127.6
100°	411.0	92.9	132.3	150.8	155.5
102.5°	564.0	559.6	137.0	162.4	169.5
105°	705.7	775.5	141.7	167.1	176.4
107.5°	870.5	928.4	146.4	171.7	181.1
110°	1028.5	1077.0	406.3	174.2	183.3

TEST NUMBER: P915667

CATALOG NUMBER: DFN2DIP-TR4F0-090D120US927-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1177.1	1218.7	1179.3	178.6	185.8
115°	1334.7	1374.2	1432.3	357.5	190.5
117.5°	1471.8	1518.1	1557.8	1225.6	617.5
120°	1625.1	1659.8	1701.7	1729.6	1416.1
122.5°	1754.9	1792.2	1838.7	1852.5	1855.0
125°	1887.2	1917.6	1961.7	1977.9	1984.8
127.5°	2007.9	2040.5	2075.5	2098.6	2100.9
130°	2121.8	2159.0	2184.4	2210.0	2207.8
132.5°	2237.8	2268.2	2293.5	2314.5	2312.3
135°	2335.4	2372.7	2393.3	2416.8	2412.1
137.5°	2437.5	2465.3	2488.7	2511.8	2505.0
140°	2537.3	2556.0	2581.3	2602.3	2590.7
142.5°	2621.0	2637.3	2667.4	2685.8	2674.2
145°	2709.3	2706.8	2746.2	2762.5	2750.8
147.5°	2785.6	2778.7	2818.2	2829.8	2820.6
150°	2860.0	2843.8	2881.0	2894.8	2883.2
152.5°	2922.6	2904.1	2938.9	2952.9	2936.7
155°	2983.0	2962.3	2990.2	3004.0	2985.5
157.5°	3031.8	3013.3	3034.3	3050.5	3031.8
160°	3073.7	3059.6	3073.7	3087.4	3071.2
162.5°	3110.7	3096.9	3108.4	3124.7	3103.8
165°	3143.1	3129.4	3136.2	3152.6	3136.2
167.5°	3168.8	3154.7	3161.9	3178.2	3157.2
170°	3189.7	3175.7	3180.4	3196.6	3175.7
172.5°	3203.5	3189.7	3194.5	3210.7	3189.7
175°	3215.1	3198.8	3203.5	3219.8	3196.6
177.5°	3219.8	3203.5	3206.0	3222.3	3201.4
180°	3208.3	3208.3	3208.3	3208.3	3208.3

TEST NUMBER: P915667

CATALOG NUMBER: DFN2DIP-TR4F0-090D120US927-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.32	10.12	10.33	11.14	12.51	8.89	9.69	9.90	10.71	12.08
	3H	10.97	11.69	12.00	12.72	14.11	10.50	11.22	11.53	12.25	13.64
	4H	11.56	12.24	12.60	13.27	14.67	11.08	11.77	12.12	12.80	14.20
	6H	11.95	12.58	13.00	13.62	15.03	11.48	12.11	12.53	13.15	14.56
	8H	12.06	12.65	13.11	13.71	15.11	11.58	12.18	12.64	13.24	14.64
	12H	12.10	12.67	13.16	13.72	15.15	11.62	12.19	12.68	13.24	14.67
4H	2H	9.77	10.45	10.82	11.49	12.89	9.43	10.11	10.47	11.14	12.54
	3H	11.63	12.20	12.69	13.26	14.67	11.24	11.81	12.29	12.87	14.28
	4H	12.34	12.86	13.40	13.92	15.35	11.94	12.46	13.00	13.51	14.95
	6H	12.86	13.30	13.92	14.38	15.81	12.45	12.89	13.52	13.97	15.40
	8H	13.00	13.42	14.07	14.49	15.93	12.59	13.01	13.66	14.08	15.52
	12H	13.07	13.45	14.16	14.54	15.98	12.65	13.03	13.74	14.12	15.56
8H	4H	12.54	12.95	13.61	14.02	15.47	12.18	12.59	13.25	13.66	15.11
	6H	13.16	13.51	14.26	14.62	16.06	12.80	13.15	13.89	14.26	15.70
	8H	13.38	13.69	14.48	14.78	16.24	13.02	13.32	14.11	14.41	15.87
	12H	13.51	13.78	14.62	14.87	16.37	13.13	13.40	14.23	14.49	15.99
12H	4H	12.52	12.90	13.61	13.98	15.43	12.17	12.54	13.25	13.63	15.08
	6H	13.19	13.50	14.29	14.59	16.05	12.84	13.15	13.94	14.24	15.70
	8H	13.43	13.70	14.54	14.79	16.29	13.08	13.34	14.18	14.43	15.93