

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P915691

Luminaire Tested: DFN2DIP-TR4F0-100D090US927-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P915691
REPORT IS A COMBINATION OF REPORTS P901991 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-100D090US927-FLLONL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14900.9 lumens
Efficiency: N/A
Efficacy: 88.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 168.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9972
Total Harmonic Distortion (THDi): 0.128
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P915691

CATALOG NUMBER: DFN2DIP-TR4F0-100D090US927-FLLONL

Luminous Intensity Polar Plot

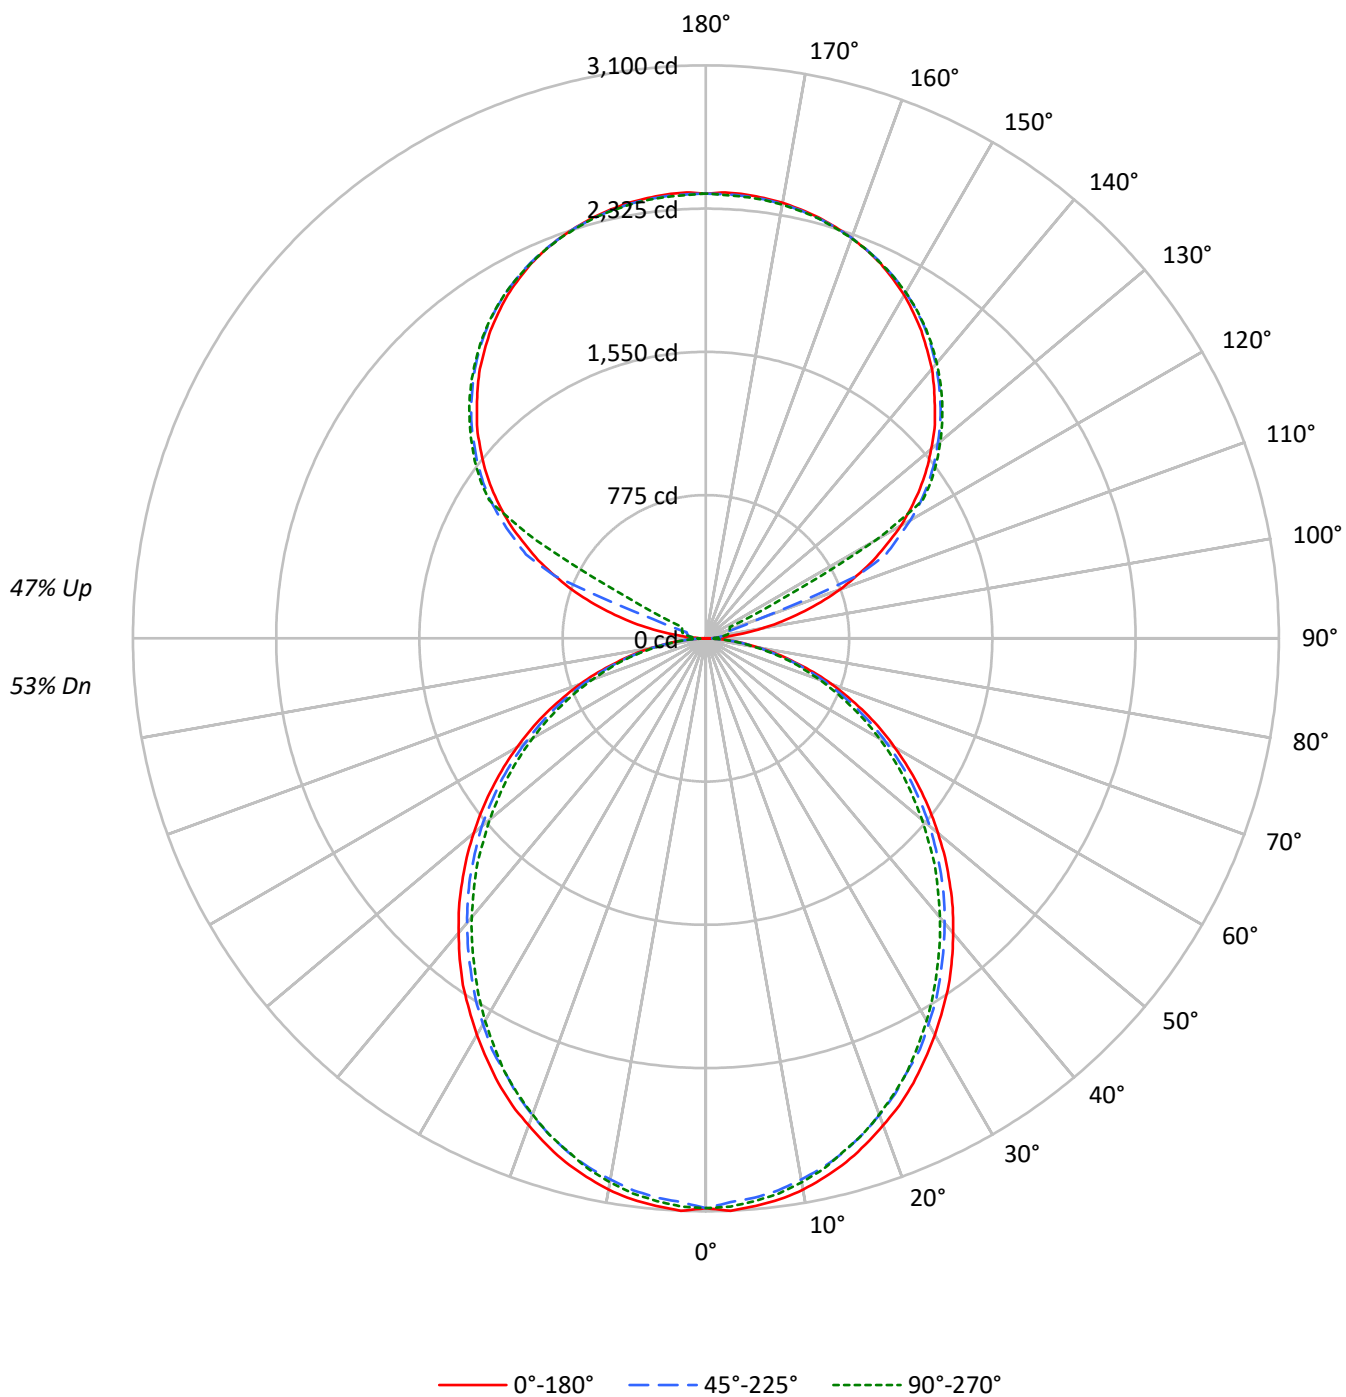

TEST NUMBER: P915691

CATALOG NUMBER: DFN2DIP-TR4F0-100D090US927-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	71	71	71	59	59	59
1	98	94	90	87	91	87	84	81	74	72	70	63	61	59	52	51	49
2	90	82	76	71	83	76	71	66	65	61	58	55	52	50	46	44	42
3	82	72	65	59	75	67	61	55	58	53	49	49	45	42	40	38	35
4	75	64	56	50	69	59	52	47	51	46	41	43	39	36	36	33	31
5	69	57	49	43	63	53	46	40	46	40	36	39	35	31	33	29	27
6	63	51	43	37	58	48	40	35	41	35	31	35	31	27	30	26	23
7	59	46	38	33	54	43	36	31	37	32	27	32	28	24	27	24	21
8	54	42	34	29	50	39	32	27	34	28	24	29	25	22	25	21	19
9	51	38	31	26	47	36	29	24	31	26	22	27	23	19	23	19	17
10	47	35	28	23	44	33	26	22	29	23	20	25	21	18	21	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2449	2449	2449
5°	2453	2415	2431
10°	2433	2382	2398
15°	2397	2343	2346
20°	2349	2288	2294
25°	2301	2223	2233
30°	2240	2162	2155
35°	2183	2091	2073
40°	2113	2019	1995
45°	2043	1946	1916
50°	1966	1870	1823
55°	1886	1782	1738
60°	1796	1678	1641
65°	1697	1570	1526
70°	1571	1438	1402
75°	1396	1280	1288
80°	1186	1079	1070
85°	858	732	709

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2043 cd/sqm

TEST NUMBER: P915691

CATALOG NUMBER: DFN2DIP-TR4F0-100D090US927-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	290.1	1.9
10°-20°	816.3	5.5
20°-30°	1199.6	8.1
30°-40°	1393.3	9.4
40°-50°	1391.5	9.3
50°-60°	1213.4	8.1
60°-70°	897.0	6.0
70°-80°	507.5	3.4
80°-90°	138.2	0.9
90°-100°	79.3	0.5
100°-110°	295.8	2.0
110°-120°	784.4	5.3
120°-130°	1301.0	8.7
130°-140°	1382.0	9.3
140°-150°	1284.4	8.6
150°-160°	1032.6	6.9
160°-170°	665.4	4.5
170°-180°	229.0	1.5
0°-30°	2306.0	15.5
0°-40°	3699.3	24.8
0°-60°	6304.2	42.3
0°-90°	7846.8	52.7
90°-120°	1159.5	7.8
90°-150°	5127.0	34.4
90°-180°	7054.0	47.3
0°-180°	14900.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3082	3082	3082	3082	3082	
5°	3082	3071	3038	3062	3056	293
15°	2934	2917	2878	2890	2875	826
25°	2656	2632	2582	2587	2582	1222
35°	2291	2262	2214	2196	2181	1431
45°	1864	1844	1799	1767	1755	1439
55°	1411	1393	1358	1322	1307	1262
65°	952	934	904	877	863	941
75°	498	492	477	460	465	531
85°	121	119	116	107	104	135
90°	2	21	35	44	47	14
95°	113	56	68	77	75	134
105°	529	582	106	125	132	566
115°	1001	1031	1074	268	143	986
125°	1415	1438	1471	1483	1489	1262
135°	1752	1780	1795	1813	1809	1353
145°	2032	2030	2060	2072	2063	1271
155°	2237	2222	2243	2253	2239	1031
165°	2357	2347	2352	2364	2352	666
175°	2411	2399	2403	2415	2398	229
180°	2406	2406	2406	2406	2406	

TEST NUMBER: P915691

CATALOG NUMBER: DFN2DIP-TR4F0-100D090US927-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3082.5	3082.5	3082.5	3082.5	3082.5
2.5°	3100.4	3085.5	3052.8	3082.5	3076.8
5°	3082.5	3070.8	3038.1	3061.7	3056.0
7.5°	3061.7	3044.0	3011.3	3035.2	3029.3
10°	3029.3	3008.5	2973.0	2996.6	2987.8
12.5°	2984.6	2967.0	2931.5	2946.3	2940.3
15°	2934.3	2916.7	2878.0	2890.0	2875.2
17.5°	2872.1	2854.5	2815.7	2830.5	2815.7
20°	2803.8	2786.2	2744.7	2753.5	2741.8
22.5°	2735.9	2709.2	2670.4	2670.4	2664.5
25°	2655.7	2632.1	2581.8	2587.4	2581.8
27.5°	2566.7	2545.9	2507.6	2498.8	2484.0
30°	2478.0	2454.1	2409.7	2400.9	2389.0
32.5°	2383.0	2365.5	2317.9	2300.0	2288.1
35°	2291.2	2261.7	2214.1	2196.2	2181.4
37.5°	2187.4	2160.7	2113.2	2092.5	2077.7
40°	2080.8	2056.9	2009.4	1983.1	1971.1
42.5°	1977.0	1953.1	1906.0	1876.1	1858.5
45°	1864.5	1843.7	1799.0	1766.6	1754.8
47.5°	1754.8	1734.0	1686.5	1653.8	1636.2
50°	1639.0	1624.2	1582.7	1541.2	1526.5
52.5°	1526.5	1505.7	1467.3	1434.6	1413.9
55°	1411.0	1393.1	1357.6	1322.0	1307.3
57.5°	1295.3	1280.5	1241.8	1206.3	1194.4
60°	1179.6	1167.9	1126.4	1093.7	1084.9
62.5°	1067.0	1046.2	1016.7	987.1	975.2
65°	951.6	933.7	904.1	877.3	862.6
67.5°	833.1	817.9	791.5	770.8	758.8
70°	723.3	711.3	684.6	663.8	652.2
72.5°	610.7	598.7	584.0	563.2	554.4
75°	497.8	492.2	477.1	459.5	465.4
77.5°	397.2	385.2	379.2	370.4	361.6
80°	296.5	293.4	287.4	278.6	272.7
82.5°	201.6	201.6	198.8	186.8	186.8
85°	121.4	118.6	115.7	106.6	103.8
87.5°	53.5	47.5	41.5	32.7	29.5
90°	1.7	20.9	34.7	43.6	46.9
92.5°	43.6	36.6	41.7	45.3	46.9
95°	113.1	55.6	67.8	76.7	74.9
97.5°	203.7	61.0	88.7	94.0	95.7
100°	308.2	69.7	99.3	113.1	116.6
102.5°	423.0	419.7	102.7	121.8	127.1
105°	529.3	581.6	106.2	125.3	132.3
107.5°	652.9	696.3	109.8	128.8	135.9
110°	771.3	807.8	304.8	130.6	137.5

TEST NUMBER: P915691

CATALOG NUMBER: DFN2DIP-TR4F0-100D090US927-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	882.8	914.0	884.5	134.0	139.3
115°	1001.1	1030.6	1074.3	268.2	142.8
117.5°	1103.8	1138.6	1168.3	919.2	463.1
120°	1218.8	1244.8	1276.3	1297.1	1062.1
122.5°	1316.2	1344.1	1379.0	1389.3	1391.2
125°	1415.4	1438.1	1471.2	1483.4	1488.6
127.5°	1505.9	1530.3	1556.6	1574.0	1575.6
130°	1591.3	1619.3	1638.3	1657.5	1655.9
132.5°	1678.4	1701.1	1720.1	1735.9	1734.2
135°	1751.6	1779.5	1795.0	1812.6	1809.1
137.5°	1828.1	1849.0	1866.5	1883.9	1878.7
140°	1902.9	1917.0	1936.0	1951.7	1943.1
142.5°	1965.8	1978.0	2000.5	2014.4	2005.7
145°	2031.9	2030.0	2059.7	2071.9	2063.2
147.5°	2089.2	2084.1	2113.6	2122.3	2115.4
150°	2145.1	2132.9	2160.8	2171.1	2162.4
152.5°	2192.0	2178.1	2204.2	2214.7	2202.5
155°	2237.3	2221.8	2242.6	2253.0	2239.1
157.5°	2273.9	2260.0	2275.7	2287.9	2273.9
160°	2305.2	2294.7	2305.2	2315.6	2303.4
162.5°	2333.0	2322.6	2331.3	2343.5	2327.8
165°	2357.4	2347.0	2352.2	2364.4	2352.2
167.5°	2376.6	2366.1	2371.4	2383.6	2367.9
170°	2392.3	2381.8	2385.3	2397.5	2381.8
172.5°	2402.7	2392.3	2395.8	2408.0	2392.3
175°	2411.3	2399.1	2402.7	2414.8	2397.5
177.5°	2414.8	2402.7	2404.5	2416.7	2401.0
180°	2406.2	2406.2	2406.2	2406.2	2406.2

TEST NUMBER: P915691

CATALOG NUMBER: DFN2DIP-TR4F0-100D090US927-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.62	11.51	11.55	12.46	13.69	10.19	11.08	11.12	12.03	13.26
	3H	12.28	13.08	13.23	14.04	15.29	11.81	12.61	12.76	13.57	14.82
	4H	12.87	13.62	13.83	14.59	15.85	12.40	13.15	13.36	14.12	15.38
	6H	13.27	13.97	14.24	14.94	16.21	12.80	13.49	13.77	14.46	15.74
	8H	13.38	14.04	14.36	15.03	16.30	12.90	13.56	13.88	14.55	15.83
	12H	13.43	14.05	14.41	15.04	16.34	12.95	13.57	13.93	14.56	15.86
4H	2H	11.09	11.84	12.05	12.80	14.07	10.74	11.49	11.71	12.46	13.72
	3H	12.95	13.58	13.93	14.58	15.85	12.56	13.19	13.54	14.18	15.46
	4H	13.67	14.24	14.65	15.23	16.53	13.26	13.84	14.25	14.83	16.13
	6H	14.19	14.68	15.18	15.69	16.99	13.78	14.27	14.77	15.28	16.58
	8H	14.34	14.80	15.33	15.80	17.12	13.92	14.39	14.92	15.39	16.71
	12H	14.41	14.83	15.43	15.85	17.17	13.99	14.41	15.00	15.43	16.75
8H	4H	13.87	14.33	14.87	15.33	16.65	13.51	13.97	14.51	14.97	16.29
	6H	14.50	14.88	15.52	15.93	17.24	14.14	14.52	15.16	15.57	16.88
	8H	14.72	15.06	15.75	16.09	17.42	14.35	14.69	15.38	15.72	17.05
	12H	14.85	15.15	15.89	16.18	17.55	14.47	14.77	15.50	15.79	17.17
12H	4H	13.85	14.27	14.87	15.29	16.61	13.50	13.92	14.52	14.94	16.26
	6H	14.53	14.87	15.56	15.90	17.23	14.18	14.52	15.21	15.55	16.88
	8H	14.77	15.07	15.81	16.10	17.47	14.42	14.71	15.45	15.74	17.12

END OF REPORT