

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P915695

Luminaire Tested: DFN2DIP-TR4F0-100D100US927-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P915695
REPORT IS A COMBINATION OF REPORTS P902009 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-100D100US927-FLLONL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15685.2 lumens
Efficiency: N/A
Efficacy: 88.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 177.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9972
Total Harmonic Distortion (THDi): 0.128
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P915695

CATALOG NUMBER: DFN2DIP-TR4F0-100D100US927-FLLONL

Luminous Intensity Polar Plot

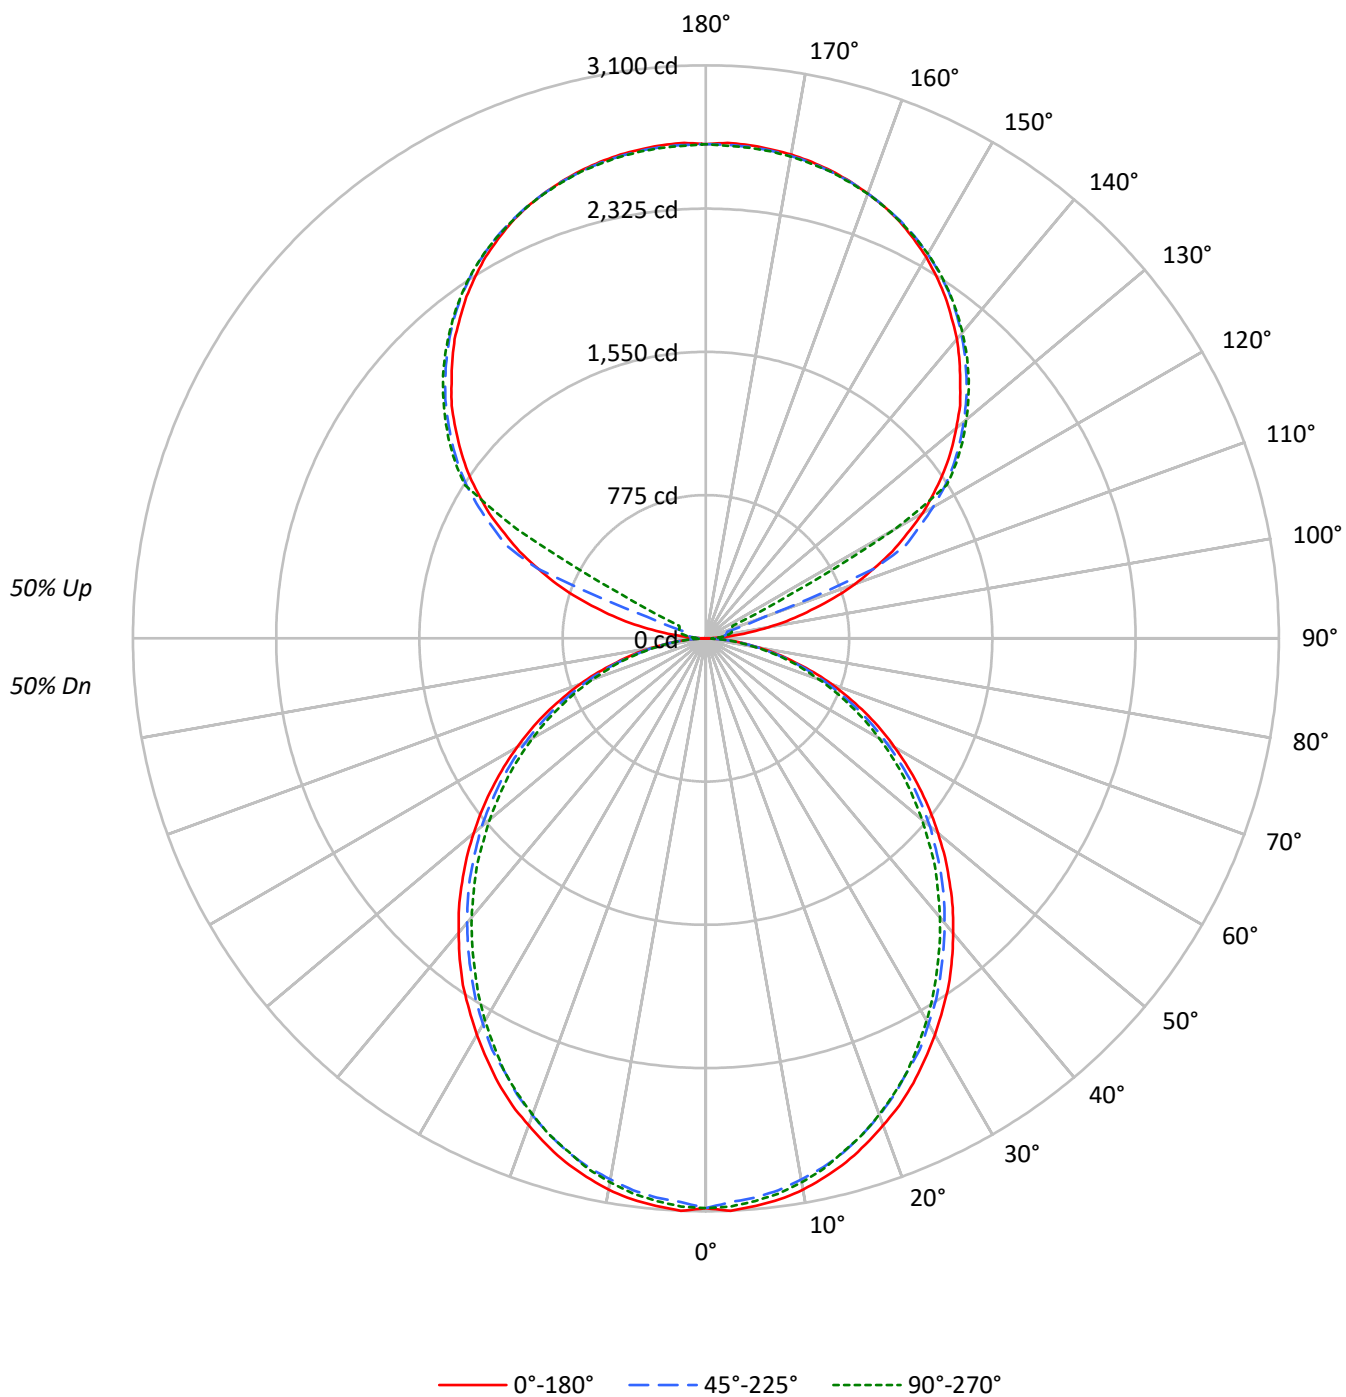

TEST NUMBER: P915695

CATALOG NUMBER: DFN2DIP-TR4F0-100D100US927-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2449	2449	2449
5°	2453	2415	2431
10°	2433	2382	2398
15°	2397	2343	2346
20°	2349	2288	2294
25°	2301	2223	2233
30°	2240	2162	2155
35°	2183	2091	2073
40°	2113	2019	1995
45°	2043	1946	1916
50°	1966	1870	1823
55°	1886	1782	1738
60°	1796	1678	1641
65°	1697	1570	1526
70°	1571	1438	1402
75°	1396	1280	1288
80°	1186	1079	1070
85°	858	732	709

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2043 cd/sqm

TEST NUMBER: P915695

CATALOG NUMBER: DFN2DIP-TR4F0-100D100US927-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	290.1	1.8
10°-20°	816.3	5.2
20°-30°	1199.6	7.6
30°-40°	1393.3	8.9
40°-50°	1391.5	8.9
50°-60°	1213.4	7.7
60°-70°	897.0	5.7
70°-80°	507.5	3.2
80°-90°	138.7	0.9
90°-100°	88.1	0.6
100°-110°	328.6	2.1
110°-120°	871.6	5.6
120°-130°	1445.6	9.2
130°-140°	1535.6	9.8
140°-150°	1427.1	9.1
150°-160°	1147.4	7.3
160°-170°	739.3	4.7
170°-180°	254.5	1.6
0°-30°	2306.0	14.7
0°-40°	3699.3	23.6
0°-60°	6304.2	40.2
0°-90°	7847.3	50.0
90°-120°	1288.4	8.2
90°-150°	5696.7	36.3
90°-180°	7838.0	50.0
0°-180°	15685.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3082	3082	3082	3082	3082	
5°	3082	3071	3038	3062	3056	293
15°	2934	2917	2878	2890	2875	826
25°	2656	2632	2582	2587	2582	1222
35°	2291	2262	2214	2196	2181	1431
45°	1864	1844	1799	1767	1755	1439
55°	1411	1393	1358	1322	1307	1262
65°	952	934	904	877	863	941
75°	498	492	477	460	465	531
85°	121	119	116	107	104	135
90°	2	23	39	48	52	14
95°	126	62	75	85	83	149
105°	588	646	118	139	147	628
115°	1112	1145	1194	298	159	1095
125°	1573	1598	1635	1648	1654	1403
135°	1946	1977	1994	2014	2010	1503
145°	2258	2256	2288	2302	2292	1412
155°	2486	2469	2492	2503	2488	1146
165°	2619	2608	2614	2627	2614	740
175°	2679	2666	2670	2683	2664	255
180°	2674	2674	2674	2674	2674	

TEST NUMBER: P915695

CATALOG NUMBER: DFN2DIP-TR4F0-100D100US927-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3082.5	3082.5	3082.5	3082.5	3082.5
2.5°	3100.4	3085.5	3052.8	3082.5	3076.8
5°	3082.5	3070.8	3038.1	3061.7	3056.0
7.5°	3061.7	3044.0	3011.3	3035.2	3029.3
10°	3029.3	3008.5	2973.0	2996.6	2987.8
12.5°	2984.6	2967.0	2931.5	2946.3	2940.3
15°	2934.3	2916.7	2878.0	2890.0	2875.2
17.5°	2872.1	2854.5	2815.7	2830.5	2815.7
20°	2803.8	2786.2	2744.7	2753.5	2741.8
22.5°	2735.9	2709.2	2670.4	2670.4	2664.5
25°	2655.7	2632.1	2581.8	2587.4	2581.8
27.5°	2566.7	2545.9	2507.6	2498.8	2484.0
30°	2478.0	2454.1	2409.7	2400.9	2389.0
32.5°	2383.0	2365.5	2317.9	2300.0	2288.1
35°	2291.2	2261.7	2214.1	2196.2	2181.4
37.5°	2187.4	2160.7	2113.2	2092.5	2077.7
40°	2080.8	2056.9	2009.4	1983.1	1971.1
42.5°	1977.0	1953.1	1906.0	1876.1	1858.5
45°	1864.5	1843.7	1799.0	1766.6	1754.8
47.5°	1754.8	1734.0	1686.5	1653.8	1636.2
50°	1639.0	1624.2	1582.7	1541.2	1526.5
52.5°	1526.5	1505.7	1467.3	1434.6	1413.9
55°	1411.0	1393.1	1357.6	1322.0	1307.3
57.5°	1295.3	1280.5	1241.8	1206.3	1194.4
60°	1179.6	1167.9	1126.4	1093.7	1084.9
62.5°	1067.0	1046.2	1016.7	987.1	975.2
65°	951.6	933.7	904.1	877.3	862.6
67.5°	833.1	817.9	791.5	770.8	758.8
70°	723.3	711.3	684.6	663.8	652.2
72.5°	610.7	598.7	584.0	563.2	554.4
75°	497.8	492.2	477.1	459.5	465.4
77.5°	397.2	385.2	379.2	370.4	361.6
80°	296.5	293.4	287.4	278.6	272.7
82.5°	201.6	201.6	198.8	186.8	186.8
85°	121.4	118.6	115.7	106.6	103.8
87.5°	53.5	47.5	41.5	32.7	29.5
90°	1.8	23.2	38.6	48.5	52.1
92.5°	48.5	40.6	46.4	50.3	52.1
95°	125.6	61.8	75.3	85.2	83.2
97.5°	226.2	67.7	98.5	104.5	106.4
100°	342.5	77.4	110.3	125.6	129.6
102.5°	470.0	466.4	114.2	135.3	141.2
105°	588.1	646.2	118.1	139.2	147.0
107.5°	725.5	773.7	122.0	143.1	150.9
110°	857.1	897.5	338.6	145.2	152.7

TEST NUMBER: P915695

CATALOG NUMBER: DFN2DIP-TR4F0-100D100US927-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	980.9	1015.6	982.8	148.9	154.9
115°	1112.3	1145.2	1193.7	297.9	158.8
117.5°	1226.5	1265.1	1298.1	1021.4	514.6
120°	1354.2	1383.1	1418.1	1441.3	1180.1
122.5°	1462.4	1493.4	1532.2	1543.7	1545.8
125°	1572.7	1598.0	1634.7	1648.3	1654.0
127.5°	1673.3	1700.4	1729.6	1748.9	1750.7
130°	1768.1	1799.2	1820.4	1841.7	1839.8
132.5°	1864.9	1890.1	1911.3	1928.7	1926.9
135°	1946.2	1977.2	1994.5	2014.0	2010.1
137.5°	2031.2	2054.4	2073.9	2093.3	2087.5
140°	2114.3	2130.0	2151.1	2168.6	2158.9
142.5°	2184.2	2197.7	2222.8	2238.1	2228.6
145°	2257.7	2255.7	2288.5	2302.1	2292.4
147.5°	2321.3	2315.6	2348.4	2358.1	2350.6
150°	2383.4	2369.8	2400.9	2412.4	2402.7
152.5°	2435.5	2420.1	2449.1	2460.8	2447.2
155°	2485.9	2468.6	2491.8	2503.3	2487.9
157.5°	2526.5	2511.1	2528.6	2542.1	2526.5
160°	2561.4	2549.7	2561.4	2572.9	2559.4
162.5°	2592.2	2580.7	2590.4	2603.9	2586.5
165°	2619.3	2607.8	2613.6	2627.1	2613.6
167.5°	2640.7	2628.9	2635.0	2648.5	2631.0
170°	2658.1	2646.4	2650.3	2663.9	2646.4
172.5°	2669.6	2658.1	2662.0	2675.6	2658.1
175°	2679.2	2665.7	2669.6	2683.2	2663.9
177.5°	2683.2	2669.6	2671.7	2685.3	2667.7
180°	2673.5	2673.5	2673.5	2673.5	2673.5

TEST NUMBER: P915695

CATALOG NUMBER: DFN2DIP-TR4F0-100D100US927-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.38	11.24	11.34	12.22	13.49	9.95	10.81	10.91	11.78	13.05
	3H	12.04	12.81	13.01	13.80	15.09	11.57	12.34	12.54	13.32	14.62
	4H	12.63	13.36	13.61	14.35	15.65	12.16	12.89	13.14	13.87	15.17
	6H	13.03	13.70	14.02	14.69	16.01	12.55	13.23	13.55	14.22	15.53
	8H	13.13	13.77	14.13	14.78	16.09	12.66	13.30	13.66	14.31	15.62
	12H	13.18	13.79	14.19	14.79	16.13	12.70	13.31	13.71	14.31	15.65
4H	2H	10.84	11.57	11.83	12.56	13.86	10.50	11.23	11.49	12.22	13.52
	3H	12.71	13.32	13.71	14.33	15.65	12.32	12.93	13.31	13.94	15.26
	4H	13.42	13.98	14.43	14.99	16.33	13.02	13.58	14.02	14.58	15.92
	6H	13.94	14.42	14.95	15.45	16.79	13.53	14.01	14.55	15.04	16.38
	8H	14.09	14.54	15.11	15.56	16.91	13.68	14.13	14.69	15.15	16.50
	12H	14.16	14.57	15.20	15.61	16.96	13.74	14.14	14.78	15.18	16.54
8H	4H	13.62	14.07	14.64	15.09	16.44	13.26	13.71	14.28	14.73	16.08
	6H	14.25	14.62	15.29	15.69	17.04	13.89	14.26	14.93	15.33	16.67
	8H	14.47	14.80	15.52	15.85	17.22	14.10	14.43	15.15	15.48	16.85
	12H	14.60	14.89	15.66	15.94	17.35	14.22	14.51	15.27	15.55	16.96
12H	4H	13.61	14.01	14.64	15.05	16.41	13.25	13.66	14.29	14.70	16.05
	6H	14.28	14.61	15.33	15.66	17.03	13.93	14.26	14.98	15.31	16.68
	8H	14.52	14.81	15.58	15.86	17.27	14.17	14.45	15.22	15.50	16.91

END OF REPORT