

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P915696

Luminaire Tested: DFN2DIP-TR4F0-100D100US927-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P915696
REPORT IS A COMBINATION OF REPORTS P900490 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-100D100US927-RLLFLL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13744.3 lumens
Efficiency: N/A
Efficacy: 77.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 177.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9972
Total Harmonic Distortion (THDi): 0.128
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P915696

CATALOG NUMBER: DFN2DIP-TR4F0-100D100US927-RLLFLL

Luminous Intensity Polar Plot

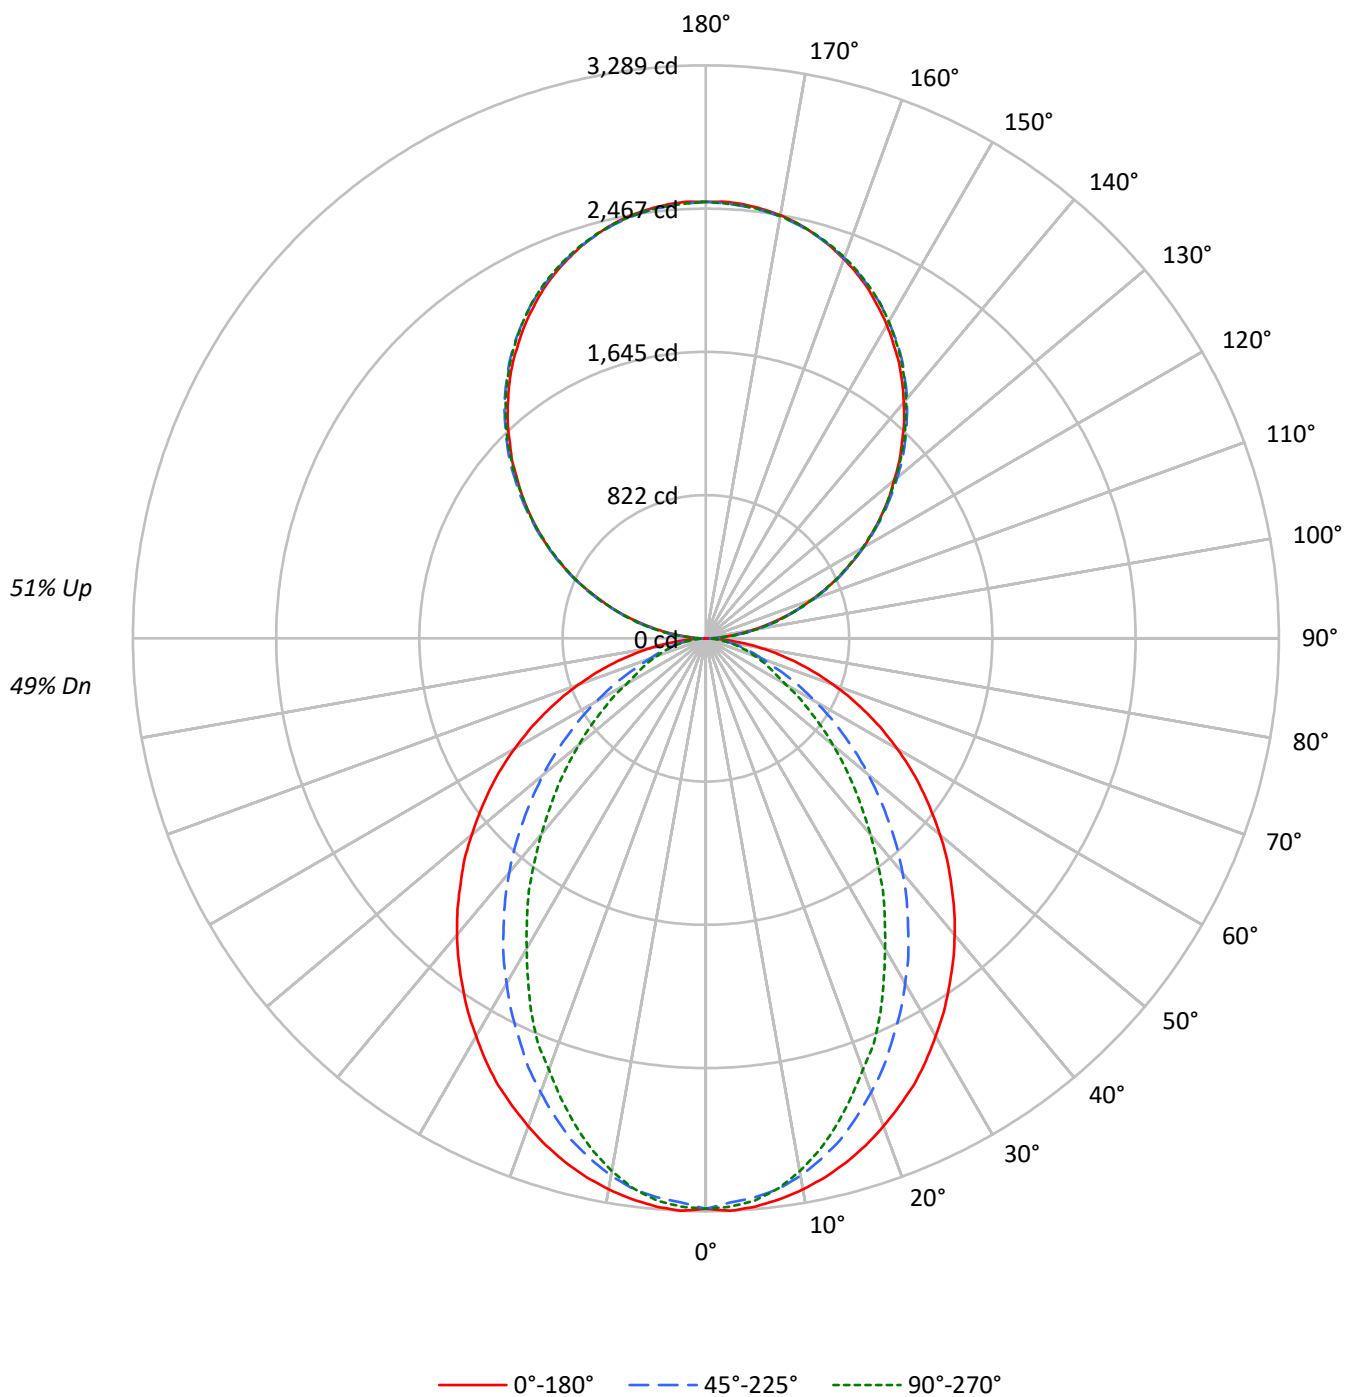

TEST NUMBER: P915696

CATALOG NUMBER: DFN2DIP-TR4F0-100D100US927-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	68	68	68	55	55	55
1	98	94	90	87	90	87	84	81	73	71	69	61	59	58	50	49	48
2	90	83	77	72	82	76	71	67	65	61	58	54	51	49	44	42	41
3	82	73	66	60	75	68	61	57	58	53	49	48	45	42	40	37	35
4	75	65	57	51	69	60	54	48	51	46	42	43	40	36	36	33	31
5	69	58	50	44	64	54	47	42	46	41	37	39	35	32	32	29	27
6	64	52	44	39	59	49	42	37	42	36	32	35	31	28	30	26	24
7	59	47	40	34	55	44	37	32	38	33	29	32	28	25	27	24	22
8	55	43	36	30	51	40	33	29	35	29	26	30	26	23	25	22	20
9	51	39	32	27	47	37	30	26	32	27	23	27	23	20	23	20	18
10	48	36	29	24	44	34	28	23	30	24	21	25	21	19	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2601	2601	2601
5°	2605	2560	2576
10°	2579	2510	2492
15°	2544	2426	2362
20°	2497	2312	2203
25°	2449	2184	2050
30°	2384	2053	1855
35°	2321	1911	1684
40°	2257	1765	1488
45°	2182	1603	1310
50°	2105	1439	1136
55°	2024	1264	969
60°	1930	1081	798
65°	1823	895	718
70°	1693	722	650
75°	1529	636	591
80°	1292	534	512
85°	900	356	384

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2182 cd/sqm

TEST NUMBER: P915696

CATALOG NUMBER: DFN2DIP-TR4F0-100D100US927-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	306.9	2.2
10°-20°	842.4	6.1
20°-30°	1182.6	8.6
30°-40°	1289.2	9.4
40°-50°	1184.9	8.6
50°-60°	930.5	6.8
60°-70°	605.7	4.4
70°-80°	311.8	2.3
80°-90°	86.7	0.6
90°-100°	155.0	1.1
100°-110°	492.6	3.6
110°-120°	843.0	6.1
120°-130°	1108.6	8.1
130°-140°	1244.4	9.1
140°-150°	1220.3	8.9
150°-160°	1023.6	7.4
160°-170°	678.9	4.9
170°-180°	237.3	1.7
0°-30°	2331.9	17.0
0°-40°	3621.0	26.3
0°-60°	5736.5	41.7
0°-90°	6740.6	49.0
90°-120°	1490.6	10.8
90°-150°	5063.9	36.8
90°-180°	7004.0	51.0
0°-180°	13744.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3274	3274	3274	3274	3274	
5°	3274	3259	3221	3247	3238	310
15°	3114	3081	2981	2924	2895	878
25°	2827	2732	2536	2415	2370	1300
35°	2436	2284	2024	1837	1772	1524
45°	1991	1792	1482	1271	1200	1538
55°	1514	1283	963	785	729	1353
65°	1022	782	516	415	406	1014
75°	545	338	237	216	213	577
85°	127	65	56	56	56	146
90°	2	27	74	70	72	14
95°	110	131	135	135	131	123
105°	455	461	465	469	469	480
115°	846	858	854	852	846	837
125°	1230	1249	1243	1236	1234	1100
135°	1591	1615	1619	1617	1611	1230
145°	1932	1947	1959	1962	1953	1207
155°	2209	2215	2222	2233	2226	1017
165°	2403	2401	2401	2416	2406	678
175°	2501	2495	2490	2505	2492	238
180°	2505	2505	2505	2505	2505	

TEST NUMBER: P915696

CATALOG NUMBER: DFN2DIP-TR4F0-100D100US927-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3274.1	3274.1	3274.1	3274.1	3274.1
2.5°	3288.8	3274.1	3241.4	3271.2	3265.3
5°	3274.1	3259.3	3220.6	3247.4	3238.5
7.5°	3247.4	3229.7	3188.2	3199.9	3185.1
10°	3211.8	3191.1	3132.0	3122.9	3105.3
12.5°	3167.5	3140.8	3060.6	3043.0	3010.3
15°	3114.1	3081.3	2980.7	2924.5	2894.9
17.5°	3051.8	3004.3	2879.9	2814.8	2767.3
20°	2980.7	2921.3	2773.3	2699.4	2634.0
22.5°	2903.7	2835.5	2663.6	2563.0	2518.7
25°	2826.7	2731.8	2536.2	2414.9	2370.3
27.5°	2734.9	2634.0	2417.7	2278.5	2210.3
30°	2637.2	2524.3	2287.3	2136.4	2056.3
32.5°	2542.3	2405.8	2163.1	1985.2	1911.0
35°	2435.6	2284.5	2023.9	1837.1	1771.7
37.5°	2331.9	2168.8	1893.4	1688.8	1614.9
40°	2222.2	2044.6	1757.0	1546.7	1469.7
42.5°	2109.7	1920.1	1620.9	1401.4	1327.5
45°	1991.1	1792.5	1481.6	1271.0	1199.9
47.5°	1878.7	1668.3	1348.3	1137.7	1072.6
50°	1754.1	1543.8	1217.8	1013.2	951.3
52.5°	1632.4	1410.2	1093.4	897.8	841.5
55°	1513.9	1282.9	962.9	785.3	729.0
57.5°	1392.7	1155.6	847.6	681.5	634.1
60°	1268.1	1031.1	725.9	575.0	527.5
62.5°	1146.8	909.7	622.1	480.1	456.5
65°	1022.3	782.1	515.6	414.9	405.8
67.5°	903.8	663.6	414.9	364.3	355.5
70°	779.3	548.3	343.6	314.0	302.1
72.5°	660.8	441.3	287.3	263.7	257.8
75°	545.1	337.6	237.0	216.3	213.4
77.5°	429.8	239.9	186.7	174.8	168.8
80°	322.8	172.0	142.1	130.5	130.5
82.5°	225.1	115.7	97.8	91.8	91.8
85°	127.3	65.0	56.2	56.2	56.2
87.5°	47.5	23.6	23.6	20.8	20.8
90°	2.3	27.2	74.0	69.5	71.8
92.5°	46.8	63.5	65.8	68.0	68.0
95°	110.3	131.4	135.2	135.2	131.4
97.5°	183.5	203.2	211.5	211.5	211.5
100°	268.2	285.5	291.5	291.5	289.3
102.5°	357.3	370.1	378.4	380.6	378.4
105°	454.7	460.7	465.2	469.1	469.1
107.5°	551.4	560.5	560.5	562.0	551.4
110°	645.1	657.1	657.1	657.1	651.1

TEST NUMBER: P915696

CATALOG NUMBER: DFN2DIP-TR4F0-100D100US927-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	746.2	759.1	756.8	750.8	746.2
115°	846.0	858.0	854.3	852.0	846.0
117.5°	944.9	961.5	950.9	944.9	938.8
120°	1044.6	1061.2	1044.6	1044.6	1037.8
122.5°	1135.2	1156.3	1145.8	1139.8	1135.2
125°	1230.4	1249.3	1243.2	1236.4	1234.2
127.5°	1323.3	1346.7	1338.4	1329.4	1323.3
130°	1410.2	1437.3	1433.6	1429.0	1420.8
132.5°	1507.6	1528.8	1530.3	1519.7	1513.6
135°	1591.4	1614.9	1619.4	1617.2	1611.1
137.5°	1685.1	1704.0	1707.8	1706.3	1697.2
140°	1767.4	1786.3	1796.9	1796.9	1788.6
142.5°	1852.0	1870.9	1876.9	1879.2	1870.9
145°	1932.1	1947.2	1959.3	1961.5	1953.2
147.5°	2003.8	2022.8	2031.8	2035.6	2027.3
150°	2077.9	2090.7	2099.0	2105.8	2099.0
152.5°	2143.6	2156.4	2167.0	2175.3	2167.0
155°	2209.3	2215.3	2222.1	2232.7	2225.9
157.5°	2266.0	2270.5	2274.3	2289.3	2278.8
160°	2316.6	2321.1	2323.3	2336.1	2327.1
162.5°	2363.4	2363.4	2365.6	2379.9	2369.4
165°	2403.4	2401.1	2401.1	2416.2	2405.7
167.5°	2439.7	2432.9	2432.9	2448.0	2437.4
170°	2466.9	2460.8	2458.5	2473.7	2460.8
172.5°	2485.7	2479.7	2477.4	2492.5	2479.7
175°	2500.8	2494.8	2490.3	2505.4	2492.5
177.5°	2509.2	2503.1	2498.5	2511.4	2498.5
180°	2505.4	2505.4	2505.4	2505.4	2505.4

TEST NUMBER: P915696

CATALOG NUMBER: DFN2DIP-TR4F0-100D100US927-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.37	11.19	11.34	12.18	13.46	6.34	7.17	7.32	8.15	9.44
	3H	12.05	12.78	13.03	13.77	15.08	7.53	8.27	8.52	9.26	10.57
	4H	12.66	13.35	13.65	14.35	15.66	7.98	8.68	8.98	9.67	10.99
	6H	13.08	13.72	14.08	14.72	16.05	8.31	8.95	9.31	9.94	11.27
	8H	13.20	13.81	14.22	14.83	16.15	8.40	9.01	9.41	10.02	11.35
	12H	13.26	13.84	14.28	14.85	16.20	8.44	9.02	9.46	10.03	11.38
4H	2H	10.39	11.08	11.39	12.08	13.40	6.94	7.63	7.94	8.63	9.95
	3H	12.22	12.80	13.23	13.82	15.15	8.29	8.87	9.30	9.89	11.22
	4H	12.91	13.44	13.93	14.45	15.81	8.84	9.37	9.86	10.38	11.74
	6H	13.42	13.88	14.45	14.92	16.27	9.26	9.71	10.29	10.75	12.10
	8H	13.60	14.02	14.63	15.05	16.42	9.39	9.81	10.42	10.84	12.21
	12H	13.69	14.07	14.74	15.12	16.49	9.45	9.83	10.50	10.88	12.25
8H	4H	12.88	13.30	13.91	14.33	15.70	9.12	9.54	10.15	10.57	11.94
	6H	13.44	13.79	14.50	14.87	16.23	9.64	9.99	10.69	11.06	12.42
	8H	13.66	13.97	14.72	15.02	16.41	9.83	10.14	10.89	11.19	12.58
	12H	13.80	14.07	14.86	15.12	16.55	9.95	10.22	11.01	11.27	12.70
12H	4H	12.83	13.21	13.88	14.26	15.63	9.12	9.50	10.17	10.55	11.92
	6H	13.42	13.73	14.48	14.78	16.17	9.69	9.99	10.75	11.05	12.43
	8H	13.64	13.91	14.70	14.96	16.39	9.90	10.17	10.96	11.22	12.65

END OF REPORT