

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P915711

Luminaire Tested: DFN2DIP-TR4F0-110D050US927-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P915711
REPORT IS A COMBINATION OF REPORTS P901921 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-110D050US927-FLLONL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12548.1 lumens
Efficiency: N/A
Efficacy: 83.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 150.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9613
Total Harmonic Distortion (THDi): 0.083
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P915711

CATALOG NUMBER: DFN2DIP-TR4F0-110D050US927-FLLONL

Luminous Intensity Polar Plot

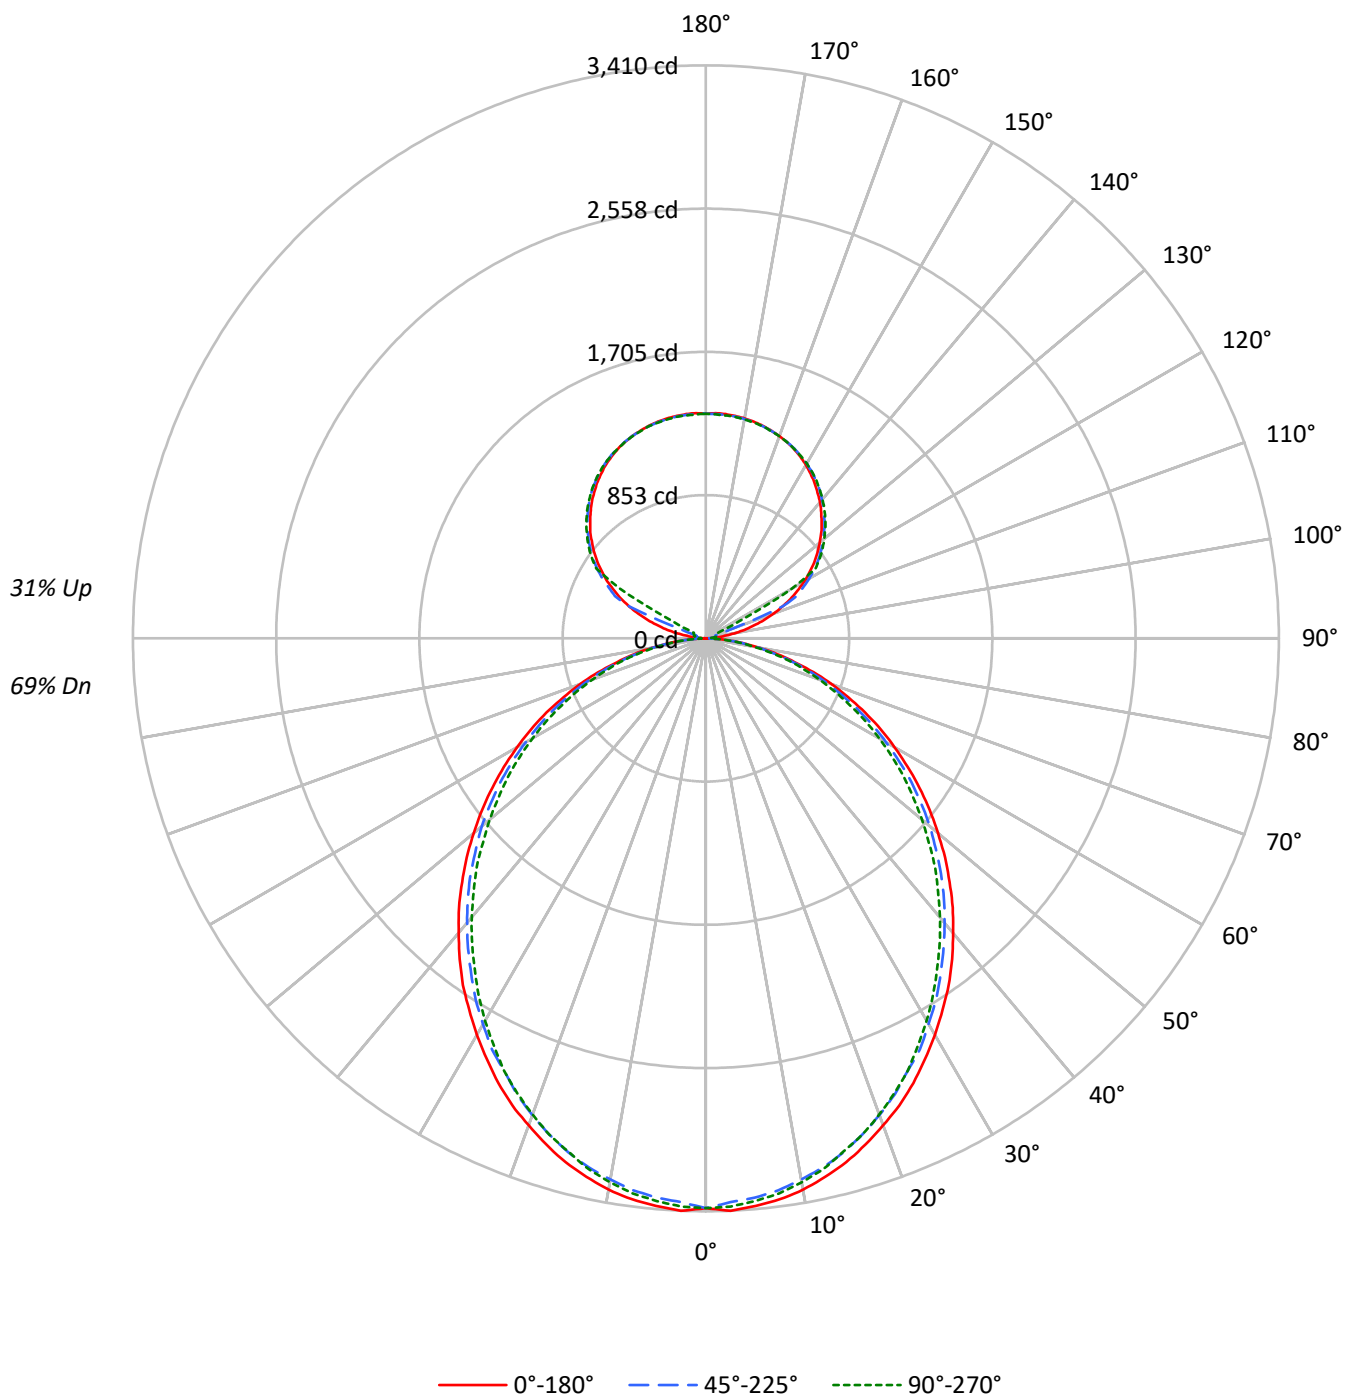

TEST NUMBER: P915711

CATALOG NUMBER: DFN2DIP-TR4F0-110D050US927-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	112	112	112	112	105	105	105	105	94	94	94	83	83	83	73	73	73
1	102	98	94	90	96	92	89	86	82	80	77	73	71	69	65	63	62
2	93	85	79	74	87	81	75	70	72	68	64	64	61	58	57	55	52
3	85	75	67	61	80	71	64	59	64	58	54	57	53	49	51	47	45
4	78	66	58	52	73	63	56	50	57	51	46	51	46	42	45	42	38
5	71	59	51	45	67	56	49	43	51	45	40	46	41	37	41	37	33
6	66	53	45	39	62	51	43	38	46	40	35	41	36	32	37	33	30
7	61	48	40	34	57	46	38	33	42	35	31	38	32	29	34	30	26
8	57	44	36	30	53	42	35	29	38	32	27	35	29	26	31	27	24
9	53	40	33	27	50	38	31	26	35	29	25	32	27	23	29	24	21
10	50	37	30	25	47	35	29	24	32	26	22	29	24	21	27	22	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2694	2694	2694
5°	2698	2656	2674
10°	2676	2620	2638
15°	2637	2577	2581
20°	2584	2517	2523
25°	2531	2446	2456
30°	2464	2379	2371
35°	2402	2300	2281
40°	2324	2221	2195
45°	2247	2141	2107
50°	2163	2057	2005
55°	2075	1960	1912
60°	1975	1846	1805
65°	1866	1727	1679
70°	1728	1582	1543
75°	1536	1408	1417
80°	1305	1187	1177
85°	945	806	781

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2247 cd/sqm

TEST NUMBER: P915711

CATALOG NUMBER: DFN2DIP-TR4F0-110D050US927-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	319.1	2.5
10°-20°	897.9	7.2
20°-30°	1319.6	10.5
30°-40°	1532.6	12.2
40°-50°	1530.7	12.2
50°-60°	1334.7	10.6
60°-70°	986.7	7.9
70°-80°	558.2	4.4
80°-90°	149.7	1.2
90°-100°	44.1	0.4
100°-110°	164.3	1.3
110°-120°	435.8	3.5
120°-130°	722.8	5.8
130°-140°	767.8	6.1
140°-150°	713.6	5.7
150°-160°	573.7	4.6
160°-170°	369.7	2.9
170°-180°	127.2	1.0
0°-30°	2536.6	20.2
0°-40°	4069.2	32.4
0°-60°	6934.6	55.3
0°-90°	8629.2	68.8
90°-120°	644.2	5.1
90°-150°	2848.4	22.7
90°-180°	3919.0	31.2
0°-180°	12548.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3391	3391	3391	3391	3391	
5°	3391	3378	3342	3368	3362	322
15°	3228	3208	3166	3179	3163	909
25°	2921	2895	2840	2846	2840	1344
35°	2520	2488	2436	2416	2400	1574
45°	2051	2028	1979	1943	1930	1583
55°	1552	1532	1493	1454	1438	1388
65°	1047	1027	994	965	949	1035
75°	548	541	525	505	512	585
85°	134	130	127	117	114	149
90°	1	12	19	24	26	12
95°	63	31	38	43	42	74
105°	294	323	59	70	74	314
115°	556	573	597	149	79	548
125°	786	799	817	824	827	701
135°	973	989	997	1007	1005	752
145°	1129	1128	1144	1151	1146	706
155°	1243	1234	1246	1252	1244	573
165°	1310	1304	1307	1314	1307	370
175°	1340	1333	1335	1342	1332	127
180°	1337	1337	1337	1337	1337	

TEST NUMBER: P915711

CATALOG NUMBER: DFN2DIP-TR4F0-110D050US927-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3390.7	3390.7	3390.7	3390.7	3390.7
2.5°	3410.3	3394.1	3358.1	3390.7	3384.4
5°	3390.7	3377.9	3341.9	3367.8	3361.6
7.5°	3367.8	3348.5	3312.5	3338.8	3332.2
10°	3332.2	3309.3	3270.3	3296.2	3286.5
12.5°	3283.1	3263.7	3224.7	3240.9	3234.3
15°	3227.7	3208.3	3165.8	3178.9	3162.7
17.5°	3159.2	3139.9	3097.3	3113.6	3097.3
20°	3084.2	3064.8	3019.2	3028.8	3016.1
22.5°	3009.5	2980.0	2937.5	2937.5	2930.9
25°	2921.2	2895.3	2840.0	2846.2	2840.0
27.5°	2823.3	2800.5	2758.3	2748.6	2732.4
30°	2725.8	2699.5	2650.7	2641.1	2627.9
32.5°	2621.3	2602.0	2549.7	2530.0	2516.8
35°	2520.3	2487.8	2435.6	2415.8	2399.6
37.5°	2406.2	2376.8	2324.6	2301.7	2285.4
40°	2288.9	2262.6	2210.4	2181.4	2168.2
42.5°	2174.8	2148.5	2096.6	2063.7	2044.4
45°	2051.0	2028.1	1978.9	1943.4	1930.2
47.5°	1930.2	1907.4	1855.1	1819.2	1799.8
50°	1802.9	1786.7	1741.0	1695.3	1679.1
52.5°	1679.1	1656.2	1614.1	1578.0	1555.2
55°	1552.1	1532.4	1493.3	1454.2	1438.0
57.5°	1424.8	1408.6	1366.0	1326.9	1313.8
60°	1297.5	1284.8	1239.1	1203.1	1193.4
62.5°	1173.7	1150.9	1118.3	1085.8	1072.7
65°	1046.7	1027.0	994.5	965.1	948.9
67.5°	916.3	899.8	870.7	847.9	834.7
70°	795.6	782.4	753.0	730.2	717.4
72.5°	671.8	658.6	642.4	619.6	609.8
75°	547.6	541.4	524.7	505.4	512.0
77.5°	436.9	423.7	417.2	407.5	397.8
80°	326.2	322.7	316.2	306.5	299.9
82.5°	221.7	221.7	218.6	205.5	205.5
85°	133.6	130.4	127.3	117.2	114.2
87.5°	58.8	52.2	45.6	36.0	32.5
90°	1.0	11.6	19.3	24.2	26.1
92.5°	24.2	20.4	23.2	25.2	26.1
95°	62.8	30.9	37.7	42.6	41.6
97.5°	113.1	33.9	49.3	52.3	53.2
100°	171.3	38.7	55.1	62.8	64.8
102.5°	235.0	233.1	57.1	67.7	70.7
105°	294.1	323.1	59.0	69.6	73.5
107.5°	362.7	386.8	61.0	71.5	75.5
110°	428.6	448.8	169.3	72.6	76.4



TEST NUMBER: P915711

CATALOG NUMBER: DFN2DIP-TR4F0-110D050US927-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	490.4	507.8	491.4	74.5	77.4
115°	556.2	572.6	596.8	149.0	79.4
117.5°	613.2	632.6	649.1	510.6	257.3
120°	677.1	691.6	709.0	720.6	590.0
122.5°	731.2	746.7	766.1	771.9	772.9
125°	786.3	799.0	817.4	824.1	827.0
127.5°	836.6	850.2	864.8	874.4	875.4
130°	884.1	899.6	910.1	920.8	920.0
132.5°	932.5	945.1	955.6	964.4	963.5
135°	973.1	988.6	997.2	1007.0	1005.0
137.5°	1015.6	1027.2	1037.0	1046.6	1043.8
140°	1057.2	1065.0	1075.5	1084.3	1079.5
142.5°	1092.1	1098.9	1111.4	1119.1	1114.3
145°	1128.9	1127.8	1144.2	1151.0	1146.2
147.5°	1160.7	1157.8	1174.3	1179.1	1175.3
150°	1191.7	1184.9	1200.4	1206.2	1201.3
152.5°	1217.7	1210.1	1224.6	1230.4	1223.6
155°	1242.9	1234.3	1245.9	1251.6	1244.0
157.5°	1263.2	1255.5	1264.2	1271.1	1263.2
160°	1280.7	1274.9	1280.7	1286.4	1279.7
162.5°	1296.1	1290.4	1295.1	1301.9	1293.2
165°	1309.6	1303.9	1306.8	1313.5	1306.8
167.5°	1320.3	1314.5	1317.5	1324.2	1315.5
170°	1329.0	1323.2	1325.2	1331.9	1323.2
172.5°	1334.8	1329.0	1331.0	1337.8	1329.0
175°	1339.7	1332.8	1334.8	1341.6	1331.9
177.5°	1341.6	1334.8	1335.9	1342.6	1333.9
180°	1336.7	1336.7	1336.7	1336.7	1336.7

TEST NUMBER: P915711

CATALOG NUMBER: DFN2DIP-TR4F0-110D050US927-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.28	13.34	13.06	14.14	15.12	11.85	12.91	12.63	13.71	14.69
	3H	13.96	14.91	14.75	15.72	16.73	13.49	14.44	14.28	15.25	16.25
	4H	14.56	15.45	15.36	16.27	17.29	14.08	14.98	14.89	15.80	16.82
	6H	14.97	15.79	15.79	16.62	17.65	14.49	15.32	15.31	16.15	17.18
	8H	15.08	15.87	15.91	16.71	17.74	14.60	15.39	15.43	16.24	17.27
	12H	15.13	15.88	15.97	16.72	17.78	14.65	15.40	15.49	16.24	17.30
4H	2H	12.77	13.67	13.58	14.49	15.50	12.42	13.32	13.24	14.14	15.16
	3H	14.65	15.40	15.48	16.26	17.29	14.26	15.01	15.08	15.86	16.89
	4H	15.38	16.06	16.21	16.91	17.97	14.97	15.65	15.81	16.50	17.56
	6H	15.90	16.49	16.76	17.37	18.43	15.49	16.08	16.35	16.96	18.02
	8H	16.06	16.61	16.91	17.48	18.55	15.64	16.20	16.50	17.07	18.14
	12H	16.14	16.64	17.02	17.53	18.61	15.72	16.21	16.59	17.10	18.19
8H	4H	15.59	16.14	16.45	17.01	18.09	15.23	15.78	16.08	16.65	17.73
	6H	16.23	16.69	17.11	17.60	18.67	15.86	16.32	16.75	17.23	18.31
	8H	16.45	16.86	17.35	17.76	18.86	16.08	16.49	16.98	17.39	18.49
	12H	16.59	16.95	17.49	17.85	18.99	16.21	16.56	17.11	17.46	18.61
12H	4H	15.58	16.08	16.46	16.97	18.05	15.23	15.73	16.11	16.62	17.70
	6H	16.26	16.67	17.15	17.57	18.66	15.91	16.31	16.80	17.22	18.31
	8H	16.51	16.87	17.41	17.77	18.91	16.15	16.51	17.05	17.41	18.56

END OF REPORT