

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P918270

Luminaire Tested: DFN2DIP-TR4F0-060D080US930-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P918270
REPORT IS A COMBINATION OF REPORTS P900445 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-060D080US930-FLLFLL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10615.2 lumens
Efficiency: N/A
Efficacy: 94.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 112.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P918270

CATALOG NUMBER: DFN2DIP-TR4F0-060D080US930-FLLFLL

Luminous Intensity Polar Plot

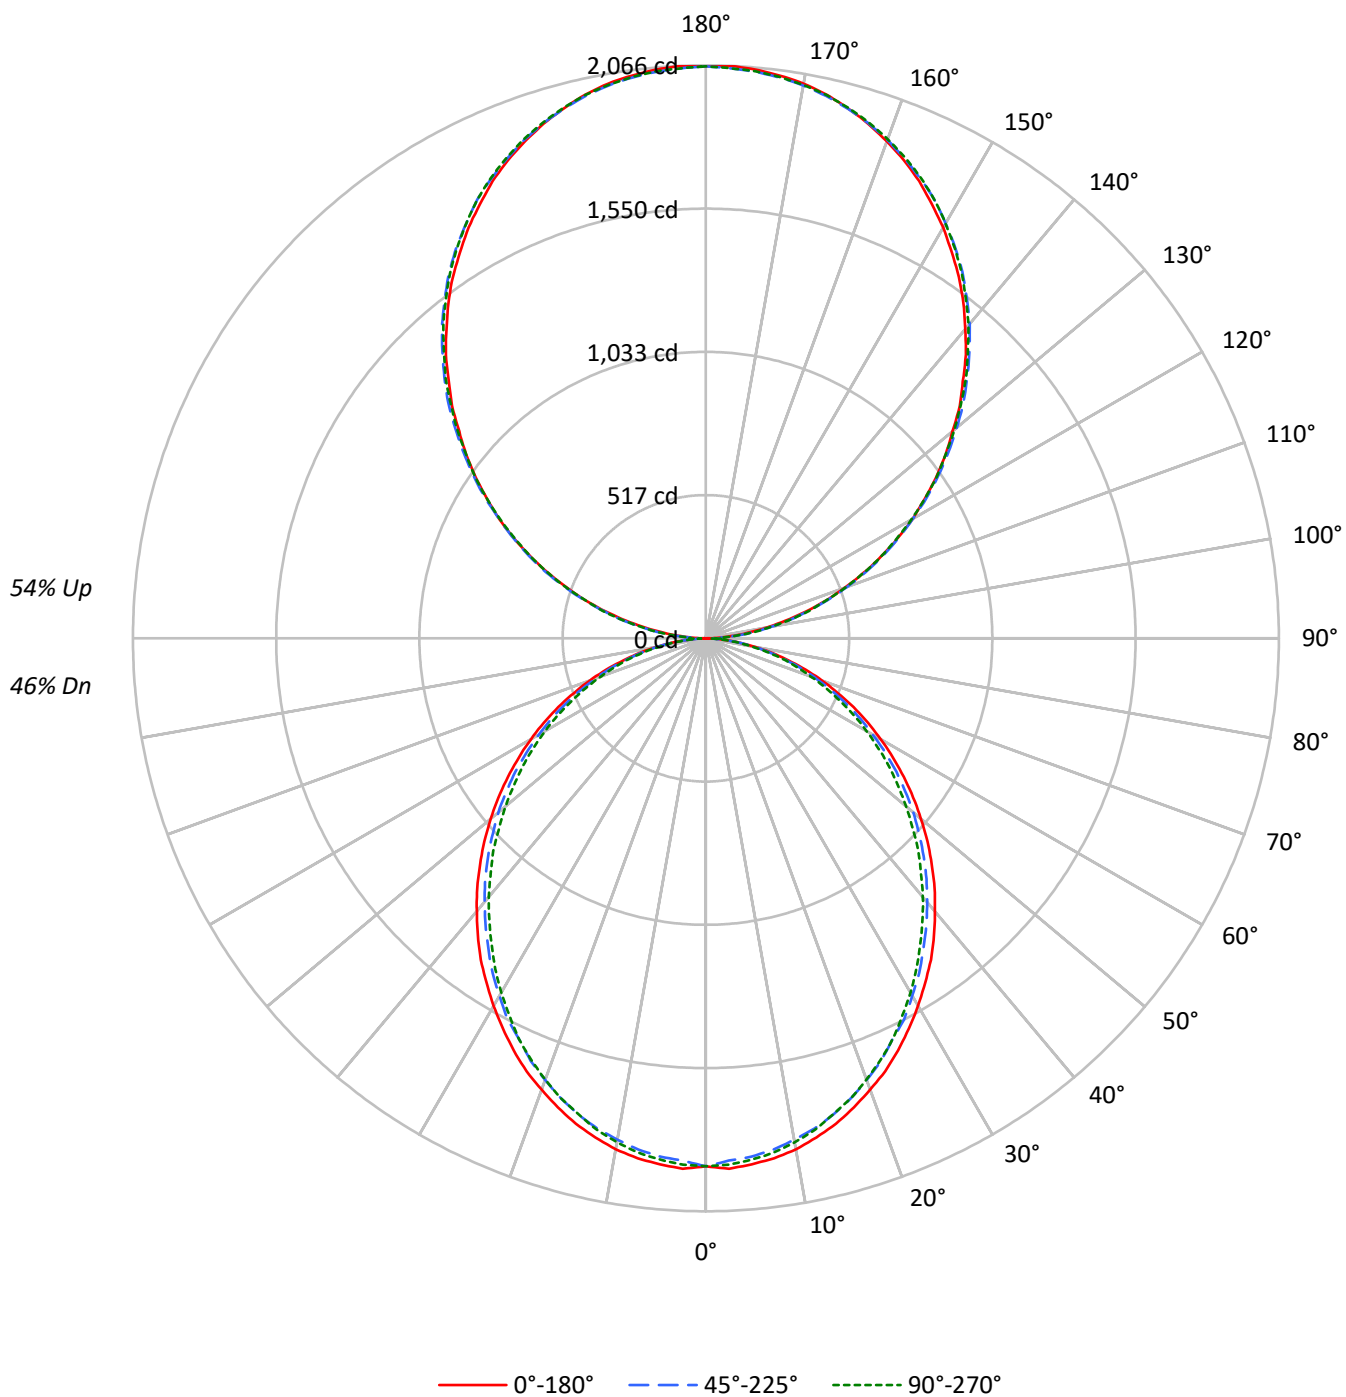

TEST NUMBER: P918270

CATALOG NUMBER: DFN2DIP-TR4F0-060D080US930-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	81	81	81	66	66	66	52	52	52
1	97	93	89	85	89	85	82	79	71	69	66	58	56	55	46	45	44
2	88	81	75	70	81	74	69	65	62	58	55	51	48	46	41	39	37
3	80	71	64	58	73	65	59	54	55	50	46	45	42	39	36	34	32
4	74	63	55	49	67	58	51	46	49	43	39	40	36	33	32	29	27
5	67	56	48	42	62	52	45	39	44	38	34	36	32	29	29	26	24
6	62	50	42	36	57	46	39	34	39	34	30	33	28	25	26	23	21
7	57	45	37	32	53	42	35	30	36	30	26	30	25	22	24	21	19
8	53	41	33	28	49	38	31	26	32	27	23	27	23	20	22	19	17
9	50	37	30	25	45	35	28	24	30	24	21	25	21	18	20	17	15
10	46	34	27	22	42	32	25	21	27	22	19	23	19	16	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1512	1512	1512
5°	1515	1491	1501
10°	1502	1471	1481
15°	1480	1447	1449
20°	1450	1413	1416
25°	1421	1373	1379
30°	1384	1335	1331
35°	1348	1291	1280
40°	1305	1247	1232
45°	1262	1202	1183
50°	1214	1155	1126
55°	1165	1101	1073
60°	1109	1036	1013
65°	1048	969	942
70°	970	888	866
75°	862	791	796
80°	733	666	661
85°	530	452	438

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1608 cd/sqm

TEST NUMBER: P918270

CATALOG NUMBER: DFN2DIP-TR4F0-060D080US930-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	179.1	1.7
10°-20°	504.1	4.7
20°-30°	740.8	7.0
30°-40°	860.4	8.1
40°-50°	859.3	8.1
50°-60°	749.3	7.1
60°-70°	553.9	5.2
70°-80°	313.4	3.0
80°-90°	88.6	0.8
90°-100°	127.6	1.2
100°-110°	405.6	3.8
110°-120°	694.1	6.5
120°-130°	912.8	8.6
130°-140°	1024.6	9.7
140°-150°	1004.7	9.5
150°-160°	842.8	7.9
160°-170°	558.9	5.3
170°-180°	195.4	1.8
0°-30°	1424.0	13.4
0°-40°	2284.3	21.5
0°-60°	3892.9	36.7
0°-90°	4848.7	45.7
90°-120°	1227.3	11.6
90°-150°	4169.4	39.3
90°-180°	5766.0	54.3
0°-180°	10615.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1903	1903	1903	1903	1903	
5°	1903	1896	1876	1891	1887	181
15°	1812	1801	1777	1785	1776	510
25°	1640	1625	1594	1598	1594	755
35°	1415	1397	1367	1356	1347	884
45°	1151	1138	1111	1091	1084	889
55°	871	860	838	816	807	779
65°	588	577	558	542	533	581
75°	307	304	295	284	287	328
85°	75	73	71	66	64	84
90°	2	22	61	57	59	10
95°	91	108	111	111	108	101
105°	374	379	383	386	386	395
115°	696	706	703	702	696	689
125°	1013	1029	1024	1018	1016	905
135°	1310	1330	1333	1332	1326	1013
145°	1591	1603	1613	1615	1608	994
155°	1819	1824	1830	1838	1833	837
165°	1979	1977	1977	1989	1981	558
175°	2059	2054	2050	2063	2052	196
180°	2063	2063	2063	2063	2063	

TEST NUMBER: P918270

CATALOG NUMBER: DFN2DIP-TR4F0-060D080US930-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1903.4	1903.4	1903.4	1903.4	1903.4
2.5°	1914.5	1905.4	1885.1	1903.4	1899.9
5°	1903.4	1896.2	1876.0	1890.6	1887.1
7.5°	1890.6	1879.8	1859.5	1874.3	1870.6
10°	1870.6	1857.8	1835.8	1850.4	1844.9
12.5°	1843.1	1832.1	1810.2	1819.3	1815.7
15°	1811.9	1801.1	1777.2	1784.6	1775.5
17.5°	1773.5	1762.7	1738.8	1747.8	1738.8
20°	1731.4	1720.5	1694.8	1700.3	1693.1
22.5°	1689.5	1672.9	1649.0	1649.0	1645.4
25°	1639.9	1625.4	1594.2	1597.7	1594.2
27.5°	1584.9	1572.1	1548.4	1543.0	1533.9
30°	1530.2	1515.4	1488.1	1482.6	1475.2
32.5°	1471.5	1460.7	1431.3	1420.2	1412.9
35°	1414.9	1396.6	1367.3	1356.2	1347.0
37.5°	1350.8	1334.2	1305.0	1292.1	1283.0
40°	1284.9	1270.2	1240.9	1224.6	1217.2
42.5°	1220.8	1206.1	1177.0	1158.5	1147.6
45°	1151.4	1138.5	1110.9	1091.0	1083.5
47.5°	1083.5	1070.7	1041.5	1021.2	1010.3
50°	1012.1	1003.0	977.4	951.7	942.6
52.5°	942.6	929.8	906.0	885.9	873.1
55°	871.3	860.2	838.3	816.4	807.2
57.5°	799.9	790.8	766.9	744.9	737.5
60°	728.4	721.2	695.6	675.4	669.9
62.5°	658.8	646.0	627.8	609.5	602.2
65°	587.6	576.6	558.3	541.8	532.6
67.5°	514.4	505.1	488.8	476.0	468.6
70°	446.6	439.3	422.7	409.9	402.8
72.5°	377.1	369.7	360.6	347.8	342.3
75°	307.4	303.9	294.6	283.7	287.4
77.5°	245.2	237.9	234.2	228.8	223.3
80°	183.1	181.2	177.5	172.0	168.4
82.5°	124.5	124.5	122.7	115.4	115.4
85°	74.9	73.2	71.4	65.8	64.1
87.5°	33.0	29.4	25.6	20.2	18.3
90°	1.9	22.4	61.0	57.2	59.1
92.5°	38.6	52.3	54.1	55.9	55.9
95°	90.8	108.2	111.3	111.3	108.2
97.5°	151.2	167.3	174.1	174.1	174.1
100°	220.8	235.1	240.0	240.0	238.1
102.5°	294.2	304.8	311.5	313.4	311.5
105°	374.4	379.4	383.1	386.2	386.2
107.5°	454.0	461.5	461.5	462.7	454.0
110°	531.1	541.0	541.0	541.0	536.1

TEST NUMBER: P918270

CATALOG NUMBER: DFN2DIP-TR4F0-060D080US930-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	614.4	625.0	623.1	618.2	614.4
115°	696.5	706.5	703.4	701.5	696.5
117.5°	778.0	791.7	782.9	778.0	773.0
120°	860.1	873.8	860.1	860.1	854.4
122.5°	934.7	952.1	943.4	938.4	934.7
125°	1013.0	1028.6	1023.6	1018.0	1016.2
127.5°	1089.6	1108.8	1102.0	1094.5	1089.6
130°	1161.1	1183.4	1180.3	1176.6	1169.8
132.5°	1241.3	1258.7	1260.0	1251.2	1246.3
135°	1310.3	1329.6	1333.3	1331.5	1326.5
137.5°	1387.4	1403.0	1406.1	1404.8	1397.3
140°	1455.2	1470.7	1479.4	1479.4	1472.6
142.5°	1524.9	1540.4	1545.4	1547.3	1540.4
145°	1590.8	1603.2	1613.1	1615.0	1608.2
147.5°	1649.8	1665.4	1672.8	1676.0	1669.2
150°	1710.8	1721.3	1728.2	1733.8	1728.2
152.5°	1764.9	1775.5	1784.2	1791.0	1784.2
155°	1819.0	1824.0	1829.6	1838.3	1832.7
157.5°	1865.6	1869.4	1872.5	1884.9	1876.2
160°	1907.3	1911.1	1912.9	1923.5	1916.0
162.5°	1945.9	1945.9	1947.7	1959.6	1950.8
165°	1978.8	1976.9	1976.9	1989.4	1980.7
167.5°	2008.7	2003.1	2003.1	2015.5	2006.8
170°	2031.1	2026.1	2024.2	2036.7	2026.1
172.5°	2046.6	2041.7	2039.8	2052.2	2041.7
175°	2059.0	2054.1	2050.3	2062.8	2052.2
177.5°	2065.9	2060.9	2057.2	2067.8	2057.2
180°	2062.8	2062.8	2062.8	2062.8	2062.8

TEST NUMBER: P918270

CATALOG NUMBER: DFN2DIP-TR4F0-060D080US930-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.29	9.11	9.28	10.12	11.45	7.86	8.68	8.85	9.69	11.02
	3H	9.95	10.68	10.95	11.70	13.05	9.47	10.21	10.48	11.23	12.58
	4H	10.53	11.23	11.55	12.25	13.61	10.06	10.76	11.08	11.78	13.14
	6H	10.93	11.57	11.96	12.60	13.97	10.45	11.10	11.48	12.12	13.49
	8H	11.03	11.65	12.07	12.68	14.05	10.56	11.17	11.59	12.21	13.58
	12H	11.08	11.66	12.12	12.69	14.09	10.60	11.18	11.64	12.21	13.61
4H	2H	8.75	9.45	9.77	10.46	11.82	8.40	9.10	9.42	10.12	11.48
	3H	10.61	11.19	11.64	12.24	13.61	10.22	10.80	11.25	11.84	13.22
	4H	11.32	11.86	12.36	12.89	14.29	10.91	11.45	11.95	12.49	13.88
	6H	11.83	12.29	12.88	13.35	14.75	11.42	11.88	12.47	12.94	14.34
	8H	11.98	12.41	13.03	13.47	14.87	11.57	12.00	12.62	13.05	14.46
	12H	12.05	12.44	13.12	13.51	14.92	11.63	12.02	12.70	13.09	14.50
8H	4H	11.51	11.94	12.56	13.00	14.40	11.15	11.58	12.20	12.64	14.04
	6H	12.14	12.50	13.22	13.59	15.00	11.78	12.14	12.85	13.23	14.64
	8H	12.36	12.68	13.44	13.76	15.18	12.00	12.31	13.08	13.39	14.81
	12H	12.49	12.77	13.58	13.84	15.31	12.11	12.38	13.19	13.46	14.92
12H	4H	11.50	11.89	12.57	12.95	14.37	11.15	11.53	12.21	12.60	14.01
	6H	12.17	12.49	13.25	13.57	14.99	11.82	12.13	12.90	13.21	14.64
	8H	12.41	12.69	13.50	13.76	15.23	12.06	12.33	13.14	13.41	14.87