

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P918285

Luminaire Tested: DFN2DIP-TR4F0-060D110US930-RLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P918285
REPORT IS A COMBINATION OF REPORTS P902020 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-060D110US930-RLLONL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13036.6 lumens
Efficiency: N/A
Efficacy: 94.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 138.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P918285

CATALOG NUMBER: DFN2DIP-TR4F0-060D110US930-RLLONL

Luminous Intensity Polar Plot

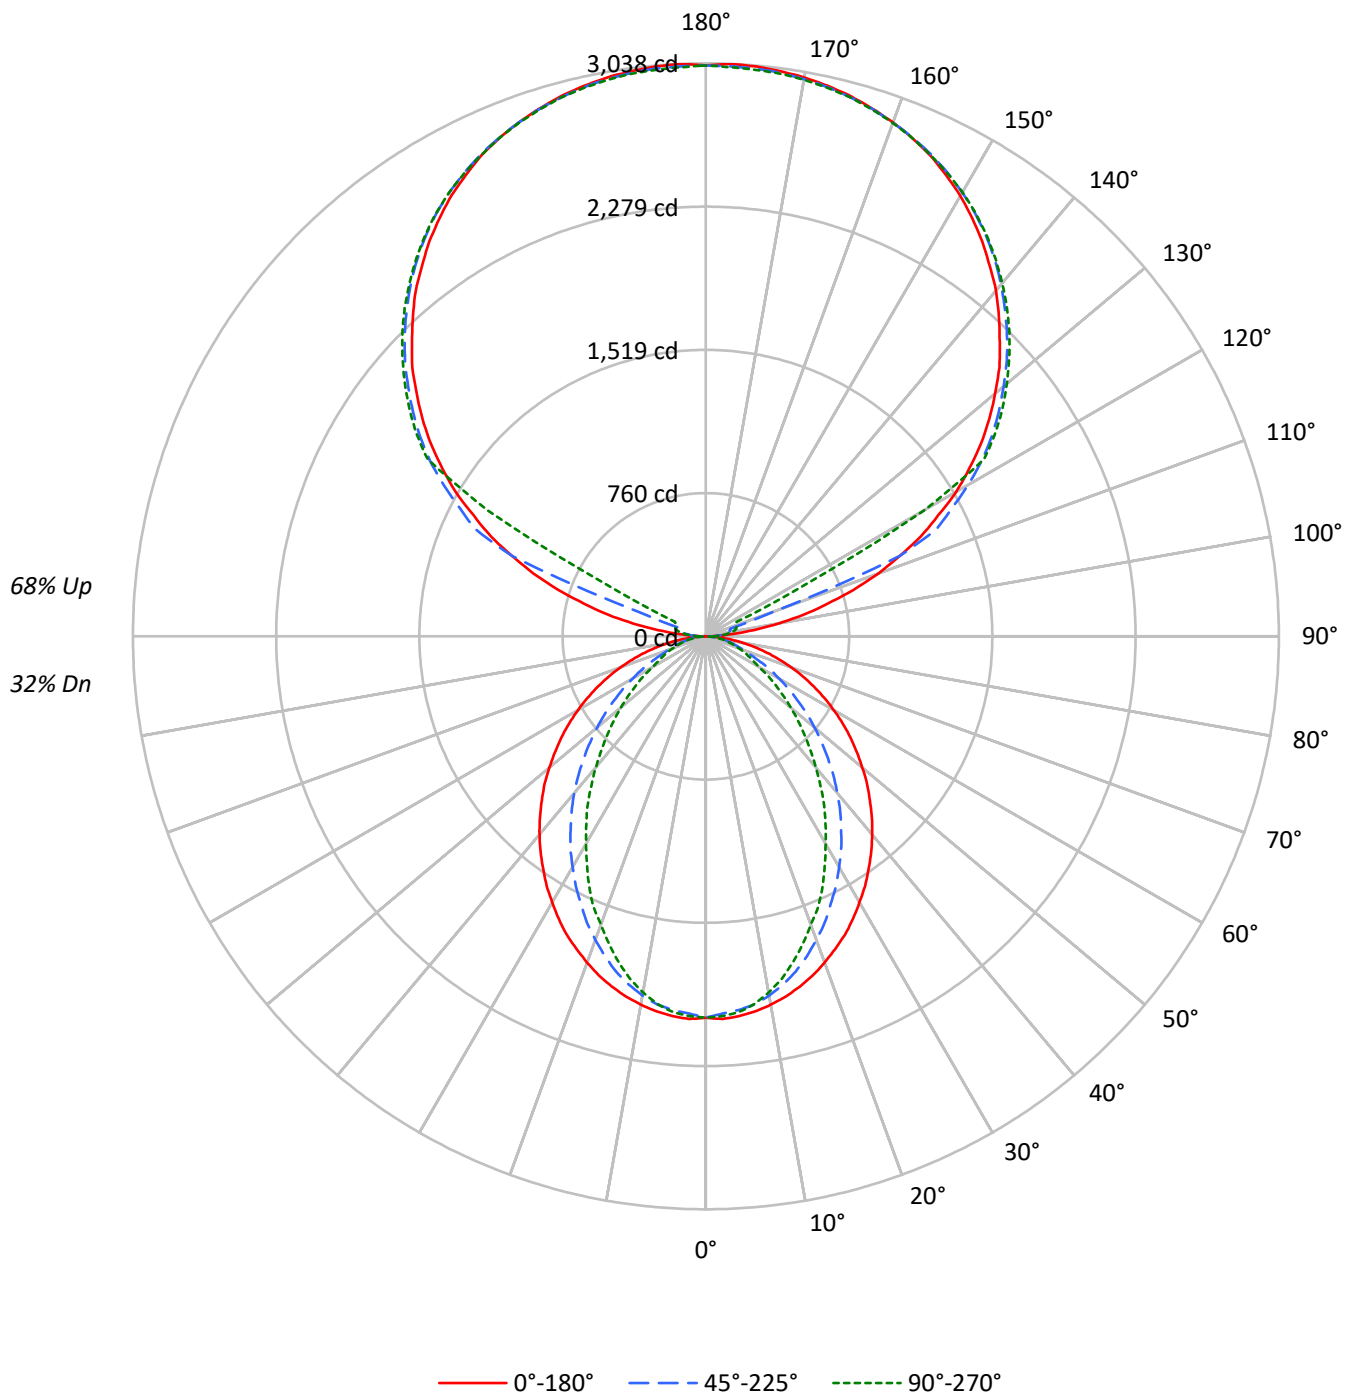

TEST NUMBER: P918285

CATALOG NUMBER: DFN2DIP-TR4F0-060D110US930-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	103	103	103	103	93	93	93	93	73	73	73	56	56	56	40	40	40
1	94	90	86	83	85	81	78	75	65	63	61	49	48	47	35	35	34
2	86	79	73	68	77	71	66	62	57	54	51	44	42	40	31	30	29
3	78	70	63	57	70	63	57	52	50	46	43	39	36	34	28	26	25
4	72	62	54	48	64	56	49	44	45	40	37	35	32	29	25	23	22
5	66	55	47	42	59	50	43	38	40	35	32	31	28	25	23	21	19
6	61	49	42	36	55	45	38	33	36	31	28	28	25	22	21	19	17
7	56	44	37	32	51	41	34	29	33	28	24	26	22	20	19	17	15
8	52	40	33	28	47	37	30	26	30	25	22	24	20	18	18	15	14
9	48	37	30	25	44	34	27	23	27	23	19	22	18	16	16	14	12
10	45	34	27	22	41	31	25	21	25	21	17	20	17	14	15	13	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1606	1606	1606
5°	1609	1581	1591
10°	1593	1550	1539
15°	1571	1498	1459
20°	1542	1428	1361
25°	1512	1349	1266
30°	1472	1267	1145
35°	1433	1180	1040
40°	1393	1090	919
45°	1347	990	809
50°	1300	889	702
55°	1250	781	598
60°	1192	668	493
65°	1126	553	443
70°	1045	446	401
75°	944	393	365
80°	797	329	316
85°	556	220	237

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1606 cd/sqm

TEST NUMBER: P918285

CATALOG NUMBER: DFN2DIP-TR4F0-060D110US930-RLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	189.5	1.5
10°-20°	520.2	4.0
20°-30°	730.3	5.6
30°-40°	796.1	6.1
40°-50°	731.7	5.6
50°-60°	574.6	4.4
60°-70°	374.0	2.9
70°-80°	192.5	1.5
80°-90°	54.5	0.4
90°-100°	99.8	0.8
100°-110°	372.1	2.9
110°-120°	986.7	7.6
120°-130°	1636.6	12.6
130°-140°	1738.4	13.3
140°-150°	1615.7	12.4
150°-160°	1298.9	10.0
160°-170°	837.0	6.4
170°-180°	288.1	2.2
0°-30°	1439.9	11.0
0°-40°	2236.0	17.2
0°-60°	3542.3	27.2
0°-90°	4163.3	31.9
90°-120°	1458.6	11.2
90°-150°	6449.2	49.5
90°-180°	8873.0	68.1
0°-180°	13036.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2022	2022	2022	2022	2022	
5°	2022	2013	1989	2005	2000	192
15°	1923	1903	1841	1806	1788	542
25°	1746	1687	1566	1491	1464	803
35°	1504	1411	1250	1134	1094	941
45°	1230	1107	915	785	741	950
55°	935	792	595	485	450	835
65°	631	483	318	256	251	626
75°	337	208	146	134	132	356
85°	79	40	35	35	35	90
90°	2	26	44	55	59	12
95°	142	70	85	96	94	169
105°	666	732	134	158	166	711
115°	1259	1296	1351	337	180	1240
125°	1780	1809	1851	1866	1872	1588
135°	2203	2238	2258	2280	2276	1702
145°	2556	2554	2591	2606	2595	1599
155°	2814	2795	2821	2834	2816	1297
165°	2965	2952	2959	2974	2959	838
175°	3033	3018	3022	3038	3016	289
180°	3027	3027	3027	3027	3027	

TEST NUMBER: P918285

CATALOG NUMBER: DFN2DIP-TR4F0-060D110US930-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2021.8	2021.8	2021.8	2021.8	2021.8
2.5°	2030.9	2021.8	2001.6	2020.0	2016.3
5°	2021.8	2012.6	1988.8	2005.3	1999.8
7.5°	2005.3	1994.4	1968.8	1976.0	1966.8
10°	1983.3	1970.5	1934.1	1928.4	1917.5
12.5°	1956.0	1939.4	1889.9	1879.1	1858.9
15°	1923.0	1902.7	1840.6	1805.9	1787.6
17.5°	1884.6	1855.2	1778.3	1738.1	1708.9
20°	1840.6	1803.9	1712.5	1666.9	1626.5
22.5°	1793.1	1750.9	1644.8	1582.7	1555.3
25°	1745.6	1686.9	1566.2	1491.3	1463.7
27.5°	1688.9	1626.5	1493.0	1407.0	1364.9
30°	1628.5	1558.8	1412.4	1319.2	1269.7
32.5°	1569.9	1485.6	1335.8	1225.9	1180.1
35°	1504.1	1410.7	1249.8	1134.4	1094.0
37.5°	1440.0	1339.2	1169.2	1042.8	997.2
40°	1372.2	1262.6	1084.9	955.0	907.5
42.5°	1302.8	1185.7	1000.9	865.4	819.8
45°	1229.6	1106.8	914.9	784.8	740.9
47.5°	1160.1	1030.2	832.6	702.5	662.3
50°	1083.2	953.3	752.0	625.7	587.4
52.5°	1008.0	870.8	675.1	554.4	519.7
55°	934.9	792.2	594.6	484.9	450.1
57.5°	860.0	713.5	523.3	420.9	391.5
60°	783.1	636.7	448.3	355.1	325.7
62.5°	708.2	561.8	384.2	296.4	281.8
65°	631.3	483.0	318.4	256.2	250.6
67.5°	558.1	409.8	256.2	225.0	219.6
70°	481.2	338.5	212.1	194.0	186.5
72.5°	408.1	272.6	177.4	162.9	159.1
75°	336.6	208.5	146.3	133.5	131.8
77.5°	265.4	148.1	115.3	107.9	104.3
80°	199.3	106.2	87.7	80.6	80.6
82.5°	139.0	71.4	60.3	56.7	56.7
85°	78.6	40.2	34.7	34.7	34.7
87.5°	29.4	14.6	14.6	12.8	12.8
90°	2.1	26.3	43.7	54.9	59.0
92.5°	54.9	46.1	52.5	57.0	59.0
95°	142.3	70.0	85.3	96.4	94.2
97.5°	256.2	76.7	111.5	118.3	120.4
100°	387.8	87.6	124.8	142.3	146.7
102.5°	532.1	527.9	129.2	153.2	160.0
105°	665.8	731.6	133.7	157.6	166.5
107.5°	821.3	875.9	138.1	162.0	170.9
110°	970.3	1016.1	383.4	164.4	172.9

TEST NUMBER: P918285

CATALOG NUMBER: DFN2DIP-TR4F0-060D110US930-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1110.5	1149.7	1112.6	168.5	175.3
115°	1259.2	1296.4	1351.4	337.3	179.7
117.5°	1388.5	1432.2	1469.7	1156.3	582.5
120°	1533.1	1565.9	1605.4	1631.7	1335.9
122.5°	1655.6	1690.7	1734.6	1747.7	1750.0
125°	1780.4	1809.1	1850.6	1866.0	1872.5
127.5°	1894.3	1925.0	1958.0	1979.9	1982.0
130°	2001.7	2036.9	2060.7	2085.0	2082.9
132.5°	2111.2	2139.8	2163.8	2183.5	2181.5
135°	2203.3	2238.4	2257.9	2280.1	2275.6
137.5°	2299.5	2325.8	2347.9	2369.7	2363.2
140°	2393.7	2411.3	2435.3	2455.0	2444.1
142.5°	2472.7	2488.0	2516.4	2533.9	2522.9
145°	2556.0	2553.6	2590.8	2606.2	2595.3
147.5°	2628.0	2621.5	2658.7	2669.6	2661.1
150°	2698.2	2682.9	2718.0	2731.0	2720.1
152.5°	2757.3	2739.8	2772.6	2785.9	2770.5
155°	2814.2	2794.7	2820.9	2834.0	2816.5
157.5°	2860.2	2842.8	2862.6	2877.9	2860.2
160°	2899.8	2886.5	2899.8	2912.7	2897.4
162.5°	2934.6	2921.6	2932.5	2947.9	2928.1
165°	2965.3	2952.3	2958.8	2974.1	2958.8
167.5°	2989.5	2976.2	2983.0	2998.3	2978.6
170°	3009.3	2996.0	3000.4	3015.8	2996.0
172.5°	3022.2	3009.3	3013.7	3029.0	3009.3
175°	3033.2	3017.8	3022.2	3037.6	3015.8
177.5°	3037.6	3022.2	3024.6	3039.9	3020.2
180°	3026.7	3026.7	3026.7	3026.7	3026.7

TEST NUMBER: P918285

CATALOG NUMBER: DFN2DIP-TR4F0-060D110US930-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.82	7.52	7.92	8.61	10.12	2.79	3.49	3.89	4.59	6.10
	3H	8.48	9.11	9.59	10.21	11.74	3.97	4.60	5.08	5.70	7.23
	4H	9.08	9.68	10.21	10.79	12.32	4.41	5.01	5.54	6.11	7.65
	6H	9.50	10.05	10.63	11.16	12.70	4.73	5.28	5.86	6.39	7.93
	8H	9.62	10.14	10.76	11.27	12.80	4.82	5.34	5.95	6.46	8.00
	12H	9.68	10.17	10.82	11.29	12.85	4.86	5.35	5.99	6.47	8.03
4H	2H	6.82	7.41	7.95	8.52	10.05	3.37	3.96	4.50	5.07	6.60
	3H	8.63	9.13	9.77	10.26	11.81	4.71	5.20	5.84	6.34	7.88
	4H	9.32	9.78	10.46	10.90	12.46	5.25	5.71	6.39	6.83	8.39
	6H	9.83	10.22	10.97	11.36	12.92	5.66	6.05	6.81	7.20	8.75
	8H	10.00	10.37	11.15	11.50	13.07	5.79	6.16	6.94	7.29	8.86
	12H	10.09	10.42	11.25	11.57	13.15	5.85	6.18	7.01	7.33	8.91
8H	4H	9.28	9.64	10.42	10.78	12.35	5.52	5.89	6.67	7.02	8.59
	6H	9.84	10.14	11.01	11.32	12.89	6.04	6.34	7.20	7.51	9.08
	8H	10.06	10.32	11.23	11.48	13.07	6.23	6.49	7.40	7.65	9.24
	12H	10.19	10.42	11.36	11.57	13.20	6.34	6.57	7.52	7.73	9.35
12H	4H	9.23	9.56	10.39	10.70	12.28	5.52	5.85	6.68	7.00	8.57
	6H	9.82	10.08	10.99	11.24	12.82	6.09	6.35	7.26	7.50	9.09
	8H	10.03	10.26	11.20	11.42	13.04	6.29	6.52	7.46	7.68	9.30

END OF REPORT