

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P918298

Luminaire Tested: DFN2DIP-TR4F0-070D060US930-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P918298
REPORT IS A COMBINATION OF REPORTS P900411 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-070D060US930-FLLFLL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9979.3 lumens
Efficiency: N/A
Efficacy: 90.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 110.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9977
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P918298

CATALOG NUMBER: DFN2DIP-TR4F0-070D060US930-FLLFLL

Luminous Intensity Polar Plot

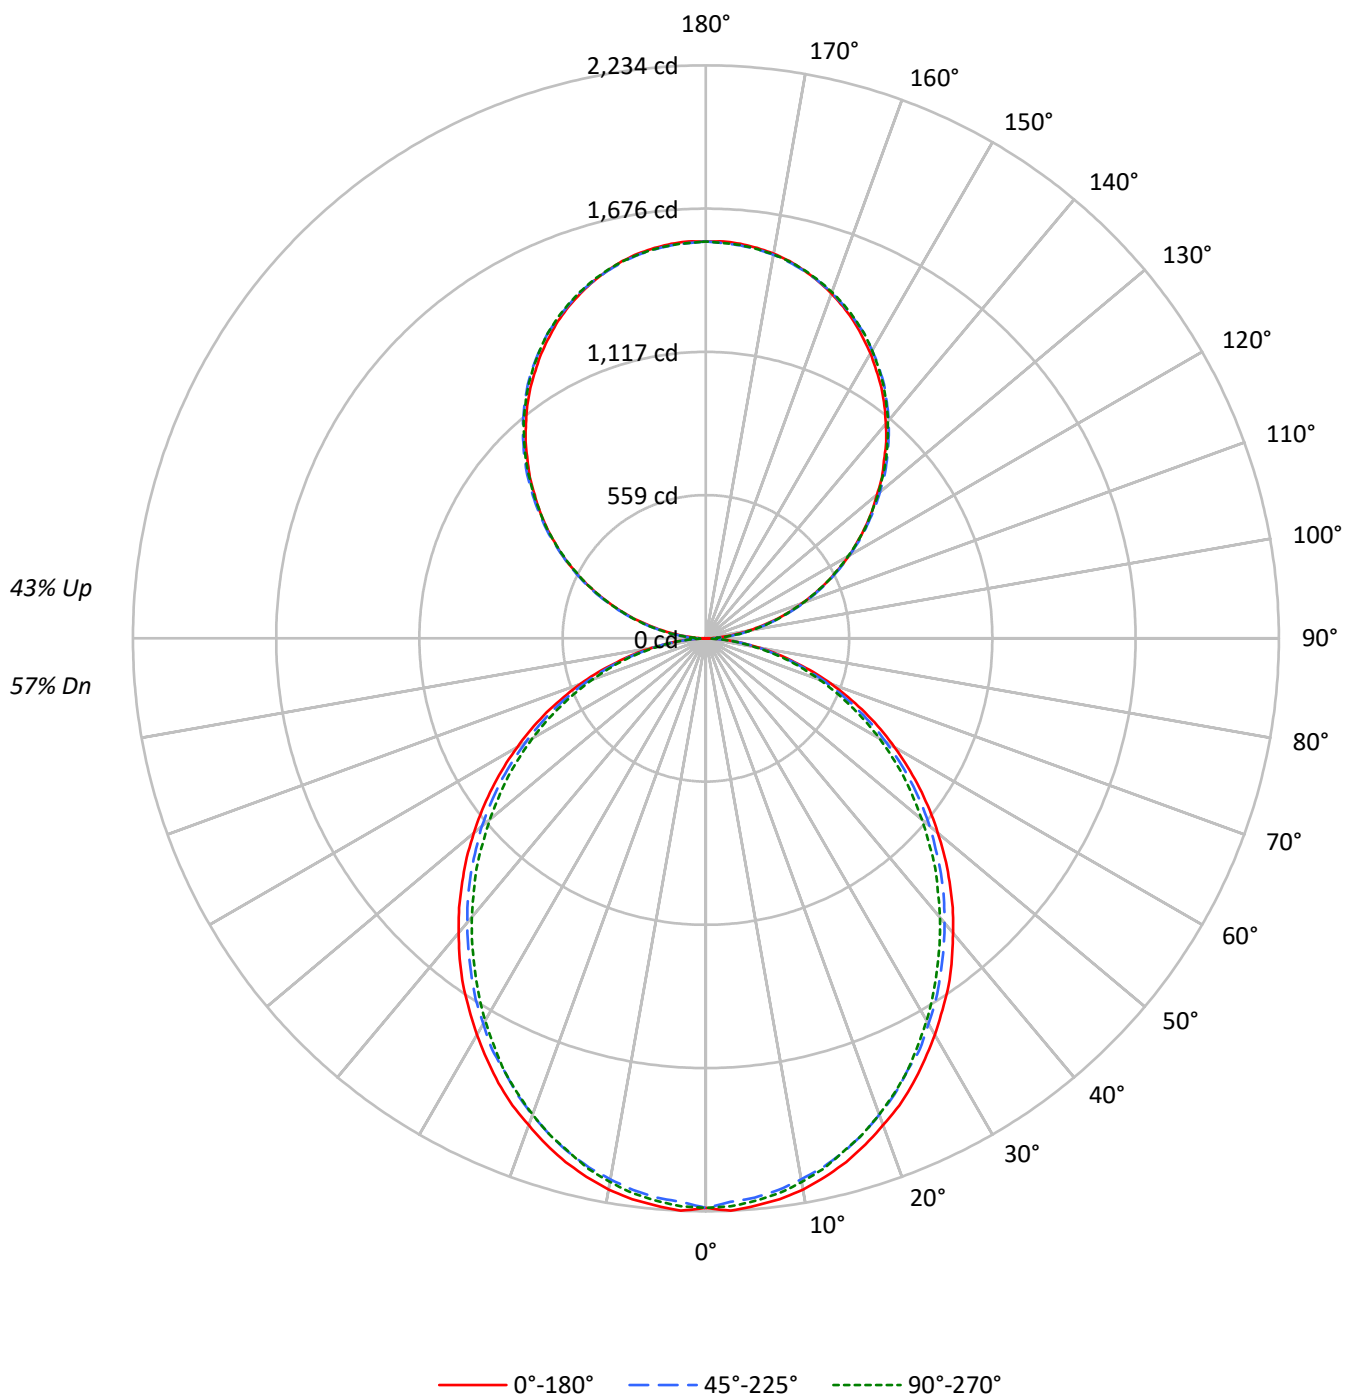

TEST NUMBER: P918298

CATALOG NUMBER: DFN2DIP-TR4F0-070D060US930-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	101	101	101	101	87	87	87	74	74	74	62	62	62
1	99	95	91	87	92	88	85	82	76	74	72	65	63	62	55	54	53
2	90	83	77	71	84	77	72	67	67	63	59	57	54	52	48	46	44
3	82	73	65	60	76	68	62	56	59	54	50	51	47	44	43	40	38
4	75	65	57	50	70	60	53	48	53	47	43	45	41	37	38	35	33
5	69	58	49	43	64	54	47	41	47	41	37	41	36	32	35	31	28
6	64	52	43	38	59	48	41	36	42	36	32	37	32	28	31	28	25
7	59	47	39	33	55	44	37	31	38	33	28	33	29	25	29	25	22
8	55	42	35	29	51	40	33	28	35	29	25	31	26	23	26	23	20
9	51	39	31	26	48	37	30	25	32	27	23	28	24	20	24	21	18
10	48	36	28	23	45	34	27	22	30	24	20	26	22	18	23	19	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1764	1764	1764
5°	1767	1740	1751
10°	1753	1716	1728
15°	1727	1688	1690
20°	1692	1649	1652
25°	1658	1602	1609
30°	1614	1558	1553
35°	1573	1506	1494
40°	1522	1454	1437
45°	1472	1402	1380
50°	1417	1347	1313
55°	1359	1284	1252
60°	1294	1209	1182
65°	1222	1131	1099
70°	1132	1036	1010
75°	1006	922	928
80°	855	778	771
85°	619	528	511

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1472 cd/sqm

TEST NUMBER: P918298

CATALOG NUMBER: DFN2DIP-TR4F0-070D060US930-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	209.0	2.1
10°-20°	588.1	5.9
20°-30°	864.2	8.7
30°-40°	1003.7	10.1
40°-50°	1002.5	10.0
50°-60°	874.2	8.8
60°-70°	646.2	6.5
70°-80°	365.6	3.7
80°-90°	100.9	1.0
90°-100°	95.7	1.0
100°-110°	304.2	3.0
110°-120°	520.6	5.2
120°-130°	684.6	6.9
130°-140°	768.4	7.7
140°-150°	753.5	7.6
150°-160°	632.1	6.3
160°-170°	419.2	4.2
170°-180°	146.5	1.5
0°-30°	1661.3	16.6
0°-40°	2665.1	26.7
0°-60°	4541.7	45.5
0°-90°	5654.4	56.7
90°-120°	920.5	9.2
90°-150°	3127.0	31.3
90°-180°	4325.0	43.3
0°-180°	9979.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2221	2221	2221	2221	2221	
5°	2221	2212	2189	2206	2202	211
15°	2114	2101	2073	2082	2071	595
25°	1913	1896	1860	1864	1860	880
35°	1651	1629	1595	1582	1572	1031
45°	1343	1328	1296	1273	1264	1037
55°	1016	1004	978	952	942	909
65°	686	673	651	632	621	678
75°	359	355	344	331	335	383
85°	88	85	83	77	75	98
90°	1	17	46	43	44	10
95°	68	81	84	84	81	76
105°	281	284	287	290	290	296
115°	522	530	528	526	522	517
125°	760	771	768	764	762	679
135°	983	997	1000	999	995	760
145°	1193	1202	1210	1211	1206	745
155°	1364	1368	1372	1379	1374	628
165°	1484	1483	1483	1492	1486	419
175°	1544	1541	1538	1547	1539	147
180°	1547	1547	1547	1547	1547	

TEST NUMBER: P918298

CATALOG NUMBER: DFN2DIP-TR4F0-070D060US930-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2220.6	2220.6	2220.6	2220.6	2220.6
2.5°	2233.6	2222.9	2199.3	2220.6	2216.6
5°	2220.6	2212.3	2188.7	2205.7	2201.6
7.5°	2205.7	2193.0	2169.4	2186.7	2182.4
10°	2182.4	2167.4	2141.8	2158.8	2152.5
12.5°	2150.2	2137.5	2111.9	2122.5	2118.2
15°	2114.0	2101.3	2073.4	2082.0	2071.3
17.5°	2069.1	2056.4	2028.5	2039.2	2028.5
20°	2019.9	2007.3	1977.3	1983.7	1975.3
22.5°	1971.0	1951.7	1923.9	1923.9	1919.5
25°	1913.3	1896.2	1860.0	1864.1	1860.0
27.5°	1849.1	1834.2	1806.5	1800.2	1789.5
30°	1785.3	1768.0	1736.1	1729.7	1721.1
32.5°	1716.8	1704.1	1669.9	1657.0	1648.4
35°	1650.7	1629.4	1595.1	1582.2	1571.6
37.5°	1575.9	1556.6	1522.4	1507.5	1496.8
40°	1499.1	1481.9	1447.6	1428.6	1420.0
42.5°	1424.3	1407.1	1373.1	1351.6	1338.9
45°	1343.2	1328.3	1296.1	1272.8	1264.1
47.5°	1264.1	1249.2	1215.0	1191.4	1178.8
50°	1180.8	1170.1	1140.2	1110.4	1099.7
52.5°	1099.7	1084.8	1057.1	1033.6	1018.6
55°	1016.5	1003.6	978.0	952.4	941.8
57.5°	933.2	922.5	894.6	869.0	860.5
60°	849.8	841.4	811.5	788.0	781.6
62.5°	768.7	753.7	732.5	711.2	702.5
65°	685.6	672.6	651.3	632.1	621.4
67.5°	600.1	589.3	570.2	555.3	546.7
70°	521.1	512.5	493.2	478.3	469.9
72.5°	439.9	431.4	420.7	405.8	399.4
75°	358.6	354.6	343.6	331.0	335.3
77.5°	286.2	277.5	273.2	266.8	260.6
80°	213.6	211.4	207.1	200.7	196.4
82.5°	145.2	145.2	143.2	134.6	134.6
85°	87.5	85.4	83.4	76.8	74.8
87.5°	38.5	34.2	29.9	23.6	21.3
90°	1.4	16.8	45.7	42.9	44.3
92.5°	28.9	39.2	40.6	42.0	42.0
95°	68.1	81.1	83.5	83.5	81.1
97.5°	113.3	125.5	130.6	130.6	130.6
100°	165.6	176.3	180.0	180.0	178.6
102.5°	220.6	228.5	233.7	235.1	233.7
105°	280.8	284.5	287.3	289.7	289.7
107.5°	340.5	346.1	346.1	347.0	340.5
110°	398.4	405.8	405.8	405.8	402.0

TEST NUMBER: P918298

CATALOG NUMBER: DFN2DIP-TR4F0-070D060US930-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	460.8	468.7	467.3	463.6	460.8
115°	522.4	529.9	527.5	526.1	522.4
117.5°	583.5	593.8	587.2	583.5	579.8
120°	645.1	655.3	645.1	645.1	640.8
122.5°	701.0	714.0	707.5	703.8	701.0
125°	759.8	771.4	767.7	763.5	762.1
127.5°	817.2	831.6	826.5	820.9	817.2
130°	870.8	887.6	885.3	882.5	877.3
132.5°	931.0	944.0	944.9	938.4	934.7
135°	982.8	997.2	1000.0	998.6	994.8
137.5°	1040.6	1052.2	1054.6	1053.6	1048.1
140°	1091.4	1103.1	1109.6	1109.6	1104.5
142.5°	1143.6	1155.3	1159.0	1160.4	1155.3
145°	1193.1	1202.4	1209.9	1211.3	1206.2
147.5°	1237.4	1249.0	1254.7	1256.9	1251.8
150°	1283.1	1291.0	1296.2	1300.3	1296.2
152.5°	1323.6	1331.6	1338.1	1343.3	1338.1
155°	1364.2	1368.0	1372.1	1378.8	1374.5
157.5°	1399.2	1402.1	1404.4	1413.7	1407.2
160°	1430.5	1433.3	1434.7	1442.6	1437.0
162.5°	1459.4	1459.4	1460.8	1469.7	1463.1
165°	1484.1	1482.7	1482.7	1492.1	1485.6
167.5°	1506.5	1502.4	1502.4	1511.6	1505.1
170°	1523.3	1519.6	1518.2	1527.5	1519.6
172.5°	1535.0	1531.2	1529.8	1539.1	1531.2
175°	1544.3	1540.6	1537.7	1547.1	1539.1
177.5°	1549.4	1545.7	1542.9	1550.8	1542.9
180°	1547.1	1547.1	1547.1	1547.1	1547.1

TEST NUMBER: P918298

CATALOG NUMBER: DFN2DIP-TR4F0-070D060US930-FLLFL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.83	10.76	10.73	11.67	12.85	9.40	10.32	10.30	11.24	12.41
	3H	11.50	12.33	12.41	13.25	14.45	11.02	11.85	11.93	12.78	13.98
	4H	12.09	12.87	13.01	13.80	15.01	11.61	12.40	12.54	13.33	14.54
	6H	12.49	13.21	13.43	14.15	15.37	12.01	12.74	12.95	13.68	14.90
	8H	12.60	13.28	13.54	14.24	15.46	12.12	12.81	13.07	13.77	14.98
	12H	12.65	13.30	13.60	14.25	15.50	12.17	12.82	13.12	13.77	15.01
4H	2H	10.30	11.09	11.23	12.02	13.22	9.96	10.74	10.89	11.67	12.88
	3H	12.17	12.83	13.11	13.79	15.01	11.78	12.43	12.72	13.40	14.62
	4H	12.89	13.49	13.84	14.44	15.69	12.48	13.08	13.43	14.04	15.29
	6H	13.41	13.92	14.37	14.90	16.15	13.00	13.51	13.96	14.50	15.74
	8H	13.56	14.04	14.52	15.02	16.28	13.15	13.63	14.11	14.60	15.86
	12H	13.63	14.07	14.62	15.06	16.33	13.21	13.65	14.20	14.64	15.91
8H	4H	13.09	13.57	14.06	14.55	15.81	12.73	13.21	13.70	14.19	15.45
	6H	13.72	14.12	14.72	15.14	16.40	13.36	13.76	14.35	14.78	16.04
	8H	13.95	14.30	14.95	15.30	16.58	13.58	13.93	14.58	14.93	16.21
	12H	14.08	14.39	15.08	15.39	16.71	13.70	14.01	14.70	15.00	16.33
12H	4H	13.08	13.51	14.06	14.51	15.77	12.73	13.16	13.71	14.15	15.42
	6H	13.76	14.11	14.76	15.11	16.39	13.40	13.76	14.40	14.76	16.04
	8H	14.00	14.31	15.00	15.31	16.63	13.64	13.95	14.65	14.95	16.27