

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P918325

Luminaire Tested: DFN2DIP-TR4F0-070D120US930-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P918325
REPORT IS A COMBINATION OF REPORTS P902040 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-070D120US930-RLLONL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14536.7 lumens
Efficiency: N/A
Efficacy: 92.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 156.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9977
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P918325

CATALOG NUMBER: DFN2DIP-TR4F0-070D120US930-RLLONL

Luminous Intensity Polar Plot

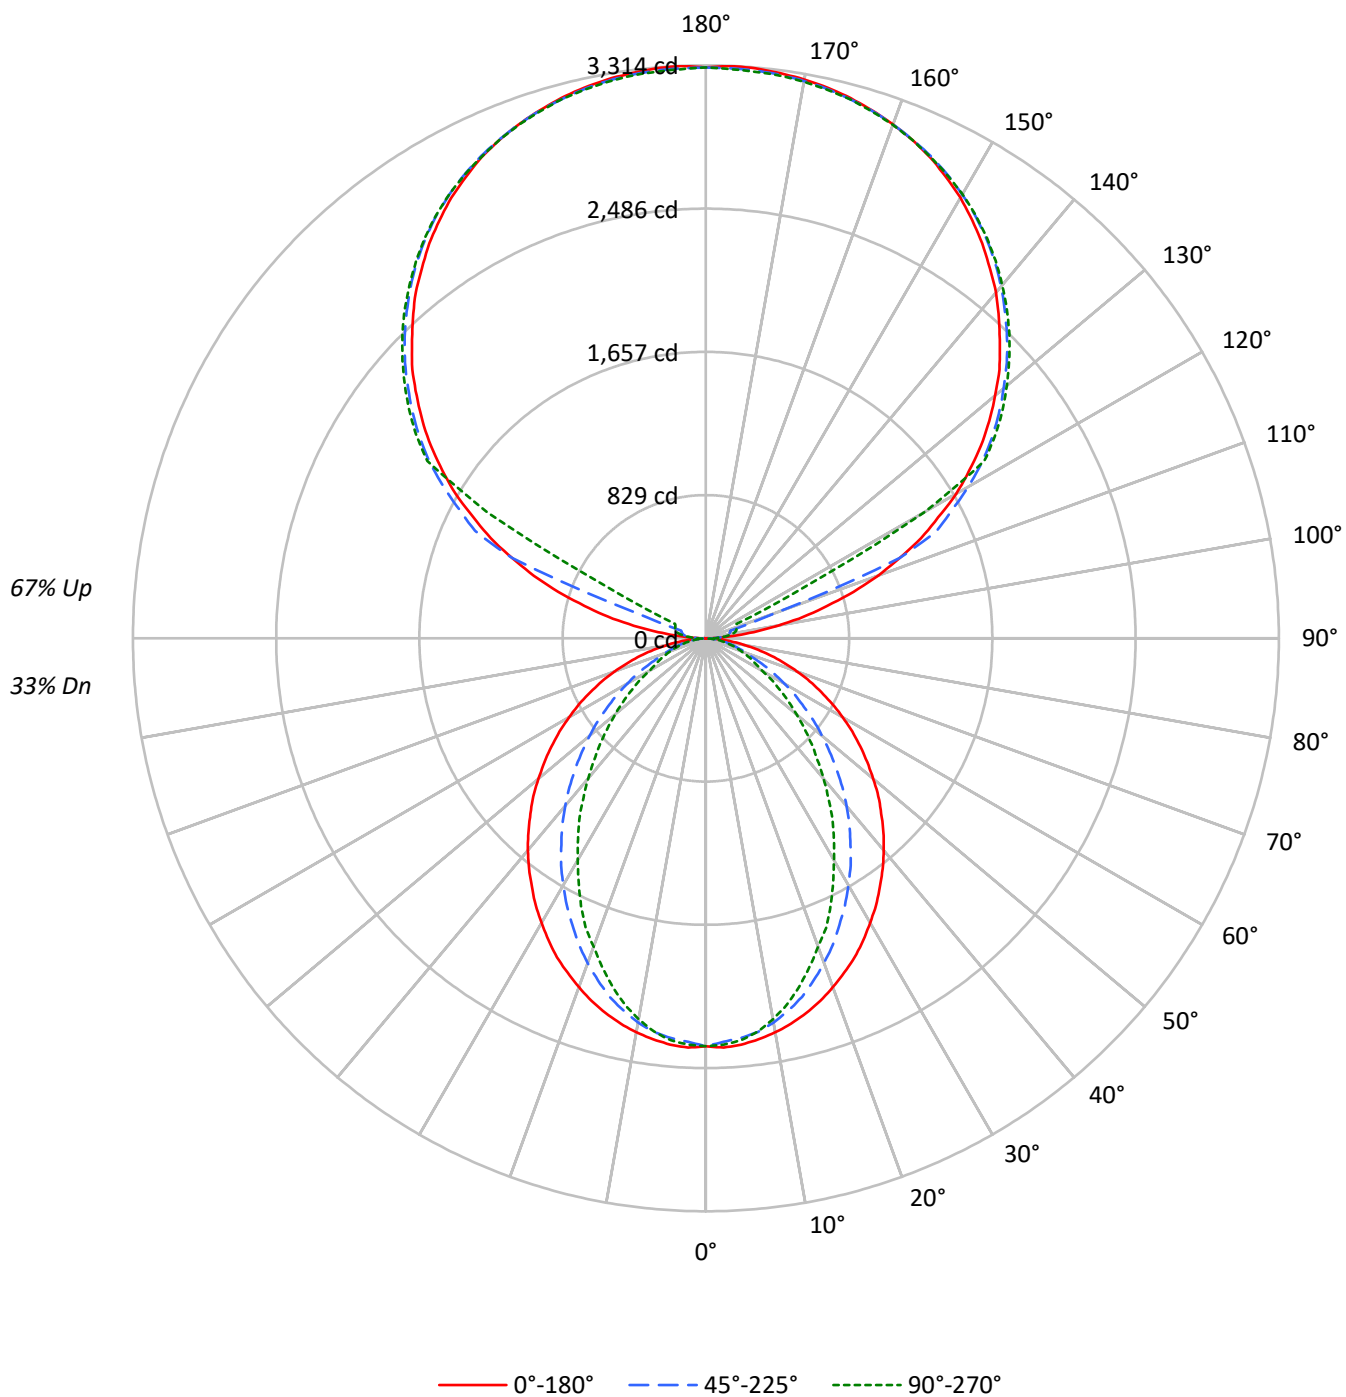

TEST NUMBER: P918325

CATALOG NUMBER: DFN2DIP-TR4F0-070D120US930-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	103	103	103	103	93	93	93	93	74	74	74	57	57	57	41	41	41
1	94	90	87	83	85	82	79	76	65	63	61	50	49	48	37	36	35
2	86	79	73	69	78	72	67	63	58	54	51	45	42	40	33	31	30
3	79	70	63	57	71	63	57	53	51	47	43	40	37	35	29	27	26
4	72	62	54	49	65	56	50	45	45	41	37	36	32	30	26	24	23
5	66	55	48	42	60	50	44	39	41	36	32	32	29	26	24	22	20
6	61	50	42	36	55	45	38	34	37	32	28	29	25	23	22	19	18
7	56	45	37	32	51	41	34	29	33	28	25	26	23	20	20	18	16
8	52	41	33	28	47	37	31	26	30	26	22	24	21	18	18	16	14
9	49	37	30	25	44	34	28	23	28	23	20	22	19	16	17	15	13
10	45	34	27	22	41	31	25	21	26	21	18	21	17	15	16	13	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1874	1874	1874
5°	1877	1844	1856
10°	1858	1808	1795
15°	1833	1748	1702
20°	1799	1666	1587
25°	1764	1573	1477
30°	1718	1479	1336
35°	1672	1377	1213
40°	1626	1272	1072
45°	1572	1155	944
50°	1516	1037	819
55°	1458	911	698
60°	1391	779	575
65°	1313	645	517
70°	1219	520	468
75°	1101	458	426
80°	931	384	369
85°	648	256	277

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1753 cd/sqm

TEST NUMBER: P918325

CATALOG NUMBER: DFN2DIP-TR4F0-070D120US930-RLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	221.1	1.5
10°-20°	606.9	4.2
20°-30°	852.0	5.9
30°-40°	928.8	6.4
40°-50°	853.6	5.9
50°-60°	670.4	4.6
60°-70°	436.4	3.0
70°-80°	224.6	1.5
80°-90°	63.1	0.4
90°-100°	108.9	0.7
100°-110°	405.9	2.8
110°-120°	1076.4	7.4
120°-130°	1785.3	12.3
130°-140°	1896.5	13.0
140°-150°	1762.5	12.1
150°-160°	1417.0	9.7
160°-170°	913.1	6.3
170°-180°	314.3	2.2
0°-30°	1679.9	11.6
0°-40°	2608.7	17.9
0°-60°	4132.7	28.4
0°-90°	4856.8	33.4
90°-120°	1591.2	10.9
90°-150°	7035.5	48.4
90°-180°	9680.0	66.6
0°-180°	14536.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2359	2359	2359	2359	2359	
5°	2359	2348	2320	2340	2333	224
15°	2244	2220	2147	2107	2086	632
25°	2036	1968	1827	1740	1708	937
35°	1755	1646	1458	1324	1276	1098
45°	1434	1291	1067	916	864	1108
55°	1091	924	694	566	525	975
65°	736	564	371	299	292	730
75°	393	243	171	156	154	415
85°	92	47	40	40	40	105
90°	2	29	48	60	64	14
95°	155	76	93	105	103	184
105°	726	798	146	172	182	776
115°	1374	1414	1474	368	196	1352
125°	1942	1974	2019	2036	2043	1732
135°	2404	2442	2463	2487	2482	1857
145°	2788	2786	2826	2843	2831	1744
155°	3070	3049	3077	3092	3073	1415
165°	3235	3221	3228	3245	3228	914
175°	3309	3292	3297	3314	3290	315
180°	3302	3302	3302	3302	3302	

TEST NUMBER: P918325

CATALOG NUMBER: DFN2DIP-TR4F0-070D120US930-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2358.7	2358.7	2358.7	2358.7	2358.7
2.5°	2369.3	2358.7	2335.2	2356.7	2352.4
5°	2358.7	2348.1	2320.3	2339.5	2333.1
7.5°	2339.5	2326.8	2296.9	2305.3	2294.7
10°	2313.9	2299.0	2256.3	2249.8	2237.1
12.5°	2281.9	2262.7	2205.0	2192.3	2168.7
15°	2243.5	2219.9	2147.4	2106.9	2085.6
17.5°	2198.6	2164.5	2074.8	2027.8	1993.6
20°	2147.4	2104.6	1998.0	1944.7	1897.6
22.5°	2092.0	2042.8	1918.9	1846.4	1814.5
25°	2036.5	1968.0	1827.2	1739.8	1707.6
27.5°	1970.3	1897.6	1741.8	1641.5	1592.4
30°	1899.9	1818.6	1647.8	1539.1	1481.4
32.5°	1831.5	1733.2	1558.4	1430.2	1376.7
35°	1754.7	1645.8	1458.1	1323.6	1276.4
37.5°	1680.0	1562.4	1364.1	1216.6	1163.4
40°	1600.9	1473.0	1265.8	1114.3	1058.7
42.5°	1519.9	1383.3	1167.7	1009.6	956.4
45°	1434.5	1291.4	1067.4	915.7	864.5
47.5°	1353.4	1201.9	971.3	819.6	772.7
50°	1263.7	1112.2	877.3	729.9	685.3
52.5°	1176.1	1015.9	787.7	646.8	606.3
55°	1090.7	924.2	693.7	565.7	525.2
57.5°	1003.3	832.5	610.6	491.0	456.8
60°	913.6	742.8	522.9	414.3	380.0
62.5°	826.1	655.4	448.2	345.8	328.8
65°	736.5	563.5	371.4	299.0	292.4
67.5°	651.1	478.1	299.0	262.4	256.2
70°	561.4	394.9	247.5	226.2	217.6
72.5°	476.1	318.0	207.0	190.0	185.7
75°	392.7	243.2	170.7	155.8	153.8
77.5°	309.6	172.8	134.5	125.9	121.6
80°	232.6	123.8	102.4	94.0	94.0
82.5°	162.2	83.3	70.4	66.1	66.1
85°	91.7	46.9	40.5	40.5	40.5
87.5°	34.2	17.0	17.0	14.9	14.9
90°	2.3	28.6	47.7	59.8	64.4
92.5°	59.8	50.2	57.3	62.1	64.4
95°	155.2	76.3	93.0	105.3	102.7
97.5°	279.5	83.7	121.7	129.1	131.3
100°	423.0	95.6	136.2	155.2	160.0
102.5°	580.5	575.9	141.0	167.1	174.5
105°	726.3	798.1	145.9	171.9	181.6
107.5°	895.9	955.5	150.7	176.8	186.4
110°	1058.5	1108.5	418.2	179.3	188.7

TEST NUMBER: P918325

CATALOG NUMBER: DFN2DIP-TR4F0-070D120US930-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1211.5	1254.3	1213.7	183.8	191.2
115°	1373.7	1414.3	1474.1	367.9	196.1
117.5°	1514.7	1562.4	1603.3	1261.3	635.5
120°	1672.5	1708.2	1751.3	1780.0	1457.4
122.5°	1806.1	1844.4	1892.4	1906.6	1909.1
125°	1942.3	1973.5	2018.9	2035.6	2042.7
127.5°	2066.5	2100.0	2136.1	2159.9	2162.2
130°	2183.7	2222.0	2248.1	2274.5	2272.2
132.5°	2303.1	2334.4	2360.5	2382.1	2379.8
135°	2403.6	2441.9	2463.2	2487.3	2482.5
137.5°	2508.6	2537.2	2561.3	2585.1	2578.1
140°	2611.3	2630.6	2656.6	2678.3	2666.4
142.5°	2697.5	2714.3	2745.2	2764.2	2752.3
145°	2788.3	2785.8	2826.3	2843.1	2831.1
147.5°	2866.9	2859.8	2900.4	2912.3	2903.0
150°	2943.5	2926.8	2965.1	2979.3	2967.4
152.5°	3007.9	2988.9	3024.7	3039.1	3022.4
155°	3070.0	3048.7	3077.4	3091.6	3072.6
157.5°	3120.2	3101.2	3122.8	3139.6	3120.2
160°	3163.4	3148.9	3163.4	3177.5	3160.8
162.5°	3201.4	3187.2	3199.1	3215.9	3194.3
165°	3234.9	3220.7	3227.8	3244.6	3227.8
167.5°	3261.3	3246.8	3254.2	3270.9	3249.4
170°	3282.8	3268.4	3273.2	3289.9	3268.4
172.5°	3297.0	3282.8	3287.7	3304.4	3282.8
175°	3308.9	3292.2	3297.0	3313.8	3289.9
177.5°	3313.8	3297.0	3299.6	3316.3	3294.8
180°	3301.9	3301.9	3301.9	3301.9	3301.9

TEST NUMBER: P918325

CATALOG NUMBER: DFN2DIP-TR4F0-070D120US930-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.54	8.25	8.63	9.34	10.83	3.51	4.22	4.61	5.31	6.80
	3H	9.21	9.84	10.31	10.94	12.45	4.69	5.33	5.80	6.43	7.93
	4H	9.81	10.41	10.92	11.51	13.03	5.14	5.74	6.25	6.84	8.35
	6H	10.23	10.78	11.35	11.88	13.41	5.46	6.01	6.58	7.11	8.64
	8H	10.35	10.88	11.47	11.99	13.51	5.54	6.07	6.67	7.19	8.71
	12H	10.41	10.91	11.53	12.02	13.56	5.58	6.08	6.71	7.19	8.74
4H	2H	7.54	8.15	8.66	9.24	10.76	4.09	4.70	5.21	5.79	7.31
	3H	9.36	9.86	10.49	10.99	12.51	5.43	5.94	6.56	7.06	8.59
	4H	10.05	10.51	11.18	11.62	13.17	5.98	6.44	7.11	7.55	9.10
	6H	10.56	10.95	11.69	12.09	13.63	6.39	6.79	7.53	7.92	9.46
	8H	10.73	11.10	11.87	12.23	13.78	6.52	6.89	7.65	8.01	9.57
	12H	10.82	11.15	11.97	12.29	13.85	6.58	6.91	7.73	8.05	9.61
8H	4H	10.01	10.38	11.14	11.50	13.06	6.25	6.62	7.38	7.75	9.30
	6H	10.57	10.87	11.73	12.04	13.60	6.76	7.07	7.92	8.24	9.79
	8H	10.79	11.05	11.95	12.20	13.77	6.96	7.22	8.12	8.37	9.94
	12H	10.92	11.15	12.08	12.30	13.91	7.07	7.30	8.23	8.45	10.06
12H	4H	9.95	10.29	11.11	11.43	12.99	6.25	6.58	7.40	7.72	9.28
	6H	10.54	10.81	11.71	11.96	13.53	6.81	7.08	7.97	8.23	9.80
	8H	10.76	10.99	11.92	12.14	13.75	7.02	7.25	8.18	8.40	10.01

END OF REPORT