

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P918332

Luminaire Tested: DFN2DIP-TR4F0-080D050US930-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P918332
REPORT IS A COMBINATION OF REPORTS P900396 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-080D050US930-RLLFLL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9151.7 lumens
Efficiency: N/A
Efficacy: 81.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 112.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P918332

CATALOG NUMBER: DFN2DIP-TR4F0-080D050US930-RLLFLL

Luminous Intensity Polar Plot

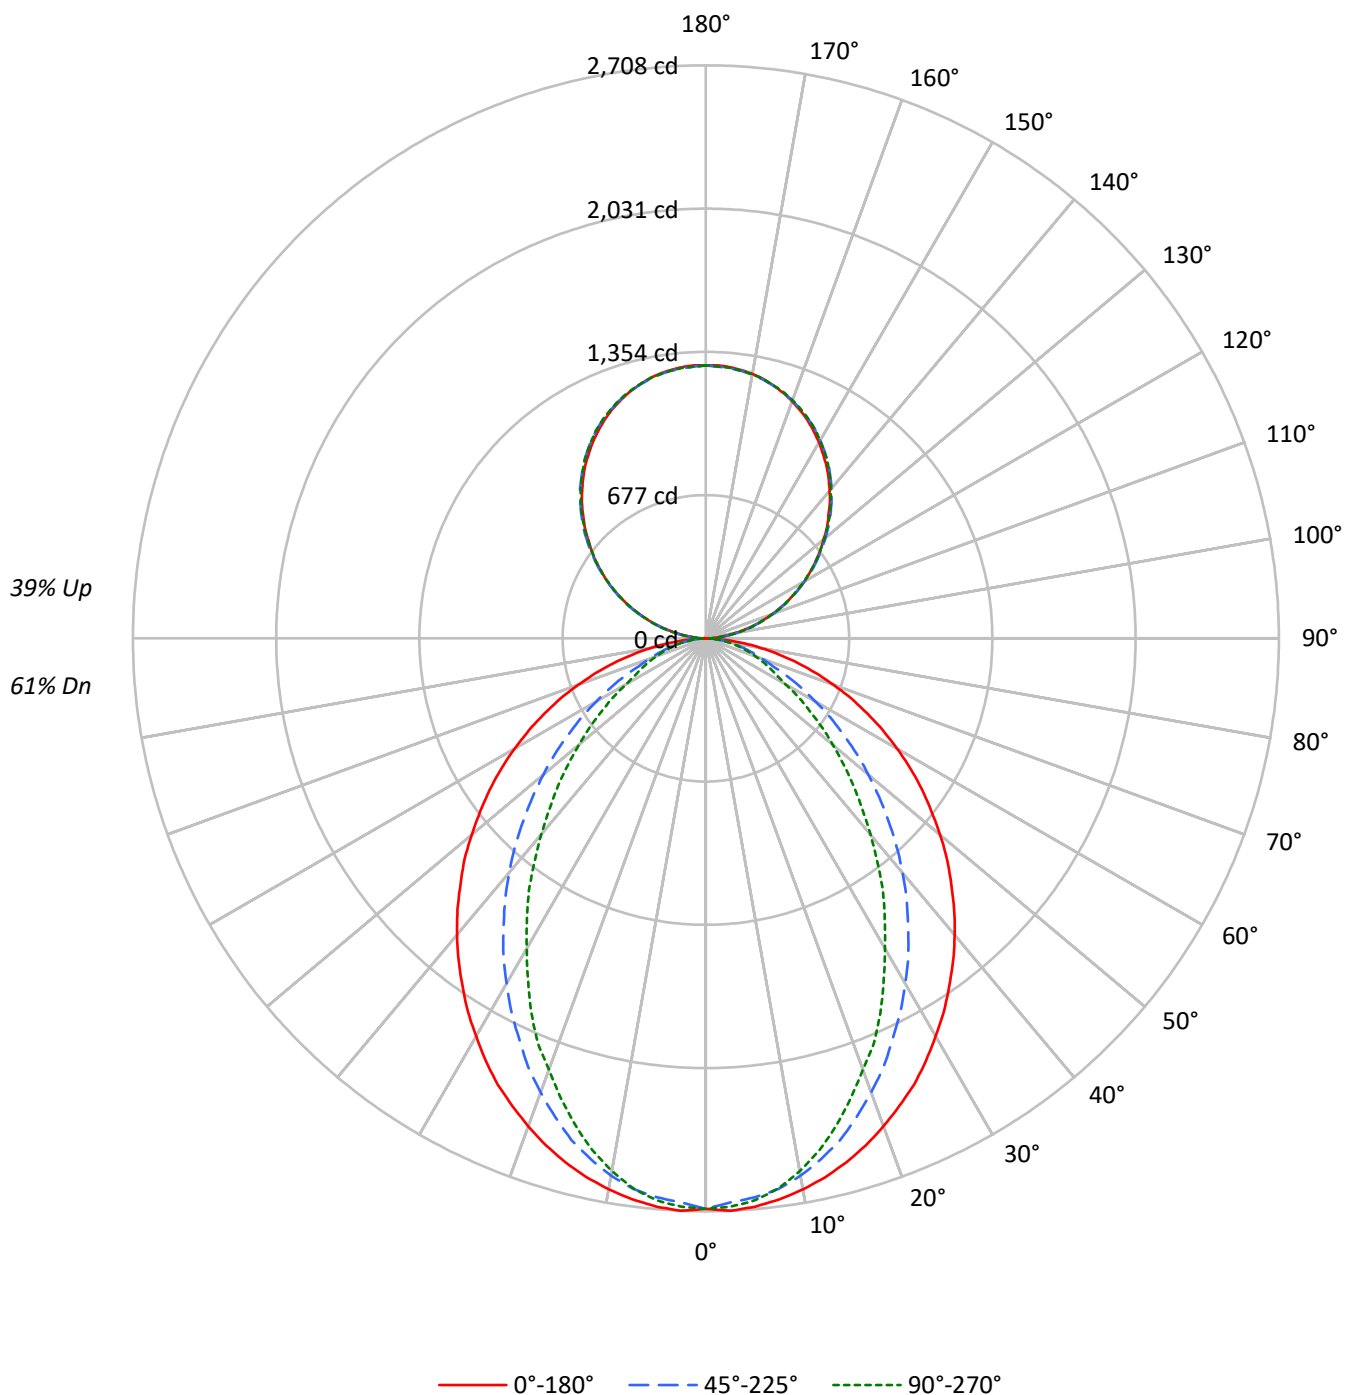

TEST NUMBER: P918332

CATALOG NUMBER: DFN2DIP-TR4F0-080D050US930-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	89	89	89	77	77	77	66	66	66
1	101	97	93	89	94	91	87	84	79	77	75	69	67	65	59	58	57
2	92	85	79	74	86	80	75	70	70	66	63	61	58	56	53	51	49
3	85	75	68	62	79	71	64	59	62	57	53	55	51	48	47	45	42
4	78	67	59	53	72	63	56	51	56	50	46	49	45	41	43	39	37
5	72	60	52	46	67	57	50	44	50	45	40	44	40	36	39	35	32
6	66	54	46	41	62	51	44	39	46	40	35	40	36	32	35	32	29
7	61	49	41	36	57	47	39	34	42	36	32	37	32	29	32	29	26
8	57	45	37	32	53	43	36	31	38	32	28	34	29	26	30	26	23
9	53	41	34	29	50	39	32	28	35	29	26	31	27	23	28	24	21
10	50	38	31	26	47	36	29	25	32	27	23	29	25	21	26	22	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2142	2142	2142
5°	2145	2108	2121
10°	2124	2066	2052
15°	2095	1998	1945
20°	2056	1904	1814
25°	2016	1798	1688
30°	1963	1690	1527
35°	1911	1574	1386
40°	1858	1453	1225
45°	1796	1320	1079
50°	1733	1185	935
55°	1666	1041	798
60°	1589	890	657
65°	1501	737	591
70°	1393	594	535
75°	1259	524	487
80°	1064	439	422
85°	741	293	316

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1796 cd/sqm

TEST NUMBER: P918332

CATALOG NUMBER: DFN2DIP-TR4F0-080D050US930-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	252.6	2.8
10°-20°	693.6	7.6
20°-30°	973.7	10.6
30°-40°	1061.4	11.6
40°-50°	975.6	10.7
50°-60°	766.2	8.4
60°-70°	498.7	5.4
70°-80°	256.7	2.8
80°-90°	69.2	0.8
90°-100°	79.8	0.9
100°-110°	253.5	2.8
110°-120°	433.8	4.7
120°-130°	570.5	6.2
130°-140°	640.4	7.0
140°-150°	627.9	6.9
150°-160°	526.8	5.8
160°-170°	349.3	3.8
170°-180°	122.1	1.3
0°-30°	1919.9	21.0
0°-40°	2981.4	32.6
0°-60°	4723.1	51.6
0°-90°	5547.7	60.6
90°-120°	767.0	8.4
90°-150°	2605.8	28.5
90°-180°	3604.0	39.4
0°-180°	9151.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2696	2696	2696	2696	2696	
5°	2696	2684	2652	2674	2666	256
15°	2564	2537	2454	2408	2384	722
25°	2327	2249	2088	1988	1952	1070
35°	2005	1881	1666	1513	1459	1255
45°	1639	1476	1220	1046	988	1266
55°	1246	1056	793	646	600	1114
65°	842	644	424	342	334	834
75°	449	278	195	178	176	475
85°	105	54	46	46	46	120
90°	1	14	38	36	37	9
95°	57	68	70	70	68	63
105°	234	237	240	241	241	247
115°	435	442	440	438	435	431
125°	633	643	640	636	635	566
135°	819	831	833	832	829	633
145°	994	1002	1008	1009	1005	621
155°	1137	1140	1144	1149	1145	523
165°	1237	1236	1236	1243	1238	349
175°	1287	1284	1282	1289	1283	122
180°	1289	1289	1289	1289	1289	

TEST NUMBER: P918332

CATALOG NUMBER: DFN2DIP-TR4F0-080D050US930-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2695.7	2695.7	2695.7	2695.7	2695.7
2.5°	2707.9	2695.7	2668.8	2693.3	2688.4
5°	2695.7	2683.6	2651.7	2673.7	2666.4
7.5°	2673.7	2659.2	2625.0	2634.6	2622.4
10°	2644.4	2627.4	2578.7	2571.2	2556.7
12.5°	2608.0	2586.0	2519.9	2505.4	2478.5
15°	2563.9	2537.0	2454.2	2407.9	2383.5
17.5°	2512.7	2473.6	2371.1	2317.6	2278.4
20°	2454.2	2405.3	2283.4	2222.6	2168.7
22.5°	2390.8	2334.6	2193.1	2110.2	2073.7
25°	2327.4	2249.2	2088.2	1988.3	1951.6
27.5°	2251.8	2168.7	1990.6	1876.0	1819.8
30°	2171.3	2078.4	1883.3	1759.0	1693.0
32.5°	2093.1	1980.8	1781.0	1634.5	1573.4
35°	2005.4	1880.9	1666.3	1512.6	1458.7
37.5°	1919.9	1785.7	1558.9	1390.4	1329.6
40°	1829.7	1683.4	1446.6	1273.4	1210.0
42.5°	1737.0	1580.9	1334.5	1153.9	1093.0
45°	1639.4	1475.9	1219.8	1046.4	988.0
47.5°	1546.8	1373.6	1110.1	936.7	883.1
50°	1444.2	1271.1	1002.7	834.2	783.2
52.5°	1344.1	1161.1	900.2	739.2	692.9
55°	1246.5	1056.3	792.8	646.5	600.2
57.5°	1146.6	951.5	697.8	561.2	522.0
60°	1044.1	849.0	597.6	473.4	434.3
62.5°	944.2	749.0	512.3	395.3	375.9
65°	841.7	643.9	424.4	341.7	334.1
67.5°	744.1	546.4	341.7	299.9	292.8
70°	641.6	451.4	282.9	258.5	248.7
72.5°	544.0	363.4	236.6	217.2	212.2
75°	448.8	278.0	195.2	178.1	175.8
77.5°	353.8	197.5	153.8	143.9	139.0
80°	265.8	141.6	117.0	107.4	107.4
82.5°	185.3	95.2	80.5	75.6	75.6
85°	104.8	53.6	46.3	46.3	46.3
87.5°	39.1	19.4	19.4	17.1	17.1
90°	1.1	14.0	38.1	35.8	36.9
92.5°	24.1	32.6	33.8	35.0	35.0
95°	56.7	67.7	69.5	69.5	67.7
97.5°	94.4	104.5	108.8	108.8	108.8
100°	137.9	146.9	150.0	150.0	148.9
102.5°	183.8	190.5	194.7	195.9	194.7
105°	234.0	237.1	239.5	241.3	241.3
107.5°	283.7	288.4	288.4	289.2	283.7
110°	331.9	338.2	338.2	338.2	335.0

TEST NUMBER: P918332

CATALOG NUMBER: DFN2DIP-TR4F0-080D050US930-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	384.0	390.6	389.5	386.4	384.0
115°	435.3	441.6	439.6	438.5	435.3
117.5°	486.2	494.8	489.3	486.2	483.1
120°	537.5	546.1	537.5	537.5	534.0
122.5°	584.2	595.1	589.6	586.5	584.2
125°	633.2	642.9	639.8	636.3	635.1
127.5°	680.9	693.0	688.8	684.0	680.9
130°	725.7	739.6	737.7	735.4	731.1
132.5°	775.8	786.7	787.5	782.0	778.9
135°	819.0	831.0	833.3	832.2	829.1
137.5°	867.2	876.9	878.8	878.0	873.3
140°	909.5	919.2	924.6	924.6	920.4
142.5°	953.0	962.8	965.9	967.0	962.8
145°	994.3	1002.0	1008.2	1009.4	1005.1
147.5°	1031.2	1040.9	1045.5	1047.5	1043.2
150°	1069.3	1075.9	1080.1	1083.6	1080.1
152.5°	1103.1	1109.7	1115.1	1119.4	1115.1
155°	1136.9	1140.0	1143.5	1148.9	1145.4
157.5°	1166.0	1168.3	1170.3	1178.1	1172.6
160°	1192.0	1194.4	1195.6	1202.2	1197.5
162.5°	1216.2	1216.2	1217.3	1224.7	1219.3
165°	1236.8	1235.6	1235.6	1243.4	1237.9
167.5°	1255.4	1251.9	1251.9	1259.7	1254.3
170°	1269.4	1266.3	1265.2	1272.9	1266.3
172.5°	1279.1	1276.0	1274.9	1282.6	1276.0
175°	1286.9	1283.8	1281.5	1289.2	1282.6
177.5°	1291.2	1288.1	1285.7	1292.3	1285.7
180°	1289.2	1289.2	1289.2	1289.2	1289.2

TEST NUMBER: P918332

CATALOG NUMBER: DFN2DIP-TR4F0-080D050US930-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.72	11.65	11.59	12.53	13.65	6.70	7.62	7.57	8.51	9.62
	3H	12.41	13.24	13.29	14.13	15.27	7.89	8.72	8.77	9.62	10.76
	4H	13.02	13.80	13.92	14.70	15.85	8.35	9.13	9.25	10.03	11.18
	6H	13.45	14.17	14.36	15.07	16.24	8.68	9.40	9.58	10.30	11.46
	8H	13.58	14.26	14.49	15.18	16.35	8.77	9.45	9.69	10.38	11.54
	12H	13.64	14.29	14.56	15.21	16.40	8.82	9.47	9.74	10.39	11.57
4H	2H	10.75	11.54	11.66	12.43	13.58	7.30	8.09	8.21	8.98	10.14
	3H	12.59	13.24	13.50	14.17	15.34	8.66	9.31	9.58	10.24	11.41
	4H	13.29	13.88	14.21	14.80	16.00	9.22	9.81	10.14	10.73	11.92
	6H	13.81	14.32	14.74	15.27	16.46	9.64	10.15	10.58	11.10	12.29
	8H	13.98	14.46	14.92	15.40	16.61	9.77	10.25	10.71	11.19	12.40
	12H	14.08	14.51	15.04	15.47	16.68	9.84	10.27	10.80	11.23	12.44
8H	4H	13.26	13.74	14.20	14.68	15.89	9.50	9.98	10.44	10.92	12.13
	6H	13.83	14.22	14.80	15.21	16.41	10.03	10.42	10.99	11.40	12.61
	8H	14.05	14.40	15.02	15.37	16.59	10.22	10.57	11.19	11.54	12.76
	12H	14.19	14.50	15.17	15.47	16.74	10.34	10.65	11.32	11.62	12.89
12H	4H	13.22	13.65	14.18	14.61	15.82	9.51	9.94	10.47	10.90	12.11
	6H	13.81	14.15	14.78	15.13	16.35	10.08	10.42	11.05	11.40	12.62
	8H	14.03	14.34	15.01	15.31	16.58	10.29	10.60	11.27	11.57	12.84

END OF REPORT