

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P918349

Luminaire Tested: DFN2DIP-TR4F0-080D090US930-RLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P918349
REPORT IS A COMBINATION OF REPORTS P901988 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-080D090US930-RLLONL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12808.3 lumens
Efficiency: N/A
Efficacy: 89.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 142.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P918349

CATALOG NUMBER: DFN2DIP-TR4F0-080D090US930-RLLONL

Luminous Intensity Polar Plot

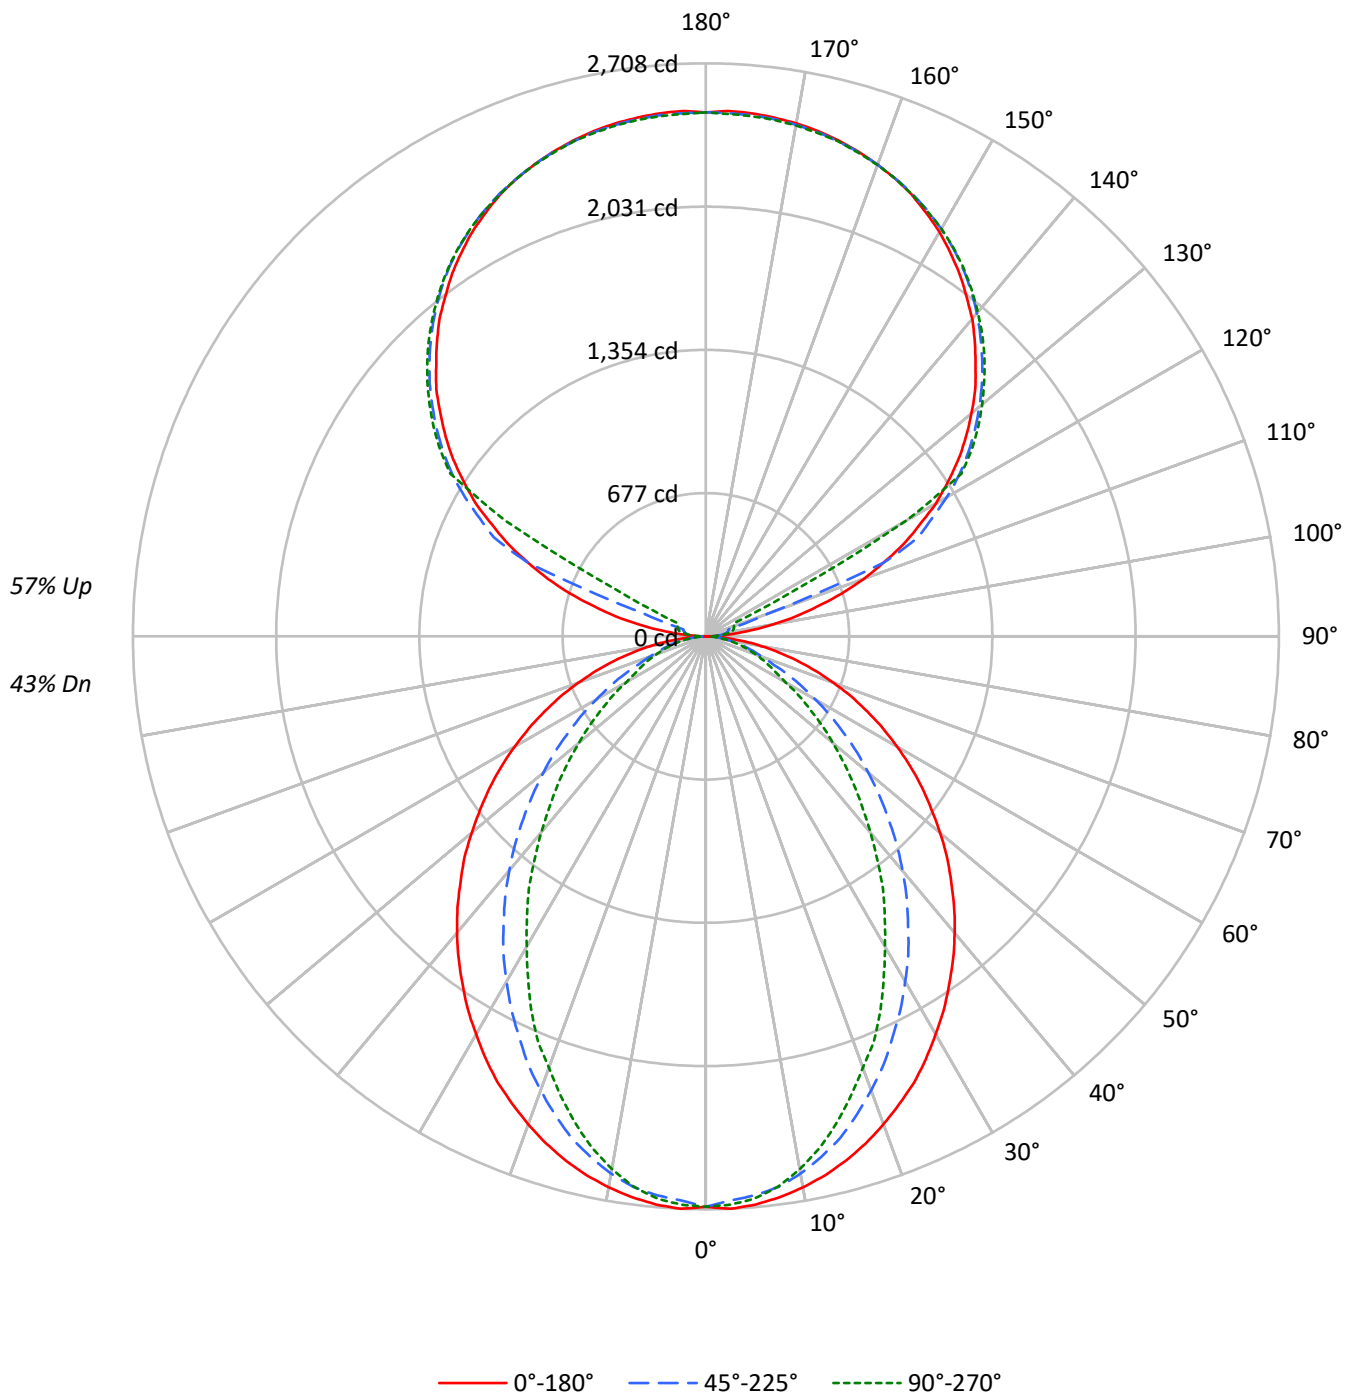

TEST NUMBER: P918349

CATALOG NUMBER: DFN2DIP-TR4F0-080D090US930-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	80	80	80	64	64	64	50	50	50
1	97	93	89	86	88	85	82	79	70	68	66	57	56	54	45	44	43
2	88	81	75	71	81	75	70	65	62	59	55	51	48	46	40	38	37
3	81	72	65	59	74	66	60	55	55	51	47	45	42	39	36	34	32
4	74	64	56	50	68	59	52	47	49	44	40	40	37	34	32	30	28
5	68	57	49	43	62	53	46	41	44	39	35	36	33	30	29	27	24
6	63	51	43	38	57	47	40	35	40	35	31	33	29	26	27	24	22
7	58	46	39	33	53	43	36	31	36	31	27	30	26	23	24	22	19
8	54	42	35	30	49	39	32	28	33	28	24	28	24	21	23	20	18
9	50	39	31	26	46	36	29	25	31	25	22	26	22	19	21	18	16
10	47	35	28	24	43	33	27	22	28	23	20	24	20	17	19	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2142	2142	2142
5°	2145	2108	2121
10°	2124	2066	2052
15°	2095	1998	1945
20°	2056	1904	1814
25°	2016	1798	1688
30°	1963	1690	1527
35°	1911	1574	1386
40°	1858	1453	1225
45°	1796	1320	1079
50°	1733	1185	935
55°	1666	1041	798
60°	1589	890	657
65°	1501	737	591
70°	1393	594	535
75°	1259	524	487
80°	1064	439	422
85°	741	293	316

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 1796 cd/sqm

TEST NUMBER: P918349

CATALOG NUMBER: DFN2DIP-TR4F0-080D090US930-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	252.6	2.0
10°-20°	693.6	5.4
20°-30°	973.7	7.6
30°-40°	1061.4	8.3
40°-50°	975.6	7.6
50°-60°	766.2	6.0
60°-70°	498.7	3.9
70°-80°	256.7	2.0
80°-90°	69.9	0.5
90°-100°	81.7	0.6
100°-110°	304.4	2.4
110°-120°	807.3	6.3
120°-130°	1339.0	10.5
130°-140°	1422.3	11.1
140°-150°	1321.9	10.3
150°-160°	1062.8	8.3
160°-170°	684.8	5.3
170°-180°	235.7	1.8
0°-30°	1919.9	15.0
0°-40°	2981.4	23.3
0°-60°	4723.1	36.9
0°-90°	5548.4	43.3
90°-120°	1193.4	9.3
90°-150°	5276.6	41.2
90°-180°	7260.0	56.7
0°-180°	12808.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2696	2696	2696	2696	2696	
5°	2696	2684	2652	2674	2666	256
15°	2564	2537	2454	2408	2384	722
25°	2327	2249	2088	1988	1952	1070
35°	2005	1881	1666	1513	1459	1255
45°	1639	1476	1220	1046	988	1266
55°	1246	1056	793	646	600	1114
65°	842	644	424	342	334	834
75°	449	278	195	178	176	475
85°	105	54	46	46	46	120
90°	2	22	36	45	48	12
95°	116	57	70	79	77	138
105°	545	599	109	129	136	582
115°	1030	1061	1106	276	147	1014
125°	1457	1480	1514	1527	1532	1299
135°	1803	1831	1847	1866	1862	1393
145°	2091	2089	2120	2132	2123	1308
155°	2303	2287	2308	2319	2304	1061
165°	2426	2416	2421	2433	2421	685
175°	2482	2469	2473	2485	2467	236
180°	2476	2476	2476	2476	2476	

TEST NUMBER: P918349

CATALOG NUMBER: DFN2DIP-TR4F0-080D090US930-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2695.7	2695.7	2695.7	2695.7	2695.7
2.5°	2707.9	2695.7	2668.8	2693.3	2688.4
5°	2695.7	2683.6	2651.7	2673.7	2666.4
7.5°	2673.7	2659.2	2625.0	2634.6	2622.4
10°	2644.4	2627.4	2578.7	2571.2	2556.7
12.5°	2608.0	2586.0	2519.9	2505.4	2478.5
15°	2563.9	2537.0	2454.2	2407.9	2383.5
17.5°	2512.7	2473.6	2371.1	2317.6	2278.4
20°	2454.2	2405.3	2283.4	2222.6	2168.7
22.5°	2390.8	2334.6	2193.1	2110.2	2073.7
25°	2327.4	2249.2	2088.2	1988.3	1951.6
27.5°	2251.8	2168.7	1990.6	1876.0	1819.8
30°	2171.3	2078.4	1883.3	1759.0	1693.0
32.5°	2093.1	1980.8	1781.0	1634.5	1573.4
35°	2005.4	1880.9	1666.3	1512.6	1458.7
37.5°	1919.9	1785.7	1558.9	1390.4	1329.6
40°	1829.7	1683.4	1446.6	1273.4	1210.0
42.5°	1737.0	1580.9	1334.5	1153.9	1093.0
45°	1639.4	1475.9	1219.8	1046.4	988.0
47.5°	1546.8	1373.6	1110.1	936.7	883.1
50°	1444.2	1271.1	1002.7	834.2	783.2
52.5°	1344.1	1161.1	900.2	739.2	692.9
55°	1246.5	1056.3	792.8	646.5	600.2
57.5°	1146.6	951.5	697.8	561.2	522.0
60°	1044.1	849.0	597.6	473.4	434.3
62.5°	944.2	749.0	512.3	395.3	375.9
65°	841.7	643.9	424.4	341.7	334.1
67.5°	744.1	546.4	341.7	299.9	292.8
70°	641.6	451.4	282.9	258.5	248.7
72.5°	544.0	363.4	236.6	217.2	212.2
75°	448.8	278.0	195.2	178.1	175.8
77.5°	353.8	197.5	153.8	143.9	139.0
80°	265.8	141.6	117.0	107.4	107.4
82.5°	185.3	95.2	80.5	75.6	75.6
85°	104.8	53.6	46.3	46.3	46.3
87.5°	39.1	19.4	19.4	17.1	17.1
90°	1.7	21.5	35.7	44.9	48.3
92.5°	44.9	37.7	43.0	46.6	48.3
95°	116.4	57.2	69.8	78.9	77.0
97.5°	209.6	62.8	91.3	96.8	98.5
100°	317.2	71.7	102.2	116.4	120.0
102.5°	435.4	431.9	105.7	125.3	130.9
105°	544.7	598.6	109.3	129.0	136.2
107.5°	672.0	716.6	113.0	132.6	139.8
110°	793.9	831.4	313.6	134.4	141.5

TEST NUMBER: P918349

CATALOG NUMBER: DFN2DIP-TR4F0-080D090US930-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	908.6	940.7	910.3	137.9	143.4
115°	1030.3	1060.7	1105.6	276.0	147.0
117.5°	1136.0	1171.8	1202.4	946.1	476.6
120°	1254.3	1281.2	1313.5	1335.0	1093.1
122.5°	1354.6	1383.3	1419.3	1429.9	1431.8
125°	1456.7	1480.1	1514.2	1526.7	1532.0
127.5°	1549.9	1575.0	1602.1	1619.9	1621.6
130°	1637.8	1666.6	1686.1	1705.8	1704.2
132.5°	1727.4	1750.8	1770.3	1786.6	1784.9
135°	1802.7	1831.4	1847.4	1865.5	1861.9
137.5°	1881.5	1902.9	1921.0	1938.9	1933.6
140°	1958.4	1972.9	1992.5	2008.7	1999.8
142.5°	2023.2	2035.7	2058.9	2073.1	2064.3
145°	2091.2	2089.3	2119.8	2132.3	2123.4
147.5°	2150.2	2144.9	2175.3	2184.3	2177.2
150°	2207.7	2195.1	2223.8	2234.4	2225.5
152.5°	2255.9	2241.7	2268.5	2279.3	2266.8
155°	2302.6	2286.6	2308.0	2318.7	2304.4
157.5°	2340.2	2326.0	2342.1	2354.7	2340.2
160°	2372.5	2361.7	2372.5	2383.2	2370.6
162.5°	2401.1	2390.4	2399.3	2411.9	2395.8
165°	2426.2	2415.5	2420.9	2433.4	2420.9
167.5°	2446.0	2435.1	2440.6	2453.2	2437.0
170°	2462.1	2451.3	2454.9	2467.4	2451.3
172.5°	2472.8	2462.1	2465.7	2478.3	2462.1
175°	2481.7	2469.1	2472.8	2485.3	2467.4
177.5°	2485.3	2472.8	2474.7	2487.2	2471.1
180°	2476.4	2476.4	2476.4	2476.4	2476.4

TEST NUMBER: P918349

CATALOG NUMBER: DFN2DIP-TR4F0-080D090US930-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.13	9.91	10.15	10.93	12.30	5.10	5.88	6.12	6.91	8.27
	3H	10.80	11.50	11.83	12.53	13.92	6.29	6.99	7.32	8.02	9.40
	4H	11.41	12.07	12.45	13.10	14.50	6.74	7.40	7.78	8.43	9.83
	6H	11.83	12.43	12.88	13.47	14.88	7.06	7.66	8.11	8.70	10.11
	8H	11.95	12.53	13.01	13.58	14.99	7.15	7.72	8.20	8.78	10.18
	12H	12.01	12.56	13.07	13.61	15.03	7.19	7.74	8.25	8.79	10.21
4H	2H	9.14	9.80	10.19	10.84	12.23	5.69	6.35	6.74	7.39	8.78
	3H	10.97	11.51	12.02	12.58	13.98	7.04	7.59	8.09	8.65	10.06
	4H	11.66	12.16	12.72	13.21	14.64	7.59	8.09	8.65	9.14	10.57
	6H	12.17	12.60	13.24	13.68	15.10	8.00	8.43	9.07	9.51	10.93
	8H	12.34	12.74	13.41	13.81	15.25	8.13	8.53	9.20	9.60	11.04
	12H	12.44	12.80	13.52	13.88	15.33	8.20	8.56	9.28	9.64	11.09
8H	4H	11.62	12.02	12.69	13.09	14.53	7.86	8.26	8.93	9.33	10.77
	6H	12.19	12.52	13.28	13.63	15.06	8.38	8.71	9.47	9.82	11.26
	8H	12.40	12.69	13.50	13.79	15.24	8.57	8.86	9.67	9.96	11.41
	12H	12.54	12.79	13.64	13.88	15.38	8.69	8.94	9.79	10.03	11.53
12H	4H	11.57	11.93	12.66	13.02	14.46	7.86	8.23	8.95	9.31	10.75
	6H	12.16	12.45	13.26	13.55	15.00	8.43	8.72	9.53	9.81	11.27
	8H	12.38	12.63	13.48	13.72	15.22	8.64	8.89	9.74	9.98	11.48

END OF REPORT