

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P918393

Luminaire Tested: DFN2DIP-TR4F0-090D110US930-RLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P918393
REPORT IS A COMBINATION OF REPORTS P902026 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-090D110US930-RLLONL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15115.6 lumens
Efficiency: N/A
Efficacy: 87.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 172.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.099
Total Harmonic Distortion (THDi): 0.979
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P918393

CATALOG NUMBER: DFN2DIP-TR4F0-090D110US930-RLLONL

Luminous Intensity Polar Plot

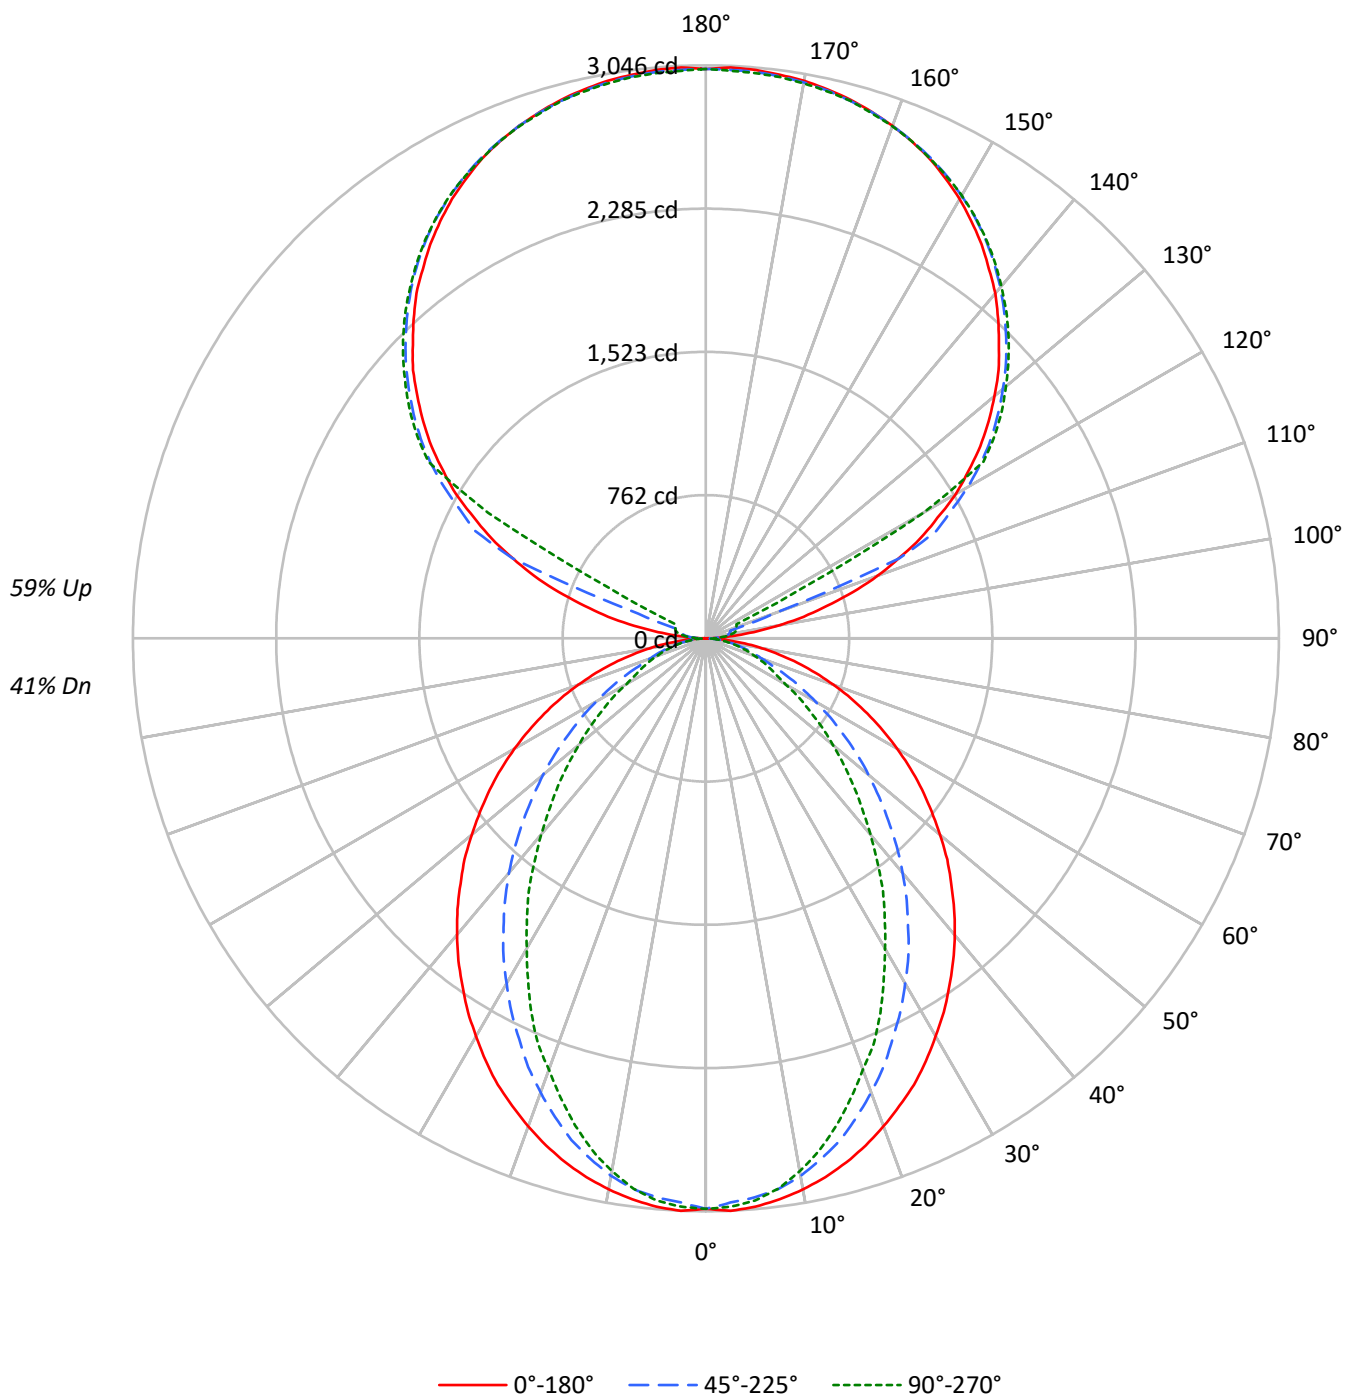

TEST NUMBER: P918393

CATALOG NUMBER: DFN2DIP-TR4F0-090D110US930-RLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	78	78	78	63	63	63	48	48	48
1	96	92	88	85	88	84	81	78	69	67	65	56	54	53	43	42	41
2	88	81	75	70	80	74	69	65	61	58	55	49	47	45	38	37	35
3	80	71	64	59	73	65	59	55	54	50	46	44	41	38	34	32	31
4	74	63	56	50	67	58	52	47	48	44	40	39	36	33	31	29	27
5	68	57	49	43	62	52	45	40	44	38	35	36	32	29	28	26	24
6	63	51	43	38	57	47	40	35	39	34	30	32	28	26	26	23	21
7	58	46	38	33	53	42	36	31	36	31	27	29	26	23	24	21	19
8	54	42	34	29	49	39	32	27	33	28	24	27	23	20	22	19	17
9	50	38	31	26	46	35	29	25	30	25	21	25	21	18	20	17	15
10	47	35	28	23	43	33	26	22	28	23	19	23	19	17	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2409	2409	2409
5°	2413	2371	2386
10°	2389	2324	2308
15°	2356	2248	2188
20°	2313	2142	2041
25°	2268	2023	1899
30°	2209	1901	1718
35°	2150	1770	1560
40°	2090	1635	1378
45°	2021	1485	1213
50°	1949	1333	1052
55°	1875	1171	898
60°	1788	1002	739
65°	1688	829	665
70°	1568	669	602
75°	1416	589	547
80°	1197	494	474
85°	834	330	356

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2021 cd/sqm

TEST NUMBER: P918393

CATALOG NUMBER: DFN2DIP-TR4F0-090D110US930-RLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	284.2	1.9
10°-20°	780.3	5.2
20°-30°	1095.5	7.2
30°-40°	1194.1	7.9
40°-50°	1097.5	7.3
50°-60°	861.9	5.7
60°-70°	561.0	3.7
70°-80°	288.8	1.9
80°-90°	79.0	0.5
90°-100°	99.8	0.7
100°-110°	372.1	2.5
110°-120°	986.7	6.5
120°-130°	1636.6	10.8
130°-140°	1738.4	11.5
140°-150°	1615.7	10.7
150°-160°	1298.9	8.6
160°-170°	837.0	5.5
170°-180°	288.1	1.9
0°-30°	2159.9	14.3
0°-40°	3354.0	22.2
0°-60°	5313.5	35.2
0°-90°	6242.4	41.3
90°-120°	1458.6	9.6
90°-150°	6449.2	42.7
90°-180°	8873.0	58.7
0°-180°	15115.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3033	3033	3033	3033	3033	
5°	3033	3019	2983	3008	3000	288
15°	2884	2854	2761	2709	2682	813
25°	2618	2530	2349	2237	2196	1204
35°	2256	2116	1875	1702	1641	1412
45°	1844	1660	1372	1177	1111	1424
55°	1402	1188	892	727	675	1253
65°	947	724	478	384	376	939
75°	505	313	220	200	198	534
85°	118	60	52	52	52	135
90°	2	26	44	55	59	14
95°	142	70	85	96	94	169
105°	666	732	134	158	166	711
115°	1259	1296	1351	337	180	1240
125°	1780	1809	1851	1866	1872	1588
135°	2203	2238	2258	2280	2276	1702
145°	2556	2554	2591	2606	2595	1599
155°	2814	2795	2821	2834	2816	1297
165°	2965	2952	2959	2974	2959	838
175°	3033	3018	3022	3038	3016	289
180°	3027	3027	3027	3027	3027	

TEST NUMBER: P918393

CATALOG NUMBER: DFN2DIP-TR4F0-090D110US930-RLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3032.7	3032.7	3032.7	3032.7	3032.7
2.5°	3046.4	3032.7	3002.3	3030.1	3024.5
5°	3032.7	3019.0	2983.2	3007.9	2999.7
7.5°	3007.9	2991.6	2953.2	2963.9	2950.2
10°	2975.0	2955.8	2901.1	2892.6	2876.3
12.5°	2933.9	2909.2	2835.0	2818.6	2788.3
15°	2884.4	2854.2	2761.0	2708.8	2681.5
17.5°	2826.8	2782.9	2667.5	2607.2	2563.3
20°	2761.0	2706.0	2568.8	2500.4	2439.8
22.5°	2689.7	2626.5	2467.2	2374.0	2333.0
25°	2618.3	2530.4	2349.3	2236.9	2195.5
27.5°	2533.3	2439.8	2239.5	2110.5	2047.3
30°	2442.7	2338.2	2118.6	1978.9	1904.6
32.5°	2354.7	2228.4	2003.6	1838.8	1770.1
35°	2256.1	2116.0	1874.6	1701.7	1641.1
37.5°	2160.0	2008.9	1753.8	1564.2	1495.8
40°	2058.4	1893.9	1627.4	1432.6	1361.3
42.5°	1954.1	1778.6	1501.3	1298.1	1229.6
45°	1844.4	1660.4	1372.3	1177.2	1111.4
47.5°	1740.1	1545.3	1248.9	1053.8	993.5
50°	1624.8	1430.0	1128.0	938.5	881.1
52.5°	1512.1	1306.3	1012.8	831.6	779.5
55°	1402.3	1188.3	891.9	727.4	675.2
57.5°	1290.0	1070.4	785.1	631.3	587.3
60°	1174.6	955.0	672.4	532.6	488.6
62.5°	1062.3	842.7	576.3	444.7	422.8
65°	946.9	724.5	477.5	384.3	375.9
67.5°	837.1	614.7	384.3	337.5	329.3
70°	721.9	507.8	318.3	290.9	279.8
72.5°	612.0	408.8	266.1	244.3	238.8
75°	504.9	312.7	219.6	200.3	197.7
77.5°	398.0	222.2	172.9	161.9	156.4
80°	299.1	159.3	131.6	120.8	120.8
82.5°	208.5	107.1	90.6	85.0	85.0
85°	117.9	60.3	52.1	52.1	52.1
87.5°	43.9	21.8	21.8	19.2	19.2
90°	2.1	26.3	43.7	54.9	59.0
92.5°	54.9	46.1	52.5	57.0	59.0
95°	142.3	70.0	85.3	96.4	94.2
97.5°	256.2	76.7	111.5	118.3	120.4
100°	387.8	87.6	124.8	142.3	146.7
102.5°	532.1	527.9	129.2	153.2	160.0
105°	665.8	731.6	133.7	157.6	166.5
107.5°	821.3	875.9	138.1	162.0	170.9
110°	970.3	1016.1	383.4	164.4	172.9



TEST NUMBER: P918393

CATALOG NUMBER: DFN2DIP-TR4F0-090D110US930-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1110.5	1149.7	1112.6	168.5	175.3
115°	1259.2	1296.4	1351.4	337.3	179.7
117.5°	1388.5	1432.2	1469.7	1156.3	582.5
120°	1533.1	1565.9	1605.4	1631.7	1335.9
122.5°	1655.6	1690.7	1734.6	1747.7	1750.0
125°	1780.4	1809.1	1850.6	1866.0	1872.5
127.5°	1894.3	1925.0	1958.0	1979.9	1982.0
130°	2001.7	2036.9	2060.7	2085.0	2082.9
132.5°	2111.2	2139.8	2163.8	2183.5	2181.5
135°	2203.3	2238.4	2257.9	2280.1	2275.6
137.5°	2299.5	2325.8	2347.9	2369.7	2363.2
140°	2393.7	2411.3	2435.3	2455.0	2444.1
142.5°	2472.7	2488.0	2516.4	2533.9	2522.9
145°	2556.0	2553.6	2590.8	2606.2	2595.3
147.5°	2628.0	2621.5	2658.7	2669.6	2661.1
150°	2698.2	2682.9	2718.0	2731.0	2720.1
152.5°	2757.3	2739.8	2772.6	2785.9	2770.5
155°	2814.2	2794.7	2820.9	2834.0	2816.5
157.5°	2860.2	2842.8	2862.6	2877.9	2860.2
160°	2899.8	2886.5	2899.8	2912.7	2897.4
162.5°	2934.6	2921.6	2932.5	2947.9	2928.1
165°	2965.3	2952.3	2958.8	2974.1	2958.8
167.5°	2989.5	2976.2	2983.0	2998.3	2978.6
170°	3009.3	2996.0	3000.4	3015.8	2996.0
172.5°	3022.2	3009.3	3013.7	3029.0	3009.3
175°	3033.2	3017.8	3022.2	3037.6	3015.8
177.5°	3037.6	3022.2	3024.6	3039.9	3020.2
180°	3026.7	3026.7	3026.7	3026.7	3026.7

TEST NUMBER: P918393

CATALOG NUMBER: DFN2DIP-TR4F0-090D110US930-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.33	10.09	10.36	11.13	12.52	5.30	6.06	6.34	7.10	8.49
	3H	11.00	11.68	12.04	12.73	14.14	6.48	7.17	7.53	8.21	9.63
	4H	11.60	12.25	12.66	13.30	14.72	6.93	7.58	7.99	8.63	10.05
	6H	12.02	12.62	13.09	13.67	15.10	7.25	7.85	8.32	8.90	10.33
	8H	12.15	12.71	13.22	13.78	15.21	7.34	7.91	8.41	8.97	10.40
	12H	12.21	12.74	13.28	13.81	15.25	7.38	7.92	8.46	8.98	10.43
4H	2H	9.34	9.98	10.40	11.03	12.45	5.89	6.53	6.95	7.58	9.00
	3H	11.16	11.70	12.23	12.77	14.21	7.23	7.77	8.30	8.85	10.28
	4H	11.85	12.34	12.93	13.41	14.86	7.78	8.27	8.85	9.34	10.79
	6H	12.36	12.78	13.45	13.87	15.32	8.20	8.62	9.28	9.71	11.16
	8H	12.53	12.93	13.62	14.01	15.47	8.32	8.72	9.41	9.80	11.26
	12H	12.63	12.98	13.73	14.08	15.55	8.39	8.74	9.49	9.84	11.31
8H	4H	11.81	12.21	12.90	13.29	14.75	8.05	8.45	9.14	9.53	10.99
	6H	12.38	12.70	13.48	13.83	15.29	8.57	8.90	9.68	10.02	11.48
	8H	12.59	12.88	13.71	13.98	15.46	8.76	9.05	9.88	10.15	11.63
	12H	12.73	12.98	13.84	14.08	15.60	8.88	9.13	10.00	10.23	11.75
12H	4H	11.76	12.12	12.86	13.21	14.68	8.06	8.41	9.16	9.51	10.98
	6H	12.35	12.64	13.46	13.74	15.22	8.62	8.90	9.73	10.01	11.49
	8H	12.57	12.82	13.69	13.92	15.44	8.83	9.08	9.94	10.18	11.70

END OF REPORT