

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P918421

Luminaire Tested: DFN2DIP-TR4F0-100D090US930-RLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P918421
REPORT IS A COMBINATION OF REPORTS P901992 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-100D090US930-RLLONL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14194.4 lumens
Efficiency: N/A
Efficacy: 84.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 168.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9972
Total Harmonic Distortion (THDi): 0.128
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P918421

CATALOG NUMBER: DFN2DIP-TR4F0-100D090US930-RLLONL

Luminous Intensity Polar Plot

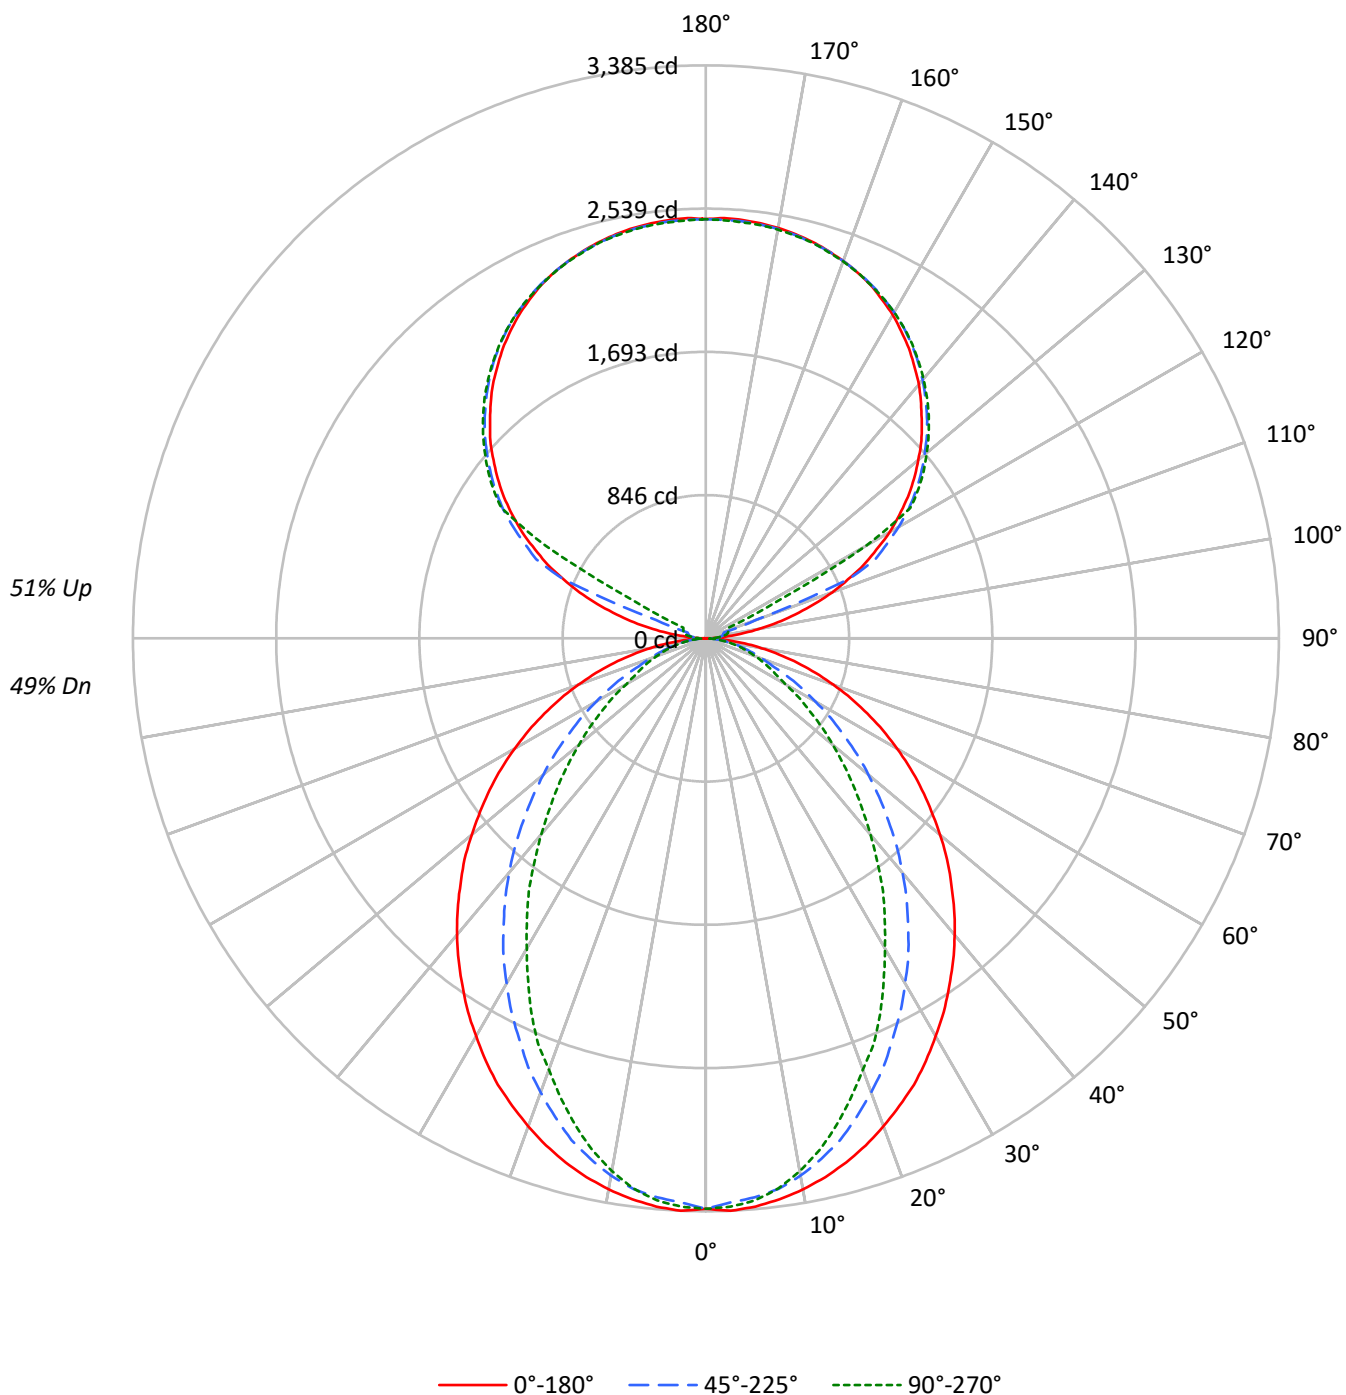

TEST NUMBER: P918421

CATALOG NUMBER: DFN2DIP-TR4F0-100D090US930-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	98	98	98	98	83	83	83	68	68	68	55	55	55
1	98	94	90	87	90	87	83	81	73	71	69	61	59	58	49	48	47
2	90	83	77	72	82	76	71	67	65	61	58	54	51	49	44	42	41
3	82	73	66	60	75	68	61	56	57	53	49	48	45	42	39	37	35
4	75	65	57	51	69	60	53	48	51	46	42	43	39	36	36	33	31
5	69	58	50	44	64	54	47	42	46	41	37	39	35	32	32	29	27
6	64	52	44	39	59	49	42	37	42	36	32	35	31	28	29	26	24
7	59	47	40	34	55	44	37	32	38	33	29	32	28	25	27	24	22
8	55	43	35	30	51	40	33	29	35	29	26	30	26	22	25	22	19
9	51	39	32	27	47	37	30	26	32	27	23	27	23	20	23	20	18
10	48	36	29	24	44	34	28	23	30	24	21	25	21	18	21	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2677	2677	2677
5°	2681	2634	2651
10°	2655	2583	2565
15°	2618	2497	2431
20°	2570	2380	2268
25°	2520	2248	2110
30°	2454	2112	1909
35°	2389	1967	1733
40°	2323	1816	1531
45°	2246	1650	1348
50°	2166	1481	1169
55°	2083	1301	997
60°	1987	1113	821
65°	1876	921	739
70°	1742	743	669
75°	1573	655	608
80°	1329	549	527
85°	926	366	396

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2246 cd/sqm

TEST NUMBER: P918421

CATALOG NUMBER: DFN2DIP-TR4F0-100D090US930-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	315.8	2.2
10°-20°	866.9	6.1
20°-30°	1217.2	8.6
30°-40°	1326.8	9.3
40°-50°	1219.5	8.6
50°-60°	957.7	6.7
60°-70°	623.4	4.4
70°-80°	320.9	2.3
80°-90°	86.3	0.6
90°-100°	81.7	0.6
100°-110°	304.4	2.1
110°-120°	807.3	5.7
120°-130°	1339.0	9.4
130°-140°	1422.3	10.0
140°-150°	1321.9	9.3
150°-160°	1062.8	7.5
160°-170°	684.8	4.8
170°-180°	235.7	1.7
0°-30°	2399.9	16.9
0°-40°	3726.7	26.3
0°-60°	5903.9	41.6
0°-90°	6934.4	48.9
90°-120°	1193.4	8.4
90°-150°	5276.6	37.2
90°-180°	7260.0	51.1
0°-180°	14194.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3370	3370	3370	3370	3370	
5°	3370	3354	3315	3342	3333	320
15°	3205	3171	3068	3010	2979	903
25°	2909	2812	2610	2485	2440	1338
35°	2507	2351	2083	1891	1823	1569
45°	2049	1845	1525	1308	1235	1583
55°	1558	1320	991	808	750	1392
65°	1052	805	531	427	418	1043
75°	561	348	244	223	220	593
85°	131	67	58	58	58	150
90°	2	22	36	45	48	13
95°	116	57	70	79	77	138
105°	545	599	109	129	136	582
115°	1030	1061	1106	276	147	1014
125°	1457	1480	1514	1527	1532	1299
135°	1803	1831	1847	1866	1862	1393
145°	2091	2089	2120	2132	2123	1308
155°	2303	2287	2308	2319	2304	1061
165°	2426	2416	2421	2433	2421	685
175°	2482	2469	2473	2485	2467	236
180°	2476	2476	2476	2476	2476	

TEST NUMBER: P918421

CATALOG NUMBER: DFN2DIP-TR4F0-100D090US930-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3369.6	3369.6	3369.6	3369.6	3369.6
2.5°	3384.8	3369.6	3336.0	3366.7	3360.6
5°	3369.6	3354.4	3314.6	3342.2	3333.0
7.5°	3342.2	3324.0	3281.2	3293.2	3278.1
10°	3305.5	3284.2	3223.4	3214.0	3195.9
12.5°	3260.0	3232.4	3149.9	3131.8	3098.1
15°	3204.9	3171.3	3067.7	3009.8	2979.4
17.5°	3140.9	3092.0	2963.9	2896.9	2848.1
20°	3067.7	3006.6	2854.2	2778.2	2710.9
22.5°	2988.5	2918.3	2741.3	2637.8	2592.2
25°	2909.2	2811.6	2610.3	2485.4	2439.5
27.5°	2814.7	2710.9	2488.3	2345.0	2274.8
30°	2714.1	2597.9	2354.0	2198.8	2116.3
32.5°	2616.5	2476.0	2226.3	2043.1	1966.7
35°	2506.7	2351.2	2082.9	1890.8	1823.4
37.5°	2400.0	2232.0	1948.6	1738.1	1662.0
40°	2287.1	2104.3	1808.2	1591.8	1512.5
42.5°	2171.2	1976.1	1668.2	1442.3	1366.3
45°	2049.3	1844.8	1524.9	1308.1	1234.9
47.5°	1933.5	1717.0	1387.6	1170.8	1103.9
50°	1805.3	1588.9	1253.4	1042.8	979.0
52.5°	1680.1	1451.4	1125.3	924.0	866.1
55°	1558.1	1320.4	991.0	808.2	750.2
57.5°	1433.3	1189.3	872.3	701.4	652.6
60°	1305.1	1061.2	747.1	591.7	542.9
62.5°	1180.2	936.3	640.3	494.1	469.8
65°	1052.1	804.9	530.6	427.1	417.7
67.5°	930.2	683.0	427.1	375.0	365.9
70°	802.0	564.3	353.6	323.2	311.0
72.5°	680.0	454.2	295.7	271.4	265.3
75°	561.0	347.5	243.9	222.6	219.6
77.5°	442.3	246.9	192.2	179.9	173.7
80°	332.2	177.0	146.3	134.3	134.3
82.5°	231.6	119.0	100.6	94.5	94.5
85°	131.0	66.9	57.9	57.9	57.9
87.5°	48.8	24.3	24.3	21.4	21.4
90°	1.7	21.5	35.7	44.9	48.3
92.5°	44.9	37.7	43.0	46.6	48.3
95°	116.4	57.2	69.8	78.9	77.0
97.5°	209.6	62.8	91.3	96.8	98.5
100°	317.2	71.7	102.2	116.4	120.0
102.5°	435.4	431.9	105.7	125.3	130.9
105°	544.7	598.6	109.3	129.0	136.2
107.5°	672.0	716.6	113.0	132.6	139.8
110°	793.9	831.4	313.6	134.4	141.5



TEST NUMBER: P918421

CATALOG NUMBER: DFN2DIP-TR4F0-100D090US930-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	908.6	940.7	910.3	137.9	143.4
115°	1030.3	1060.7	1105.6	276.0	147.0
117.5°	1136.0	1171.8	1202.4	946.1	476.6
120°	1254.3	1281.2	1313.5	1335.0	1093.1
122.5°	1354.6	1383.3	1419.3	1429.9	1431.8
125°	1456.7	1480.1	1514.2	1526.7	1532.0
127.5°	1549.9	1575.0	1602.1	1619.9	1621.6
130°	1637.8	1666.6	1686.1	1705.8	1704.2
132.5°	1727.4	1750.8	1770.3	1786.6	1784.9
135°	1802.7	1831.4	1847.4	1865.5	1861.9
137.5°	1881.5	1902.9	1921.0	1938.9	1933.6
140°	1958.4	1972.9	1992.5	2008.7	1999.8
142.5°	2023.2	2035.7	2058.9	2073.1	2064.3
145°	2091.2	2089.3	2119.8	2132.3	2123.4
147.5°	2150.2	2144.9	2175.3	2184.3	2177.2
150°	2207.7	2195.1	2223.8	2234.4	2225.5
152.5°	2255.9	2241.7	2268.5	2279.3	2266.8
155°	2302.6	2286.6	2308.0	2318.7	2304.4
157.5°	2340.2	2326.0	2342.1	2354.7	2340.2
160°	2372.5	2361.7	2372.5	2383.2	2370.6
162.5°	2401.1	2390.4	2399.3	2411.9	2395.8
165°	2426.2	2415.5	2420.9	2433.4	2420.9
167.5°	2446.0	2435.1	2440.6	2453.2	2437.0
170°	2462.1	2451.3	2454.9	2467.4	2451.3
172.5°	2472.8	2462.1	2465.7	2478.3	2462.1
175°	2481.7	2469.1	2472.8	2485.3	2467.4
177.5°	2485.3	2472.8	2474.7	2487.2	2471.1
180°	2476.4	2476.4	2476.4	2476.4	2476.4

TEST NUMBER: P918421

CATALOG NUMBER: DFN2DIP-TR4F0-100D090US930-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.45	11.28	11.43	12.26	13.55	6.43	7.25	7.40	8.23	9.52
	3H	12.13	12.87	13.12	13.86	15.17	7.62	8.35	8.60	9.34	10.66
	4H	12.74	13.43	13.74	14.43	15.75	8.07	8.76	9.07	9.76	11.08
	6H	13.16	13.80	14.17	14.80	16.13	8.39	9.03	9.40	10.03	11.36
	8H	13.29	13.89	14.30	14.91	16.24	8.48	9.09	9.49	10.10	11.43
	12H	13.35	13.92	14.37	14.94	16.29	8.52	9.10	9.54	10.11	11.46
4H	2H	10.47	11.17	11.48	12.16	13.48	7.02	7.72	8.03	8.71	10.03
	3H	12.30	12.88	13.31	13.90	15.24	8.37	8.95	9.39	9.97	11.31
	4H	12.99	13.52	14.01	14.54	15.89	8.92	9.45	9.94	10.47	11.82
	6H	13.51	13.96	14.54	15.00	16.35	9.34	9.79	10.37	10.83	12.19
	8H	13.68	14.10	14.71	15.14	16.51	9.47	9.89	10.50	10.93	12.29
	12H	13.78	14.16	14.83	15.21	16.58	9.54	9.92	10.59	10.97	12.34
8H	4H	12.96	13.38	13.99	14.41	15.78	9.20	9.62	10.23	10.66	12.02
	6H	13.52	13.87	14.58	14.95	16.31	9.72	10.07	10.78	11.14	12.51
	8H	13.74	14.05	14.80	15.11	16.49	9.91	10.22	10.97	11.28	12.66
	12H	13.88	14.15	14.95	15.20	16.63	10.03	10.30	11.10	11.36	12.78
12H	4H	12.91	13.29	13.96	14.34	15.71	9.20	9.59	10.25	10.63	12.01
	6H	13.50	13.81	14.56	14.87	16.25	9.77	10.08	10.83	11.14	12.52
	8H	13.72	13.99	14.79	15.04	16.47	9.98	10.25	11.05	11.30	12.73

END OF REPORT