

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P918426

Luminaire Tested: DFN2DIP-TR4F0-100D110US930-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P918426
REPORT IS A COMBINATION OF REPORTS P900507 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-100D110US930-FLLFLL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16008.4 lumens
Efficiency: N/A
Efficacy: 86.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 185.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9972
Total Harmonic Distortion (THDi): 0.128
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P918426

CATALOG NUMBER: DFN2DIP-TR4F0-100D110US930-FLLFLL

Luminous Intensity Polar Plot

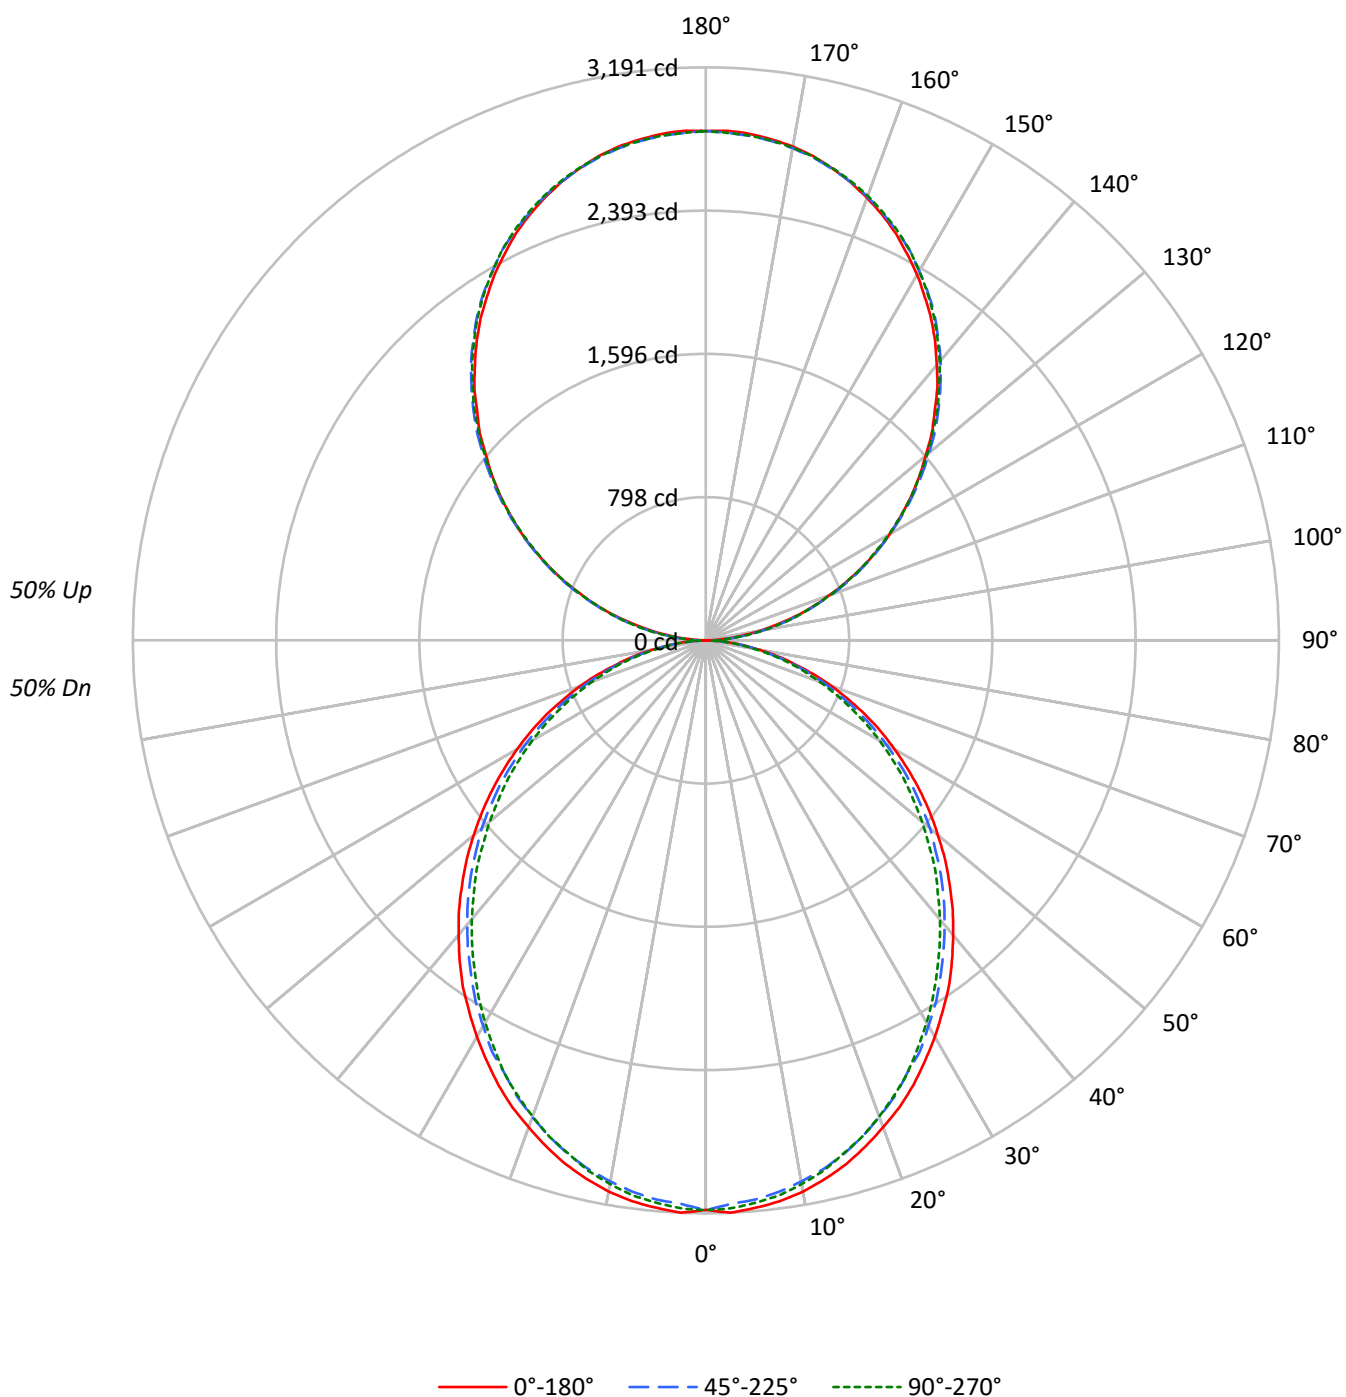

TEST NUMBER: P918426

CATALOG NUMBER: DFN2DIP-TR4F0-100D110US930-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	84	84	84	69	69	69	57	57	57
1	98	94	90	86	90	86	83	80	73	71	69	61	59	58	50	49	48
2	89	82	76	70	82	76	70	66	64	60	57	54	51	48	44	42	40
3	81	72	64	59	75	67	60	55	57	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	30
5	68	57	49	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	41	35	31	34	30	27	29	25	23
7	58	46	38	32	54	43	36	31	37	31	27	31	27	24	26	23	20
8	54	42	34	29	50	39	32	27	34	28	24	29	24	21	24	21	18
9	50	38	31	25	46	36	29	24	31	25	22	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2520	2520	2520
5°	2524	2485	2502
10°	2504	2452	2468
15°	2467	2411	2415
20°	2417	2355	2361
25°	2368	2288	2298
30°	2306	2226	2218
35°	2247	2152	2134
40°	2175	2078	2053
45°	2103	2003	1971
50°	2024	1925	1876
55°	1941	1834	1789
60°	1848	1727	1689
65°	1746	1616	1571
70°	1617	1480	1443
75°	1437	1318	1326
80°	1221	1111	1101
85°	883	754	730

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2210 cd/sqm

TEST NUMBER: P918426

CATALOG NUMBER: DFN2DIP-TR4F0-100D110US930-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	298.6	1.9
10°-20°	840.1	5.2
20°-30°	1234.6	7.7
30°-40°	1433.9	9.0
40°-50°	1432.1	8.9
50°-60°	1248.8	7.8
60°-70°	923.1	5.8
70°-80°	522.3	3.3
80°-90°	145.9	0.9
90°-100°	175.5	1.1
100°-110°	557.7	3.5
110°-120°	954.3	6.0
120°-130°	1255.1	7.8
130°-140°	1408.8	8.8
140°-150°	1381.5	8.6
150°-160°	1158.9	7.2
160°-170°	768.5	4.8
170°-180°	268.6	1.7
0°-30°	2373.3	14.8
0°-40°	3807.2	23.8
0°-60°	6488.2	40.5
0°-90°	8079.5	50.5
90°-120°	1687.5	10.5
90°-150°	5732.8	35.8
90°-180°	7929.0	49.5
0°-180°	16008.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3172	3172	3172	3172	3172	
5°	3172	3160	3127	3151	3145	301
15°	3020	3002	2962	2974	2959	851
25°	2733	2709	2657	2663	2657	1258
35°	2358	2328	2279	2260	2245	1473
45°	1919	1898	1852	1818	1806	1481
55°	1452	1434	1397	1361	1345	1298
65°	979	961	930	903	888	968
75°	512	506	491	473	479	547
85°	125	122	119	110	107	139
90°	2	31	84	79	81	15
95°	125	149	153	153	149	139
105°	515	522	527	531	531	543
115°	958	971	967	965	958	947
125°	1393	1414	1407	1400	1397	1245
135°	1802	1828	1833	1831	1824	1393
145°	2187	2204	2218	2221	2211	1367
155°	2501	2508	2516	2528	2520	1151
165°	2721	2718	2718	2735	2723	768
175°	2831	2824	2819	2836	2822	269
180°	2836	2836	2836	2836	2836	

TEST NUMBER: P918426

CATALOG NUMBER: DFN2DIP-TR4F0-100D110US930-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3172.4	3172.4	3172.4	3172.4	3172.4
2.5°	3190.8	3175.6	3141.9	3172.4	3166.5
5°	3172.4	3160.4	3126.8	3151.0	3145.2
7.5°	3151.0	3132.9	3099.2	3123.8	3117.7
10°	3117.7	3096.3	3059.7	3084.0	3075.0
12.5°	3071.7	3053.6	3017.0	3032.3	3026.1
15°	3019.9	3001.8	2962.0	2974.3	2959.1
17.5°	2955.9	2937.8	2897.9	2913.1	2897.9
20°	2885.6	2867.5	2824.8	2833.8	2821.8
22.5°	2815.7	2788.2	2748.4	2748.4	2742.3
25°	2733.2	2708.9	2657.1	2662.9	2657.1
27.5°	2641.6	2620.2	2580.7	2571.7	2556.4
30°	2550.3	2525.7	2480.1	2471.0	2458.7
32.5°	2452.6	2434.5	2385.6	2367.1	2354.8
35°	2358.1	2327.7	2278.8	2260.3	2245.1
37.5°	2251.3	2223.7	2174.9	2153.5	2138.3
40°	2141.5	2116.9	2068.1	2040.9	2028.6
42.5°	2034.7	2010.1	1961.6	1930.9	1912.8
45°	1918.9	1897.5	1851.5	1818.2	1806.0
47.5°	1806.0	1784.6	1735.7	1702.0	1683.9
50°	1686.9	1671.6	1628.9	1586.2	1571.0
52.5°	1571.0	1549.6	1510.1	1476.5	1455.1
55°	1452.2	1433.8	1397.2	1360.6	1345.4
57.5°	1333.1	1317.8	1278.1	1241.5	1229.2
60°	1214.0	1202.0	1159.3	1125.6	1116.6
62.5°	1098.1	1076.8	1046.4	1015.9	1003.6
65°	979.3	960.9	930.5	902.9	887.8
67.5°	857.4	841.8	814.6	793.3	781.0
70°	744.4	732.1	704.6	683.2	671.2
72.5°	628.5	616.2	601.0	579.7	570.5
75°	512.3	506.5	491.0	472.9	479.0
77.5°	408.8	396.5	390.3	381.2	372.2
80°	305.2	302.0	295.8	286.7	280.6
82.5°	207.5	207.5	204.6	192.2	192.2
85°	124.9	122.1	119.1	109.7	106.8
87.5°	55.0	48.8	42.7	33.7	30.4
90°	2.5	30.8	83.8	78.7	81.2
92.5°	53.0	71.8	74.4	77.0	77.0
95°	124.8	148.8	153.0	153.0	148.8
97.5°	207.8	230.0	239.5	239.5	239.5
100°	303.5	323.2	330.0	330.0	327.5
102.5°	404.5	419.0	428.4	431.0	428.4
105°	514.8	521.6	526.8	531.0	531.0
107.5°	624.2	634.5	634.5	636.2	624.2
110°	730.3	744.0	744.0	744.0	737.1

TEST NUMBER: P918426

CATALOG NUMBER: DFN2DIP-TR4F0-100D110US930-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	844.8	859.3	856.8	849.9	844.8
115°	957.7	971.3	967.1	964.6	957.7
117.5°	1069.8	1088.5	1076.5	1069.8	1062.9
120°	1182.6	1201.4	1182.6	1182.6	1174.9
122.5°	1285.2	1309.1	1297.1	1290.3	1285.2
125°	1392.9	1414.3	1407.4	1399.8	1397.2
127.5°	1498.1	1524.6	1515.2	1505.0	1498.1
130°	1596.4	1627.3	1622.9	1617.8	1608.4
132.5°	1706.7	1730.7	1732.4	1720.4	1713.6
135°	1801.6	1828.1	1833.3	1830.8	1823.9
137.5°	1907.7	1929.1	1933.3	1931.6	1921.4
140°	2000.9	2022.3	2034.3	2034.3	2024.9
142.5°	2096.7	2118.1	2124.9	2127.4	2118.1
145°	2187.3	2204.4	2218.1	2220.6	2211.3
147.5°	2268.6	2289.9	2300.2	2304.4	2295.1
150°	2352.4	2366.9	2376.3	2384.0	2376.3
152.5°	2426.7	2441.2	2453.2	2462.7	2453.2
155°	2501.2	2507.9	2515.7	2527.7	2519.9
157.5°	2565.3	2570.4	2574.6	2591.8	2579.8
160°	2622.6	2627.7	2630.2	2644.8	2634.6
162.5°	2675.6	2675.6	2678.2	2694.4	2682.4
165°	2720.9	2718.3	2718.3	2735.4	2723.4
167.5°	2761.9	2754.2	2754.2	2771.4	2759.4
170°	2792.7	2785.9	2783.3	2800.4	2785.9
172.5°	2814.1	2807.2	2804.7	2821.8	2807.2
175°	2831.2	2824.4	2819.2	2836.3	2821.8
177.5°	2840.6	2833.7	2828.6	2843.2	2828.6
180°	2836.3	2836.3	2836.3	2836.3	2836.3

TEST NUMBER: P918426

CATALOG NUMBER: DFN2DIP-TR4F0-100D110US930-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.52	11.39	11.47	12.35	13.62	10.09	10.95	11.04	11.92	13.19
	3H	12.18	12.96	13.14	13.94	15.22	11.71	12.48	12.67	13.46	14.75
	4H	12.77	13.50	13.75	14.49	15.78	12.30	13.03	13.27	14.01	15.31
	6H	13.17	13.85	14.16	14.83	16.14	12.69	13.37	13.68	14.36	15.67
	8H	13.27	13.92	14.27	14.92	16.23	12.80	13.44	13.79	14.45	15.75
	12H	13.32	13.93	14.32	14.93	16.26	12.84	13.45	13.84	14.45	15.78
4H	2H	10.98	11.72	11.97	12.70	13.99	10.64	11.37	11.62	12.36	13.65
	3H	12.85	13.46	13.84	14.47	15.78	12.46	13.07	13.45	14.08	15.39
	4H	13.56	14.12	14.56	15.13	16.46	13.16	13.72	14.16	14.72	16.06
	6H	14.08	14.56	15.09	15.59	16.92	13.67	14.15	14.68	15.18	16.51
	8H	14.23	14.68	15.24	15.70	17.05	13.82	14.27	14.83	15.29	16.63
	12H	14.30	14.71	15.33	15.75	17.10	13.88	14.29	14.91	15.32	16.67
8H	4H	13.76	14.21	14.77	15.23	16.58	13.40	13.85	14.41	14.87	16.22
	6H	14.39	14.77	15.43	15.83	17.17	14.03	14.40	15.07	15.46	16.81
	8H	14.61	14.94	15.66	15.99	17.35	14.24	14.57	15.29	15.62	16.98
	12H	14.74	15.03	15.79	16.08	17.48	14.36	14.65	15.41	15.69	17.10
12H	4H	13.75	14.15	14.78	15.19	16.54	13.39	13.80	14.43	14.84	16.19
	6H	14.42	14.75	15.47	15.80	17.16	14.07	14.40	15.12	15.45	16.81
	8H	14.66	14.95	15.71	16.00	17.40	14.31	14.60	15.36	15.64	17.04

END OF REPORT