

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P918482

Luminaire Tested: DFN2DIP-TR4F0-120D070US930-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P918482
REPORT IS A COMBINATION OF REPORTS P900439 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-120D070US930-FLLFLL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14736.5 lumens
Efficiency: N/A
Efficacy: 82.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 177.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9821
Total Harmonic Distortion (THDi): 0.08
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P918482

CATALOG NUMBER: DFN2DIP-TR4F0-120D070US930-FLLFLL

Luminous Intensity Polar Plot

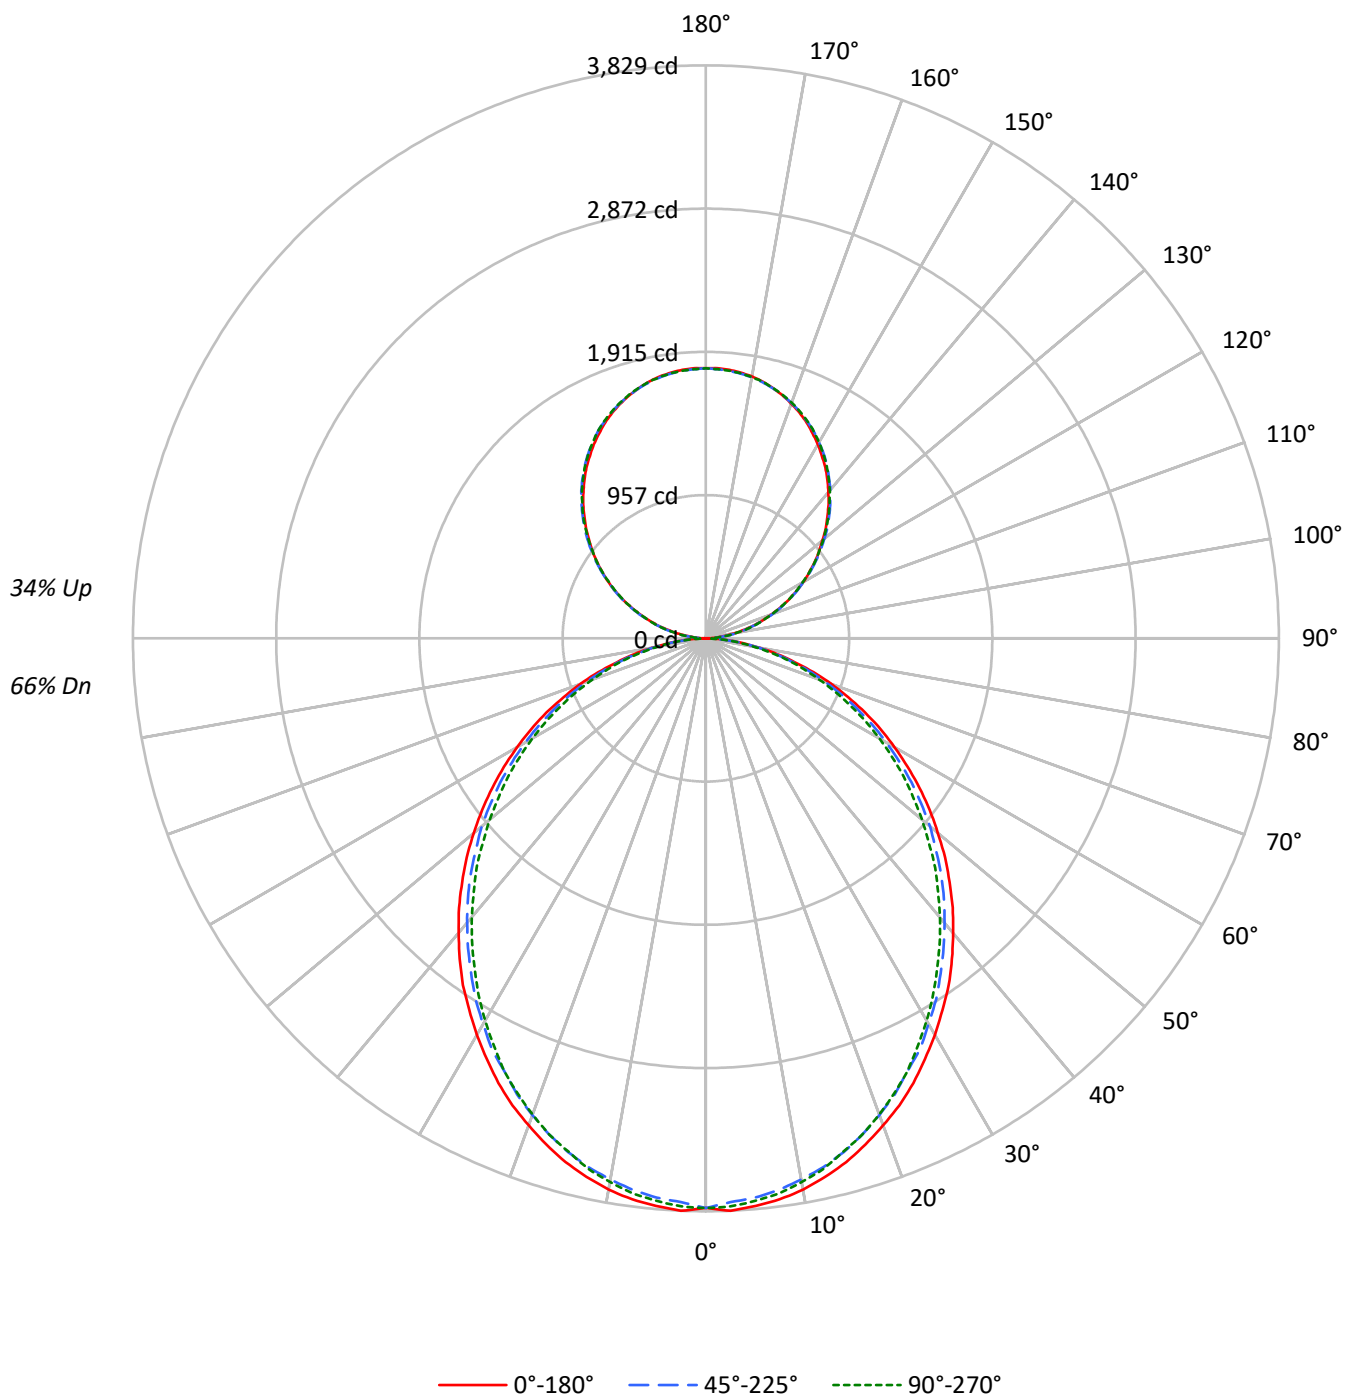

TEST NUMBER: P918482

CATALOG NUMBER: DFN2DIP-TR4F0-120D070US930-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	111	111	111	111	104	104	104	104	92	92	92	81	81	81	71	71	71
1	101	97	93	89	95	91	88	85	81	78	76	71	69	67	62	61	60
2	92	85	78	73	87	80	74	70	71	67	63	63	59	56	55	52	50
3	84	74	67	61	79	70	64	58	63	57	53	55	51	48	49	46	43
4	77	66	58	52	72	62	55	49	56	50	45	49	45	41	44	40	37
5	71	59	51	44	66	56	48	43	50	44	39	44	39	36	39	35	32
6	65	53	45	39	61	50	43	37	45	39	34	40	35	31	36	32	28
7	61	48	40	34	57	45	38	33	41	35	30	37	32	28	33	28	25
8	56	44	36	30	53	41	34	29	37	31	27	34	28	25	30	26	23
9	52	40	32	27	49	38	31	26	34	28	24	31	26	22	28	24	21
10	49	37	29	24	46	35	28	24	32	26	22	29	24	20	26	22	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3024	3024	3024
5°	3029	2982	3002
10°	3005	2942	2961
15°	2960	2893	2898
20°	2901	2826	2833
25°	2841	2746	2757
30°	2767	2671	2662
35°	2697	2582	2561
40°	2610	2493	2464
45°	2523	2404	2366
50°	2429	2310	2252
55°	2329	2201	2147
60°	2218	2072	2026
65°	2096	1939	1885
70°	1940	1776	1732
75°	1724	1581	1591
80°	1465	1333	1322
85°	1060	904	876

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2523 cd/sqm

TEST NUMBER: P918482

CATALOG NUMBER: DFN2DIP-TR4F0-120D070US930-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	358.3	2.4
10°-20°	1008.1	6.8
20°-30°	1481.5	10.1
30°-40°	1720.7	11.7
40°-50°	1718.6	11.7
50°-60°	1498.5	10.2
60°-70°	1107.8	7.5
70°-80°	626.7	4.3
80°-90°	170.5	1.2
90°-100°	111.7	0.8
100°-110°	354.9	2.4
110°-120°	607.3	4.1
120°-130°	798.7	5.4
130°-140°	896.5	6.1
140°-150°	879.1	6.0
150°-160°	737.5	5.0
160°-170°	489.1	3.3
170°-180°	170.9	1.2
0°-30°	2848.0	19.3
0°-40°	4568.7	31.0
0°-60°	7785.8	52.8
0°-90°	9690.9	65.8
90°-120°	1073.9	7.3
90°-150°	3648.2	24.8
90°-180°	5046.0	34.2
0°-180°	14736.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3807	3807	3807	3807	3807	
5°	3807	3792	3752	3781	3774	361
15°	3624	3602	3554	3569	3551	1021
25°	3280	3251	3188	3196	3188	1509
35°	2830	2793	2734	2712	2694	1767
45°	2303	2277	2222	2182	2167	1777
55°	1743	1720	1677	1633	1614	1558
65°	1175	1153	1117	1084	1065	1162
75°	615	608	589	567	575	656
85°	150	146	143	132	128	167
90°	2	20	53	50	52	14
95°	79	95	97	97	95	88
105°	328	332	335	338	338	346
115°	609	618	616	614	609	603
125°	886	900	896	891	889	792
135°	1147	1163	1167	1165	1161	886
145°	1392	1403	1412	1413	1407	870
155°	1592	1596	1601	1608	1604	733
165°	1731	1730	1730	1741	1733	488
175°	1802	1797	1794	1805	1796	171
180°	1805	1805	1805	1805	1805	

TEST NUMBER: P918482

CATALOG NUMBER: DFN2DIP-TR4F0-120D070US930-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3806.9	3806.9	3806.9	3806.9	3806.9
2.5°	3829.0	3810.7	3770.3	3806.9	3799.9
5°	3806.9	3792.4	3752.1	3781.2	3774.2
7.5°	3781.2	3759.4	3719.1	3748.6	3741.2
10°	3741.2	3715.6	3671.7	3700.8	3690.0
12.5°	3686.0	3664.3	3620.4	3638.7	3631.3
15°	3623.9	3602.2	3554.4	3569.1	3550.9
17.5°	3547.0	3525.3	3477.5	3495.8	3477.5
20°	3462.7	3441.0	3389.8	3400.6	3386.3
22.5°	3378.8	3345.8	3298.0	3298.0	3290.7
25°	3279.8	3250.7	3188.5	3195.6	3188.5
27.5°	3169.9	3144.3	3096.9	3086.0	3067.8
30°	3060.4	3030.9	2976.1	2965.2	2950.5
32.5°	2943.1	2921.4	2862.7	2840.6	2825.8
35°	2829.7	2793.2	2734.5	2712.4	2694.2
37.5°	2701.5	2668.6	2609.9	2584.3	2566.0
40°	2569.9	2540.4	2481.7	2449.1	2434.3
42.5°	2441.7	2412.2	2353.9	2317.1	2295.3
45°	2302.6	2277.0	2221.9	2181.9	2167.1
47.5°	2167.1	2141.5	2082.8	2042.5	2020.7
50°	2024.2	2006.0	1954.7	1903.4	1885.1
52.5°	1885.1	1859.5	1812.2	1771.7	1746.1
55°	1742.6	1720.5	1676.6	1632.7	1614.5
57.5°	1599.7	1581.4	1533.7	1489.8	1475.0
60°	1456.8	1442.4	1391.1	1350.8	1339.9
62.5°	1317.8	1292.1	1255.6	1219.1	1204.4
65°	1175.3	1153.1	1116.6	1083.5	1065.4
67.5°	1028.8	1010.2	977.5	951.9	937.2
70°	893.2	878.5	845.5	819.9	805.5
72.5°	754.2	739.5	721.2	695.6	684.7
75°	614.8	607.8	589.1	567.4	574.8
77.5°	490.5	475.7	468.4	457.5	446.6
80°	366.2	362.3	355.0	344.1	336.7
82.5°	248.9	248.9	245.5	230.7	230.7
85°	149.9	146.4	142.9	131.7	128.2
87.5°	66.0	58.6	51.3	40.4	36.5
90°	1.6	19.6	53.3	50.1	51.7
92.5°	33.8	45.7	47.4	49.0	49.0
95°	79.4	94.7	97.4	97.4	94.7
97.5°	132.2	146.3	152.4	152.4	152.4
100°	193.1	205.7	210.0	210.0	208.4
102.5°	257.4	266.6	272.6	274.3	272.6
105°	327.6	331.9	335.2	337.9	337.9
107.5°	397.2	403.7	403.7	404.9	397.2
110°	464.7	473.4	473.4	473.4	469.0

TEST NUMBER: P918482

CATALOG NUMBER: DFN2DIP-TR4F0-120D070US930-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	537.6	546.9	545.3	540.9	537.6
115°	609.4	618.2	615.5	613.8	609.4
117.5°	680.7	692.7	685.1	680.7	676.4
120°	752.5	764.5	752.5	752.5	747.6
122.5°	817.8	833.1	825.5	821.1	817.8
125°	886.4	900.0	895.7	890.8	889.2
127.5°	953.3	970.2	964.3	957.7	953.3
130°	1015.9	1035.5	1032.8	1029.6	1023.5
132.5°	1086.1	1101.4	1102.4	1094.9	1090.5
135°	1146.6	1163.3	1166.7	1165.0	1160.7
137.5°	1214.0	1227.6	1230.3	1229.2	1222.7
140°	1273.3	1286.9	1294.5	1294.5	1288.6
142.5°	1334.2	1347.9	1352.2	1353.8	1347.9
145°	1392.0	1402.8	1411.5	1413.2	1407.2
147.5°	1443.6	1457.3	1463.8	1466.5	1460.5
150°	1497.0	1506.2	1512.2	1517.1	1512.2
152.5°	1544.3	1553.6	1561.1	1567.2	1561.1
155°	1591.6	1595.9	1600.9	1608.5	1603.6
157.5°	1632.5	1635.7	1638.4	1649.3	1641.7
160°	1668.9	1672.2	1673.8	1683.0	1676.5
162.5°	1702.7	1702.7	1704.3	1714.6	1707.0
165°	1731.4	1729.8	1729.8	1740.7	1733.1
167.5°	1757.6	1752.7	1752.7	1763.6	1756.0
170°	1777.2	1772.9	1771.2	1782.1	1772.9
172.5°	1790.8	1786.4	1784.8	1795.7	1786.4
175°	1801.6	1797.3	1794.1	1804.9	1795.7
177.5°	1807.7	1803.3	1800.0	1809.3	1800.0
180°	1804.9	1804.9	1804.9	1804.9	1804.9

TEST NUMBER: P918482

CATALOG NUMBER: DFN2DIP-TR4F0-120D070US930-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.45	13.47	13.26	14.31	15.33	12.02	13.04	12.83	13.87	14.90
	3H	14.12	15.04	14.94	15.88	16.94	13.65	14.57	14.47	15.41	16.47
	4H	14.72	15.59	15.56	16.43	17.50	14.24	15.11	15.08	15.96	17.03
	6H	15.13	15.93	15.98	16.78	17.86	14.65	15.45	15.50	16.31	17.39
	8H	15.23	16.00	16.09	16.87	17.95	14.76	15.52	15.62	16.40	17.48
	12H	15.29	16.02	16.15	16.88	17.99	14.81	15.54	15.67	16.40	17.51
4H	2H	12.93	13.80	13.77	14.65	15.71	12.59	13.46	13.43	14.30	15.37
	3H	14.81	15.54	15.67	16.42	17.50	14.42	15.14	15.27	16.03	17.11
	4H	15.53	16.19	16.40	17.07	18.18	15.13	15.79	16.00	16.67	17.78
	6H	16.06	16.63	16.94	17.53	18.64	15.65	16.22	16.53	17.12	18.23
	8H	16.21	16.74	17.10	17.64	18.77	15.80	16.33	16.68	17.23	18.35
	12H	16.29	16.77	17.20	17.69	18.82	15.87	16.35	16.78	17.27	18.40
8H	4H	15.74	16.28	16.63	17.17	18.30	15.38	15.92	16.27	16.81	17.94
	6H	16.38	16.82	17.29	17.76	18.89	16.02	16.46	16.93	17.40	18.52
	8H	16.60	16.99	17.53	17.93	19.07	16.23	16.63	17.16	17.56	18.70
	12H	16.74	17.09	17.67	18.01	19.20	16.36	16.70	17.28	17.63	18.82
12H	4H	15.74	16.22	16.64	17.13	18.26	15.38	15.87	16.29	16.78	17.91
	6H	16.41	16.80	17.34	17.74	18.88	16.06	16.45	16.98	17.38	18.53
	8H	16.66	17.01	17.59	17.93	19.12	16.30	16.65	17.23	17.57	18.77