

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P920987

Luminaire Tested: DFN2DIP-TR4F0-060D050US935-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P920987
REPORT IS A COMBINATION OF REPORTS P901911 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-060D050US935-FLLONL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9376.3 lumens
Efficiency: N/A
Efficacy: 102.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 91.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P920987

CATALOG NUMBER: DFN2DIP-TR4F0-060D050US935-FLLONL

Luminous Intensity Polar Plot

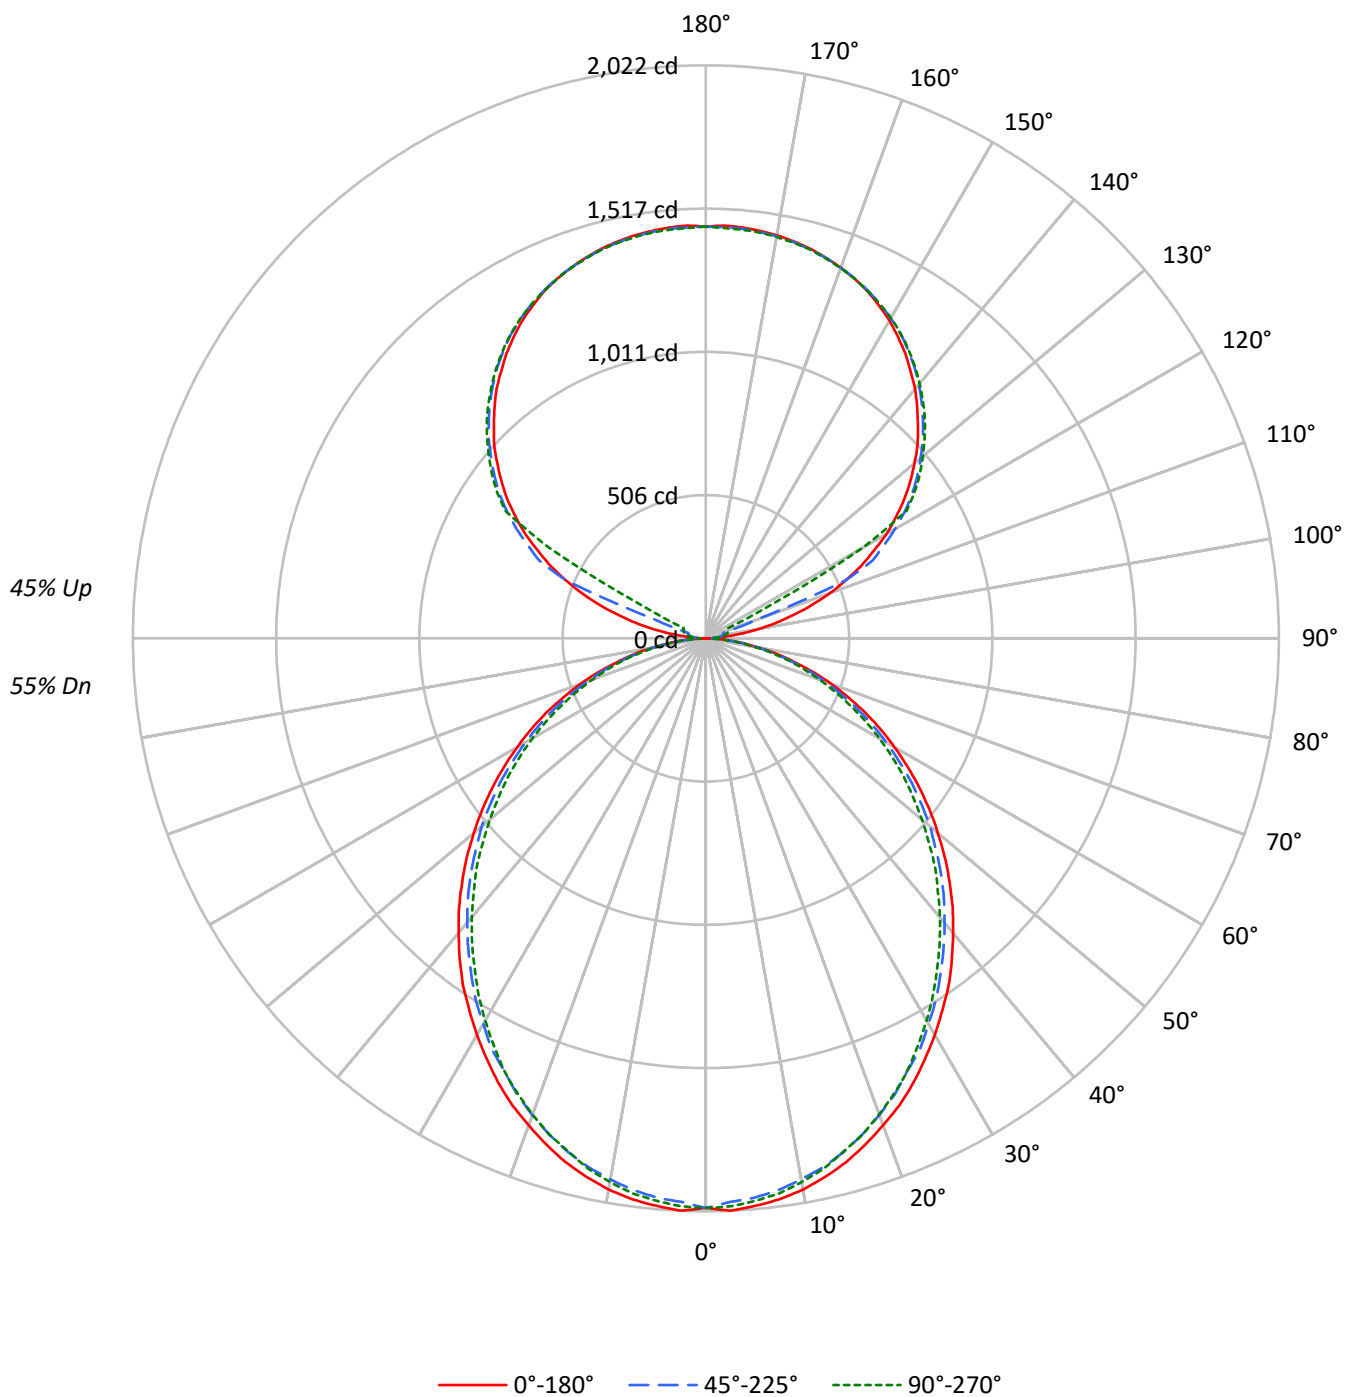

TEST NUMBER: P920987

CATALOG NUMBER: DFN2DIP-TR4F0-060D050US935-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	86	86	86	73	73	73	60	60	60
1	99	94	91	87	92	88	84	81	75	73	71	64	62	60	53	52	51
2	90	82	76	71	83	77	71	67	66	62	58	56	53	51	47	45	43
3	82	73	65	59	76	68	61	56	58	53	49	50	46	43	42	39	37
4	75	64	56	50	69	60	53	47	52	46	42	44	40	37	37	34	32
5	69	57	49	43	64	53	46	41	46	41	36	40	35	32	34	30	27
6	64	51	43	37	59	48	41	35	42	36	32	36	31	28	30	27	24
7	59	46	38	33	54	43	36	31	38	32	28	33	28	25	28	24	22
8	55	42	34	29	51	40	33	28	35	29	25	30	25	22	26	22	19
9	51	39	31	26	47	36	29	25	32	26	22	28	23	20	24	20	17
10	48	35	28	23	44	33	27	22	29	24	20	25	21	18	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1597	1597	1597
5°	1599	1575	1585
10°	1587	1553	1564
15°	1563	1528	1530
20°	1532	1492	1496
25°	1500	1450	1456
30°	1461	1410	1405
35°	1424	1364	1352
40°	1378	1316	1301
45°	1332	1269	1249
50°	1282	1220	1189
55°	1230	1162	1134
60°	1171	1094	1070
65°	1106	1024	995
70°	1024	938	915
75°	910	835	840
80°	774	704	698
85°	559	477	463

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1332 cd/sqm

TEST NUMBER: P920987

CATALOG NUMBER: DFN2DIP-TR4F0-060D050US935-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	189.2	2.0
10°-20°	532.3	5.7
20°-30°	782.3	8.3
30°-40°	908.6	9.7
40°-50°	907.5	9.7
50°-60°	791.3	8.4
60°-70°	584.9	6.2
70°-80°	330.9	3.5
80°-90°	89.9	1.0
90°-100°	47.9	0.5
100°-110°	178.6	1.9
110°-120°	473.7	5.1
120°-130°	785.6	8.4
130°-140°	834.5	8.9
140°-150°	775.6	8.3
150°-160°	623.5	6.7
160°-170°	401.8	4.3
170°-180°	138.3	1.5
0°-30°	1503.8	16.0
0°-40°	2412.4	25.7
0°-60°	4111.1	43.8
0°-90°	5116.9	54.6
90°-120°	700.2	7.5
90°-150°	3095.8	33.0
90°-180°	4259.0	45.4
0°-180°	9376.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2010	2010	2010	2010	2010	
5°	2010	2002	1981	1997	1993	191
15°	1914	1902	1877	1885	1875	539
25°	1732	1716	1684	1687	1684	797
35°	1494	1475	1444	1432	1422	933
45°	1216	1202	1173	1152	1144	938
55°	920	908	885	862	852	823
65°	620	609	590	572	562	614
75°	325	321	311	300	304	347
85°	79	77	75	70	68	88
90°	1	13	21	26	28	9
95°	68	34	41	46	45	81
105°	320	351	64	76	80	342
115°	604	622	649	162	86	595
125°	855	868	888	896	899	762
135°	1058	1074	1084	1094	1092	817
145°	1227	1226	1244	1251	1246	767
155°	1351	1342	1354	1360	1352	622
165°	1423	1417	1420	1428	1420	402
175°	1456	1449	1451	1458	1448	139
180°	1453	1453	1453	1453	1453	

TEST NUMBER: P920987

CATALOG NUMBER: DFN2DIP-TR4F0-060D050US935-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2010.1	2010.1	2010.1	2010.1	2010.1
2.5°	2021.8	2012.2	1990.8	2010.1	2006.4
5°	2010.1	2002.5	1981.2	1996.6	1992.9
7.5°	1996.6	1985.1	1963.8	1979.3	1975.5
10°	1975.5	1962.0	1938.7	1954.1	1948.4
12.5°	1946.4	1934.8	1911.7	1921.3	1917.4
15°	1913.5	1902.0	1876.8	1884.6	1875.0
17.5°	1872.9	1861.5	1836.3	1845.8	1836.3
20°	1828.4	1817.0	1789.8	1795.6	1788.0
22.5°	1784.2	1766.7	1741.5	1741.5	1737.6
25°	1731.8	1716.5	1683.6	1687.3	1683.6
27.5°	1673.8	1660.3	1635.2	1629.5	1619.9
30°	1616.0	1600.3	1571.5	1565.7	1557.9
32.5°	1554.0	1542.6	1511.6	1499.9	1492.1
35°	1494.2	1474.9	1443.9	1432.2	1422.5
37.5°	1426.5	1409.0	1378.1	1364.5	1354.9
40°	1356.9	1341.3	1310.4	1293.2	1285.4
42.5°	1289.3	1273.7	1242.9	1223.5	1211.9
45°	1215.9	1202.3	1173.2	1152.1	1144.3
47.5°	1144.3	1130.7	1099.8	1078.5	1066.9
50°	1068.8	1059.2	1032.2	1005.0	995.4
52.5°	995.4	981.9	956.8	935.6	922.0
55°	920.1	908.4	885.3	862.1	852.5
57.5°	844.7	835.1	809.9	786.7	778.9
60°	769.2	761.6	734.6	713.3	707.5
62.5°	695.8	682.3	663.0	643.7	635.9
65°	620.5	608.9	589.6	572.1	562.5
67.5°	543.2	533.4	516.2	502.7	494.8
70°	471.7	463.9	446.4	432.9	425.3
72.5°	398.2	390.5	380.8	367.3	361.5
75°	324.6	321.0	311.1	299.6	303.5
77.5°	259.0	251.2	247.3	241.6	235.8
80°	193.4	191.3	187.4	181.7	177.8
82.5°	131.5	131.5	129.6	121.8	121.8
85°	79.1	77.3	75.4	69.5	67.7
87.5°	34.9	31.0	27.0	21.4	19.3
90°	1.0	12.6	21.0	26.3	28.3
92.5°	26.3	22.1	25.2	27.4	28.3
95°	68.3	33.6	41.0	46.3	45.2
97.5°	123.0	36.9	53.6	56.8	57.8
100°	186.1	42.1	59.9	68.3	70.4
102.5°	255.5	253.4	62.1	73.5	76.8
105°	319.6	351.2	64.1	75.7	79.9
107.5°	394.3	420.4	66.3	77.7	82.1
110°	465.8	487.8	184.0	78.9	83.0



TEST NUMBER: P920987

CATALOG NUMBER: DFN2DIP-TR4F0-060D050US935-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	533.0	551.9	534.1	80.9	84.1
115°	604.5	622.3	648.7	162.0	86.3
117.5°	666.5	687.5	705.5	555.0	279.7
120°	735.9	751.7	770.6	783.2	641.3
122.5°	794.7	811.6	832.7	839.0	840.1
125°	854.6	868.4	888.4	895.7	898.9
127.5°	909.3	924.0	940.0	950.4	951.4
130°	960.9	977.7	989.2	1000.8	999.9
132.5°	1013.5	1027.2	1038.6	1048.2	1047.1
135°	1057.6	1074.5	1083.8	1094.5	1092.3
137.5°	1103.8	1116.5	1127.0	1137.6	1134.5
140°	1149.0	1157.5	1169.0	1178.4	1173.3
142.5°	1187.0	1194.4	1208.0	1216.3	1211.1
145°	1226.9	1225.8	1243.6	1251.0	1245.8
147.5°	1261.5	1258.3	1276.3	1281.5	1277.4
150°	1295.2	1287.9	1304.7	1311.0	1305.7
152.5°	1323.5	1315.2	1330.9	1337.3	1329.9
155°	1350.9	1341.5	1354.1	1360.4	1352.0
157.5°	1372.9	1364.6	1374.1	1381.5	1372.9
160°	1392.0	1385.6	1392.0	1398.2	1390.9
162.5°	1408.7	1402.5	1407.6	1415.0	1405.6
165°	1423.4	1417.2	1420.3	1427.6	1420.3
167.5°	1435.0	1428.7	1431.9	1439.2	1429.8
170°	1444.5	1438.1	1440.3	1447.6	1438.1
172.5°	1450.8	1444.5	1446.6	1454.0	1444.5
175°	1456.0	1448.6	1450.8	1458.1	1447.6
177.5°	1458.1	1450.8	1451.9	1459.2	1449.7
180°	1452.8	1452.8	1452.8	1452.8	1452.8

TEST NUMBER: P920987

CATALOG NUMBER: DFN2DIP-TR4F0-060D050US935-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.31	10.21	10.22	11.15	12.35	8.87	9.78	9.79	10.71	11.92
	3H	10.97	11.78	11.90	12.72	13.95	10.50	11.31	11.42	12.25	13.48
	4H	11.56	12.33	12.50	13.27	14.51	11.09	11.85	12.03	12.80	14.04
	6H	11.96	12.67	12.91	13.62	14.87	11.48	12.19	12.44	13.15	14.40
	8H	12.07	12.74	13.03	13.71	14.96	11.59	12.26	12.55	13.24	14.49
	12H	12.12	12.76	13.08	13.72	15.00	11.64	12.28	12.60	13.24	14.52
4H	2H	9.77	10.54	10.72	11.49	12.73	9.43	10.20	10.38	11.14	12.38
	3H	11.64	12.28	12.60	13.26	14.51	11.25	11.89	12.21	12.87	14.12
	4H	12.36	12.94	13.33	13.92	15.19	11.95	12.54	12.92	13.51	14.79
	6H	12.88	13.38	13.86	14.38	15.65	12.47	12.97	13.45	13.97	15.24
	8H	13.03	13.50	14.01	14.49	15.78	12.61	13.09	13.60	14.08	15.37
	12H	13.10	13.53	14.10	14.53	15.83	12.68	13.10	13.68	14.11	15.41
8H	4H	12.56	13.03	13.54	14.02	15.31	12.20	12.67	13.18	13.66	14.95
	6H	13.19	13.58	14.20	14.61	15.90	12.83	13.22	13.84	14.25	15.54
	8H	13.41	13.76	14.43	14.78	16.08	13.04	13.39	14.06	14.41	15.71
	12H	13.55	13.85	14.57	14.86	16.21	13.16	13.46	14.18	14.48	15.83
12H	4H	12.55	12.97	13.55	13.98	15.27	12.19	12.62	13.20	13.63	14.92
	6H	13.22	13.57	14.24	14.59	15.89	12.87	13.21	13.89	14.23	15.54
	8H	13.47	13.77	14.49	14.78	16.13	13.11	13.41	14.13	14.42	15.78

END OF REPORT