

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P921000

Luminaire Tested: DFN2DIP-TR4F0-060D080US935-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P921000
REPORT IS A COMBINATION OF REPORTS P900446 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-060D080US935-RLLFLL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10487.0 lumens
Efficiency: N/A
Efficacy: 93.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 112.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P921000

CATALOG NUMBER: DFN2DIP-TR4F0-060D080US935-RLLFLL

Luminous Intensity Polar Plot

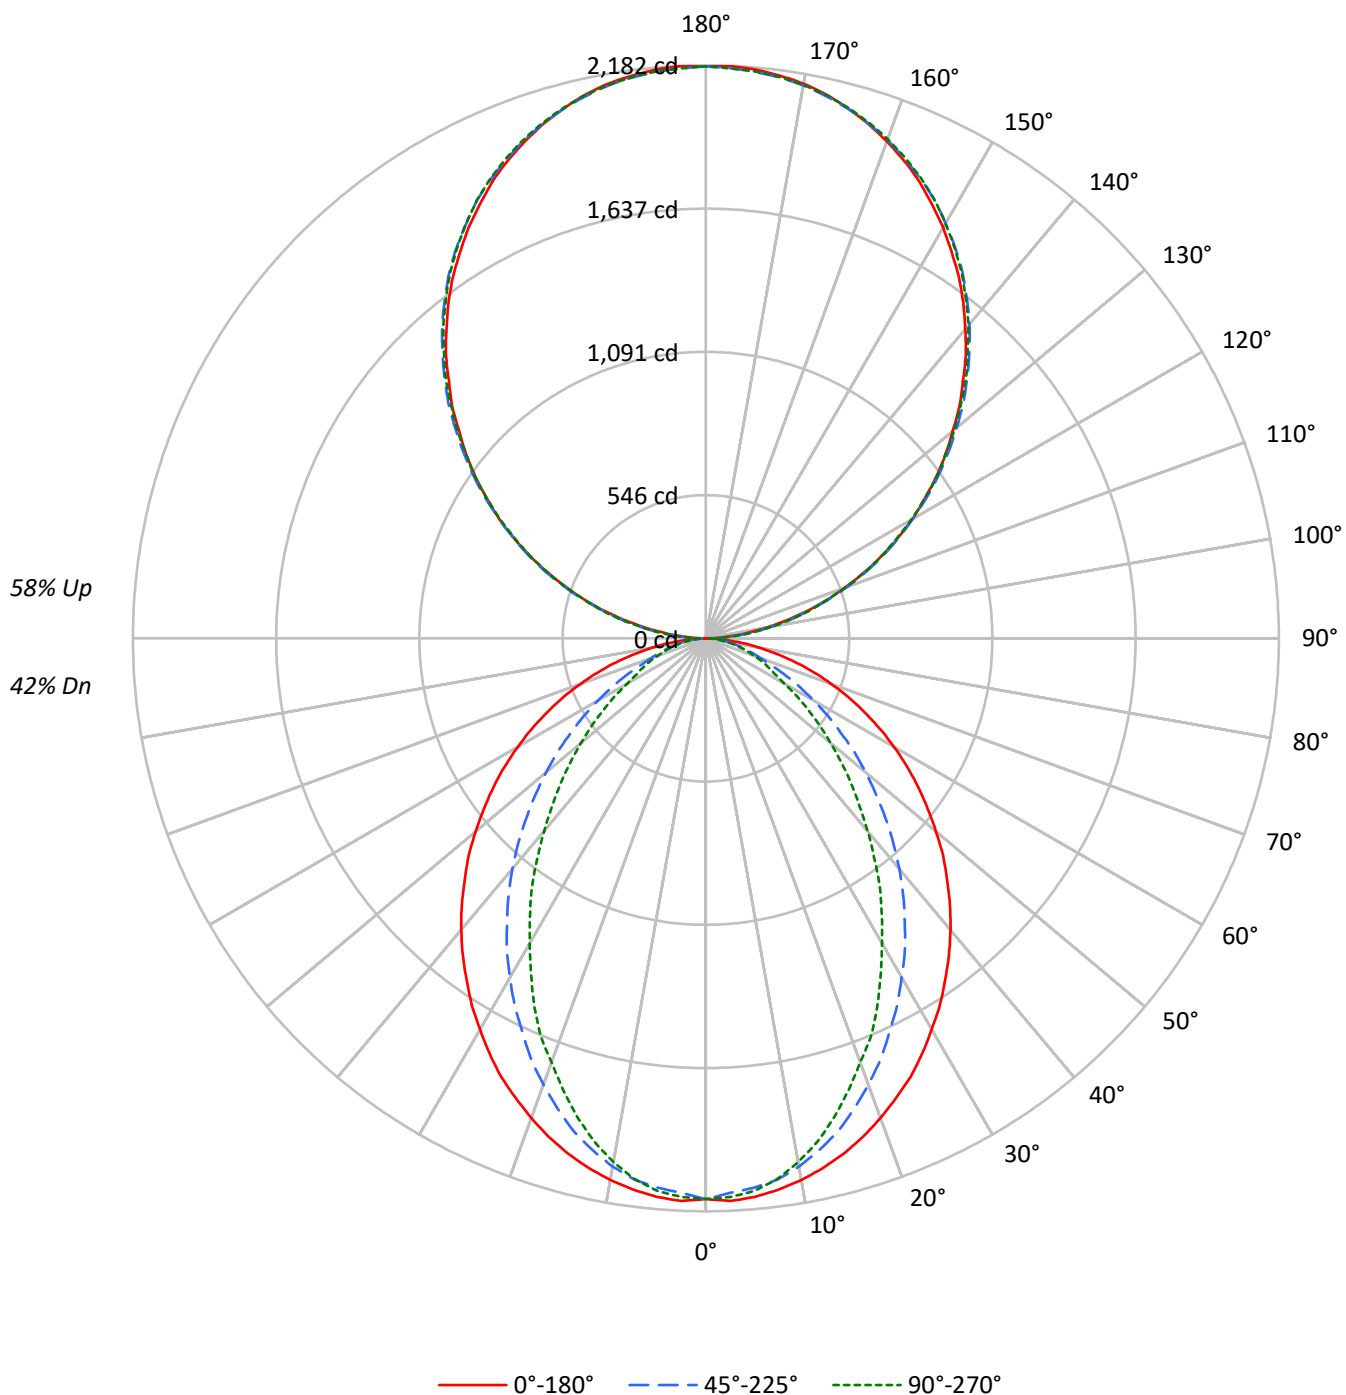

TEST NUMBER: P921000

CATALOG NUMBER: DFN2DIP-TR4F0-060D080US935-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	63	63	63	49	49	49
1	96	92	89	85	88	84	81	78	70	67	65	56	55	53	44	43	42
2	88	81	75	70	80	74	69	65	61	58	55	50	47	45	39	37	36
3	81	72	65	59	73	66	60	55	55	50	47	44	41	39	35	33	31
4	74	64	56	50	67	58	52	47	49	44	40	40	36	33	31	29	27
5	68	57	49	43	62	52	45	40	44	39	35	36	32	29	28	26	24
6	63	51	43	38	57	47	40	35	40	34	30	33	29	26	26	23	21
7	58	46	38	33	53	43	36	31	36	31	27	30	26	23	24	21	19
8	54	42	34	29	49	39	32	28	33	28	24	27	23	21	22	19	17
9	50	38	31	26	46	36	29	25	30	25	22	25	21	19	20	18	16
10	47	35	28	24	43	33	26	22	28	23	19	23	19	17	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1696	1696	1696
5°	1699	1669	1680
10°	1682	1637	1625
15°	1659	1582	1541
20°	1628	1508	1437
25°	1597	1424	1337
30°	1555	1339	1210
35°	1514	1246	1098
40°	1472	1151	970
45°	1423	1045	854
50°	1372	938	741
55°	1320	824	632
60°	1259	705	520
65°	1189	584	468
70°	1104	471	424
75°	997	415	385
80°	842	348	334
85°	587	232	251

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1698 cd/sqm

TEST NUMBER: P921000

CATALOG NUMBER: DFN2DIP-TR4F0-060D080US935-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	200.1	1.9
10°-20°	549.3	5.2
20°-30°	771.2	7.4
30°-40°	840.7	8.0
40°-50°	772.7	7.4
50°-60°	606.8	5.8
60°-70°	395.0	3.8
70°-80°	203.3	1.9
80°-90°	58.1	0.6
90°-100°	134.8	1.3
100°-110°	428.3	4.1
110°-120°	733.0	7.0
120°-130°	964.0	9.2
130°-140°	1082.0	10.3
140°-150°	1061.0	10.1
150°-160°	890.1	8.5
160°-170°	590.3	5.6
170°-180°	206.3	2.0
0°-30°	1520.7	14.5
0°-40°	2361.4	22.5
0°-60°	3740.9	35.7
0°-90°	4397.3	41.9
90°-120°	1296.1	12.4
90°-150°	4403.1	42.0
90°-180°	6090.0	58.1
0°-180°	10487.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2135	2135	2135	2135	2135	
5°	2135	2126	2100	2118	2112	202
15°	2031	2009	1944	1907	1888	572
25°	1843	1782	1654	1575	1546	848
35°	1588	1490	1320	1198	1155	994
45°	1298	1169	966	829	782	1003
55°	987	837	628	512	475	882
65°	667	510	336	271	265	661
75°	356	220	154	141	139	376
85°	83	42	37	37	37	95
90°	2	24	64	60	62	10
95°	96	114	118	118	114	107
105°	395	401	405	408	408	417
115°	736	746	743	741	736	728
125°	1070	1086	1081	1075	1073	956
135°	1384	1404	1408	1406	1401	1070
145°	1680	1693	1704	1706	1698	1050
155°	1921	1926	1932	1941	1935	884
165°	2090	2088	2088	2101	2092	590
175°	2174	2169	2165	2178	2167	207
180°	2178	2178	2178	2178	2178	

TEST NUMBER: P921000

CATALOG NUMBER: DFN2DIP-TR4F0-060D080US935-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2135.1	2135.1	2135.1	2135.1	2135.1
2.5°	2144.7	2135.1	2113.7	2133.2	2129.3
5°	2135.1	2125.5	2100.2	2117.7	2111.9
7.5°	2117.7	2106.2	2079.1	2086.7	2077.1
10°	2094.5	2080.9	2042.5	2036.5	2025.0
12.5°	2065.6	2048.1	1995.9	1984.4	1963.1
15°	2030.7	2009.4	1943.8	1907.1	1887.8
17.5°	1990.2	1959.2	1878.0	1835.6	1804.7
20°	1943.8	1905.0	1808.5	1760.3	1717.7
22.5°	1893.6	1849.1	1737.0	1671.4	1642.4
25°	1843.4	1781.5	1654.0	1574.9	1545.7
27.5°	1783.6	1717.7	1576.7	1485.8	1441.4
30°	1719.8	1646.1	1491.6	1393.2	1340.9
32.5°	1657.9	1568.9	1410.7	1294.6	1246.2
35°	1588.4	1489.8	1319.8	1198.0	1155.4
37.5°	1520.7	1414.3	1234.8	1101.3	1053.1
40°	1449.1	1333.3	1145.7	1008.6	958.4
42.5°	1375.8	1252.1	1057.0	913.9	865.7
45°	1298.5	1168.9	966.2	828.8	782.5
47.5°	1225.1	1088.0	879.3	741.9	699.5
50°	1143.9	1006.8	794.2	660.7	620.3
52.5°	1064.5	919.6	713.0	585.5	548.8
55°	987.3	836.6	627.9	512.1	475.4
57.5°	908.2	753.5	552.7	444.4	413.5
60°	827.0	672.4	473.4	375.0	344.0
62.5°	747.9	593.3	405.7	313.1	297.6
65°	666.7	510.1	336.2	270.6	264.7
67.5°	589.4	432.7	270.6	237.6	231.9
70°	508.2	357.5	224.0	204.8	197.0
72.5°	430.9	287.8	187.4	172.0	168.1
75°	355.5	220.2	154.5	141.0	139.2
77.5°	280.3	156.4	121.7	114.0	110.1
80°	210.5	112.1	92.6	85.1	85.1
82.5°	146.8	75.4	63.7	59.8	59.8
85°	83.0	42.4	36.7	36.7	36.7
87.5°	31.0	15.4	15.4	13.5	13.5
90°	2.0	23.7	64.4	60.4	62.4
92.5°	40.7	55.2	57.2	59.1	59.1
95°	95.9	114.3	117.5	117.5	114.3
97.5°	159.6	176.7	183.9	183.9	183.9
100°	233.2	248.2	253.5	253.5	251.5
102.5°	310.6	321.8	329.0	331.0	329.0
105°	395.4	400.6	404.6	407.9	407.9
107.5°	479.4	487.3	487.3	488.6	479.4
110°	560.9	571.4	571.4	571.4	566.1

TEST NUMBER: P921000

CATALOG NUMBER: DFN2DIP-TR4F0-060D080US935-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	648.8	660.0	658.1	652.8	648.8
115°	735.6	746.1	742.8	740.8	735.6
117.5°	821.6	836.0	826.8	821.6	816.3
120°	908.3	922.7	908.3	908.3	902.3
122.5°	987.0	1005.5	996.3	991.0	987.0
125°	1069.8	1086.2	1081.0	1075.0	1073.1
127.5°	1150.6	1171.0	1163.7	1155.9	1150.6
130°	1226.1	1249.7	1246.5	1242.6	1235.4
132.5°	1310.9	1329.2	1330.6	1321.4	1316.1
135°	1383.7	1404.1	1408.1	1406.1	1400.8
137.5°	1465.2	1481.6	1484.9	1483.6	1475.7
140°	1536.8	1553.2	1562.4	1562.4	1555.1
142.5°	1610.3	1626.8	1632.0	1634.0	1626.8
145°	1680.0	1693.1	1703.6	1705.6	1698.3
147.5°	1742.3	1758.8	1766.6	1770.0	1762.7
150°	1806.7	1817.8	1825.1	1831.0	1825.1
152.5°	1863.8	1875.0	1884.2	1891.4	1884.2
155°	1921.0	1926.2	1932.2	1941.3	1935.4
157.5°	1970.2	1974.2	1977.5	1990.5	1981.4
160°	2014.2	2018.2	2020.2	2031.3	2023.4
162.5°	2054.9	2054.9	2056.9	2069.4	2060.2
165°	2089.7	2087.7	2087.7	2100.9	2091.7
167.5°	2121.2	2115.4	2115.4	2128.5	2119.3
170°	2144.9	2139.7	2137.7	2150.9	2139.7
172.5°	2161.4	2156.1	2154.1	2167.2	2156.1
175°	2174.5	2169.2	2165.2	2178.4	2167.2
177.5°	2181.7	2176.4	2172.5	2183.7	2172.5
180°	2178.4	2178.4	2178.4	2178.4	2178.4

TEST NUMBER: P921000

CATALOG NUMBER: DFN2DIP-TR4F0-060D080US935-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.17	8.94	9.20	9.97	11.36	4.15	4.91	5.18	5.95	7.33
	3H	9.84	10.53	10.88	11.57	12.98	5.33	6.02	6.37	7.06	8.46
	4H	10.45	11.10	11.50	12.15	13.56	5.78	6.43	6.83	7.47	8.89
	6H	10.87	11.47	11.93	12.52	13.94	6.10	6.70	7.16	7.74	9.17
	8H	10.99	11.56	12.06	12.63	14.04	6.19	6.76	7.25	7.82	9.24
	12H	11.05	11.59	12.12	12.65	14.09	6.23	6.77	7.30	7.83	9.27
4H	2H	8.18	8.83	9.24	9.88	11.29	4.73	5.38	5.79	6.43	7.84
	3H	10.01	10.55	11.07	11.62	13.04	6.08	6.62	7.14	7.69	9.12
	4H	10.70	11.19	11.77	12.25	13.70	6.63	7.12	7.70	8.18	9.63
	6H	11.21	11.63	12.29	12.72	14.16	7.04	7.47	8.12	8.55	9.99
	8H	11.38	11.78	12.46	12.86	14.31	7.17	7.57	8.25	8.65	10.10
	12H	11.47	11.83	12.57	12.92	14.38	7.23	7.59	8.33	8.68	10.14
8H	4H	10.66	11.06	11.74	12.13	13.59	6.90	7.30	7.98	8.38	9.83
	6H	11.22	11.55	12.33	12.67	14.12	7.42	7.75	8.52	8.87	10.32
	8H	11.44	11.73	12.55	12.83	14.30	7.61	7.90	8.72	9.00	10.47
	12H	11.58	11.83	12.69	12.93	14.44	7.73	7.98	8.84	9.08	10.59
12H	4H	10.61	10.97	11.71	12.06	13.52	6.90	7.26	8.00	8.35	9.81
	6H	11.20	11.49	12.31	12.59	14.06	7.47	7.75	8.58	8.86	10.33
	8H	11.42	11.67	12.53	12.77	14.28	7.68	7.93	8.79	9.03	10.54