

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P921019

Luminaire Tested: DFN2DIP-TR4F0-070D040US935-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P921019
REPORT IS A COMBINATION OF REPORTS P901895 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-070D040US935-FLLONL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9376.3 lumens
Efficiency: N/A
Efficacy: 97.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 95.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9977
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P921019

CATALOG NUMBER: DFN2DIP-TR4F0-070D040US935-FLLONL

Luminous Intensity Polar Plot

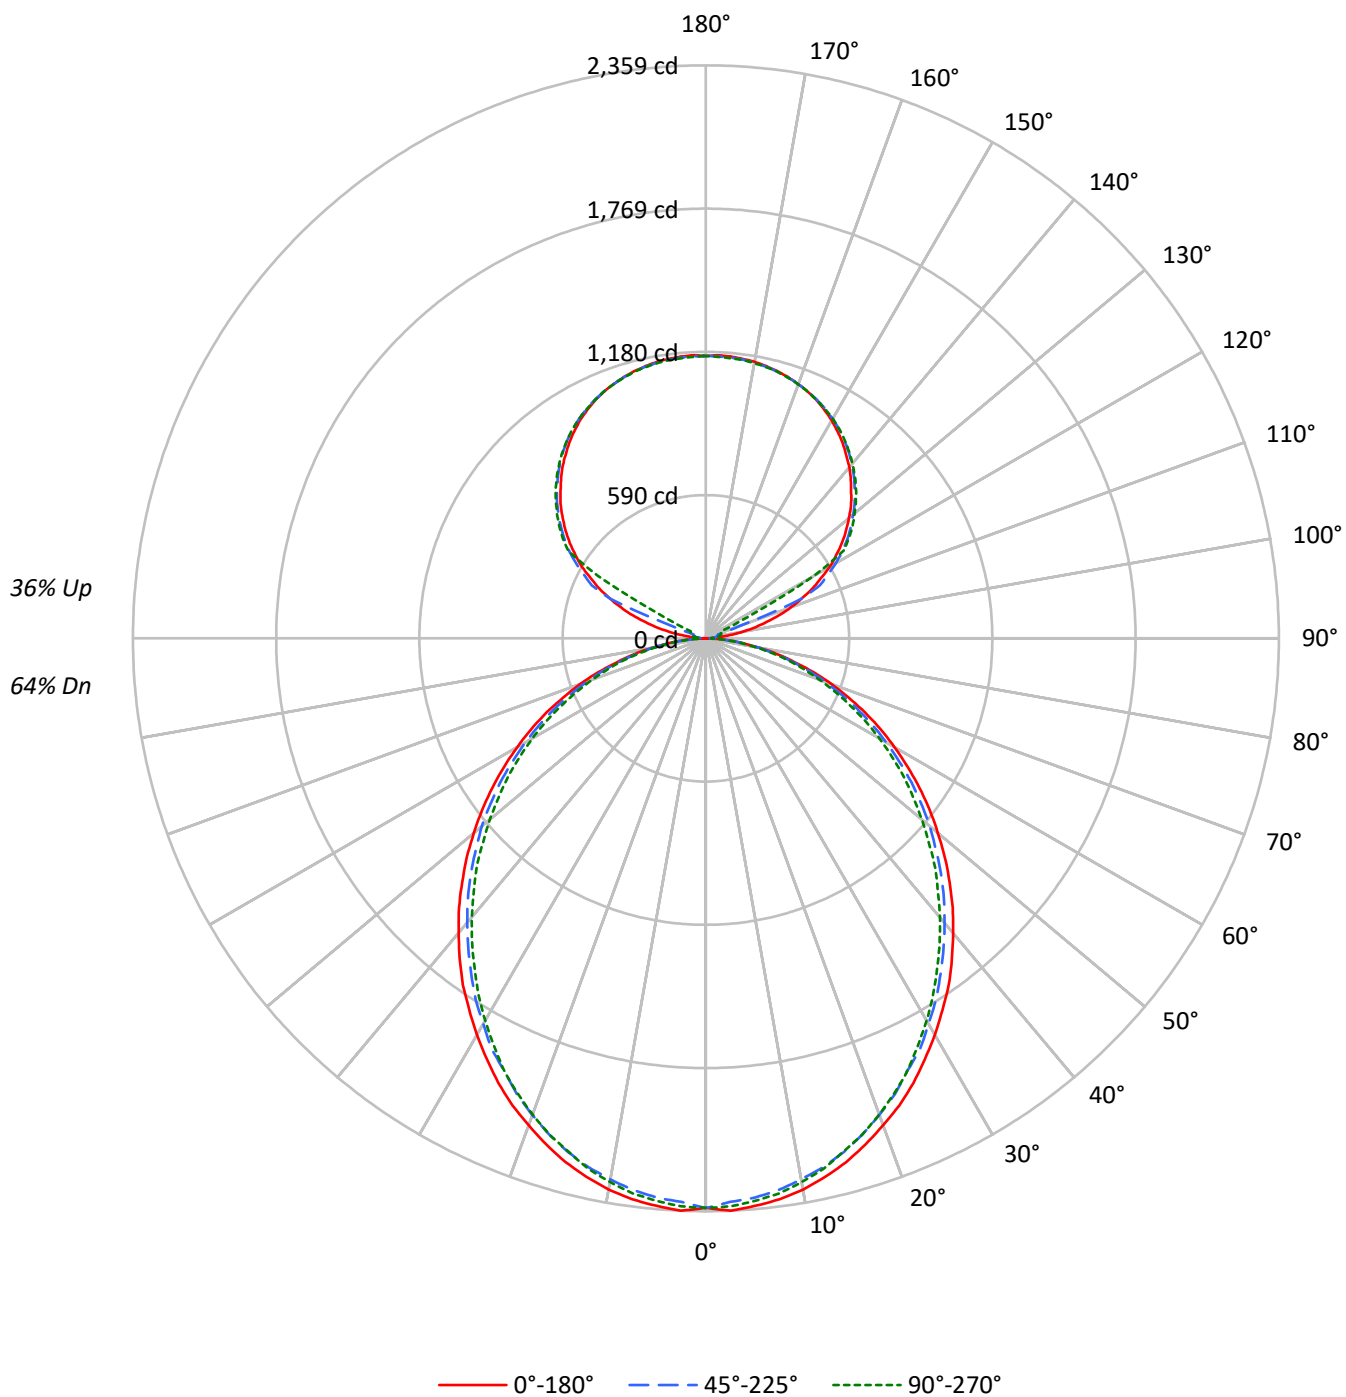

TEST NUMBER: P921019

CATALOG NUMBER: DFN2DIP-TR4F0-070D040US935-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	104	104	104	104	91	91	91	79	79	79	69	69	69
1	101	96	92	89	94	91	87	84	80	77	75	70	68	66	61	59	58
2	92	84	78	73	86	79	74	69	70	66	62	61	58	55	53	51	49
3	84	74	67	61	78	70	63	58	62	57	52	54	50	47	47	44	42
4	77	66	58	51	72	62	55	49	55	49	45	48	44	40	42	39	36
5	71	59	50	44	66	55	48	42	49	43	39	44	39	35	38	34	31
6	65	53	44	38	61	50	42	37	44	38	34	39	34	31	35	31	28
7	60	48	39	34	56	45	38	32	40	34	30	36	31	27	32	28	25
8	56	43	35	30	52	41	34	29	37	31	27	33	28	24	29	25	22
9	52	40	32	27	49	38	31	26	34	28	24	30	25	22	27	23	20
10	49	36	29	24	46	35	28	23	31	26	22	28	23	20	25	21	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1863	1863	1863
5°	1866	1837	1849
10°	1851	1812	1824
15°	1824	1782	1785
20°	1787	1741	1745
25°	1750	1691	1699
30°	1705	1645	1640
35°	1661	1591	1577
40°	1608	1536	1518
45°	1554	1481	1457
50°	1496	1423	1387
55°	1435	1356	1322
60°	1366	1276	1248
65°	1291	1194	1161
70°	1195	1094	1067
75°	1062	974	980
80°	903	821	814
85°	653	558	540

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1554 cd/sqm

TEST NUMBER: P921019

CATALOG NUMBER: DFN2DIP-TR4F0-070D040US935-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	220.7	2.4
10°-20°	621.0	6.6
20°-30°	912.7	9.7
30°-40°	1060.0	11.3
40°-50°	1058.7	11.3
50°-60°	923.2	9.8
60°-70°	682.4	7.3
70°-80°	386.1	4.1
80°-90°	104.0	1.1
90°-100°	38.3	0.4
100°-110°	142.9	1.5
110°-120°	378.9	4.0
120°-130°	628.5	6.7
130°-140°	667.6	7.1
140°-150°	620.4	6.6
150°-160°	498.8	5.3
160°-170°	321.4	3.4
170°-180°	110.6	1.2
0°-30°	1754.4	18.7
0°-40°	2814.4	30.0
0°-60°	4796.3	51.2
0°-90°	5968.8	63.7
90°-120°	560.1	6.0
90°-150°	2476.6	26.4
90°-180°	3407.0	36.3
0°-180°	9376.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2345	2345	2345	2345	2345	
5°	2345	2336	2311	2329	2325	223
15°	2232	2219	2190	2199	2188	629
25°	2020	2002	1964	1969	1964	930
35°	1743	1721	1684	1671	1660	1089
45°	1418	1403	1369	1344	1335	1095
55°	1074	1060	1033	1006	994	960
65°	724	710	688	668	656	716
75°	379	374	363	350	354	404
85°	92	90	88	81	79	103
90°	1	10	17	21	23	9
95°	55	27	33	37	36	65
105°	256	281	51	60	64	273
115°	484	498	519	130	69	476
125°	684	695	711	717	719	610
135°	846	860	867	876	874	654
145°	982	981	995	1001	997	614
155°	1081	1073	1083	1088	1082	498
165°	1139	1134	1136	1142	1136	322
175°	1165	1159	1161	1166	1158	111
180°	1162	1162	1162	1162	1162	

TEST NUMBER: P921019

CATALOG NUMBER: DFN2DIP-TR4F0-070D040US935-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2345.1	2345.1	2345.1	2345.1	2345.1
2.5°	2358.8	2347.5	2322.6	2345.1	2340.8
5°	2345.1	2336.3	2311.4	2329.3	2325.0
7.5°	2329.3	2315.9	2291.0	2309.3	2304.7
10°	2304.7	2288.9	2261.8	2279.8	2273.1
12.5°	2270.7	2257.4	2230.3	2241.5	2237.0
15°	2232.5	2219.0	2189.6	2198.7	2187.5
17.5°	2185.0	2171.7	2142.2	2153.5	2142.2
20°	2133.1	2119.8	2088.2	2094.9	2086.0
22.5°	2081.5	2061.1	2031.7	2031.7	2027.1
25°	2020.5	2002.5	1964.3	1968.6	1964.3
27.5°	1952.7	1937.0	1907.8	1901.1	1889.8
30°	1885.3	1867.1	1833.4	1826.7	1817.6
32.5°	1813.0	1799.7	1763.5	1749.9	1740.8
35°	1743.2	1720.7	1684.5	1670.9	1659.7
37.5°	1664.2	1643.9	1607.7	1592.0	1580.7
40°	1583.1	1564.9	1528.8	1508.7	1499.6
42.5°	1504.2	1486.0	1450.1	1427.4	1413.9
45°	1418.5	1402.7	1368.7	1344.1	1335.0
47.5°	1335.0	1319.2	1283.1	1258.2	1244.8
50°	1247.0	1235.7	1204.1	1172.6	1161.3
52.5°	1161.3	1145.6	1116.4	1091.5	1075.6
55°	1073.5	1059.9	1032.9	1005.8	994.5
57.5°	985.5	974.2	944.8	917.7	908.7
60°	897.4	888.5	857.0	832.2	825.4
62.5°	811.7	796.0	773.5	751.0	741.9
65°	724.0	710.3	687.9	667.5	656.3
67.5°	633.8	622.3	602.2	586.4	577.3
70°	550.3	541.2	520.8	505.1	496.2
72.5°	464.6	455.6	444.3	428.5	421.8
75°	378.8	374.4	362.9	349.6	354.1
77.5°	302.2	293.1	288.5	281.8	275.2
80°	225.6	223.3	218.7	212.0	207.4
82.5°	153.3	153.3	151.2	142.2	142.2
85°	92.4	90.2	88.1	81.1	79.0
87.5°	40.6	36.2	31.6	24.9	22.5
90°	0.8	10.1	16.8	21.1	22.6
92.5°	21.1	17.7	20.1	21.9	22.6
95°	54.6	26.9	32.7	37.0	36.2
97.5°	98.4	29.4	42.9	45.5	46.2
100°	148.9	33.7	48.0	54.6	56.3
102.5°	204.3	202.8	49.6	58.8	61.4
105°	255.6	280.9	51.3	60.5	63.9
107.5°	315.4	336.4	53.0	62.3	65.6
110°	372.6	390.2	147.2	63.1	66.4



TEST NUMBER: P921019

CATALOG NUMBER: DFN2DIP-TR4F0-070D040US935-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	426.5	441.5	427.2	64.7	67.3
115°	483.5	497.8	518.9	129.5	69.1
117.5°	533.2	550.0	564.4	444.0	223.7
120°	588.8	601.3	616.5	626.6	513.1
122.5°	635.8	649.3	666.2	671.1	672.0
125°	683.7	694.7	710.7	716.6	719.1
127.5°	727.5	739.3	751.9	760.3	761.1
130°	768.7	782.2	791.3	800.6	799.9
132.5°	810.7	821.7	830.9	838.5	837.8
135°	846.1	859.6	867.1	875.5	873.9
137.5°	883.0	893.1	901.6	910.0	907.5
140°	919.2	926.0	935.2	942.8	938.6
142.5°	949.6	955.4	966.4	973.0	968.9
145°	981.5	980.7	994.9	1000.8	996.6
147.5°	1009.2	1006.7	1021.0	1025.2	1021.9
150°	1036.1	1030.3	1043.8	1048.8	1044.6
152.5°	1058.9	1052.1	1064.7	1069.8	1063.9
155°	1080.7	1073.2	1083.3	1088.3	1081.6
157.5°	1098.4	1091.7	1099.3	1105.2	1098.4
160°	1113.5	1108.4	1113.5	1118.5	1112.7
162.5°	1127.0	1122.0	1126.2	1132.0	1124.5
165°	1138.8	1133.8	1136.3	1142.1	1136.3
167.5°	1148.1	1142.9	1145.6	1151.4	1143.8
170°	1155.6	1150.6	1152.2	1158.1	1150.6
172.5°	1160.6	1155.6	1157.4	1163.2	1155.6
175°	1164.8	1158.9	1160.6	1166.5	1158.1
177.5°	1166.5	1160.6	1161.5	1167.4	1159.9
180°	1162.3	1162.3	1162.3	1162.3	1162.3

TEST NUMBER: P921019

CATALOG NUMBER: DFN2DIP-TR4F0-070D040US935-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.60	11.60	11.43	12.45	13.52	10.17	11.17	11.00	12.02	13.08
	3H	12.27	13.17	13.11	14.03	15.12	11.80	12.70	12.64	13.56	14.65
	4H	12.87	13.71	13.72	14.58	15.68	12.39	13.24	13.25	14.11	15.21
	6H	13.27	14.05	14.14	14.93	16.04	12.80	13.58	13.67	14.46	15.57
	8H	13.38	14.13	14.26	15.02	16.13	12.91	13.65	13.79	14.55	15.66
	12H	13.43	14.14	14.32	15.03	16.17	12.95	13.66	13.84	14.55	15.69
4H	2H	11.08	11.93	11.94	12.80	13.90	10.74	11.58	11.60	12.45	13.55
	3H	12.96	13.67	13.83	14.57	15.68	12.57	13.27	13.44	14.17	15.29
	4H	13.68	14.32	14.57	15.22	16.36	13.27	13.92	14.16	14.82	15.96
	6H	14.20	14.76	15.10	15.68	16.82	13.79	14.35	14.69	15.27	16.41
	8H	14.35	14.87	15.26	15.79	16.95	13.94	14.46	14.85	15.38	16.54
	12H	14.43	14.90	15.36	15.84	17.00	14.01	14.48	14.94	15.42	16.58
8H	4H	13.89	14.41	14.79	15.32	16.48	13.53	14.05	14.43	14.96	16.12
	6H	14.52	14.95	15.46	15.91	17.07	14.16	14.59	15.09	15.55	16.71
	8H	14.74	15.13	15.69	16.08	17.25	14.38	14.76	15.32	15.71	16.88
	12H	14.88	15.22	15.83	16.16	17.39	14.50	14.84	15.44	15.78	17.00
12H	4H	13.88	14.35	14.80	15.28	16.45	13.53	14.00	14.45	14.93	16.09
	6H	14.55	14.94	15.50	15.89	17.06	14.20	14.58	15.14	15.53	16.71
	8H	14.80	15.14	15.75	16.08	17.31	14.45	14.78	15.39	15.72	16.95

END OF REPORT