

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P921024

Luminaire Tested: DFN2DIP-TR4F0-070D050US935-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P921024
REPORT IS A COMBINATION OF REPORTS P900394 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-070D050US935-RLLFLL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8932.8 lumens
Efficiency: N/A
Efficacy: 86.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 103.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9977
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P921024

CATALOG NUMBER: DFN2DIP-TR4F0-070D050US935-RLLFLL

Luminous Intensity Polar Plot

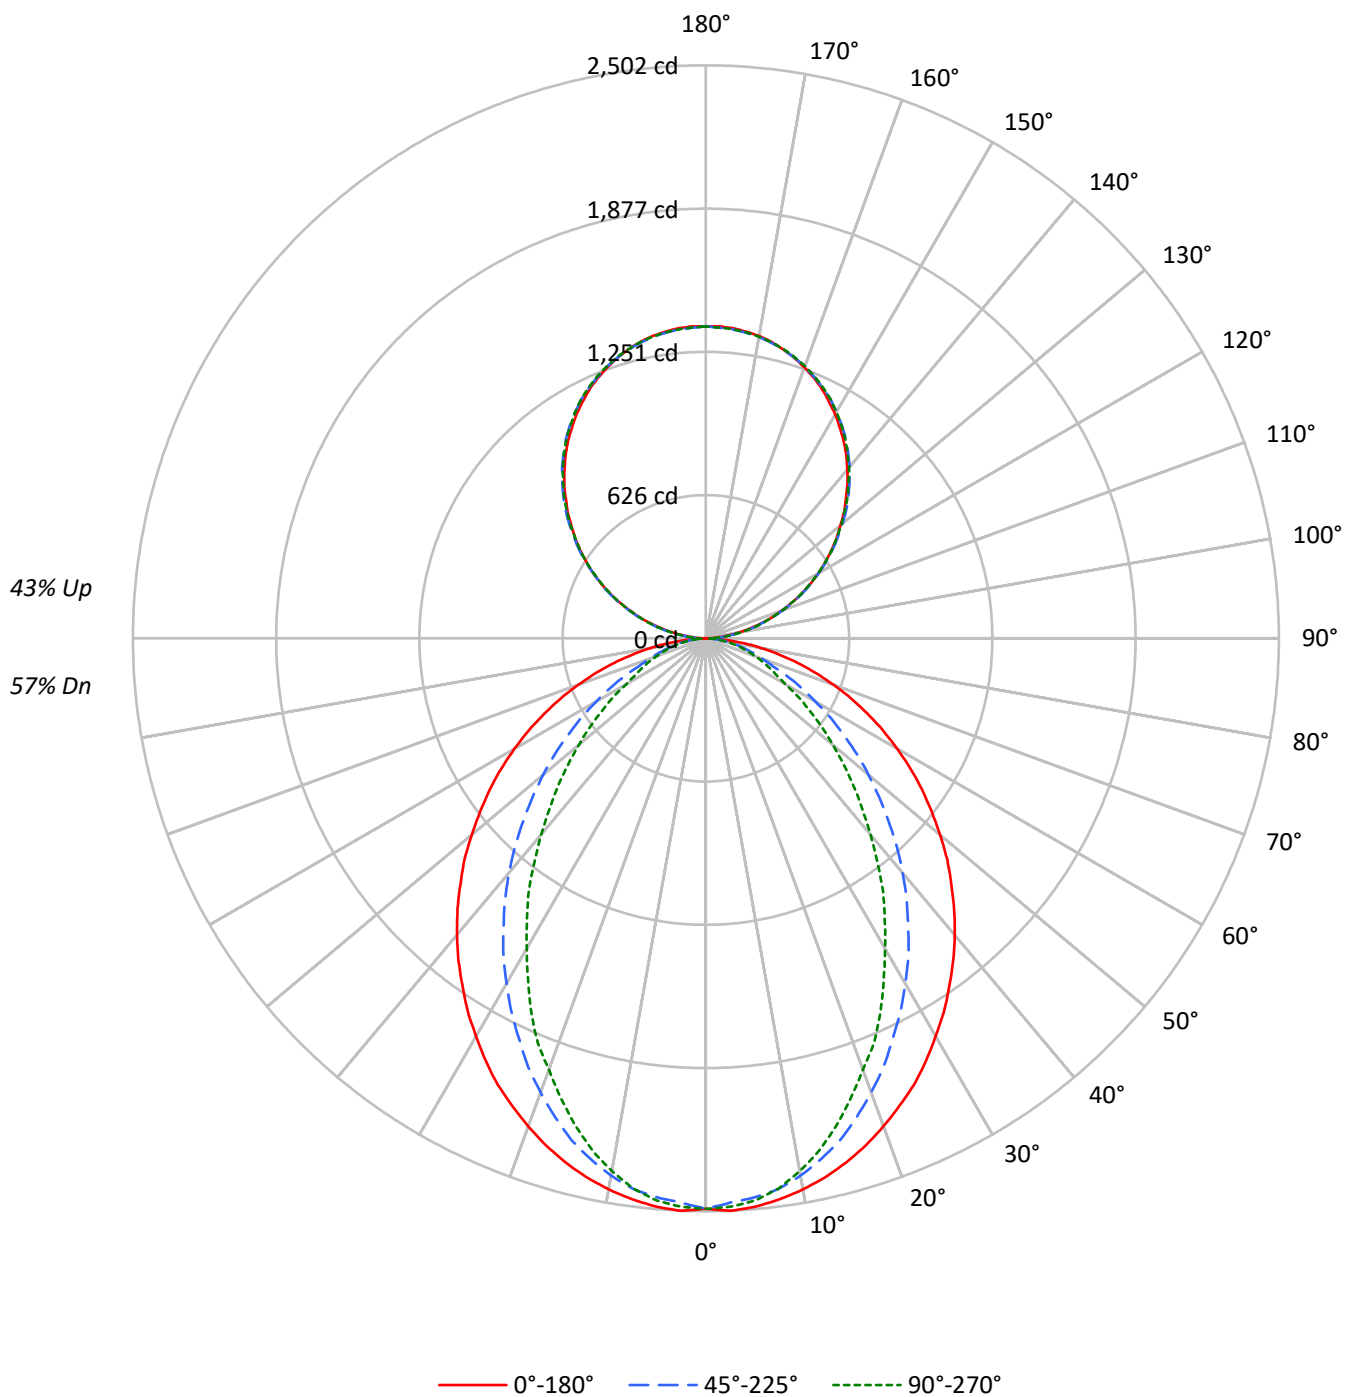

TEST NUMBER: P921024

CATALOG NUMBER: DFN2DIP-TR4F0-070D050US935-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	101	101	101	101	87	87	87	75	75	75	63	63	63
1	100	96	92	89	93	89	86	83	78	75	73	67	65	63	56	55	54
2	92	84	78	73	85	79	74	69	69	65	61	59	56	54	50	48	47
3	84	75	68	62	78	70	64	59	61	56	52	53	49	46	45	42	40
4	77	66	59	53	72	62	56	50	55	49	45	47	43	40	41	38	35
5	71	60	52	46	66	56	49	44	49	44	39	43	39	35	37	34	31
6	66	54	46	40	61	51	43	38	45	39	35	39	34	31	34	30	28
7	61	49	41	35	57	46	39	34	41	35	31	36	31	28	31	27	25
8	57	44	37	32	53	42	35	30	37	32	28	33	28	25	29	25	22
9	53	41	33	28	49	38	32	27	34	29	25	30	26	23	26	23	20
10	49	37	30	26	46	35	29	25	32	26	23	28	24	21	25	21	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1979	1979	1979
5°	1982	1947	1960
10°	1962	1909	1896
15°	1935	1846	1797
20°	1900	1759	1676
25°	1863	1662	1560
30°	1814	1562	1411
35°	1766	1454	1281
40°	1717	1343	1132
45°	1660	1219	997
50°	1601	1095	864
55°	1540	962	738
60°	1469	822	607
65°	1387	681	546
70°	1288	549	494
75°	1163	484	450
80°	983	406	390
85°	685	271	293

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1660 cd/sqm

TEST NUMBER: P921024

CATALOG NUMBER: DFN2DIP-TR4F0-070D050US935-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	233.5	2.6
10°-20°	640.9	7.2
20°-30°	899.8	10.1
30°-40°	980.8	11.0
40°-50°	901.5	10.1
50°-60°	708.0	7.9
60°-70°	460.8	5.2
70°-80°	237.2	2.7
80°-90°	64.4	0.7
90°-100°	84.2	0.9
100°-110°	267.7	3.0
110°-120°	458.1	5.1
120°-130°	602.5	6.7
130°-140°	676.3	7.6
140°-150°	663.1	7.4
150°-160°	556.3	6.2
160°-170°	368.9	4.1
170°-180°	128.9	1.4
0°-30°	1774.1	19.9
0°-40°	2754.9	30.8
0°-60°	4364.3	48.9
0°-90°	5126.8	57.4
90°-120°	810.0	9.1
90°-150°	2751.9	30.8
90°-180°	3806.0	42.6
0°-180°	8932.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2491	2491	2491	2491	2491	
5°	2491	2480	2450	2471	2464	236
15°	2369	2344	2268	2225	2202	668
25°	2151	2078	1930	1837	1803	989
35°	1853	1738	1540	1398	1348	1160
45°	1515	1364	1127	967	913	1170
55°	1152	976	732	597	555	1029
65°	778	595	392	316	309	771
75°	415	257	180	164	162	439
85°	97	50	43	43	43	111
90°	1	15	40	38	39	9
95°	60	72	73	73	72	67
105°	247	250	253	255	255	261
115°	460	466	464	463	460	455
125°	669	679	676	672	671	598
135°	865	878	880	879	876	669
145°	1050	1058	1065	1066	1061	656
155°	1201	1204	1208	1213	1210	553
165°	1306	1305	1305	1313	1307	368
175°	1359	1356	1353	1362	1354	129
180°	1362	1362	1362	1362	1362	

TEST NUMBER: P921024

CATALOG NUMBER: DFN2DIP-TR4F0-070D050US935-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2491.0	2491.0	2491.0	2491.0	2491.0
2.5°	2502.1	2491.0	2466.1	2488.8	2484.2
5°	2491.0	2479.7	2450.3	2470.6	2463.9
7.5°	2470.6	2457.2	2425.7	2434.5	2423.3
10°	2443.6	2427.8	2382.8	2375.9	2362.5
12.5°	2409.8	2389.5	2328.6	2315.1	2290.3
15°	2369.2	2344.3	2267.8	2225.0	2202.5
17.5°	2321.9	2285.8	2191.1	2141.5	2105.4
20°	2267.8	2222.6	2110.0	2053.7	2004.0
22.5°	2209.2	2157.3	2026.4	1949.9	1916.2
25°	2150.6	2078.4	1929.6	1837.3	1803.4
27.5°	2080.8	2004.0	1839.4	1733.5	1681.6
30°	2006.4	1920.5	1740.2	1625.4	1564.4
32.5°	1934.1	1830.4	1645.7	1510.4	1453.9
35°	1853.0	1738.0	1539.8	1397.7	1348.0
37.5°	1774.2	1650.0	1440.5	1284.8	1228.6
40°	1690.7	1555.6	1336.7	1176.7	1118.1
42.5°	1605.1	1460.9	1233.1	1066.2	1010.0
45°	1514.9	1363.7	1127.2	967.0	912.9
47.5°	1429.3	1269.3	1025.8	865.6	816.1
50°	1334.5	1174.6	926.5	770.9	723.8
52.5°	1242.0	1072.9	831.8	683.0	640.2
55°	1151.8	976.0	732.5	597.4	554.7
57.5°	1059.5	879.2	644.8	518.5	482.4
60°	964.8	784.5	552.2	437.5	401.3
62.5°	872.4	692.2	473.3	365.2	347.2
65°	777.7	595.0	392.3	315.7	308.8
67.5°	687.6	504.9	315.7	277.2	270.5
70°	592.9	417.1	261.4	238.9	229.8
72.5°	502.7	335.8	218.6	200.7	196.1
75°	414.7	256.8	180.3	164.5	162.4
77.5°	326.9	182.4	142.1	132.9	128.5
80°	245.6	130.8	108.1	99.3	99.3
82.5°	171.3	88.0	74.4	69.8	69.8
85°	96.9	49.5	42.8	42.8	42.8
87.5°	36.1	17.9	17.9	15.8	15.8
90°	1.2	14.8	40.2	37.8	39.0
92.5°	25.5	34.4	35.7	36.9	36.9
95°	59.9	71.5	73.4	73.4	71.5
97.5°	99.7	110.4	114.9	114.9	114.9
100°	145.7	155.2	158.4	158.4	157.2
102.5°	194.2	201.1	205.6	206.9	205.6
105°	247.1	250.4	252.9	254.9	254.9
107.5°	299.6	304.5	304.5	305.4	299.6
110°	350.5	357.1	357.1	357.1	353.8

TEST NUMBER: P921024

CATALOG NUMBER: DFN2DIP-TR4F0-070D050US935-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	405.5	412.5	411.3	408.0	405.5
115°	459.7	466.3	464.3	463.0	459.7
117.5°	513.5	522.5	516.8	513.5	510.2
120°	567.7	576.7	567.7	567.7	564.0
122.5°	616.9	628.4	622.7	619.4	616.9
125°	668.7	678.9	675.6	671.9	670.7
127.5°	719.1	731.8	727.4	722.4	719.1
130°	766.4	781.1	779.0	776.6	772.1
132.5°	819.3	830.8	831.6	825.9	822.6
135°	864.9	877.5	880.0	878.8	875.5
137.5°	915.8	926.0	928.1	927.2	922.3
140°	960.4	970.8	976.5	976.5	972.0
142.5°	1006.4	1016.8	1020.0	1021.2	1016.8
145°	1050.0	1058.2	1064.7	1066.0	1061.4
147.5°	1089.0	1099.2	1104.1	1106.2	1101.6
150°	1129.2	1136.2	1140.6	1144.4	1140.6
152.5°	1164.9	1171.9	1177.6	1182.2	1177.6
155°	1200.6	1203.8	1207.5	1213.3	1209.6
157.5°	1231.4	1233.8	1235.9	1244.1	1238.4
160°	1258.9	1261.4	1262.6	1269.5	1264.6
162.5°	1284.4	1284.4	1285.6	1293.4	1287.6
165°	1306.1	1304.8	1304.8	1313.1	1307.3
167.5°	1325.8	1322.1	1322.1	1330.3	1324.6
170°	1340.6	1337.3	1336.1	1344.3	1337.3
172.5°	1350.8	1347.5	1346.3	1354.5	1347.5
175°	1359.1	1355.7	1353.3	1361.5	1354.5
177.5°	1363.6	1360.3	1357.8	1364.8	1357.8
180°	1361.5	1361.5	1361.5	1361.5	1361.5

TEST NUMBER: P921024

CATALOG NUMBER: DFN2DIP-TR4F0-070D050US935-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.18	11.07	11.07	11.98	13.15	6.15	7.04	7.05	7.96	9.12
	3H	11.86	12.66	12.77	13.58	14.77	7.34	8.14	8.25	9.07	10.26
	4H	12.47	13.22	13.39	14.15	15.35	7.80	8.55	8.72	9.48	10.68
	6H	12.89	13.59	13.83	14.52	15.73	8.12	8.82	9.06	9.75	10.96
	8H	13.02	13.68	13.97	14.63	15.84	8.22	8.88	9.16	9.83	11.04
	12H	13.09	13.72	14.03	14.66	15.89	8.26	8.89	9.21	9.84	11.07
4H	2H	10.20	10.96	11.13	11.89	13.08	6.75	7.51	7.68	8.44	9.63
	3H	12.04	12.66	12.98	13.62	14.84	8.11	8.74	9.05	9.70	10.91
	4H	12.73	13.30	13.68	14.26	15.50	8.66	9.23	9.61	10.19	11.42
	6H	13.25	13.74	14.21	14.72	15.96	9.08	9.58	10.05	10.55	11.79
	8H	13.43	13.89	14.39	14.86	16.11	9.22	9.67	10.18	10.64	11.90
	12H	13.52	13.94	14.51	14.93	16.18	9.28	9.70	10.27	10.68	11.94
8H	4H	12.70	13.16	13.67	14.13	15.39	8.95	9.40	9.91	10.38	11.63
	6H	13.27	13.65	14.26	14.66	15.91	9.47	9.85	10.46	10.86	12.11
	8H	13.49	13.82	14.49	14.82	16.09	9.66	9.99	10.66	10.99	12.26
	12H	13.63	13.93	14.63	14.92	16.23	9.78	10.08	10.78	11.07	12.39
12H	4H	12.66	13.07	13.64	14.06	15.32	8.95	9.37	9.94	10.35	11.61
	6H	13.25	13.58	14.25	14.58	15.85	9.52	9.85	10.52	10.85	12.12
	8H	13.47	13.77	14.47	14.76	16.08	9.73	10.03	10.73	11.02	12.34

END OF REPORT