

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P921029

Luminaire Tested: DFN2DIP-TR4F0-070D060US935-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P921029
REPORT IS A COMBINATION OF REPORTS P901932 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-070D060US935-RLLONL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10237.2 lumens
Efficiency: N/A
Efficacy: 92.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 110.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9977
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P921029

CATALOG NUMBER: DFN2DIP-TR4F0-070D060US935-RLLONL

Luminous Intensity Polar Plot

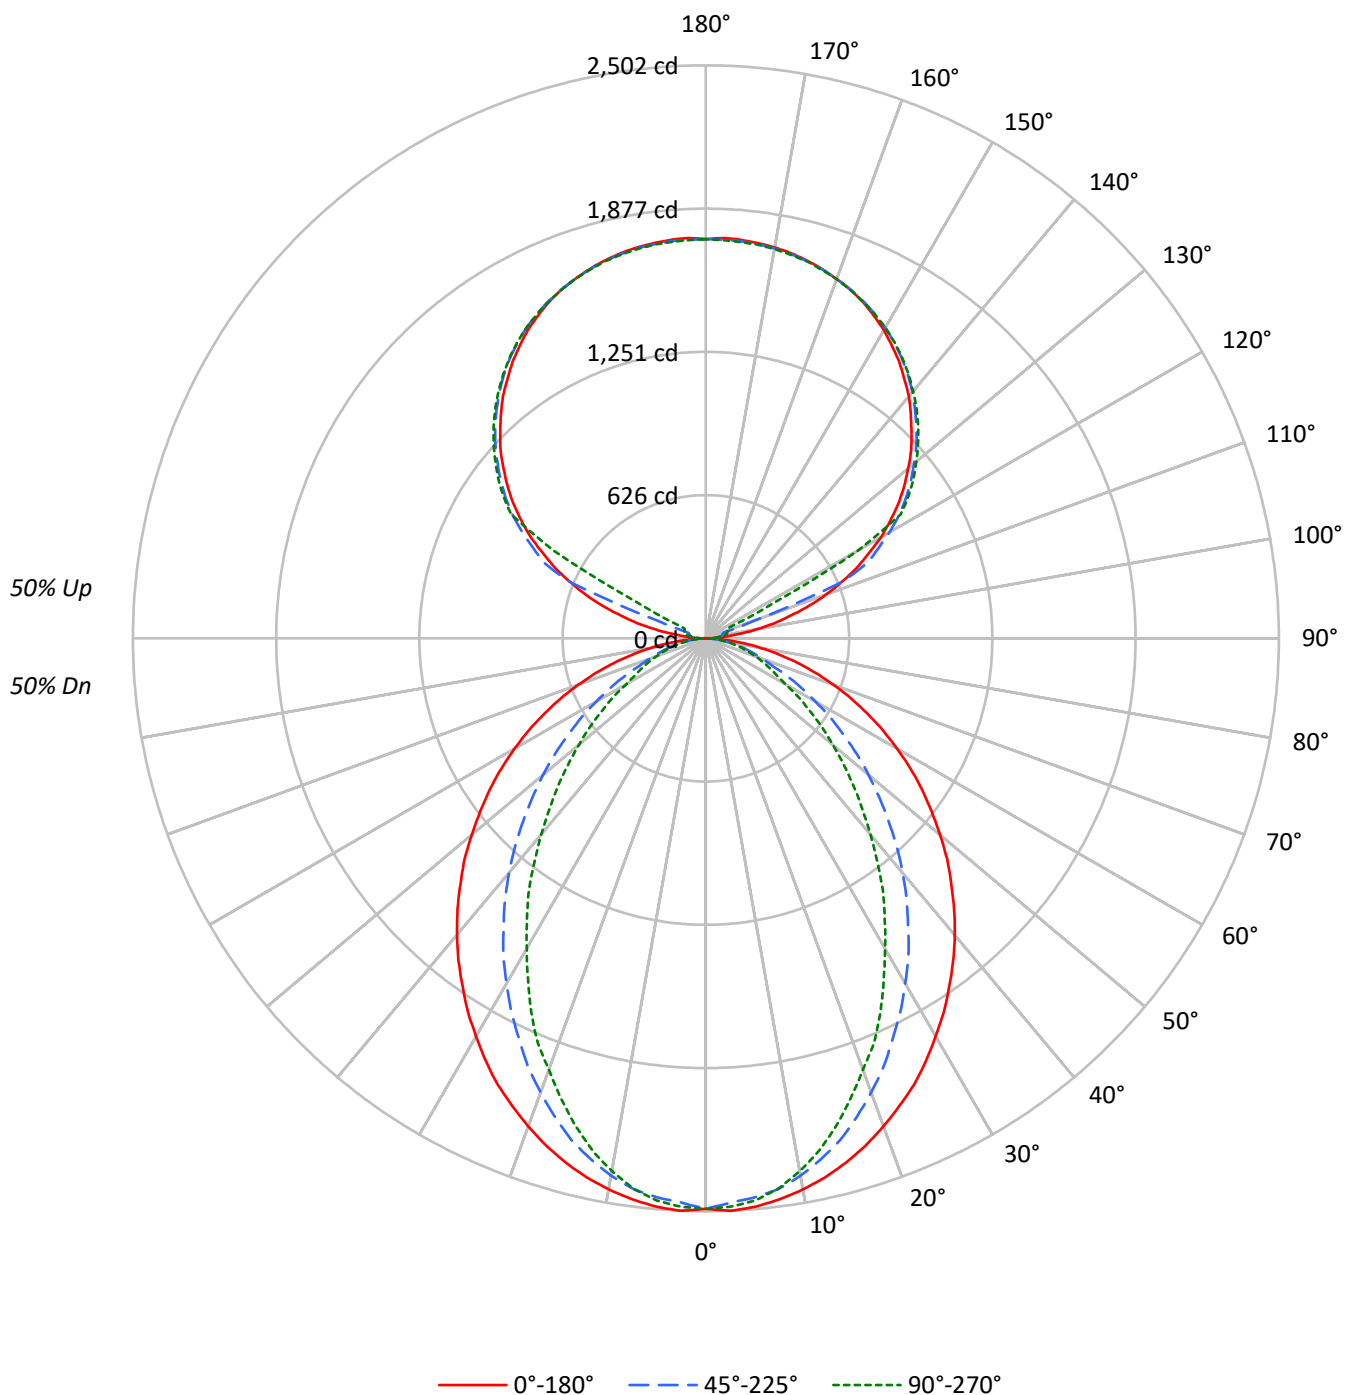

TEST NUMBER: P921029

CATALOG NUMBER: DFN2DIP-TR4F0-070D060US935-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	94	90	87	91	87	84	81	74	72	69	62	60	59	50	49	48
2	90	83	77	72	83	77	72	67	65	62	58	55	52	50	45	43	41
3	82	73	66	60	76	68	62	57	58	53	50	49	45	43	40	38	36
4	76	65	57	52	70	60	54	49	52	47	43	44	40	37	36	34	31
5	70	58	50	45	64	54	47	42	47	41	37	40	35	32	33	30	28
6	64	52	45	39	59	49	42	37	42	37	33	36	32	29	30	27	25
7	59	47	40	34	55	44	37	32	38	33	29	33	29	25	28	24	22
8	55	43	36	30	51	40	34	29	35	30	26	30	26	23	25	22	20
9	52	40	32	27	48	37	30	26	32	27	23	28	24	21	24	20	18
10	48	36	29	25	45	34	28	23	30	25	21	26	22	19	22	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1979	1979	1979
5°	1982	1947	1960
10°	1962	1909	1896
15°	1935	1846	1797
20°	1900	1759	1676
25°	1863	1662	1560
30°	1814	1562	1411
35°	1766	1454	1281
40°	1717	1343	1132
45°	1660	1219	997
50°	1601	1095	864
55°	1540	962	738
60°	1469	822	607
65°	1387	681	546
70°	1288	549	494
75°	1163	484	450
80°	983	406	390
85°	685	271	293

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 1660 cd/sqm

TEST NUMBER: P921029

CATALOG NUMBER: DFN2DIP-TR4F0-070D060US935-RLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	233.5	2.3
10°-20°	640.9	6.3
20°-30°	899.8	8.8
30°-40°	980.8	9.6
40°-50°	901.5	8.8
50°-60°	708.0	6.9
60°-70°	460.8	4.5
70°-80°	237.2	2.3
80°-90°	63.6	0.6
90°-100°	57.5	0.6
100°-110°	214.3	2.1
110°-120°	568.4	5.6
120°-130°	942.7	9.2
130°-140°	1001.4	9.8
140°-150°	930.7	9.1
150°-160°	748.2	7.3
160°-170°	482.1	4.7
170°-180°	165.9	1.6
0°-30°	1774.1	17.3
0°-40°	2754.9	26.9
0°-60°	4364.3	42.6
0°-90°	5126.0	50.1
90°-120°	840.2	8.2
90°-150°	3714.9	36.3
90°-180°	5111.0	49.9
0°-180°	10237.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2491	2491	2491	2491	2491	
5°	2491	2480	2450	2471	2464	236
15°	2369	2344	2268	2225	2202	668
25°	2151	2078	1930	1837	1803	989
35°	1853	1738	1540	1398	1348	1160
45°	1515	1364	1127	967	913	1170
55°	1152	976	732	597	555	1029
65°	778	595	392	316	309	771
75°	415	257	180	164	162	439
85°	97	50	43	43	43	111
90°	1	15	25	32	34	10
95°	82	40	49	56	54	97
105°	384	421	77	91	96	410
115°	725	747	778	194	104	714
125°	1026	1042	1066	1075	1079	915
135°	1269	1289	1301	1313	1311	980
145°	1472	1471	1492	1501	1495	921
155°	1621	1610	1625	1632	1622	747
165°	1708	1701	1704	1713	1704	483
175°	1747	1738	1741	1750	1737	166
180°	1743	1743	1743	1743	1743	

TEST NUMBER: P921029

CATALOG NUMBER: DFN2DIP-TR4F0-070D060US935-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2491.0	2491.0	2491.0	2491.0	2491.0
2.5°	2502.1	2491.0	2466.1	2488.8	2484.2
5°	2491.0	2479.7	2450.3	2470.6	2463.9
7.5°	2470.6	2457.2	2425.7	2434.5	2423.3
10°	2443.6	2427.8	2382.8	2375.9	2362.5
12.5°	2409.8	2389.5	2328.6	2315.1	2290.3
15°	2369.2	2344.3	2267.8	2225.0	2202.5
17.5°	2321.9	2285.8	2191.1	2141.5	2105.4
20°	2267.8	2222.6	2110.0	2053.7	2004.0
22.5°	2209.2	2157.3	2026.4	1949.9	1916.2
25°	2150.6	2078.4	1929.6	1837.3	1803.4
27.5°	2080.8	2004.0	1839.4	1733.5	1681.6
30°	2006.4	1920.5	1740.2	1625.4	1564.4
32.5°	1934.1	1830.4	1645.7	1510.4	1453.9
35°	1853.0	1738.0	1539.8	1397.7	1348.0
37.5°	1774.2	1650.0	1440.5	1284.8	1228.6
40°	1690.7	1555.6	1336.7	1176.7	1118.1
42.5°	1605.1	1460.9	1233.1	1066.2	1010.0
45°	1514.9	1363.7	1127.2	967.0	912.9
47.5°	1429.3	1269.3	1025.8	865.6	816.1
50°	1334.5	1174.6	926.5	770.9	723.8
52.5°	1242.0	1072.9	831.8	683.0	640.2
55°	1151.8	976.0	732.5	597.4	554.7
57.5°	1059.5	879.2	644.8	518.5	482.4
60°	964.8	784.5	552.2	437.5	401.3
62.5°	872.4	692.2	473.3	365.2	347.2
65°	777.7	595.0	392.3	315.7	308.8
67.5°	687.6	504.9	315.7	277.2	270.5
70°	592.9	417.1	261.4	238.9	229.8
72.5°	502.7	335.8	218.6	200.7	196.1
75°	414.7	256.8	180.3	164.5	162.4
77.5°	326.9	182.4	142.1	132.9	128.5
80°	245.6	130.8	108.1	99.3	99.3
82.5°	171.3	88.0	74.4	69.8	69.8
85°	96.9	49.5	42.8	42.8	42.8
87.5°	36.1	17.9	17.9	15.8	15.8
90°	1.2	15.2	25.1	31.6	34.0
92.5°	31.6	26.5	30.2	32.8	34.0
95°	82.0	40.3	49.2	55.6	54.2
97.5°	147.6	44.2	64.2	68.2	69.4
100°	223.3	50.5	71.9	82.0	84.5
102.5°	306.5	304.1	74.5	88.3	92.1
105°	383.5	421.4	77.0	90.7	95.9
107.5°	473.1	504.5	79.6	93.3	98.4
110°	559.0	585.3	220.8	94.7	99.6

TEST NUMBER: P921029

CATALOG NUMBER: DFN2DIP-TR4F0-070D060US935-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	639.6	662.3	640.8	97.0	101.0
115°	725.4	746.8	778.4	194.3	103.5
117.5°	799.8	825.0	846.5	666.1	335.5
120°	883.1	902.0	924.8	939.9	769.6
122.5°	953.6	973.9	999.2	1006.7	1008.1
125°	1025.6	1042.1	1066.0	1074.9	1078.6
127.5°	1091.2	1108.9	1127.9	1140.5	1141.7
130°	1153.0	1173.3	1187.1	1201.0	1199.8
132.5°	1216.2	1232.6	1246.4	1257.7	1256.5
135°	1269.2	1289.4	1300.6	1313.4	1310.8
137.5°	1324.6	1339.7	1352.5	1365.0	1361.3
140°	1378.8	1389.0	1402.8	1414.2	1407.9
142.5°	1424.3	1433.2	1449.6	1459.6	1453.3
145°	1472.3	1470.9	1492.4	1501.2	1495.0
147.5°	1513.8	1510.0	1531.5	1537.7	1532.8
150°	1554.3	1545.4	1565.6	1573.1	1566.8
152.5°	1588.3	1578.2	1597.1	1604.7	1595.9
155°	1621.1	1609.8	1625.0	1632.5	1622.4
157.5°	1647.6	1637.5	1648.9	1657.8	1647.6
160°	1670.3	1662.7	1670.3	1677.8	1669.0
162.5°	1690.4	1682.9	1689.2	1698.1	1686.7
165°	1708.1	1700.6	1704.3	1713.2	1704.3
167.5°	1722.0	1714.4	1718.3	1727.2	1715.7
170°	1733.4	1725.8	1728.4	1737.1	1725.8
172.5°	1740.9	1733.4	1735.9	1744.8	1733.4
175°	1747.2	1738.4	1740.9	1749.7	1737.1
177.5°	1749.7	1740.9	1742.2	1751.1	1739.7
180°	1743.4	1743.4	1743.4	1743.4	1743.4

TEST NUMBER: P921029

CATALOG NUMBER: DFN2DIP-TR4F0-070D060US935-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.52	10.35	10.48	11.32	12.60	5.49	6.32	6.46	7.30	8.57
	3H	11.20	11.94	12.17	12.92	14.22	6.68	7.43	7.66	8.41	9.70
	4H	11.81	12.51	12.79	13.49	14.80	7.13	7.84	8.12	8.82	10.13
	6H	12.23	12.87	13.23	13.86	15.18	7.46	8.10	8.46	9.09	10.41
	8H	12.35	12.97	13.36	13.98	15.29	7.55	8.16	8.55	9.17	10.48
	12H	12.42	13.00	13.42	14.00	15.34	7.59	8.18	8.60	9.18	10.51
4H	2H	9.54	10.24	10.53	11.23	12.53	6.09	6.79	7.08	7.78	9.08
	3H	11.37	11.95	12.37	12.97	14.28	7.44	8.02	8.44	9.04	10.36
	4H	12.06	12.59	13.07	13.60	14.94	7.99	8.52	9.00	9.53	10.87
	6H	12.57	13.03	13.60	14.06	15.40	8.41	8.87	9.43	9.90	11.24
	8H	12.75	13.18	13.77	14.20	15.55	8.54	8.97	9.56	9.99	11.34
	12H	12.84	13.23	13.89	14.27	15.63	8.60	8.99	9.65	10.03	11.39
8H	4H	12.03	12.46	13.05	13.48	14.83	8.27	8.70	9.29	9.72	11.07
	6H	12.59	12.95	13.64	14.01	15.36	8.79	9.14	9.84	10.21	11.56
	8H	12.81	13.12	13.86	14.17	15.54	8.98	9.29	10.03	10.34	11.71
	12H	12.95	13.22	14.01	14.27	15.68	9.10	9.37	10.16	10.42	11.83
12H	4H	11.98	12.37	13.02	13.41	14.76	8.27	8.66	9.31	9.70	11.06
	6H	12.57	12.88	13.62	13.93	15.30	8.84	9.15	9.89	10.20	11.57
	8H	12.79	13.06	13.85	14.11	15.52	9.05	9.32	10.11	10.37	11.78

END OF REPORT