

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P921047

Luminaire Tested: DFN2DIP-TR4F0-070D110US935-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P921047
REPORT IS A COMBINATION OF REPORTS P902021 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-070D110US935-FLLONL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15343.0 lumens
Efficiency: N/A
Efficacy: 102.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 150.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9977
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P921047

CATALOG NUMBER: DFN2DIP-TR4F0-070D110US935-FLLONL

Luminous Intensity Polar Plot

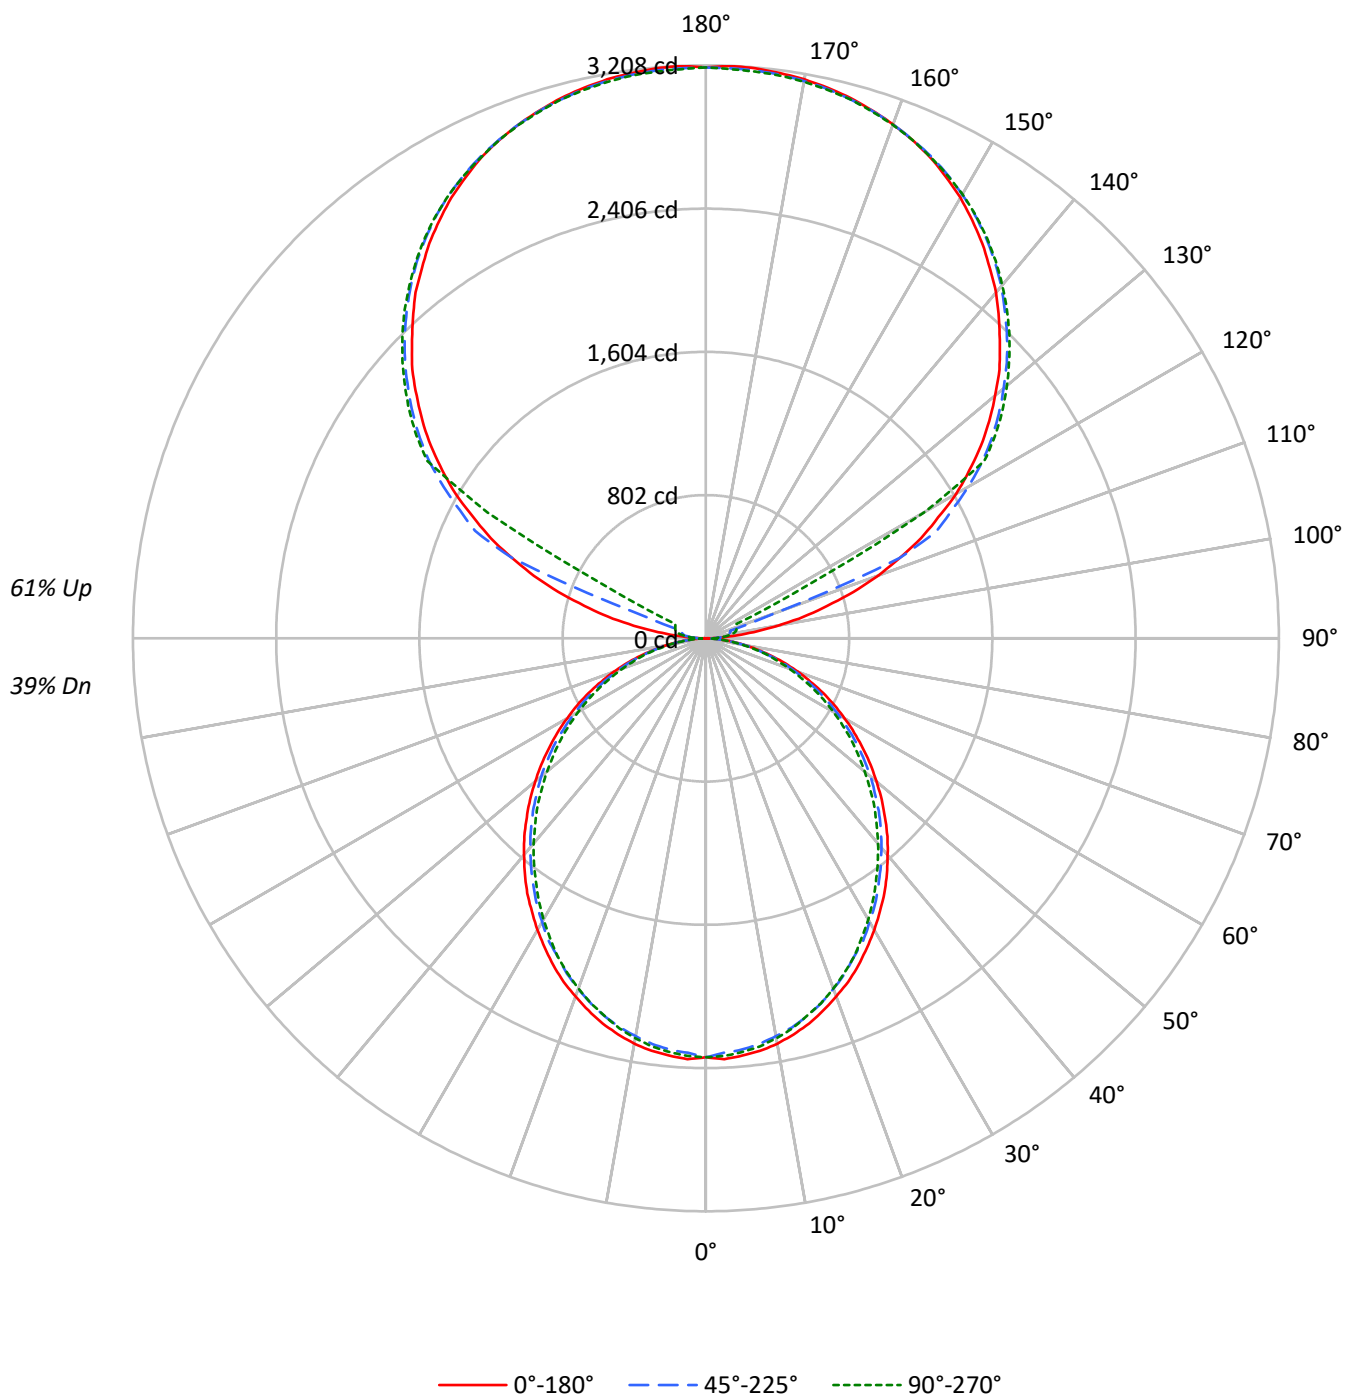

TEST NUMBER: P921047

CATALOG NUMBER: DFN2DIP-TR4F0-070D110US935-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	95	95	95	95	77	77	77	61	61	61	46	46	46
1	95	91	87	84	86	83	80	77	68	65	63	54	52	51	41	40	39
2	87	79	73	68	79	72	67	63	59	56	52	47	44	42	36	34	33
3	79	70	63	57	72	64	58	53	52	48	44	42	38	36	32	30	28
4	72	62	54	48	65	56	50	44	46	41	37	37	33	31	28	26	24
5	66	55	47	41	60	50	43	38	41	36	32	33	29	26	25	23	21
6	61	49	41	36	55	45	38	33	37	32	28	30	26	23	23	20	18
7	56	44	37	31	51	41	34	29	34	28	25	27	23	20	21	18	16
8	52	40	33	27	47	37	30	26	31	26	22	25	21	18	19	17	15
9	49	37	29	24	44	34	27	23	28	23	19	23	19	16	18	15	13
10	45	34	26	22	41	31	25	20	26	21	17	21	17	15	17	14	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1863	1863	1863
5°	1866	1837	1849
10°	1851	1812	1824
15°	1824	1782	1785
20°	1787	1741	1745
25°	1750	1691	1699
30°	1705	1645	1640
35°	1661	1591	1577
40°	1608	1536	1518
45°	1554	1481	1457
50°	1496	1423	1387
55°	1435	1356	1322
60°	1366	1276	1248
65°	1291	1194	1161
70°	1195	1094	1067
75°	1062	974	980
80°	903	821	814
85°	653	558	540

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1696 cd/sqm

TEST NUMBER: P921047

CATALOG NUMBER: DFN2DIP-TR4F0-070D110US935-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	220.7	1.4
10°-20°	621.0	4.0
20°-30°	912.7	5.9
30°-40°	1060.0	6.9
40°-50°	1058.7	6.9
50°-60°	923.2	6.0
60°-70°	682.4	4.4
70°-80°	386.1	2.5
80°-90°	107.5	0.7
90°-100°	105.4	0.7
100°-110°	392.9	2.6
110°-120°	1042.0	6.8
120°-130°	1728.3	11.3
130°-140°	1835.9	12.0
140°-150°	1706.2	11.1
150°-160°	1371.8	8.9
160°-170°	883.9	5.8
170°-180°	304.2	2.0
0°-30°	1754.4	11.4
0°-40°	2814.4	18.3
0°-60°	4796.3	31.3
0°-90°	5972.4	38.9
90°-120°	1540.3	10.0
90°-150°	6810.7	44.4
90°-180°	9371.0	61.1
0°-180°	15343.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2345	2345	2345	2345	2345	
5°	2345	2336	2311	2329	2325	223
15°	2232	2219	2190	2199	2188	629
25°	2020	2002	1964	1969	1964	930
35°	1743	1721	1684	1671	1660	1089
45°	1418	1403	1369	1344	1335	1095
55°	1074	1060	1033	1006	994	960
65°	724	710	688	668	656	716
75°	379	374	363	350	354	404
85°	92	90	88	81	79	103
90°	2	28	46	58	62	14
95°	150	74	90	102	99	178
105°	703	773	141	166	176	751
115°	1330	1369	1427	356	190	1309
125°	1880	1910	1954	1971	1978	1677
135°	2327	2364	2384	2408	2403	1797
145°	2699	2697	2736	2752	2741	1688
155°	2972	2951	2979	2993	2974	1370
165°	3132	3118	3125	3141	3125	885
175°	3203	3187	3192	3208	3185	305
180°	3196	3196	3196	3196	3196	

TEST NUMBER: P921047

CATALOG NUMBER: DFN2DIP-TR4F0-070D110US935-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2345.1	2345.1	2345.1	2345.1	2345.1
2.5°	2358.8	2347.5	2322.6	2345.1	2340.8
5°	2345.1	2336.3	2311.4	2329.3	2325.0
7.5°	2329.3	2315.9	2291.0	2309.3	2304.7
10°	2304.7	2288.9	2261.8	2279.8	2273.1
12.5°	2270.7	2257.4	2230.3	2241.5	2237.0
15°	2232.5	2219.0	2189.6	2198.7	2187.5
17.5°	2185.0	2171.7	2142.2	2153.5	2142.2
20°	2133.1	2119.8	2088.2	2094.9	2086.0
22.5°	2081.5	2061.1	2031.7	2031.7	2027.1
25°	2020.5	2002.5	1964.3	1968.6	1964.3
27.5°	1952.7	1937.0	1907.8	1901.1	1889.8
30°	1885.3	1867.1	1833.4	1826.7	1817.6
32.5°	1813.0	1799.7	1763.5	1749.9	1740.8
35°	1743.2	1720.7	1684.5	1670.9	1659.7
37.5°	1664.2	1643.9	1607.7	1592.0	1580.7
40°	1583.1	1564.9	1528.8	1508.7	1499.6
42.5°	1504.2	1486.0	1450.1	1427.4	1413.9
45°	1418.5	1402.7	1368.7	1344.1	1335.0
47.5°	1335.0	1319.2	1283.1	1258.2	1244.8
50°	1247.0	1235.7	1204.1	1172.6	1161.3
52.5°	1161.3	1145.6	1116.4	1091.5	1075.6
55°	1073.5	1059.9	1032.9	1005.8	994.5
57.5°	985.5	974.2	944.8	917.7	908.7
60°	897.4	888.5	857.0	832.2	825.4
62.5°	811.7	796.0	773.5	751.0	741.9
65°	724.0	710.3	687.9	667.5	656.3
67.5°	633.8	622.3	602.2	586.4	577.3
70°	550.3	541.2	520.8	505.1	496.2
72.5°	464.6	455.6	444.3	428.5	421.8
75°	378.8	374.4	362.9	349.6	354.1
77.5°	302.2	293.1	288.5	281.8	275.2
80°	225.6	223.3	218.7	212.0	207.4
82.5°	153.3	153.3	151.2	142.2	142.2
85°	92.4	90.2	88.1	81.1	79.0
87.5°	40.6	36.2	31.6	24.9	22.5
90°	2.2	27.7	46.1	57.9	62.3
92.5°	57.9	48.6	55.4	60.2	62.3
95°	150.2	73.9	90.1	101.9	99.4
97.5°	270.5	81.0	117.8	124.9	127.2
100°	409.5	92.6	131.8	150.2	154.9
102.5°	561.9	557.5	136.5	161.8	168.9
105°	703.1	772.6	141.2	166.4	175.8
107.5°	867.4	925.0	145.9	171.1	180.5
110°	1024.7	1073.1	404.8	173.6	182.6

TEST NUMBER: P921047

CATALOG NUMBER: DFN2DIP-TR4F0-070D110US935-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1172.8	1214.2	1174.9	178.0	185.1
115°	1329.8	1369.1	1427.1	356.2	189.8
117.5°	1466.4	1512.5	1552.0	1221.1	615.2
120°	1619.0	1653.6	1695.4	1723.1	1410.8
122.5°	1748.4	1785.5	1831.9	1845.6	1848.1
125°	1880.2	1910.5	1954.4	1970.6	1977.5
127.5°	2000.5	2032.9	2067.8	2090.8	2093.1
130°	2113.9	2151.0	2176.3	2201.8	2199.7
132.5°	2229.6	2259.8	2285.1	2305.9	2303.8
135°	2326.8	2363.9	2384.4	2407.9	2403.1
137.5°	2428.4	2456.2	2479.5	2502.6	2495.7
140°	2527.9	2546.5	2571.8	2592.6	2581.1
142.5°	2611.3	2627.5	2657.5	2675.9	2664.4
145°	2699.2	2696.7	2736.0	2752.3	2740.7
147.5°	2775.3	2768.5	2807.7	2819.3	2810.2
150°	2849.5	2833.3	2870.3	2884.1	2872.5
152.5°	2911.8	2893.4	2928.0	2942.0	2925.8
155°	2972.0	2951.3	2979.1	2992.8	2974.4
157.5°	3020.6	3002.1	3023.0	3039.2	3020.6
160°	3062.3	3048.3	3062.3	3076.0	3059.8
162.5°	3099.1	3085.4	3096.9	3113.1	3092.3
165°	3131.5	3117.8	3124.6	3140.8	3124.6
167.5°	3157.0	3143.1	3150.2	3166.4	3145.6
170°	3177.9	3163.9	3168.6	3184.8	3163.9
172.5°	3191.6	3177.9	3182.6	3198.8	3177.9
175°	3203.2	3187.0	3191.6	3207.9	3184.8
177.5°	3207.9	3191.6	3194.1	3210.3	3189.5
180°	3196.4	3196.4	3196.4	3196.4	3196.4

TEST NUMBER: P921047

CATALOG NUMBER: DFN2DIP-TR4F0-070D110US935-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.31	9.08	9.36	10.13	11.55	7.88	8.65	8.92	9.70	11.12
	3H	9.96	10.65	11.02	11.71	13.15	9.49	10.18	10.55	11.24	12.68
	4H	10.55	11.20	11.61	12.26	13.71	10.07	10.73	11.14	11.79	13.24
	6H	10.94	11.54	12.02	12.61	14.07	10.47	11.07	11.54	12.13	13.59
	8H	11.04	11.62	12.12	12.70	14.15	10.57	11.14	11.65	12.22	13.68
	12H	11.09	11.63	12.17	12.71	14.19	10.61	11.15	11.69	12.23	13.71
4H	2H	8.76	9.41	9.83	10.48	11.92	8.42	9.07	9.49	10.13	11.58
	3H	10.62	11.16	11.70	12.25	13.71	10.22	10.77	11.31	11.86	13.32
	4H	11.33	11.83	12.42	12.91	14.39	10.92	11.42	12.01	12.50	13.98
	6H	11.84	12.27	12.93	13.37	14.85	11.43	11.86	12.52	12.96	14.44
	8H	11.99	12.39	13.08	13.48	14.97	11.57	11.97	12.67	13.07	14.56
	12H	12.05	12.42	13.17	13.53	15.02	11.63	12.00	12.75	13.10	14.60
8H	4H	11.52	11.92	12.61	13.01	14.50	11.16	11.56	12.25	12.65	14.14
	6H	12.14	12.48	13.26	13.61	15.10	11.78	12.11	12.90	13.25	14.74
	8H	12.36	12.65	13.49	13.77	15.28	12.00	12.29	13.12	13.41	14.91
	12H	12.49	12.75	13.62	13.86	15.41	12.11	12.36	13.24	13.48	15.02
12H	4H	11.50	11.86	12.61	12.97	14.47	11.15	11.51	12.26	12.62	14.11
	6H	12.17	12.46	13.30	13.58	15.09	11.82	12.11	12.95	13.23	14.74
	8H	12.41	12.67	13.54	13.78	15.33	12.05	12.31	13.18	13.43	14.97

END OF REPORT