

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P921075

Luminaire Tested: DFN2DIP-TR4F0-080D090US935-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P921075
REPORT IS A COMBINATION OF REPORTS P901987 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-080D090US935-FLLONL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14490.6 lumens
Efficiency: N/A
Efficacy: 101.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 142.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P921075

CATALOG NUMBER: DFN2DIP-TR4F0-080D090US935-FLLONL

Luminous Intensity Polar Plot

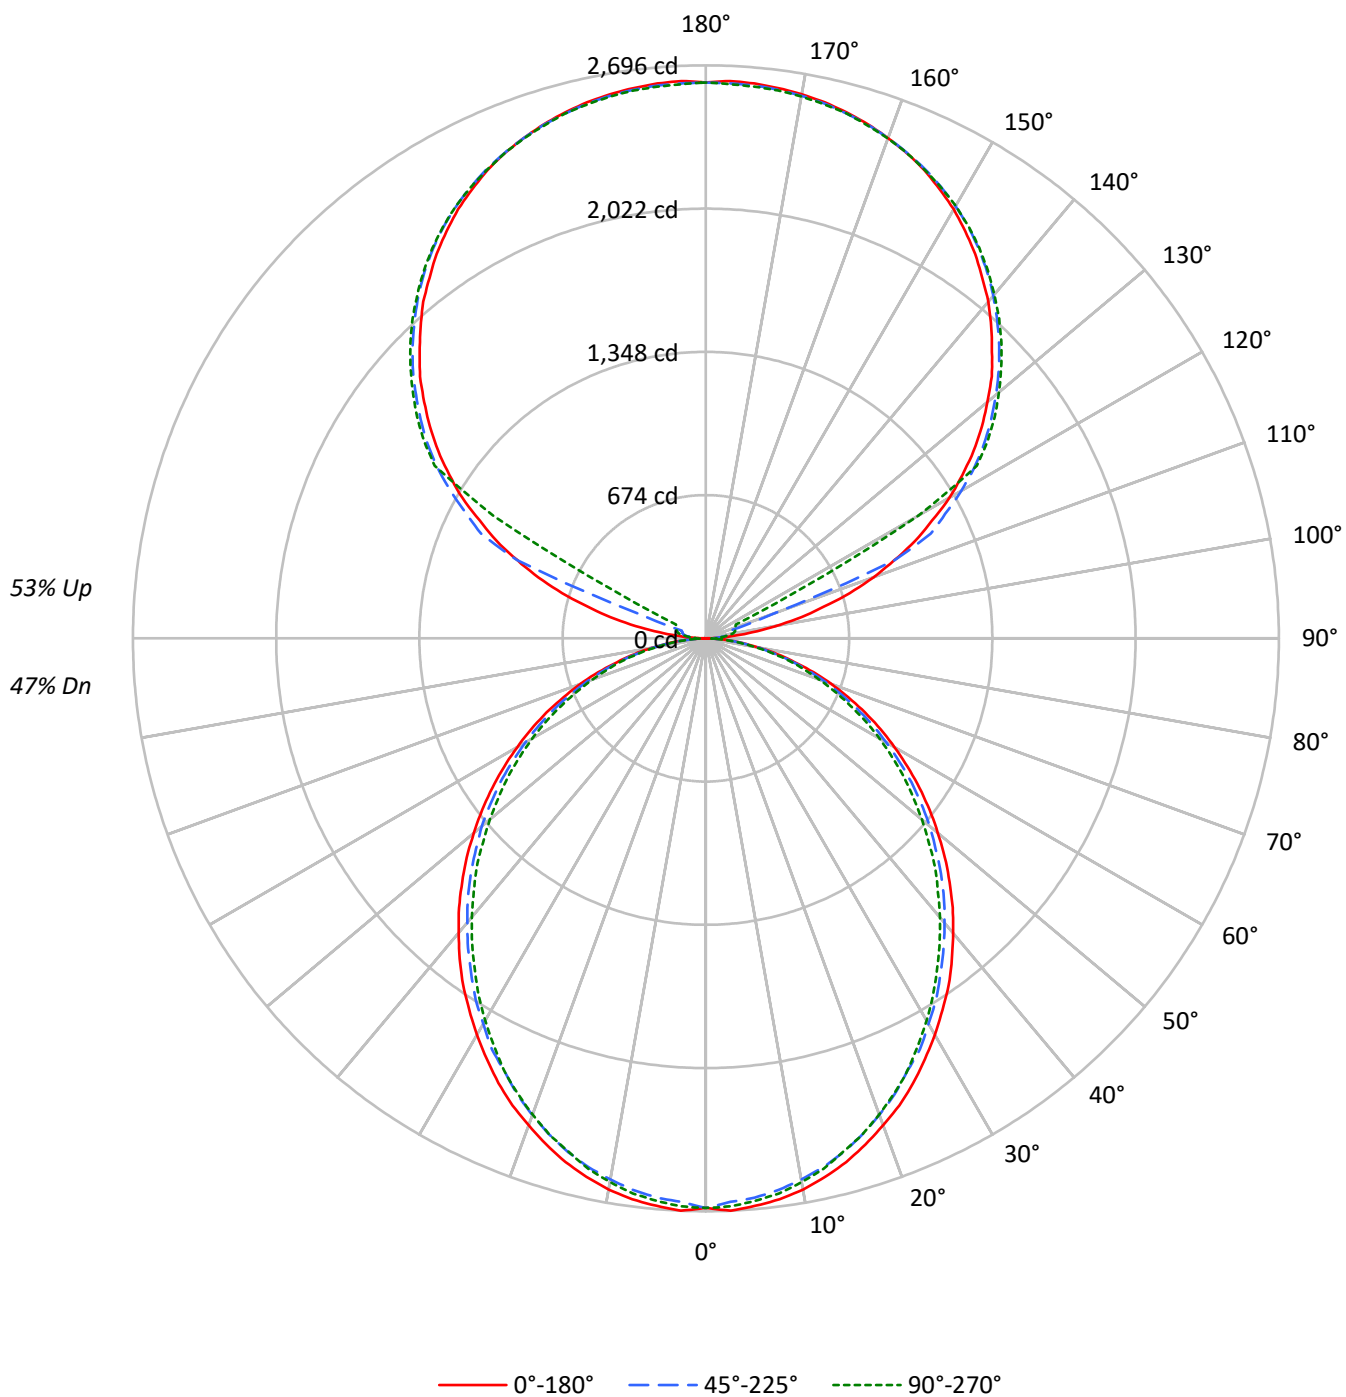

TEST NUMBER: P921075

CATALOG NUMBER: DFN2DIP-TR4F0-080D090US935-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	98	98	98	98	82	82	82	67	67	67	53	53	53
1	97	93	89	85	89	85	82	79	72	69	67	59	57	56	47	46	45
2	88	81	75	70	81	75	69	65	63	59	56	52	49	47	42	40	38
3	81	71	64	58	74	66	59	54	55	51	47	46	42	39	37	34	32
4	74	63	55	49	68	58	51	46	49	44	40	41	37	34	33	30	28
5	68	56	48	42	62	52	45	39	44	39	34	37	32	29	30	27	24
6	62	50	42	36	57	47	39	34	40	34	30	33	29	26	27	24	21
7	58	45	38	32	53	42	35	30	36	30	26	30	26	23	25	21	19
8	53	41	34	28	49	38	31	27	33	27	23	28	23	20	23	19	17
9	50	38	30	25	46	35	28	24	30	25	21	25	21	18	21	18	15
10	47	34	27	23	43	32	26	21	28	22	19	23	19	16	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2129	2129	2129
5°	2133	2100	2114
10°	2115	2071	2085
15°	2084	2037	2040
20°	2042	1990	1994
25°	2000	1933	1941
30°	1948	1880	1874
35°	1898	1818	1803
40°	1837	1755	1735
45°	1776	1692	1666
50°	1710	1626	1585
55°	1640	1550	1511
60°	1561	1459	1427
65°	1475	1365	1327
70°	1366	1250	1219
75°	1214	1113	1120
80°	1032	938	930
85°	747	637	616

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1776 cd/sqm

TEST NUMBER: P921075

CATALOG NUMBER: DFN2DIP-TR4F0-080D090US935-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	252.3	1.7
10°-20°	709.8	4.9
20°-30°	1043.1	7.2
30°-40°	1211.4	8.4
40°-50°	1209.9	8.3
50°-60°	1055.0	7.3
60°-70°	779.9	5.4
70°-80°	441.2	3.0
80°-90°	121.1	0.8
90°-100°	86.2	0.6
100°-110°	321.5	2.2
110°-120°	852.6	5.9
120°-130°	1414.1	9.8
130°-140°	1502.1	10.4
140°-150°	1396.0	9.6
150°-160°	1122.4	7.7
160°-170°	723.2	5.0
170°-180°	248.9	1.7
0°-30°	2005.1	13.8
0°-40°	3216.5	22.2
0°-60°	5481.5	37.8
0°-90°	6823.7	47.1
90°-120°	1260.3	8.7
90°-150°	5572.4	38.5
90°-180°	7667.0	52.9
0°-180°	14490.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2680	2680	2680	2680	2680	
5°	2680	2670	2642	2662	2657	254
15°	2551	2536	2502	2513	2500	719
25°	2309	2289	2245	2250	2245	1063
35°	1992	1966	1925	1910	1897	1244
45°	1621	1603	1564	1536	1526	1251
55°	1227	1211	1180	1150	1137	1097
65°	827	812	786	763	750	818
75°	433	428	415	400	405	462
85°	106	103	101	93	90	118
90°	2	23	38	47	51	13
95°	123	60	74	83	81	146
105°	575	632	116	136	144	615
115°	1088	1120	1168	291	155	1071
125°	1538	1563	1599	1612	1618	1372
135°	1904	1934	1951	1970	1966	1471
145°	2208	2206	2239	2252	2242	1381
155°	2432	2415	2437	2449	2434	1121
165°	2562	2551	2557	2570	2557	724
175°	2621	2608	2611	2625	2606	249
180°	2615	2615	2615	2615	2615	

TEST NUMBER: P921075

CATALOG NUMBER: DFN2DIP-TR4F0-080D090US935-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2680.1	2680.1	2680.1	2680.1	2680.1
2.5°	2695.7	2682.9	2654.5	2680.1	2675.2
5°	2680.1	2670.0	2641.6	2662.1	2657.2
7.5°	2662.1	2646.8	2618.4	2639.1	2634.0
10°	2634.0	2615.9	2585.0	2605.5	2597.9
12.5°	2595.1	2579.8	2548.9	2561.7	2556.6
15°	2551.4	2536.1	2502.4	2512.8	2500.0
17.5°	2497.2	2481.9	2448.2	2461.2	2448.2
20°	2437.9	2422.6	2386.5	2394.2	2384.0
22.5°	2378.9	2355.6	2321.9	2321.9	2316.8
25°	2309.1	2288.6	2244.9	2249.8	2244.9
27.5°	2231.7	2213.7	2180.3	2172.6	2159.8
30°	2154.6	2133.8	2095.3	2087.7	2077.2
32.5°	2072.1	2056.8	2015.4	1999.8	1989.5
35°	1992.2	1966.5	1925.2	1909.6	1896.8
37.5°	1901.9	1878.7	1837.5	1819.4	1806.5
40°	1809.3	1788.5	1747.2	1724.2	1713.8
42.5°	1719.1	1698.2	1657.2	1631.2	1616.0
45°	1621.2	1603.1	1564.3	1536.1	1525.8
47.5°	1525.8	1507.7	1466.4	1438.0	1422.6
50°	1425.1	1412.3	1376.1	1340.1	1327.2
52.5°	1327.2	1309.1	1275.8	1247.4	1229.3
55°	1226.8	1211.3	1180.4	1149.5	1136.6
57.5°	1126.3	1113.4	1079.8	1048.9	1038.4
60°	1025.6	1015.5	979.4	951.0	943.3
62.5°	927.7	909.7	884.0	858.3	847.9
65°	827.4	811.8	786.1	762.8	750.0
67.5°	724.3	711.2	688.2	670.2	659.8
70°	628.9	618.5	595.3	577.2	567.1
72.5°	531.0	520.6	507.7	489.7	482.1
75°	432.8	427.9	414.8	399.5	404.7
77.5°	345.3	334.9	329.8	322.1	314.4
80°	257.9	255.1	249.9	242.3	237.0
82.5°	175.3	175.3	172.8	162.4	162.4
85°	105.6	103.1	100.7	92.7	90.2
87.5°	46.5	41.3	36.1	28.4	25.7
90°	1.8	22.7	37.7	47.4	51.0
92.5°	47.4	39.8	45.4	49.2	51.0
95°	123.0	60.4	73.7	83.3	81.4
97.5°	221.4	66.3	96.4	102.2	104.0
100°	335.0	75.8	107.9	123.0	126.7
102.5°	459.8	456.2	111.7	132.3	138.2
105°	575.2	632.1	115.5	136.2	143.8
107.5°	709.6	756.8	119.3	140.0	147.7
110°	838.4	878.0	331.2	142.0	149.5

TEST NUMBER: P921075

CATALOG NUMBER: DFN2DIP-TR4F0-080D090US935-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	959.5	993.4	961.3	145.6	151.4
115°	1088.0	1120.2	1167.6	291.4	155.2
117.5°	1199.7	1237.5	1269.8	999.1	503.3
120°	1324.6	1353.0	1387.2	1409.8	1154.3
122.5°	1430.5	1460.9	1498.8	1510.0	1512.1
125°	1538.3	1563.1	1599.0	1612.3	1617.9
127.5°	1636.8	1663.3	1691.9	1710.7	1712.5
130°	1729.6	1760.0	1780.6	1801.5	1799.7
132.5°	1824.2	1848.9	1869.6	1886.7	1884.9
135°	1903.8	1934.1	1950.9	1970.0	1966.3
137.5°	1986.9	2009.6	2028.7	2047.5	2041.9
140°	2068.2	2083.5	2104.2	2121.2	2111.9
142.5°	2136.6	2149.8	2174.3	2189.3	2180.0
145°	2208.5	2206.4	2238.6	2251.9	2242.4
147.5°	2270.7	2265.1	2297.2	2306.7	2299.2
150°	2331.4	2318.2	2348.5	2359.7	2350.3
152.5°	2382.4	2367.3	2395.6	2407.1	2393.8
155°	2431.6	2414.8	2437.4	2448.7	2433.6
157.5°	2471.4	2456.3	2473.4	2486.6	2471.4
160°	2505.5	2494.1	2505.5	2516.8	2503.5
162.5°	2535.6	2524.4	2533.8	2547.1	2530.0
165°	2562.2	2550.9	2556.6	2569.8	2556.6
167.5°	2583.1	2571.6	2577.4	2590.7	2573.6
170°	2600.1	2588.7	2592.5	2605.7	2588.7
172.5°	2611.4	2600.1	2603.9	2617.2	2600.1
175°	2620.8	2607.5	2611.4	2624.6	2605.7
177.5°	2624.6	2611.4	2613.4	2626.6	2609.6
180°	2615.2	2615.2	2615.2	2615.2	2615.2

TEST NUMBER: P921075

CATALOG NUMBER: DFN2DIP-TR4F0-080D090US935-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.62	10.45	10.60	11.45	12.76	9.19	10.02	10.17	11.02	12.33
	3H	11.28	12.02	12.27	13.03	14.36	10.80	11.55	11.80	12.56	13.89
	4H	11.86	12.57	12.87	13.58	14.92	11.39	12.10	12.39	13.11	14.45
	6H	12.26	12.91	13.28	13.93	15.28	11.78	12.44	12.80	13.45	14.80
	8H	12.36	12.99	13.39	14.01	15.36	11.89	12.51	12.91	13.54	14.89
	12H	12.41	13.00	13.44	14.03	15.40	11.93	12.52	12.96	13.54	14.92
4H	2H	10.08	10.79	11.09	11.79	13.13	9.73	10.44	10.74	11.45	12.79
	3H	11.94	12.53	12.96	13.57	14.92	11.55	12.14	12.57	13.17	14.53
	4H	12.65	13.19	13.68	14.22	15.60	12.25	12.79	13.28	13.82	15.20
	6H	13.17	13.63	14.20	14.68	16.06	12.76	13.22	13.80	14.27	15.65
	8H	13.31	13.75	14.35	14.79	16.18	12.90	13.34	13.94	14.38	15.77
	12H	13.39	13.78	14.44	14.84	16.23	12.97	13.36	14.02	14.42	15.81
8H	4H	12.85	13.28	13.89	14.33	15.72	12.49	12.92	13.53	13.97	15.36
	6H	13.48	13.84	14.54	14.92	16.31	13.11	13.48	14.18	14.56	15.95
	8H	13.70	14.01	14.77	15.08	16.49	13.33	13.65	14.40	14.72	16.12
	12H	13.83	14.11	14.90	15.17	16.62	13.44	13.72	14.52	14.79	16.24
12H	4H	12.83	13.23	13.89	14.28	15.68	12.48	12.87	13.54	13.93	15.33
	6H	13.51	13.82	14.58	14.89	16.30	13.16	13.47	14.23	14.54	15.95
	8H	13.75	14.03	14.82	15.09	16.54	13.39	13.67	14.47	14.73	16.18