

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P921086

Luminaire Tested: DFN2DIP-TR4F0-080D120US935-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P921086
REPORT IS A COMBINATION OF REPORTS P900521 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-080D120US935-FLLFLL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15962.9 lumens
Efficiency: N/A
Efficacy: 95.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 166.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P921086

CATALOG NUMBER: DFN2DIP-TR4F0-080D120US935-FLLFLL

Luminous Intensity Polar Plot

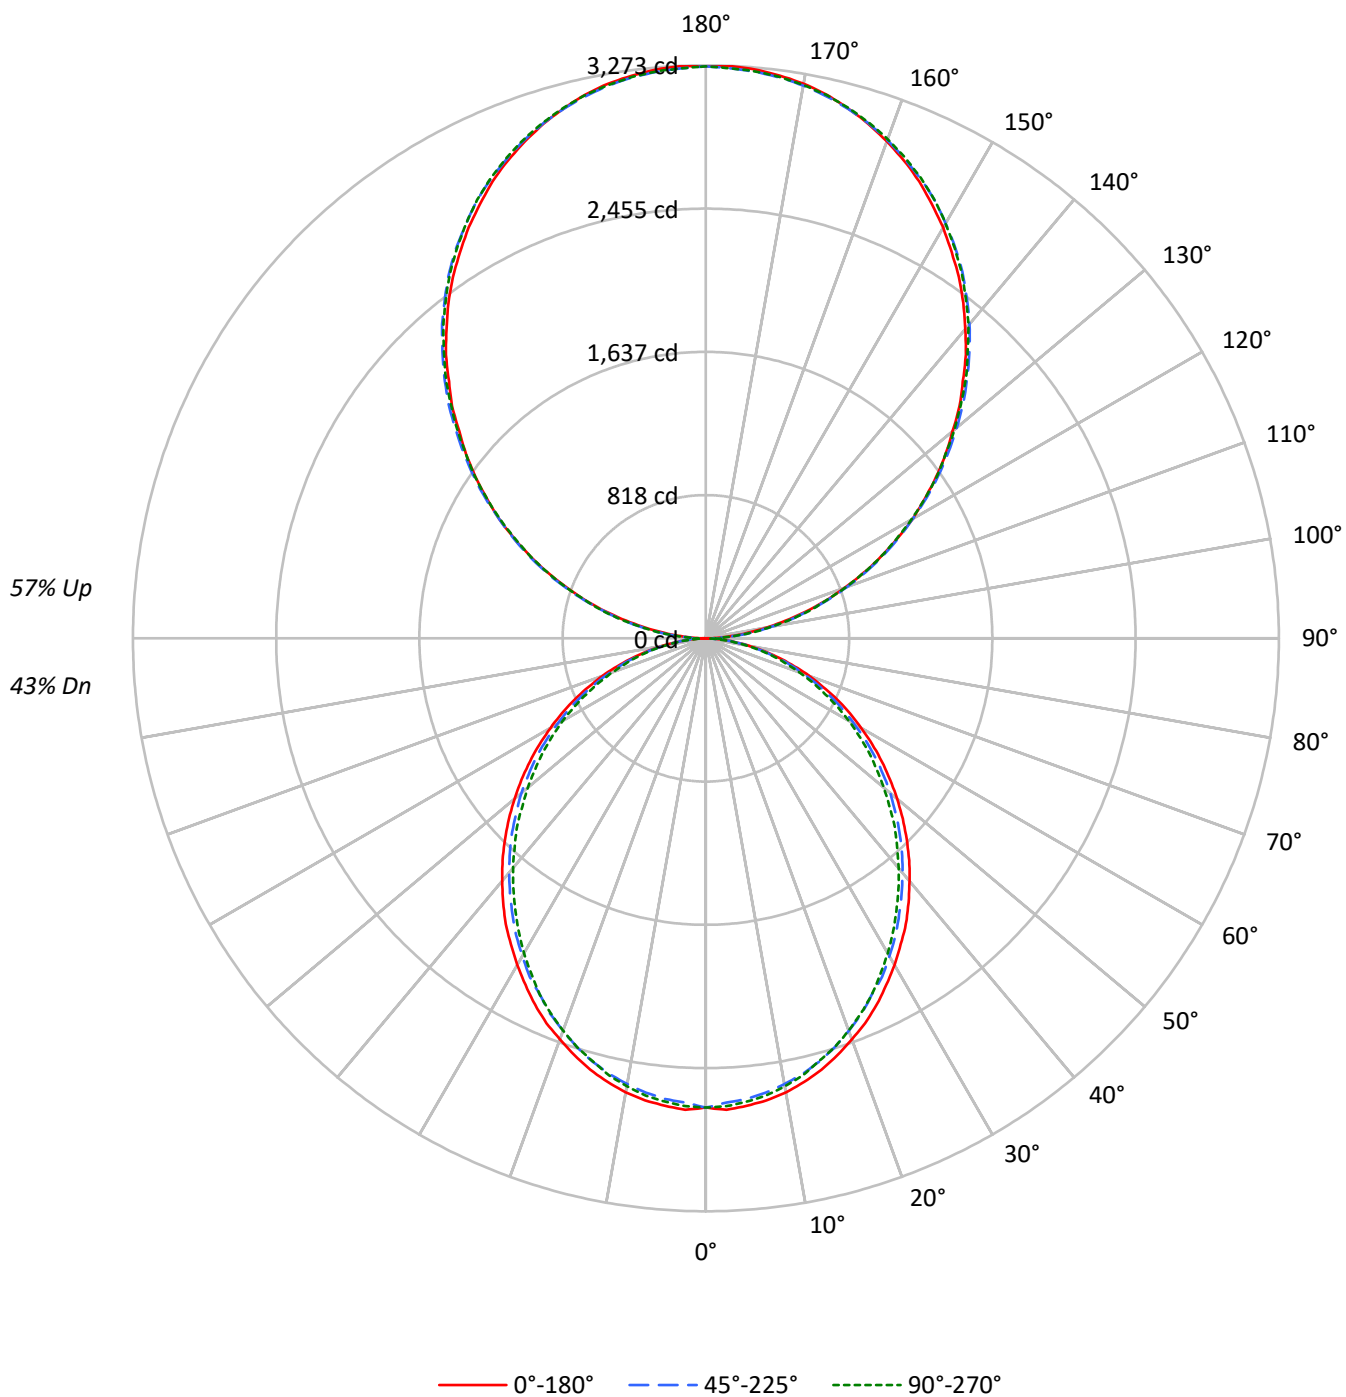

TEST NUMBER: P921086

CATALOG NUMBER: DFN2DIP-TR4F0-080D120US935-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	64	64	64	49	49	49
1	96	92	88	85	88	84	81	78	69	67	65	56	54	53	44	43	42
2	88	80	74	69	80	73	68	64	61	57	54	49	47	44	38	37	35
3	80	70	63	57	73	65	58	53	54	49	45	44	40	37	34	32	30
4	73	62	55	49	66	57	50	45	48	43	39	39	35	32	30	28	26
5	67	56	47	42	61	51	44	39	43	37	33	35	31	28	27	25	22
6	62	50	42	36	56	46	39	34	38	33	29	31	27	24	25	22	20
7	57	45	37	31	52	41	34	29	35	29	25	29	24	21	23	20	18
8	53	41	33	28	48	38	31	26	32	26	23	26	22	19	21	18	16
9	49	37	30	25	45	34	28	23	29	24	20	24	20	17	19	16	14
10	46	34	27	22	42	31	25	21	27	22	18	22	18	15	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2129	2129	2129
5°	2133	2100	2114
10°	2115	2071	2085
15°	2084	2037	2040
20°	2042	1990	1994
25°	2000	1933	1941
30°	1948	1880	1874
35°	1898	1818	1803
40°	1837	1755	1735
45°	1776	1692	1666
50°	1710	1626	1585
55°	1640	1550	1511
60°	1561	1459	1427
65°	1475	1365	1327
70°	1366	1250	1219
75°	1214	1113	1120
80°	1032	938	930
85°	747	637	616

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2547 cd/sqm

TEST NUMBER: P921086

CATALOG NUMBER: DFN2DIP-TR4F0-080D120US935-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	252.3	1.6
10°-20°	709.8	4.4
20°-30°	1043.1	6.5
30°-40°	1211.4	7.6
40°-50°	1209.9	7.6
50°-60°	1055.0	6.6
60°-70°	779.9	4.9
70°-80°	441.2	2.8
80°-90°	125.8	0.8
90°-100°	202.2	1.3
100°-110°	642.4	4.0
110°-120°	1099.4	6.9
120°-130°	1445.9	9.1
130°-140°	1623.0	10.2
140°-150°	1591.6	10.0
150°-160°	1335.1	8.4
160°-170°	885.4	5.5
170°-180°	309.5	1.9
0°-30°	2005.1	12.6
0°-40°	3216.5	20.1
0°-60°	5481.5	34.3
0°-90°	6828.4	42.8
90°-120°	1944.1	12.2
90°-150°	6604.6	41.4
90°-180°	9134.0	57.2
0°-180°	15962.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2680	2680	2680	2680	2680	
5°	2680	2670	2642	2662	2657	254
15°	2551	2536	2502	2513	2500	719
25°	2309	2289	2245	2250	2245	1063
35°	1992	1966	1925	1910	1897	1244
45°	1621	1603	1564	1536	1526	1251
55°	1227	1211	1180	1150	1137	1097
65°	827	812	786	763	750	818
75°	433	428	415	400	405	462
85°	106	103	101	93	90	118
90°	3	36	96	91	94	16
95°	144	171	176	176	171	160
105°	593	601	607	612	612	626
115°	1103	1119	1114	1111	1103	1091
125°	1605	1629	1622	1613	1610	1434
135°	2076	2106	2112	2109	2101	1604
145°	2520	2540	2555	2558	2548	1574
155°	2881	2889	2898	2912	2903	1326
165°	3135	3132	3132	3151	3138	884
175°	3262	3254	3248	3268	3251	310
180°	3268	3268	3268	3268	3268	

TEST NUMBER: P921086

CATALOG NUMBER: DFN2DIP-TR4F0-080D120US935-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2680.1	2680.1	2680.1	2680.1	2680.1
2.5°	2695.7	2682.9	2654.5	2680.1	2675.2
5°	2680.1	2670.0	2641.6	2662.1	2657.2
7.5°	2662.1	2646.8	2618.4	2639.1	2634.0
10°	2634.0	2615.9	2585.0	2605.5	2597.9
12.5°	2595.1	2579.8	2548.9	2561.7	2556.6
15°	2551.4	2536.1	2502.4	2512.8	2500.0
17.5°	2497.2	2481.9	2448.2	2461.2	2448.2
20°	2437.9	2422.6	2386.5	2394.2	2384.0
22.5°	2378.9	2355.6	2321.9	2321.9	2316.8
25°	2309.1	2288.6	2244.9	2249.8	2244.9
27.5°	2231.7	2213.7	2180.3	2172.6	2159.8
30°	2154.6	2133.8	2095.3	2087.7	2077.2
32.5°	2072.1	2056.8	2015.4	1999.8	1989.5
35°	1992.2	1966.5	1925.2	1909.6	1896.8
37.5°	1901.9	1878.7	1837.5	1819.4	1806.5
40°	1809.3	1788.5	1747.2	1724.2	1713.8
42.5°	1719.1	1698.2	1657.2	1631.2	1616.0
45°	1621.2	1603.1	1564.3	1536.1	1525.8
47.5°	1525.8	1507.7	1466.4	1438.0	1422.6
50°	1425.1	1412.3	1376.1	1340.1	1327.2
52.5°	1327.2	1309.1	1275.8	1247.4	1229.3
55°	1226.8	1211.3	1180.4	1149.5	1136.6
57.5°	1126.3	1113.4	1079.8	1048.9	1038.4
60°	1025.6	1015.5	979.4	951.0	943.3
62.5°	927.7	909.7	884.0	858.3	847.9
65°	827.4	811.8	786.1	762.8	750.0
67.5°	724.3	711.2	688.2	670.2	659.8
70°	628.9	618.5	595.3	577.2	567.1
72.5°	531.0	520.6	507.7	489.7	482.1
75°	432.8	427.9	414.8	399.5	404.7
77.5°	345.3	334.9	329.8	322.1	314.4
80°	257.9	255.1	249.9	242.3	237.0
82.5°	175.3	175.3	172.8	162.4	162.4
85°	105.6	103.1	100.7	92.7	90.2
87.5°	46.5	41.3	36.1	28.4	25.7
90°	2.9	35.5	96.5	90.7	93.6
92.5°	61.0	82.7	85.7	88.7	88.7
95°	143.8	171.4	176.3	176.3	171.4
97.5°	239.4	265.0	275.9	275.9	275.9
100°	349.7	372.4	380.2	380.2	377.3
102.5°	466.0	482.7	493.5	496.5	493.5
105°	593.1	600.9	606.8	611.7	611.7
107.5°	719.1	731.0	731.0	732.9	719.1
110°	841.3	857.0	857.0	857.0	849.2

TEST NUMBER: P921086

CATALOG NUMBER: DFN2DIP-TR4F0-080D120US935-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	973.3	990.1	987.0	979.2	973.3
115°	1103.3	1119.1	1114.1	1111.2	1103.3
117.5°	1232.3	1254.0	1240.3	1232.3	1224.5
120°	1362.4	1384.1	1362.4	1362.4	1353.6
122.5°	1480.7	1508.2	1494.4	1486.5	1480.7
125°	1604.7	1629.4	1621.5	1612.6	1609.6
127.5°	1726.0	1756.4	1745.6	1733.8	1726.0
130°	1839.2	1874.7	1869.7	1863.8	1853.0
132.5°	1966.3	1993.9	1995.8	1982.0	1974.2
135°	2075.6	2106.2	2112.1	2109.1	2101.3
137.5°	2197.8	2222.4	2227.3	2225.3	2213.5
140°	2305.1	2329.8	2343.6	2343.6	2332.7
142.5°	2415.5	2440.2	2448.0	2450.9	2440.2
145°	2519.9	2539.6	2555.4	2558.4	2547.5
147.5°	2613.5	2638.1	2650.0	2654.9	2644.0
150°	2710.1	2726.8	2737.6	2746.5	2737.6
152.5°	2795.7	2812.4	2826.3	2837.2	2826.3
155°	2881.4	2889.3	2898.2	2912.0	2903.1
157.5°	2955.4	2961.2	2966.1	2985.9	2972.1
160°	3021.3	3027.3	3030.2	3047.0	3035.1
162.5°	3082.4	3082.4	3085.4	3104.1	3090.3
165°	3134.6	3131.7	3131.7	3151.3	3137.6
167.5°	3181.9	3173.0	3173.0	3192.8	3179.0
170°	3217.4	3209.5	3206.5	3226.2	3209.5
172.5°	3242.0	3234.1	3231.2	3250.9	3234.1
175°	3261.7	3253.8	3247.9	3267.6	3250.9
177.5°	3272.6	3264.6	3258.7	3275.5	3258.7
180°	3267.6	3267.6	3267.6	3267.6	3267.6

TEST NUMBER: P921086

CATALOG NUMBER: DFN2DIP-TR4F0-080D120US935-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.18	9.98	10.20	11.01	12.38	8.75	9.55	9.77	10.58	11.95
	3H	10.84	11.56	11.87	12.59	13.98	10.37	11.08	11.39	12.12	13.51
	4H	11.42	12.10	12.46	13.14	14.54	10.95	11.63	11.99	12.67	14.07
	6H	11.82	12.45	12.87	13.49	14.90	11.35	11.97	12.39	13.01	14.42
	8H	11.92	12.52	12.98	13.58	14.98	11.45	12.04	12.50	13.10	14.51
	12H	11.97	12.54	13.03	13.59	15.02	11.49	12.06	12.55	13.11	14.54
4H	2H	9.64	10.32	10.68	11.35	12.75	9.29	9.97	10.34	11.01	12.41
	3H	11.50	12.07	12.55	13.13	14.54	11.11	11.67	12.16	12.74	14.15
	4H	12.21	12.73	13.27	13.79	15.22	11.80	12.32	12.86	13.38	14.81
	6H	12.72	13.17	13.79	14.25	15.68	12.31	12.76	13.38	13.84	15.27
	8H	12.87	13.29	13.94	14.36	15.80	12.46	12.87	13.53	13.95	15.39
	12H	12.94	13.32	14.03	14.40	15.85	12.52	12.90	13.61	13.98	15.43
8H	4H	12.40	12.82	13.47	13.89	15.33	12.04	12.46	13.11	13.53	14.97
	6H	13.03	13.38	14.12	14.49	15.93	12.67	13.01	13.76	14.13	15.57
	8H	13.25	13.55	14.35	14.65	16.11	12.88	13.18	13.98	14.28	15.74
	12H	13.38	13.65	14.48	14.74	16.24	12.99	13.26	14.10	14.35	15.85
12H	4H	12.38	12.76	13.47	13.85	15.30	12.03	12.41	13.12	13.50	14.94
	6H	13.06	13.36	14.16	14.46	15.92	12.71	13.01	13.81	14.11	15.57
	8H	13.30	13.57	14.40	14.66	16.16	12.94	13.21	14.05	14.30	15.80

END OF REPORT