

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P921112

Luminaire Tested: DFN2DIP-TR4F0-090D090US935-RLFL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P921112
REPORT IS A COMBINATION OF REPORTS P900470 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-090D090US935-RLLFLL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13444.4 lumens
Efficiency: N/A
Efficacy: 86.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 155.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.099
Total Harmonic Distortion (THDi): 0.979
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P921112

CATALOG NUMBER: DFN2DIP-TR4F0-090D090US935-RLLFLL

Luminous Intensity Polar Plot

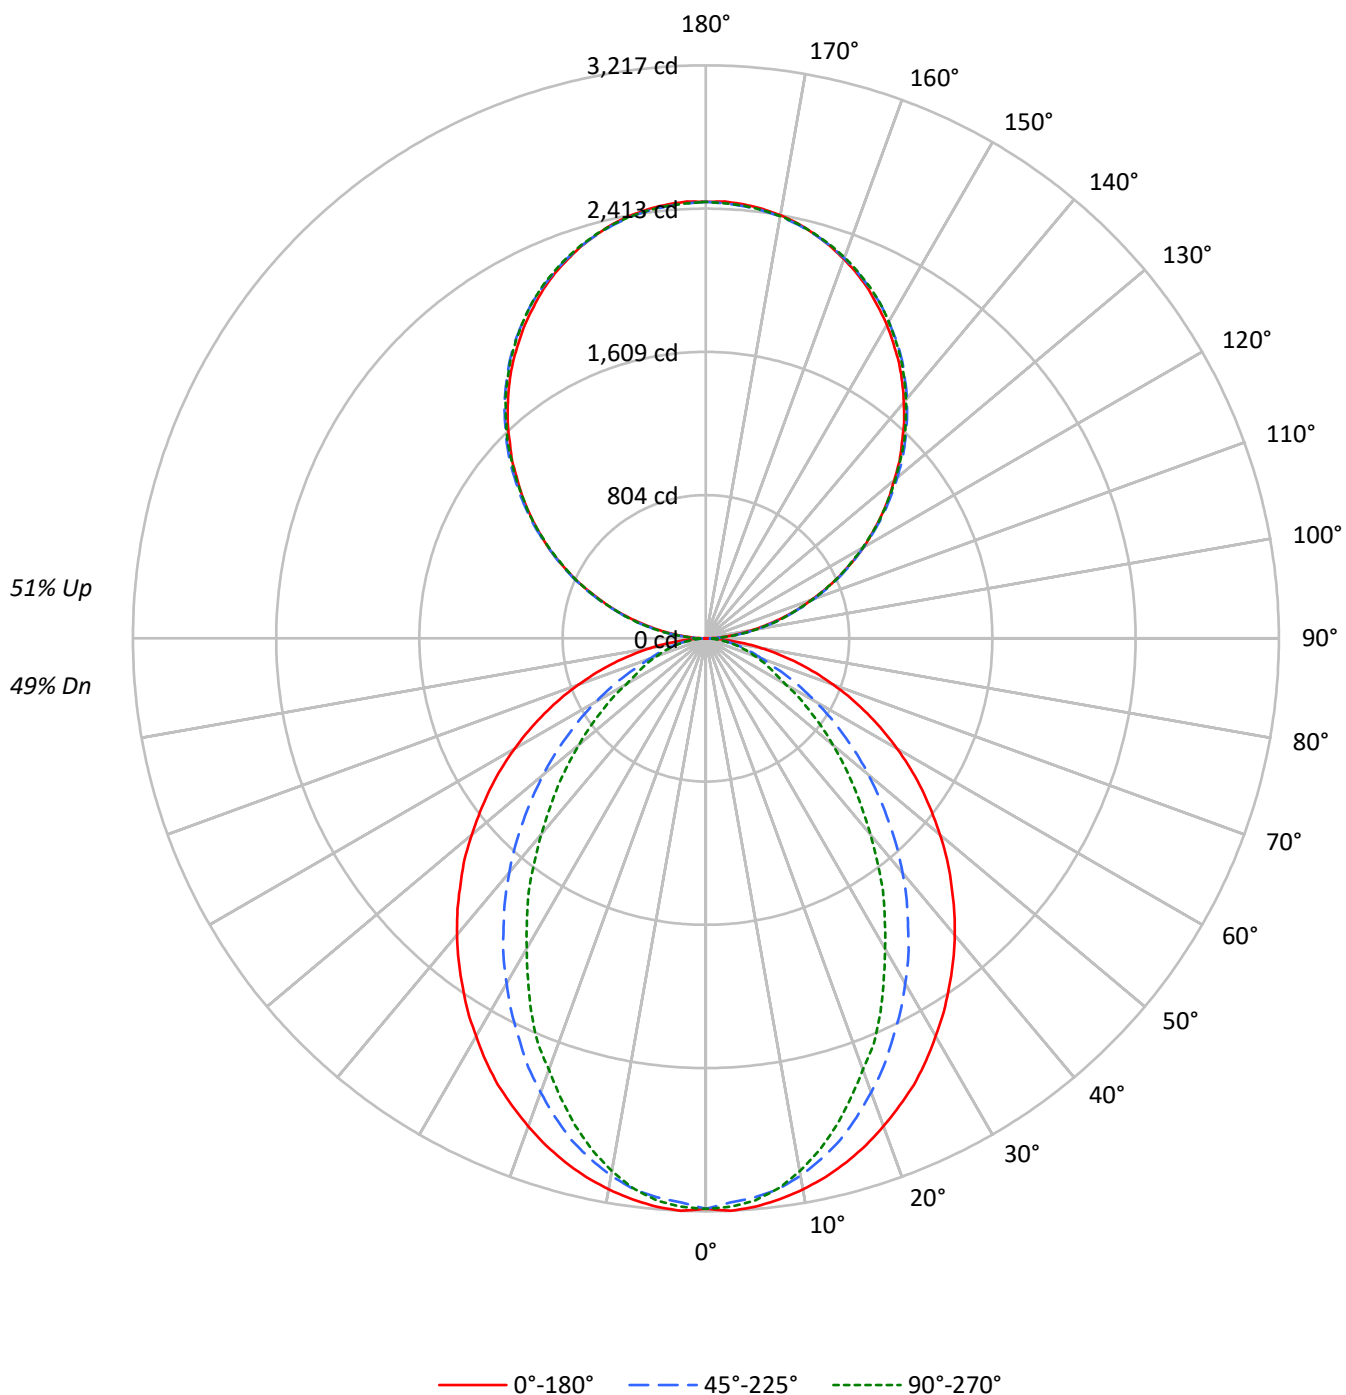

TEST NUMBER: P921112

CATALOG NUMBER: DFN2DIP-TR4F0-090D090US935-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	68	68	68	55	55	55
1	98	94	90	87	90	87	84	81	73	71	69	61	59	58	50	49	48
2	90	83	77	72	82	76	71	67	65	61	58	54	51	49	44	42	41
3	82	73	66	60	75	68	61	57	58	53	49	48	45	42	40	37	35
4	75	65	57	51	69	60	54	48	51	46	42	43	40	36	36	33	31
5	69	58	50	44	64	54	47	42	46	41	37	39	35	32	32	29	27
6	64	52	44	39	59	49	42	37	42	36	32	35	31	28	30	26	24
7	59	47	40	34	55	44	37	32	38	33	29	32	28	25	27	24	22
8	55	43	36	30	51	40	33	29	35	29	26	30	26	23	25	22	20
9	51	39	32	27	47	37	30	26	32	27	23	27	23	20	23	20	18
10	48	36	29	24	44	34	28	23	30	24	21	25	21	19	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2544	2544	2544
5°	2548	2504	2520
10°	2523	2455	2438
15°	2488	2374	2311
20°	2443	2262	2155
25°	2396	2136	2005
30°	2332	2008	1815
35°	2271	1870	1647
40°	2208	1726	1455
45°	2134	1568	1281
50°	2059	1408	1111
55°	1980	1236	948
60°	1888	1058	780
65°	1783	876	702
70°	1656	706	635
75°	1496	622	578
80°	1264	522	501
85°	880	348	376

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2134 cd/sqm

TEST NUMBER: P921112

CATALOG NUMBER: DFN2DIP-TR4F0-090D090US935-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	300.2	2.2
10°-20°	824.0	6.1
20°-30°	1156.9	8.6
30°-40°	1261.0	9.4
40°-50°	1159.0	8.6
50°-60°	910.3	6.8
60°-70°	592.5	4.4
70°-80°	305.0	2.3
80°-90°	84.8	0.6
90°-100°	151.6	1.1
100°-110°	481.8	3.6
110°-120°	824.6	6.1
120°-130°	1084.4	8.1
130°-140°	1217.2	9.1
140°-150°	1193.6	8.9
150°-160°	1001.3	7.4
160°-170°	664.0	4.9
170°-180°	232.1	1.7
0°-30°	2281.0	17.0
0°-40°	3542.0	26.3
0°-60°	5611.3	41.7
0°-90°	6593.6	49.0
90°-120°	1458.0	10.8
90°-150°	4953.4	36.8
90°-180°	6851.0	51.0
0°-180°	13444.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3203	3203	3203	3203	3203	
5°	3203	3188	3150	3176	3168	304
15°	3046	3014	2916	2861	2832	858
25°	2765	2672	2481	2362	2319	1272
35°	2383	2235	1980	1797	1733	1491
45°	1948	1753	1449	1243	1174	1504
55°	1481	1255	942	768	713	1323
65°	1000	765	504	406	397	991
75°	533	330	232	212	209	564
85°	124	64	55	55	55	143
90°	2	27	72	68	70	13
95°	108	128	132	132	128	120
105°	445	451	455	459	459	469
115°	828	839	836	833	828	818
125°	1204	1222	1216	1209	1207	1076
135°	1557	1580	1584	1582	1576	1203
145°	1890	1905	1916	1919	1911	1181
155°	2161	2167	2174	2184	2177	995
165°	2351	2349	2349	2364	2353	663
175°	2446	2440	2436	2451	2438	232
180°	2451	2451	2451	2451	2451	

TEST NUMBER: P921112

CATALOG NUMBER: DFN2DIP-TR4F0-090D090US935-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3202.7	3202.7	3202.7	3202.7	3202.7
2.5°	3217.1	3202.7	3170.6	3199.9	3194.0
5°	3202.7	3188.2	3150.4	3176.5	3167.9
7.5°	3176.5	3159.3	3118.7	3130.1	3115.6
10°	3141.8	3121.5	3063.7	3054.7	3037.5
12.5°	3098.4	3072.3	2993.9	2976.6	2944.6
15°	3046.1	3014.2	2915.8	2860.7	2831.8
17.5°	2985.3	2938.8	2817.0	2753.4	2707.0
20°	2915.8	2857.7	2712.7	2640.5	2576.5
22.5°	2840.4	2773.7	2605.5	2507.1	2463.7
25°	2765.1	2672.2	2481.0	2362.2	2318.6
27.5°	2675.3	2576.5	2365.0	2228.8	2162.1
30°	2579.6	2469.3	2237.4	2089.8	2011.4
32.5°	2486.7	2353.3	2115.9	1941.9	1869.3
35°	2382.6	2234.6	1979.7	1797.1	1733.1
37.5°	2281.0	2121.5	1852.1	1651.9	1579.7
40°	2173.8	2000.0	1718.6	1512.9	1437.6
42.5°	2063.6	1878.3	1585.4	1370.9	1298.6
45°	1947.7	1753.4	1449.2	1243.2	1173.7
47.5°	1837.6	1631.9	1318.9	1112.8	1049.2
50°	1715.9	1510.1	1191.3	991.1	930.5
52.5°	1596.9	1379.5	1069.5	878.2	823.2
55°	1480.9	1254.9	941.8	768.2	713.1
57.5°	1362.3	1130.4	829.1	666.7	620.3
60°	1240.4	1008.6	710.1	562.4	516.0
62.5°	1121.8	889.9	608.6	469.6	446.5
65°	1000.0	765.1	504.3	405.9	397.0
67.5°	884.1	649.1	405.9	356.4	347.8
70°	762.3	536.3	336.1	307.2	295.5
72.5°	646.4	431.7	281.0	258.0	252.2
75°	533.2	330.3	231.9	211.5	208.8
77.5°	420.3	234.6	182.6	171.0	165.1
80°	315.8	168.2	139.0	127.6	127.6
82.5°	220.2	113.1	95.7	89.8	89.8
85°	124.5	63.6	55.0	55.0	55.0
87.5°	46.4	23.1	23.1	20.3	20.3
90°	2.2	26.6	72.4	67.9	70.2
92.5°	45.8	62.1	64.3	66.5	66.5
95°	107.9	128.5	132.2	132.2	128.5
97.5°	179.5	198.7	206.9	206.9	206.9
100°	262.3	279.3	285.2	285.2	283.0
102.5°	349.5	362.0	370.1	372.4	370.1
105°	444.8	450.6	455.1	458.8	458.8
107.5°	539.3	548.2	548.2	549.7	539.3
110°	630.9	642.8	642.8	642.8	636.9

TEST NUMBER: P921112

CATALOG NUMBER: DFN2DIP-TR4F0-090D090US935-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	730.0	742.5	740.3	734.4	730.0
115°	827.5	839.3	835.6	833.4	827.5
117.5°	924.3	940.6	930.2	924.3	918.3
120°	1021.8	1038.0	1021.8	1021.8	1015.1
122.5°	1110.4	1131.2	1120.8	1114.9	1110.4
125°	1203.6	1222.0	1216.2	1209.4	1207.3
127.5°	1294.4	1317.3	1309.2	1300.4	1294.4
130°	1379.4	1406.0	1402.3	1397.8	1389.7
132.5°	1474.7	1495.4	1496.8	1486.5	1480.7
135°	1556.7	1579.6	1584.1	1581.8	1576.0
137.5°	1648.3	1666.8	1670.5	1669.0	1660.2
140°	1728.9	1747.3	1757.6	1757.6	1749.5
142.5°	1811.6	1830.1	1836.0	1838.2	1830.1
145°	1890.0	1904.7	1916.5	1918.7	1910.6
147.5°	1960.1	1978.6	1987.4	1991.1	1983.1
150°	2032.6	2045.1	2053.2	2059.9	2053.2
152.5°	2096.8	2109.4	2119.7	2127.9	2119.7
155°	2161.1	2167.0	2173.7	2184.0	2177.4
157.5°	2216.5	2220.9	2224.6	2239.4	2229.0
160°	2266.0	2270.5	2272.7	2285.2	2276.3
162.5°	2311.8	2311.8	2314.0	2328.1	2317.7
165°	2351.0	2348.7	2348.7	2363.5	2353.2
167.5°	2386.4	2379.8	2379.8	2394.5	2384.2
170°	2413.0	2407.1	2404.9	2419.7	2407.1
172.5°	2431.5	2425.6	2423.4	2438.2	2425.6
175°	2446.3	2440.3	2435.9	2450.7	2438.2
177.5°	2454.4	2448.5	2444.0	2456.6	2444.0
180°	2450.7	2450.7	2450.7	2450.7	2450.7

TEST NUMBER: P921112

CATALOG NUMBER: DFN2DIP-TR4F0-090D090US935-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.29	11.12	11.27	12.10	13.39	6.27	7.09	7.24	8.07	9.36
	3H	11.97	12.71	12.95	13.70	15.01	7.46	8.19	8.44	9.18	10.49
	4H	12.58	13.27	13.58	14.27	15.59	7.91	8.60	8.90	9.60	10.92
	6H	13.00	13.64	14.01	14.64	15.97	8.23	8.87	9.24	9.87	11.20
	8H	13.13	13.73	14.14	14.75	16.08	8.32	8.93	9.33	9.94	11.27
	12H	13.19	13.77	14.21	14.78	16.13	8.36	8.94	9.38	9.95	11.30
4H	2H	10.31	11.01	11.31	12.00	13.32	6.86	7.56	7.87	8.55	9.87
	3H	12.14	12.72	13.15	13.74	15.07	8.21	8.79	9.22	9.81	11.15
	4H	12.83	13.36	13.85	14.38	15.73	8.76	9.29	9.78	10.31	11.66
	6H	13.35	13.80	14.38	14.84	16.19	9.18	9.63	10.21	10.67	12.03
	8H	13.52	13.95	14.55	14.98	16.34	9.31	9.73	10.34	10.77	12.13
	12H	13.62	14.00	14.66	15.05	16.42	9.38	9.76	10.42	10.80	12.18
8H	4H	12.80	13.22	13.83	14.25	15.62	9.04	9.46	10.07	10.50	11.86
	6H	13.37	13.71	14.42	14.79	16.15	9.56	9.91	10.61	10.98	12.35
	8H	13.58	13.89	14.64	14.95	16.33	9.75	10.06	10.81	11.12	12.50
	12H	13.72	13.99	14.78	15.04	16.47	9.87	10.14	10.94	11.19	12.62
12H	4H	12.75	13.13	13.80	14.18	15.55	9.05	9.43	10.09	10.47	11.85
	6H	13.34	13.65	14.40	14.71	16.09	9.61	9.92	10.67	10.98	12.36
	8H	13.56	13.83	14.63	14.88	16.31	9.82	10.09	10.88	11.14	12.57

END OF REPORT