

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P921119

Luminaire Tested: DFN2DIP-TR4F0-090D110US935-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P921119
REPORT IS A COMBINATION OF REPORTS P902025 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-090D110US935-FLLONL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 17047.8 lumens
Efficiency: N/A
Efficacy: 99.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 172.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.099
Total Harmonic Distortion (THDi): 0.979
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P921119

CATALOG NUMBER: DFN2DIP-TR4F0-090D110US935-FLLONL

Luminous Intensity Polar Plot

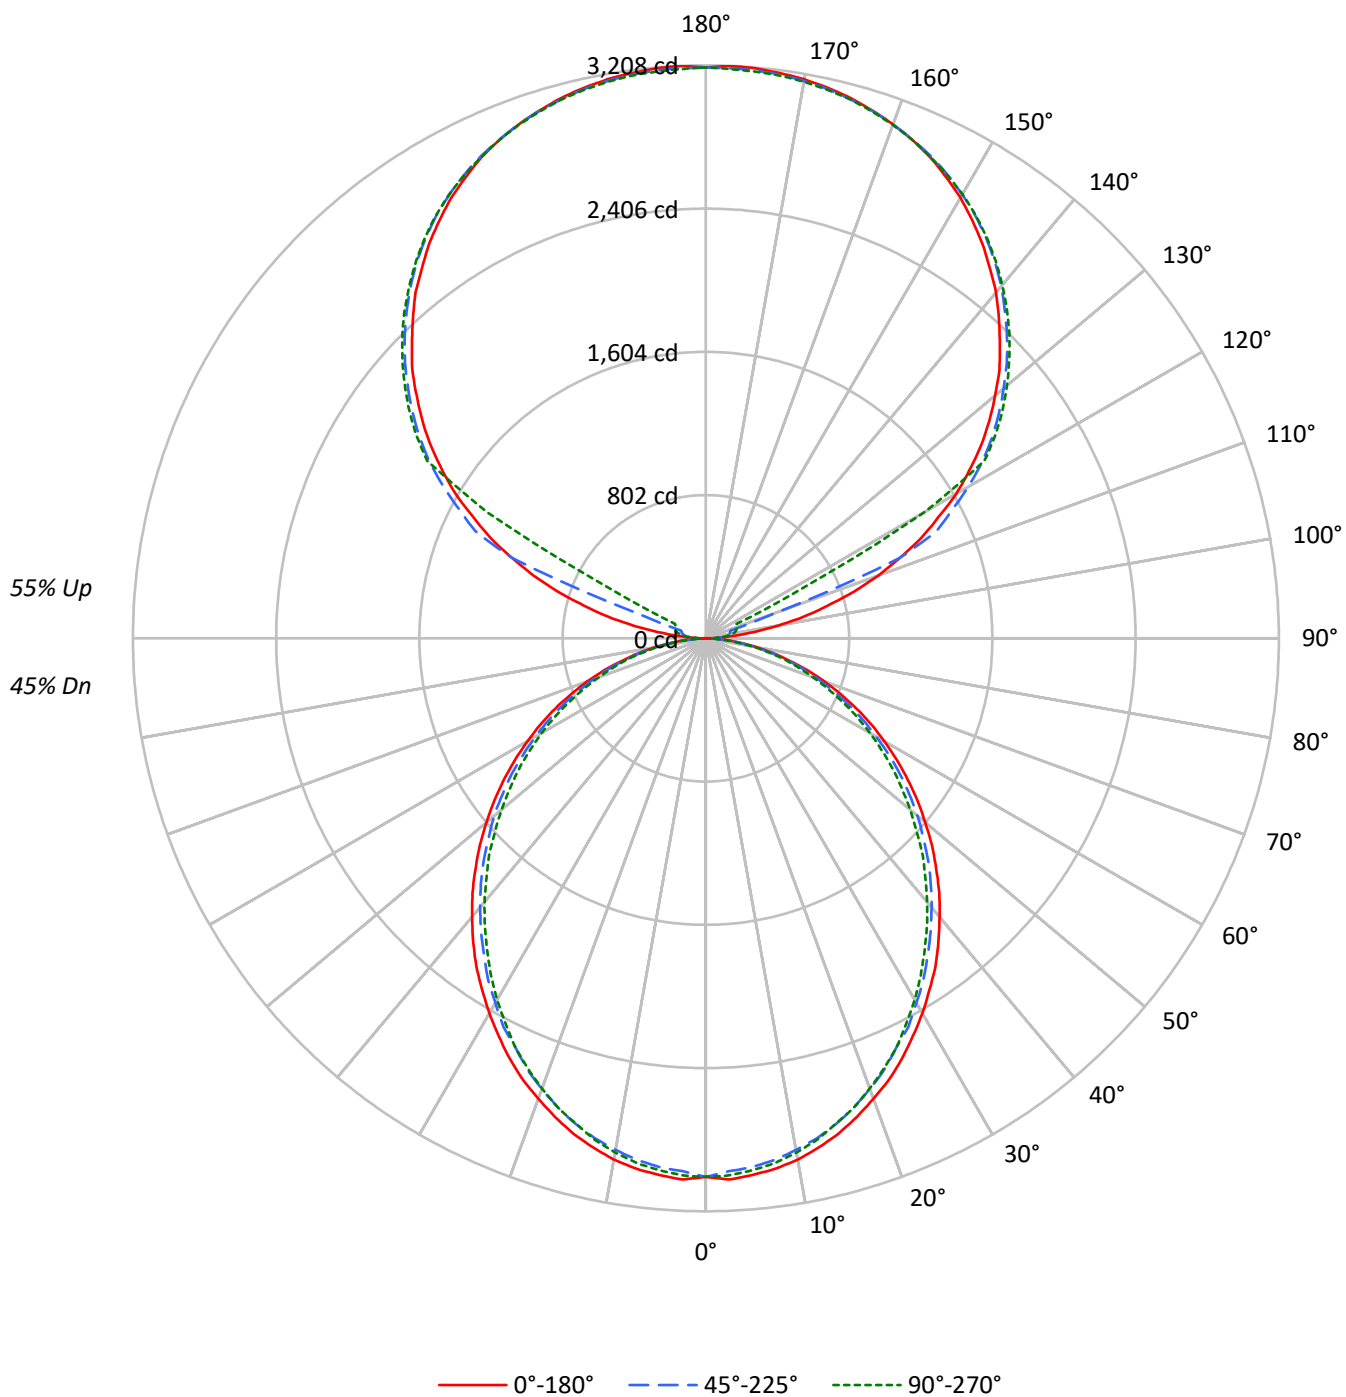

TEST NUMBER: P921119

CATALOG NUMBER: DFN2DIP-TR4F0-090D110US935-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	81	81	81	65	65	65	52	52	52
1	97	92	89	85	88	85	82	79	71	68	66	58	56	54	46	45	44
2	88	81	75	69	80	74	69	64	62	58	55	51	48	45	40	38	37
3	80	71	64	58	73	65	59	54	55	50	46	45	41	38	36	33	31
4	73	63	55	49	67	58	51	46	48	43	39	40	36	33	32	29	27
5	67	56	48	42	61	52	44	39	43	38	34	36	32	29	29	26	23
6	62	50	42	36	57	46	39	34	39	34	29	32	28	25	26	23	21
7	57	45	37	32	52	42	35	30	35	30	26	29	25	22	24	21	18
8	53	41	33	28	49	38	31	26	32	27	23	27	23	20	22	19	16
9	50	37	30	25	45	35	28	23	30	24	21	25	21	18	20	17	15
10	46	34	27	22	42	32	25	21	27	22	18	23	19	16	19	16	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2395	2395	2395
5°	2399	2362	2378
10°	2380	2330	2346
15°	2345	2292	2295
20°	2298	2238	2244
25°	2251	2175	2184
30°	2192	2115	2108
35°	2136	2045	2028
40°	2067	1975	1952
45°	1999	1904	1874
50°	1924	1829	1783
55°	1845	1743	1700
60°	1756	1641	1605
65°	1660	1535	1493
70°	1537	1407	1372
75°	1366	1252	1260
80°	1161	1055	1047
85°	839	716	694

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 1999 cd/sqm

TEST NUMBER: P921119

CATALOG NUMBER: DFN2DIP-TR4F0-090D110US935-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	283.8	1.7
10°-20°	798.5	4.7
20°-30°	1173.4	6.9
30°-40°	1362.9	8.0
40°-50°	1361.2	8.0
50°-60°	1186.9	7.0
60°-70°	877.4	5.1
70°-80°	496.4	2.9
80°-90°	136.6	0.8
90°-100°	105.4	0.6
100°-110°	392.9	2.3
110°-120°	1042.0	6.1
120°-130°	1728.3	10.1
130°-140°	1835.9	10.8
140°-150°	1706.2	10.0
150°-160°	1371.8	8.0
160°-170°	883.9	5.2
170°-180°	304.2	1.8
0°-30°	2255.7	13.2
0°-40°	3618.6	21.2
0°-60°	6166.7	36.2
0°-90°	7677.1	45.0
90°-120°	1540.3	9.0
90°-150°	6810.7	40.0
90°-180°	9371.0	55.0
0°-180°	17047.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3015	3015	3015	3015	3015	
5°	3015	3004	2972	2995	2989	286
15°	2870	2853	2815	2827	2812	808
25°	2598	2575	2526	2531	2526	1195
35°	2241	2212	2166	2148	2134	1400
45°	1824	1804	1760	1728	1716	1408
55°	1380	1363	1328	1293	1279	1234
65°	931	913	884	858	844	920
75°	487	481	467	449	455	520
85°	119	116	113	104	102	132
90°	2	28	46	58	62	16
95°	150	74	90	102	99	178
105°	703	773	141	166	176	751
115°	1330	1369	1427	356	190	1309
125°	1880	1910	1954	1971	1978	1677
135°	2327	2364	2384	2408	2403	1797
145°	2699	2697	2736	2752	2741	1688
155°	2972	2951	2979	2993	2974	1370
165°	3132	3118	3125	3141	3125	885
175°	3203	3187	3192	3208	3185	305
180°	3196	3196	3196	3196	3196	

TEST NUMBER: P921119

CATALOG NUMBER: DFN2DIP-TR4F0-090D110US935-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3015.1	3015.1	3015.1	3015.1	3015.1
2.5°	3032.7	3018.2	2986.3	3015.1	3009.6
5°	3015.1	3003.8	2971.8	2994.9	2989.3
7.5°	2994.9	2977.7	2945.6	2969.1	2963.2
10°	2963.2	2942.9	2908.1	2931.2	2922.6
12.5°	2919.5	2902.3	2867.6	2881.9	2876.2
15°	2870.3	2853.1	2815.2	2826.9	2812.4
17.5°	2809.3	2792.1	2754.3	2768.8	2754.3
20°	2742.6	2725.4	2684.8	2693.4	2682.0
22.5°	2676.2	2650.1	2612.2	2612.2	2606.3
25°	2597.7	2574.6	2525.5	2531.0	2525.5
27.5°	2510.7	2490.4	2452.9	2444.3	2429.8
30°	2424.0	2400.5	2357.2	2348.5	2336.9
32.5°	2331.1	2313.8	2267.4	2249.9	2238.2
35°	2241.3	2212.3	2165.8	2148.4	2133.9
37.5°	2139.8	2113.6	2067.1	2046.9	2032.4
40°	2035.4	2012.1	1965.6	1939.7	1928.1
42.5°	1933.9	1910.6	1864.4	1835.2	1818.0
45°	1823.8	1803.5	1759.8	1728.1	1716.5
47.5°	1716.5	1696.2	1649.7	1617.7	1600.5
50°	1603.3	1588.8	1548.2	1507.6	1493.1
52.5°	1493.1	1472.8	1435.3	1403.3	1383.0
55°	1380.3	1362.7	1327.9	1293.2	1278.8
57.5°	1267.0	1252.6	1214.8	1180.0	1168.3
60°	1153.8	1142.5	1101.8	1069.9	1061.3
62.5°	1043.7	1023.4	994.5	965.6	953.9
65°	930.8	913.3	884.3	858.2	843.8
67.5°	814.8	800.1	774.2	754.0	742.3
70°	707.5	695.8	669.7	649.4	638.0
72.5°	597.4	585.7	571.2	551.0	542.3
75°	487.0	481.4	466.7	449.4	455.3
77.5°	388.5	376.9	371.0	362.4	353.8
80°	290.1	287.0	281.1	272.5	266.7
82.5°	197.2	197.2	194.4	182.7	182.7
85°	118.7	116.0	113.2	104.3	101.5
87.5°	52.3	46.4	40.6	32.0	28.9
90°	2.2	27.7	46.1	57.9	62.3
92.5°	57.9	48.6	55.4	60.2	62.3
95°	150.2	73.9	90.1	101.9	99.4
97.5°	270.5	81.0	117.8	124.9	127.2
100°	409.5	92.6	131.8	150.2	154.9
102.5°	561.9	557.5	136.5	161.8	168.9
105°	703.1	772.6	141.2	166.4	175.8
107.5°	867.4	925.0	145.9	171.1	180.5
110°	1024.7	1073.1	404.8	173.6	182.6

TEST NUMBER: P921119

CATALOG NUMBER: DFN2DIP-TR4F0-090D110US935-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1172.8	1214.2	1174.9	178.0	185.1
115°	1329.8	1369.1	1427.1	356.2	189.8
117.5°	1466.4	1512.5	1552.0	1221.1	615.2
120°	1619.0	1653.6	1695.4	1723.1	1410.8
122.5°	1748.4	1785.5	1831.9	1845.6	1848.1
125°	1880.2	1910.5	1954.4	1970.6	1977.5
127.5°	2000.5	2032.9	2067.8	2090.8	2093.1
130°	2113.9	2151.0	2176.3	2201.8	2199.7
132.5°	2229.6	2259.8	2285.1	2305.9	2303.8
135°	2326.8	2363.9	2384.4	2407.9	2403.1
137.5°	2428.4	2456.2	2479.5	2502.6	2495.7
140°	2527.9	2546.5	2571.8	2592.6	2581.1
142.5°	2611.3	2627.5	2657.5	2675.9	2664.4
145°	2699.2	2696.7	2736.0	2752.3	2740.7
147.5°	2775.3	2768.5	2807.7	2819.3	2810.2
150°	2849.5	2833.3	2870.3	2884.1	2872.5
152.5°	2911.8	2893.4	2928.0	2942.0	2925.8
155°	2972.0	2951.3	2979.1	2992.8	2974.4
157.5°	3020.6	3002.1	3023.0	3039.2	3020.6
160°	3062.3	3048.3	3062.3	3076.0	3059.8
162.5°	3099.1	3085.4	3096.9	3113.1	3092.3
165°	3131.5	3117.8	3124.6	3140.8	3124.6
167.5°	3157.0	3143.1	3150.2	3166.4	3145.6
170°	3177.9	3163.9	3168.6	3184.8	3163.9
172.5°	3191.6	3177.9	3182.6	3198.8	3177.9
175°	3203.2	3187.0	3191.6	3207.9	3184.8
177.5°	3207.9	3191.6	3194.1	3210.3	3189.5
180°	3196.4	3196.4	3196.4	3196.4	3196.4

TEST NUMBER: P921119

CATALOG NUMBER: DFN2DIP-TR4F0-090D110US935-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.82	10.64	10.82	11.65	12.99	9.39	10.21	10.39	11.22	12.56
	3H	11.48	12.21	12.49	13.23	14.59	11.01	11.74	12.02	12.76	14.12
	4H	12.07	12.76	13.09	13.78	15.15	11.59	12.29	12.62	13.31	14.68
	6H	12.46	13.10	13.50	14.13	15.51	11.99	12.63	13.02	13.66	15.04
	8H	12.57	13.18	13.61	14.22	15.60	12.09	12.70	13.13	13.75	15.12
	12H	12.61	13.19	13.66	14.23	15.63	12.13	12.71	13.18	13.75	15.15
4H	2H	10.28	10.98	11.31	12.00	13.37	9.94	10.63	10.96	11.65	13.02
	3H	12.14	12.72	13.18	13.77	15.15	11.75	12.33	12.79	13.38	14.76
	4H	12.86	13.39	13.90	14.43	15.83	12.45	12.98	13.49	14.02	15.43
	6H	13.37	13.82	14.42	14.89	16.29	12.96	13.42	14.01	14.48	15.88
	8H	13.52	13.94	14.57	15.00	16.42	13.10	13.53	14.16	14.59	16.00
	12H	13.59	13.97	14.66	15.05	16.47	13.17	13.55	14.24	14.62	16.04
8H	4H	13.05	13.48	14.10	14.53	15.95	12.69	13.12	13.74	14.17	15.59
	6H	13.68	14.03	14.76	15.13	16.54	13.32	13.67	14.39	14.77	16.18
	8H	13.90	14.21	14.98	15.29	16.72	13.53	13.84	14.61	14.92	16.35
	12H	14.03	14.30	15.12	15.38	16.85	13.64	13.92	14.73	14.99	16.47
12H	4H	13.03	13.42	14.10	14.49	15.91	12.68	13.07	13.75	14.14	15.56
	6H	13.71	14.02	14.79	15.10	16.53	13.36	13.67	14.44	14.75	16.18
	8H	13.95	14.22	15.04	15.30	16.77	13.59	13.86	14.68	14.94	16.41