

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P921122

Luminaire Tested: DFN2DIP-TR4F0-090D120US935-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P921122
REPORT IS A COMBINATION OF REPORTS P900523 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-090D120US935-FLLFLL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16815.3 lumens
Efficiency: N/A
Efficacy: 94.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 178.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.099
Total Harmonic Distortion (THDi): 0.979
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P921122

CATALOG NUMBER: DFN2DIP-TR4F0-090D120US935-FLLFLL

Luminous Intensity Polar Plot

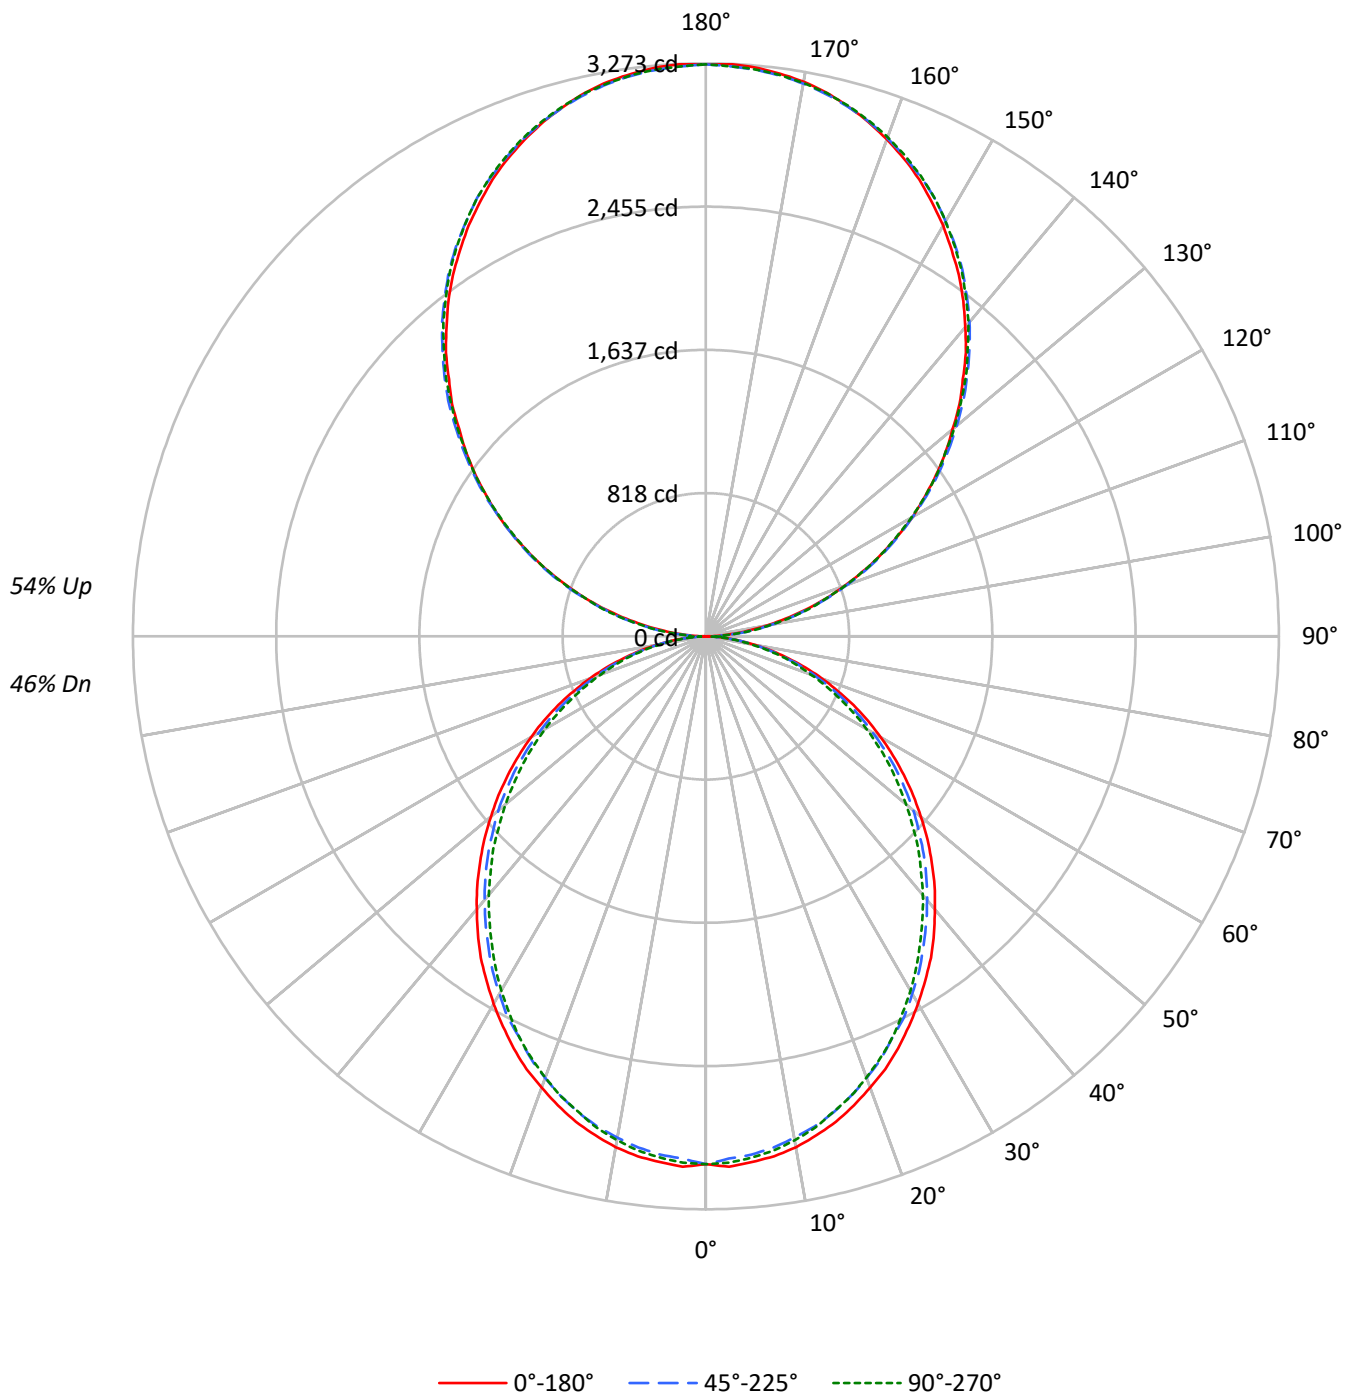

TEST NUMBER: P921122

CATALOG NUMBER: DFN2DIP-TR4F0-090D120US935-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	81	81	81	66	66	66	52	52	52
1	97	93	89	85	89	85	82	79	71	69	66	58	56	55	46	45	44
2	88	81	75	70	81	74	69	65	62	58	55	51	48	46	41	39	37
3	80	71	64	58	73	65	59	54	55	50	46	45	42	39	36	34	32
4	74	63	55	49	67	58	51	46	49	43	39	40	36	33	32	29	27
5	67	56	48	42	62	52	45	39	44	38	34	36	32	29	29	26	24
6	62	50	42	36	57	46	39	34	39	34	30	33	28	25	26	23	21
7	57	45	37	32	53	42	35	30	36	30	26	30	25	22	24	21	19
8	53	41	33	28	49	38	31	26	32	27	23	27	23	20	22	19	17
9	50	37	30	25	45	35	28	24	30	24	21	25	21	18	20	17	15
10	46	34	27	22	42	32	25	21	27	22	19	23	19	16	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2395	2395	2395
5°	2399	2362	2378
10°	2380	2330	2346
15°	2345	2292	2295
20°	2298	2238	2244
25°	2251	2175	2184
30°	2192	2115	2108
35°	2136	2045	2028
40°	2067	1975	1952
45°	1999	1904	1874
50°	1924	1829	1783
55°	1845	1743	1700
60°	1756	1641	1605
65°	1660	1535	1493
70°	1537	1407	1372
75°	1366	1252	1260
80°	1161	1055	1047
85°	839	716	694

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2547 cd/sqm

TEST NUMBER: P921122

CATALOG NUMBER: DFN2DIP-TR4F0-090D120US935-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	283.8	1.7
10°-20°	798.5	4.7
20°-30°	1173.4	7.0
30°-40°	1362.9	8.1
40°-50°	1361.2	8.1
50°-60°	1186.9	7.1
60°-70°	877.4	5.2
70°-80°	496.4	3.0
80°-90°	140.3	0.8
90°-100°	202.2	1.2
100°-110°	642.4	3.8
110°-120°	1099.4	6.5
120°-130°	1445.9	8.6
130°-140°	1623.0	9.7
140°-150°	1591.6	9.5
150°-160°	1335.1	7.9
160°-170°	885.4	5.3
170°-180°	309.5	1.8
0°-30°	2255.7	13.4
0°-40°	3618.6	21.5
0°-60°	6166.7	36.7
0°-90°	7680.8	45.7
90°-120°	1944.1	11.6
90°-150°	6604.6	39.3
90°-180°	9134.0	54.3
0°-180°	16815.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3015	3015	3015	3015	3015	
5°	3015	3004	2972	2995	2989	286
15°	2870	2853	2815	2827	2812	808
25°	2598	2575	2526	2531	2526	1195
35°	2241	2212	2166	2148	2134	1400
45°	1824	1804	1760	1728	1716	1408
55°	1380	1363	1328	1293	1279	1234
65°	931	913	884	858	844	920
75°	487	481	467	449	455	520
85°	119	116	113	104	102	132
90°	3	36	96	91	94	16
95°	144	171	176	176	171	160
105°	593	601	607	612	612	626
115°	1103	1119	1114	1111	1103	1091
125°	1605	1629	1622	1613	1610	1434
135°	2076	2106	2112	2109	2101	1604
145°	2520	2540	2555	2558	2548	1574
155°	2881	2889	2898	2912	2903	1326
165°	3135	3132	3132	3151	3138	884
175°	3262	3254	3248	3268	3251	310
180°	3268	3268	3268	3268	3268	

TEST NUMBER: P921122

CATALOG NUMBER: DFN2DIP-TR4F0-090D120US935-FLLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3015.1	3015.1	3015.1	3015.1	3015.1
2.5°	3032.7	3018.2	2986.3	3015.1	3009.6
5°	3015.1	3003.8	2971.8	2994.9	2989.3
7.5°	2994.9	2977.7	2945.6	2969.1	2963.2
10°	2963.2	2942.9	2908.1	2931.2	2922.6
12.5°	2919.5	2902.3	2867.6	2881.9	2876.2
15°	2870.3	2853.1	2815.2	2826.9	2812.4
17.5°	2809.3	2792.1	2754.3	2768.8	2754.3
20°	2742.6	2725.4	2684.8	2693.4	2682.0
22.5°	2676.2	2650.1	2612.2	2612.2	2606.3
25°	2597.7	2574.6	2525.5	2531.0	2525.5
27.5°	2510.7	2490.4	2452.9	2444.3	2429.8
30°	2424.0	2400.5	2357.2	2348.5	2336.9
32.5°	2331.1	2313.8	2267.4	2249.9	2238.2
35°	2241.3	2212.3	2165.8	2148.4	2133.9
37.5°	2139.8	2113.6	2067.1	2046.9	2032.4
40°	2035.4	2012.1	1965.6	1939.7	1928.1
42.5°	1933.9	1910.6	1864.4	1835.2	1818.0
45°	1823.8	1803.5	1759.8	1728.1	1716.5
47.5°	1716.5	1696.2	1649.7	1617.7	1600.5
50°	1603.3	1588.8	1548.2	1507.6	1493.1
52.5°	1493.1	1472.8	1435.3	1403.3	1383.0
55°	1380.3	1362.7	1327.9	1293.2	1278.8
57.5°	1267.0	1252.6	1214.8	1180.0	1168.3
60°	1153.8	1142.5	1101.8	1069.9	1061.3
62.5°	1043.7	1023.4	994.5	965.6	953.9
65°	930.8	913.3	884.3	858.2	843.8
67.5°	814.8	800.1	774.2	754.0	742.3
70°	707.5	695.8	669.7	649.4	638.0
72.5°	597.4	585.7	571.2	551.0	542.3
75°	487.0	481.4	466.7	449.4	455.3
77.5°	388.5	376.9	371.0	362.4	353.8
80°	290.1	287.0	281.1	272.5	266.7
82.5°	197.2	197.2	194.4	182.7	182.7
85°	118.7	116.0	113.2	104.3	101.5
87.5°	52.3	46.4	40.6	32.0	28.9
90°	2.9	35.5	96.5	90.7	93.6
92.5°	61.0	82.7	85.7	88.7	88.7
95°	143.8	171.4	176.3	176.3	171.4
97.5°	239.4	265.0	275.9	275.9	275.9
100°	349.7	372.4	380.2	380.2	377.3
102.5°	466.0	482.7	493.5	496.5	493.5
105°	593.1	600.9	606.8	611.7	611.7
107.5°	719.1	731.0	731.0	732.9	719.1
110°	841.3	857.0	857.0	857.0	849.2

TEST NUMBER: P921122

CATALOG NUMBER: DFN2DIP-TR4F0-090D120US935-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	973.3	990.1	987.0	979.2	973.3
115°	1103.3	1119.1	1114.1	1111.2	1103.3
117.5°	1232.3	1254.0	1240.3	1232.3	1224.5
120°	1362.4	1384.1	1362.4	1362.4	1353.6
122.5°	1480.7	1508.2	1494.4	1486.5	1480.7
125°	1604.7	1629.4	1621.5	1612.6	1609.6
127.5°	1726.0	1756.4	1745.6	1733.8	1726.0
130°	1839.2	1874.7	1869.7	1863.8	1853.0
132.5°	1966.3	1993.9	1995.8	1982.0	1974.2
135°	2075.6	2106.2	2112.1	2109.1	2101.3
137.5°	2197.8	2222.4	2227.3	2225.3	2213.5
140°	2305.1	2329.8	2343.6	2343.6	2332.7
142.5°	2415.5	2440.2	2448.0	2450.9	2440.2
145°	2519.9	2539.6	2555.4	2558.4	2547.5
147.5°	2613.5	2638.1	2650.0	2654.9	2644.0
150°	2710.1	2726.8	2737.6	2746.5	2737.6
152.5°	2795.7	2812.4	2826.3	2837.2	2826.3
155°	2881.4	2889.3	2898.2	2912.0	2903.1
157.5°	2955.4	2961.2	2966.1	2985.9	2972.1
160°	3021.3	3027.3	3030.2	3047.0	3035.1
162.5°	3082.4	3082.4	3085.4	3104.1	3090.3
165°	3134.6	3131.7	3131.7	3151.3	3137.6
167.5°	3181.9	3173.0	3173.0	3192.8	3179.0
170°	3217.4	3209.5	3206.5	3226.2	3209.5
172.5°	3242.0	3234.1	3231.2	3250.9	3234.1
175°	3261.7	3253.8	3247.9	3267.6	3250.9
177.5°	3272.6	3264.6	3258.7	3275.5	3258.7
180°	3267.6	3267.6	3267.6	3267.6	3267.6

TEST NUMBER: P921122

CATALOG NUMBER: DFN2DIP-TR4F0-090D120US935-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.89	10.71	10.88	11.72	13.05	9.45	10.28	10.45	11.28	12.62
	3H	11.54	12.28	12.55	13.30	14.65	11.07	11.81	12.08	12.82	14.18
	4H	12.13	12.83	13.15	13.85	15.21	11.66	12.36	12.67	13.37	14.73
	6H	12.53	13.17	13.55	14.19	15.57	12.05	12.70	13.08	13.72	15.09
	8H	12.63	13.24	13.66	14.28	15.65	12.16	12.77	13.19	13.81	15.18
	12H	12.68	13.26	13.72	14.29	15.69	12.20	12.78	13.24	13.81	15.21
4H	2H	10.34	11.04	11.37	12.06	13.42	10.00	10.70	11.02	11.72	13.08
	3H	12.21	12.79	13.24	13.84	15.21	11.81	12.40	12.85	13.44	14.82
	4H	12.92	13.45	13.96	14.49	15.89	12.51	13.05	13.55	14.09	15.48
	6H	13.43	13.89	14.48	14.95	16.34	13.02	13.48	14.07	14.54	15.94
	8H	13.58	14.01	14.63	15.06	16.47	13.17	13.60	14.22	14.65	16.06
	12H	13.65	14.04	14.72	15.11	16.52	13.23	13.62	14.30	14.69	16.10
8H	4H	13.11	13.54	14.16	14.60	16.00	12.75	13.18	13.80	14.24	15.64
	6H	13.74	14.10	14.82	15.19	16.60	13.38	13.73	14.45	14.83	16.23
	8H	13.96	14.27	15.04	15.35	16.78	13.59	13.91	14.67	14.98	16.41
	12H	14.09	14.37	15.18	15.44	16.91	13.71	13.98	14.79	15.06	16.52
12H	4H	13.10	13.48	14.16	14.55	15.97	12.74	13.13	13.81	14.20	15.61
	6H	13.77	14.08	14.85	15.16	16.59	13.42	13.73	14.50	14.81	16.24
	8H	14.01	14.29	15.10	15.36	16.83	13.65	13.93	14.74	15.00	16.47