

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P921124

Luminaire Tested: DFN2DIP-TR4F0-090D120US935-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P921124
REPORT IS A COMBINATION OF REPORTS P900524 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-090D120US935-RLLFLL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15730.4 lumens
Efficiency: N/A
Efficacy: 88.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 178.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.099
Total Harmonic Distortion (THDi): 0.979
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P921124

CATALOG NUMBER: DFN2DIP-TR4F0-090D120US935-RLLFLL

Luminous Intensity Polar Plot

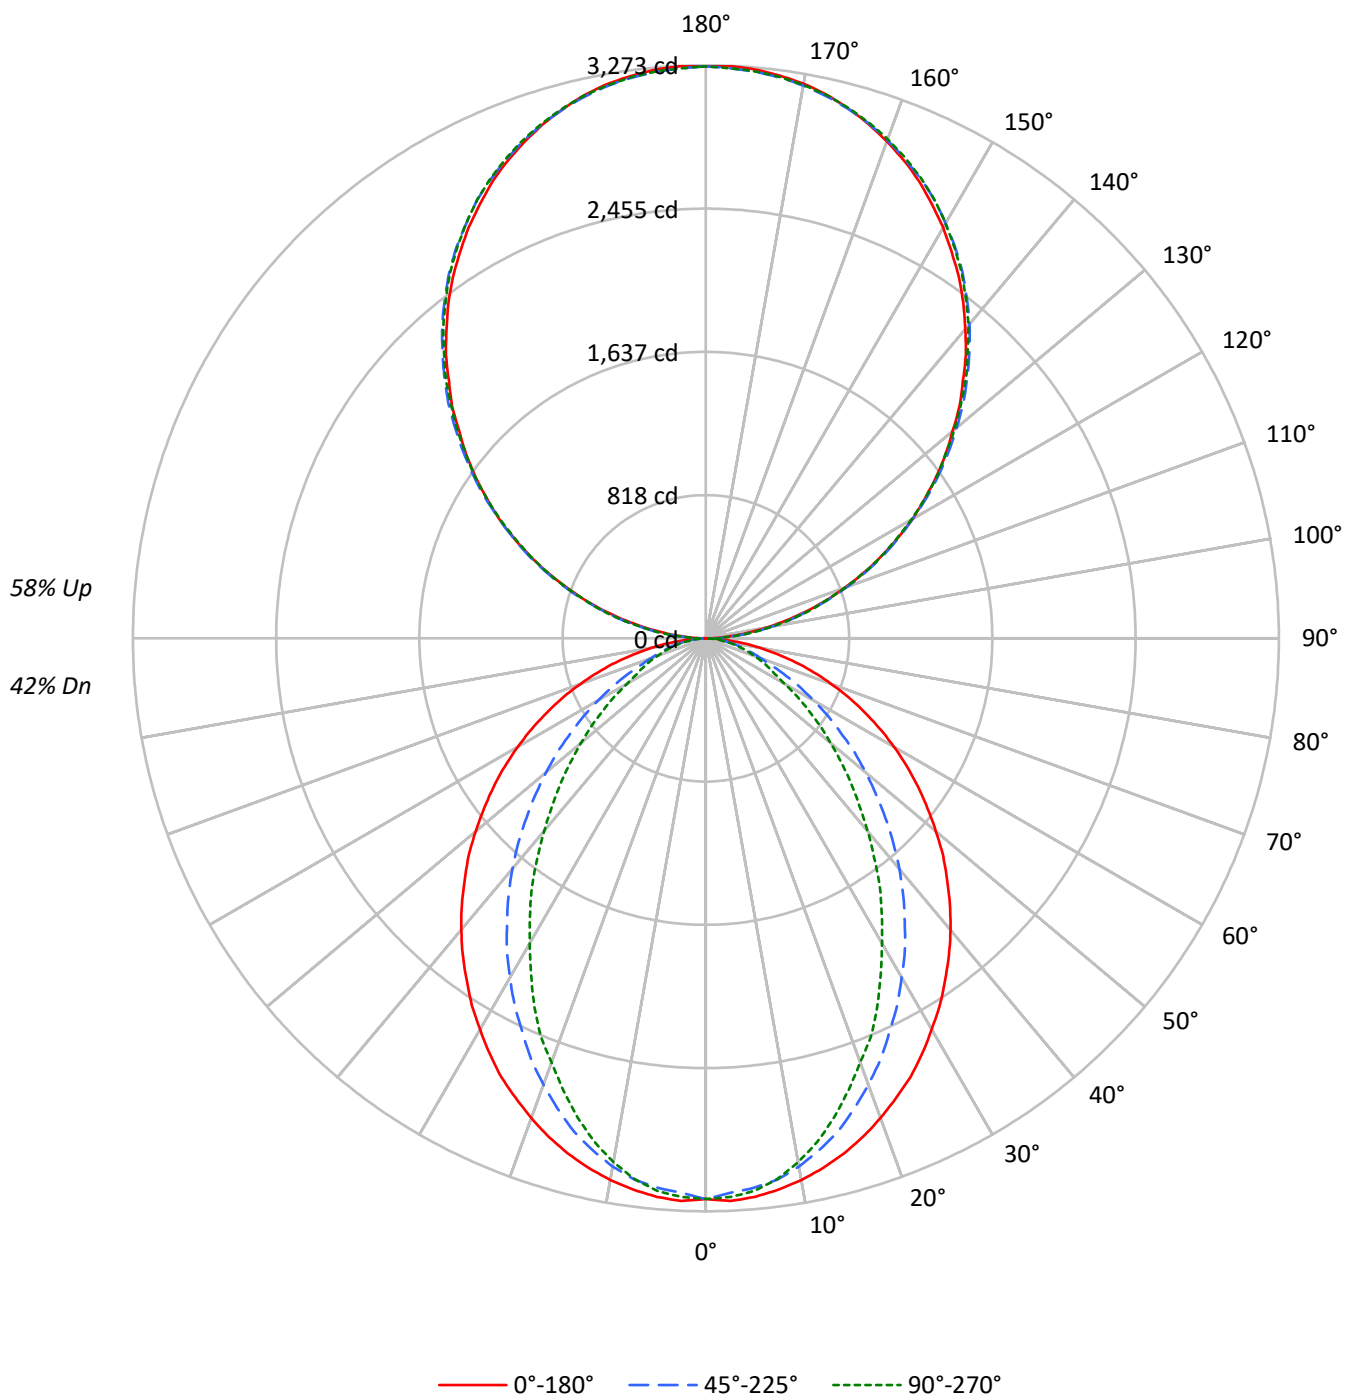

TEST NUMBER: P921124

CATALOG NUMBER: DFN2DIP-TR4F0-090D120US935-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	63	63	63	49	49	49
1	96	92	89	85	88	84	81	78	70	67	65	56	55	53	44	43	42
2	88	81	75	70	80	74	69	65	61	58	55	50	47	45	39	37	36
3	81	72	65	59	73	66	60	55	55	50	47	44	41	39	35	33	31
4	74	64	56	50	67	58	52	47	49	44	40	40	36	33	31	29	27
5	68	57	49	43	62	52	45	40	44	39	35	36	32	29	28	26	24
6	63	51	43	38	57	47	40	35	40	34	30	33	29	26	26	23	21
7	58	46	38	33	53	43	36	31	36	31	27	30	26	23	24	21	19
8	54	42	34	29	49	39	32	28	33	28	24	27	23	21	22	19	17
9	50	38	31	26	46	36	29	25	30	25	22	25	21	19	20	18	16
10	47	35	28	24	43	33	26	22	28	23	19	23	19	17	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2544	2544	2544
5°	2548	2504	2520
10°	2523	2455	2438
15°	2488	2374	2311
20°	2443	2262	2155
25°	2396	2136	2005
30°	2332	2008	1815
35°	2271	1870	1647
40°	2208	1726	1455
45°	2134	1568	1281
50°	2059	1408	1111
55°	1980	1236	948
60°	1888	1058	780
65°	1783	876	702
70°	1656	706	635
75°	1496	622	578
80°	1264	522	501
85°	880	348	376

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2547 cd/sqm

TEST NUMBER: P921124

CATALOG NUMBER: DFN2DIP-TR4F0-090D120US935-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	300.2	1.9
10°-20°	824.0	5.2
20°-30°	1156.9	7.4
30°-40°	1261.0	8.0
40°-50°	1159.0	7.4
50°-60°	910.3	5.8
60°-70°	592.5	3.8
70°-80°	305.0	1.9
80°-90°	87.1	0.6
90°-100°	202.2	1.3
100°-110°	642.4	4.1
110°-120°	1099.4	7.0
120°-130°	1445.9	9.2
130°-140°	1623.0	10.3
140°-150°	1591.6	10.1
150°-160°	1335.1	8.5
160°-170°	885.4	5.6
170°-180°	309.5	2.0
0°-30°	2281.0	14.5
0°-40°	3542.0	22.5
0°-60°	5611.3	35.7
0°-90°	6595.9	41.9
90°-120°	1944.1	12.4
90°-150°	6604.6	42.0
90°-180°	9134.0	58.1
0°-180°	15730.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3203	3203	3203	3203	3203	
5°	3203	3188	3150	3176	3168	304
15°	3046	3014	2916	2861	2832	858
25°	2765	2672	2481	2362	2319	1272
35°	2383	2235	1980	1797	1733	1491
45°	1948	1753	1449	1243	1174	1504
55°	1481	1255	942	768	713	1323
65°	1000	765	504	406	397	991
75°	533	330	232	212	209	564
85°	124	64	55	55	55	143
90°	3	36	96	91	94	16
95°	144	171	176	176	171	160
105°	593	601	607	612	612	626
115°	1103	1119	1114	1111	1103	1091
125°	1605	1629	1622	1613	1610	1434
135°	2076	2106	2112	2109	2101	1604
145°	2520	2540	2555	2558	2548	1574
155°	2881	2889	2898	2912	2903	1326
165°	3135	3132	3132	3151	3138	884
175°	3262	3254	3248	3268	3251	310
180°	3268	3268	3268	3268	3268	

TEST NUMBER: P921124

CATALOG NUMBER: DFN2DIP-TR4F0-090D120US935-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3202.7	3202.7	3202.7	3202.7	3202.7
2.5°	3217.1	3202.7	3170.6	3199.9	3194.0
5°	3202.7	3188.2	3150.4	3176.5	3167.9
7.5°	3176.5	3159.3	3118.7	3130.1	3115.6
10°	3141.8	3121.5	3063.7	3054.7	3037.5
12.5°	3098.4	3072.3	2993.9	2976.6	2944.6
15°	3046.1	3014.2	2915.8	2860.7	2831.8
17.5°	2985.3	2938.8	2817.0	2753.4	2707.0
20°	2915.8	2857.7	2712.7	2640.5	2576.5
22.5°	2840.4	2773.7	2605.5	2507.1	2463.7
25°	2765.1	2672.2	2481.0	2362.2	2318.6
27.5°	2675.3	2576.5	2365.0	2228.8	2162.1
30°	2579.6	2469.3	2237.4	2089.8	2011.4
32.5°	2486.7	2353.3	2115.9	1941.9	1869.3
35°	2382.6	2234.6	1979.7	1797.1	1733.1
37.5°	2281.0	2121.5	1852.1	1651.9	1579.7
40°	2173.8	2000.0	1718.6	1512.9	1437.6
42.5°	2063.6	1878.3	1585.4	1370.9	1298.6
45°	1947.7	1753.4	1449.2	1243.2	1173.7
47.5°	1837.6	1631.9	1318.9	1112.8	1049.2
50°	1715.9	1510.1	1191.3	991.1	930.5
52.5°	1596.9	1379.5	1069.5	878.2	823.2
55°	1480.9	1254.9	941.8	768.2	713.1
57.5°	1362.3	1130.4	829.1	666.7	620.3
60°	1240.4	1008.6	710.1	562.4	516.0
62.5°	1121.8	889.9	608.6	469.6	446.5
65°	1000.0	765.1	504.3	405.9	397.0
67.5°	884.1	649.1	405.9	356.4	347.8
70°	762.3	536.3	336.1	307.2	295.5
72.5°	646.4	431.7	281.0	258.0	252.2
75°	533.2	330.3	231.9	211.5	208.8
77.5°	420.3	234.6	182.6	171.0	165.1
80°	315.8	168.2	139.0	127.6	127.6
82.5°	220.2	113.1	95.7	89.8	89.8
85°	124.5	63.6	55.0	55.0	55.0
87.5°	46.4	23.1	23.1	20.3	20.3
90°	2.9	35.5	96.5	90.7	93.6
92.5°	61.0	82.7	85.7	88.7	88.7
95°	143.8	171.4	176.3	176.3	171.4
97.5°	239.4	265.0	275.9	275.9	275.9
100°	349.7	372.4	380.2	380.2	377.3
102.5°	466.0	482.7	493.5	496.5	493.5
105°	593.1	600.9	606.8	611.7	611.7
107.5°	719.1	731.0	731.0	732.9	719.1
110°	841.3	857.0	857.0	857.0	849.2

TEST NUMBER: P921124

CATALOG NUMBER: DFN2DIP-TR4F0-090D120US935-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	973.3	990.1	987.0	979.2	973.3
115°	1103.3	1119.1	1114.1	1111.2	1103.3
117.5°	1232.3	1254.0	1240.3	1232.3	1224.5
120°	1362.4	1384.1	1362.4	1362.4	1353.6
122.5°	1480.7	1508.2	1494.4	1486.5	1480.7
125°	1604.7	1629.4	1621.5	1612.6	1609.6
127.5°	1726.0	1756.4	1745.6	1733.8	1726.0
130°	1839.2	1874.7	1869.7	1863.8	1853.0
132.5°	1966.3	1993.9	1995.8	1982.0	1974.2
135°	2075.6	2106.2	2112.1	2109.1	2101.3
137.5°	2197.8	2222.4	2227.3	2225.3	2213.5
140°	2305.1	2329.8	2343.6	2343.6	2332.7
142.5°	2415.5	2440.2	2448.0	2450.9	2440.2
145°	2519.9	2539.6	2555.4	2558.4	2547.5
147.5°	2613.5	2638.1	2650.0	2654.9	2644.0
150°	2710.1	2726.8	2737.6	2746.5	2737.6
152.5°	2795.7	2812.4	2826.3	2837.2	2826.3
155°	2881.4	2889.3	2898.2	2912.0	2903.1
157.5°	2955.4	2961.2	2966.1	2985.9	2972.1
160°	3021.3	3027.3	3030.2	3047.0	3035.1
162.5°	3082.4	3082.4	3085.4	3104.1	3090.3
165°	3134.6	3131.7	3131.7	3151.3	3137.6
167.5°	3181.9	3173.0	3173.0	3192.8	3179.0
170°	3217.4	3209.5	3206.5	3226.2	3209.5
172.5°	3242.0	3234.1	3231.2	3250.9	3234.1
175°	3261.7	3253.8	3247.9	3267.6	3250.9
177.5°	3272.6	3264.6	3258.7	3275.5	3258.7
180°	3267.6	3267.6	3267.6	3267.6	3267.6

TEST NUMBER: P921124

CATALOG NUMBER: DFN2DIP-TR4F0-090D120US935-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.58	10.35	10.61	11.38	12.77	5.56	6.32	6.59	7.36	8.74
	3H	11.25	11.94	12.29	12.98	14.39	6.74	7.43	7.78	8.47	9.87
	4H	11.86	12.51	12.91	13.55	14.97	7.19	7.84	8.24	8.88	10.29
	6H	12.28	12.88	13.34	13.92	15.35	7.51	8.11	8.57	9.15	10.58
	8H	12.40	12.97	13.47	14.04	15.45	7.60	8.17	8.66	9.23	10.65
	12H	12.46	13.00	13.53	14.06	15.50	7.64	8.18	8.71	9.24	10.68
4H	2H	9.59	10.24	10.65	11.29	12.70	6.14	6.79	7.20	7.84	9.25
	3H	11.42	11.96	12.48	13.03	14.45	7.49	8.03	8.55	9.10	10.53
	4H	12.11	12.60	13.18	13.66	15.11	8.03	8.53	9.11	9.59	11.04
	6H	12.62	13.04	13.70	14.13	15.57	8.45	8.88	9.53	9.96	11.40
	8H	12.79	13.19	13.87	14.27	15.72	8.58	8.98	9.66	10.05	11.51
	12H	12.88	13.24	13.98	14.33	15.79	8.64	9.00	9.74	10.09	11.55
8H	4H	12.07	12.47	13.15	13.54	15.00	8.31	8.71	9.39	9.78	11.24
	6H	12.63	12.96	13.74	14.08	15.53	8.83	9.15	9.93	10.27	11.73
	8H	12.85	13.14	13.96	14.24	15.71	9.02	9.31	10.13	10.41	11.88
	12H	12.98	13.24	14.10	14.34	15.85	9.14	9.39	10.25	10.49	12.00
12H	4H	12.02	12.38	13.12	13.47	14.93	8.31	8.67	9.41	9.76	11.22
	6H	12.61	12.89	13.72	14.00	15.47	8.88	9.16	9.99	10.27	11.74
	8H	12.83	13.08	13.94	14.18	15.69	9.08	9.34	10.20	10.44	11.95

END OF REPORT