

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P921146

Luminaire Tested: DFN2DIP-TR4F0-100D090US935-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P921146
REPORT IS A COMBINATION OF REPORTS P900471 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-100D090US935-FLLFLL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15381.7 lumens
Efficiency: N/A
Efficacy: 91.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 168.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9972
Total Harmonic Distortion (THDi): 0.128
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P921146

CATALOG NUMBER: DFN2DIP-TR4F0-100D090US935-FLLFLL

Luminous Intensity Polar Plot

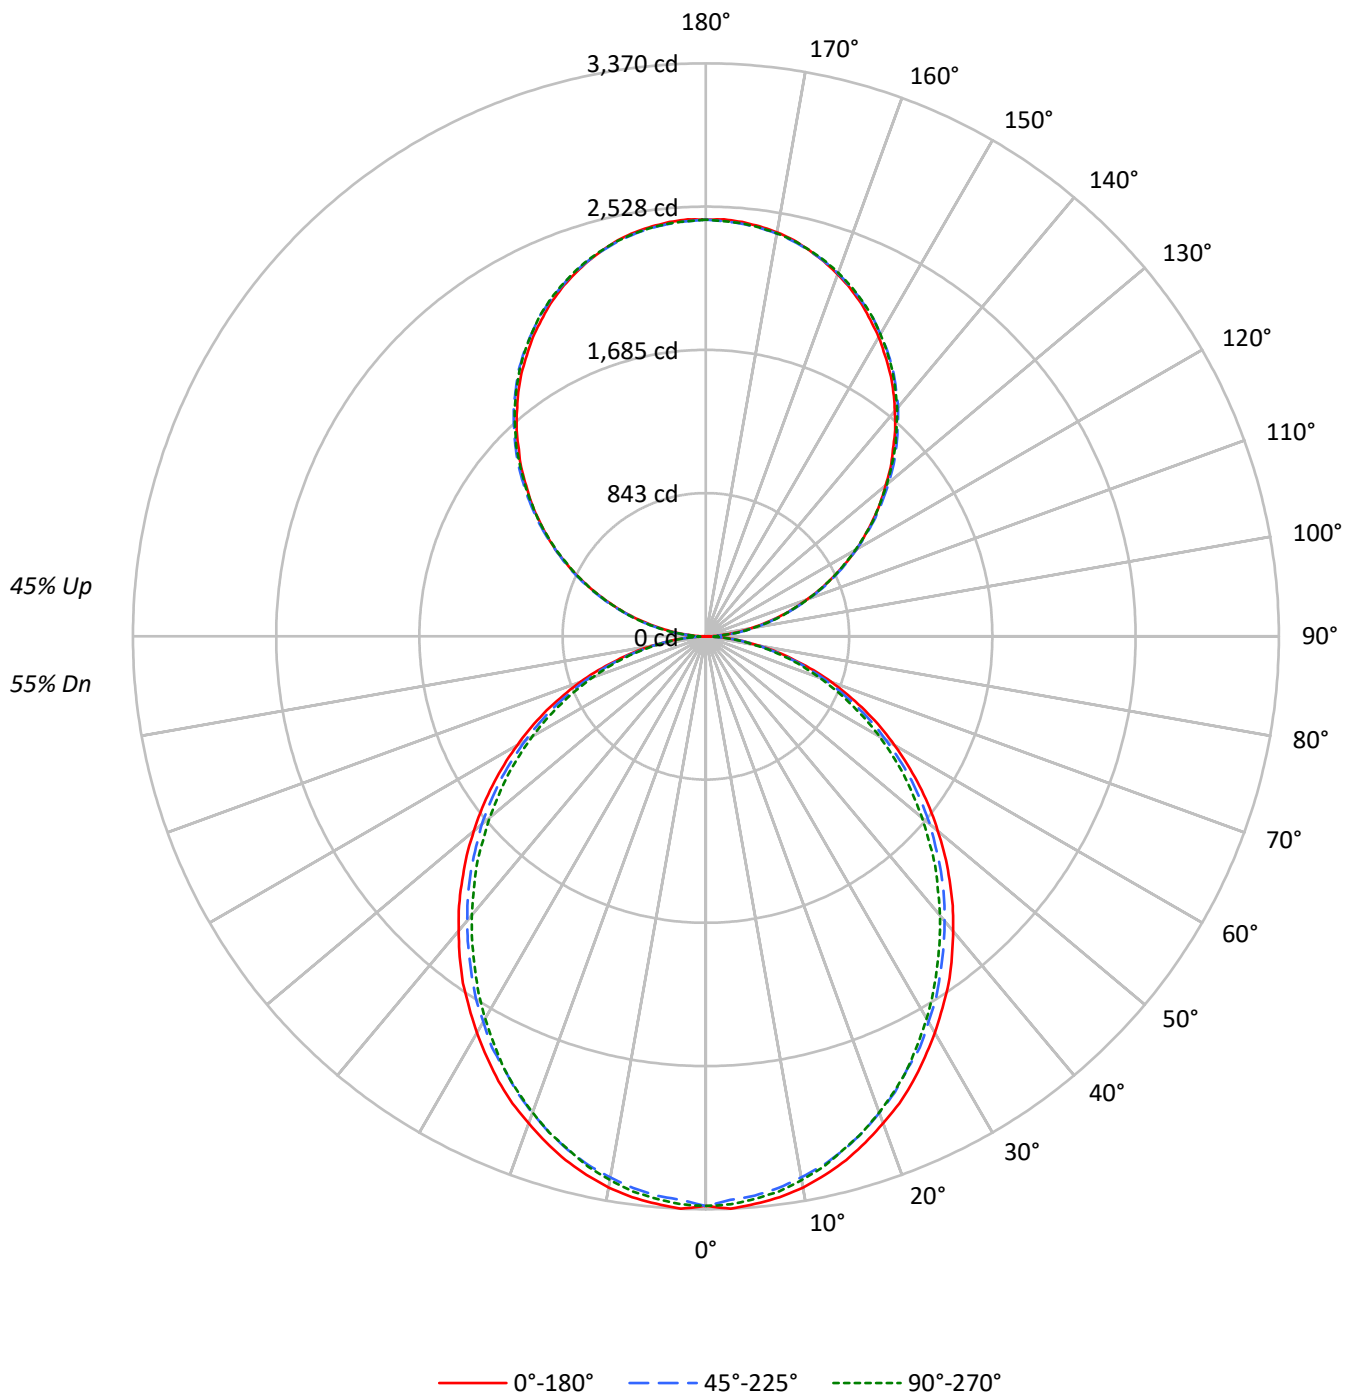

TEST NUMBER: P921146

CATALOG NUMBER: DFN2DIP-TR4F0-100D090US935-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	101	101	101	101	86	86	86	73	73	73	61	61	61
1	99	95	91	87	92	88	85	82	76	73	71	64	63	61	54	53	52
2	90	83	76	71	83	77	72	67	66	62	59	57	54	51	48	45	43
3	82	73	65	59	76	68	61	56	59	54	49	50	46	43	42	39	37
4	75	64	56	50	70	60	53	48	52	47	42	45	40	37	38	35	32
5	69	57	49	43	64	54	46	41	47	41	36	40	36	32	34	31	28
6	64	52	43	37	59	48	41	36	42	36	32	36	32	28	31	27	25
7	59	47	39	33	55	44	36	31	38	32	28	33	28	25	28	25	22
8	55	42	34	29	51	40	33	28	35	29	25	30	26	22	26	22	20
9	51	39	31	26	47	36	29	25	32	26	22	28	23	20	24	20	18
10	48	35	28	23	44	33	27	22	29	24	20	26	21	18	22	19	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2662	2662	2662
5°	2666	2624	2642
10°	2644	2589	2606
15°	2605	2546	2550
20°	2553	2487	2493
25°	2501	2416	2427
30°	2435	2350	2342
35°	2373	2273	2253
40°	2297	2194	2169
45°	2221	2115	2082
50°	2137	2033	1982
55°	2050	1937	1889
60°	1951	1824	1783
65°	1844	1706	1658
70°	1707	1563	1524
75°	1518	1391	1400
80°	1290	1173	1163
85°	933	796	771

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2221 cd/sqm

TEST NUMBER: P921146

CATALOG NUMBER: DFN2DIP-TR4F0-100D090US935-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	315.3	2.0
10°-20°	887.2	5.8
20°-30°	1303.8	8.5
30°-40°	1514.3	9.8
40°-50°	1512.4	9.8
50°-60°	1318.8	8.6
60°-70°	974.9	6.3
70°-80°	551.6	3.6
80°-90°	152.5	1.0
90°-100°	151.6	1.0
100°-110°	481.8	3.1
110°-120°	824.6	5.4
120°-130°	1084.4	7.1
130°-140°	1217.2	7.9
140°-150°	1193.6	7.8
150°-160°	1001.3	6.5
160°-170°	664.0	4.3
170°-180°	232.1	1.5
0°-30°	2506.3	16.3
0°-40°	4020.6	26.1
0°-60°	6851.8	44.5
0°-90°	8530.8	55.5
90°-120°	1458.0	9.5
90°-150°	4953.4	32.2
90°-180°	6851.0	44.5
0°-180°	15381.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3350	3350	3350	3350	3350	
5°	3350	3338	3302	3328	3322	318
15°	3189	3170	3128	3141	3125	898
25°	2886	2861	2806	2812	2806	1328
35°	2490	2458	2406	2387	2371	1555
45°	2026	2004	1955	1920	1907	1564
55°	1534	1514	1476	1437	1421	1371
65°	1034	1015	983	954	938	1023
75°	541	535	518	499	506	578
85°	132	129	126	116	113	147
90°	2	27	72	68	70	15
95°	108	128	132	132	128	120
105°	445	451	455	459	459	469
115°	828	839	836	833	828	818
125°	1204	1222	1216	1209	1207	1076
135°	1557	1580	1584	1582	1576	1203
145°	1890	1905	1916	1919	1911	1181
155°	2161	2167	2174	2184	2177	995
165°	2351	2349	2349	2364	2353	663
175°	2446	2440	2436	2451	2438	232
180°	2451	2451	2451	2451	2451	

TEST NUMBER: P921146

CATALOG NUMBER: DFN2DIP-TR4F0-100D090US935-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3350.2	3350.2	3350.2	3350.2	3350.2
2.5°	3369.7	3353.6	3318.0	3350.2	3344.0
5°	3350.2	3337.6	3302.0	3327.7	3321.5
7.5°	3327.7	3308.5	3272.9	3298.9	3292.5
10°	3292.5	3269.9	3231.2	3256.9	3247.3
12.5°	3243.9	3224.8	3186.1	3202.2	3195.7
15°	3189.2	3170.1	3128.0	3141.0	3125.0
17.5°	3121.5	3102.4	3060.3	3076.4	3060.3
20°	3047.3	3028.2	2983.1	2992.7	2980.0
22.5°	2973.5	2944.5	2902.4	2902.4	2896.0
25°	2886.4	2860.8	2806.1	2812.2	2806.1
27.5°	2789.6	2767.1	2725.4	2715.8	2699.7
30°	2693.3	2667.3	2619.1	2609.5	2596.5
32.5°	2590.1	2570.9	2519.3	2499.8	2486.8
35°	2490.3	2458.1	2406.5	2387.0	2370.9
37.5°	2377.5	2348.4	2296.8	2274.2	2258.1
40°	2261.6	2235.6	2184.0	2155.3	2142.3
42.5°	2148.8	2122.8	2071.6	2039.1	2020.0
45°	2026.4	2003.9	1955.3	1920.1	1907.2
47.5°	1907.2	1884.6	1833.0	1797.4	1778.3
50°	1781.4	1765.3	1720.2	1675.1	1659.1
52.5°	1659.1	1636.5	1594.7	1559.3	1536.7
55°	1533.6	1514.2	1475.5	1436.8	1420.8
57.5°	1407.8	1391.7	1349.7	1311.1	1298.1
60°	1282.0	1269.4	1224.3	1188.7	1179.1
62.5°	1159.7	1137.1	1105.0	1072.9	1059.9
65°	1034.2	1014.8	982.7	953.6	937.5
67.5°	905.4	889.0	860.3	837.8	824.7
70°	786.1	773.1	744.1	721.5	708.9
72.5°	663.7	650.7	634.7	612.2	602.5
75°	541.1	534.9	518.5	499.4	505.8
77.5°	431.7	418.7	412.2	402.6	393.0
80°	322.3	318.9	312.4	302.8	296.4
82.5°	219.1	219.1	216.0	203.0	203.0
85°	131.9	128.9	125.8	115.9	112.8
87.5°	58.1	51.6	45.1	35.6	32.1
90°	2.2	26.6	72.4	67.9	70.2
92.5°	45.8	62.1	64.3	66.5	66.5
95°	107.9	128.5	132.2	132.2	128.5
97.5°	179.5	198.7	206.9	206.9	206.9
100°	262.3	279.3	285.2	285.2	283.0
102.5°	349.5	362.0	370.1	372.4	370.1
105°	444.8	450.6	455.1	458.8	458.8
107.5°	539.3	548.2	548.2	549.7	539.3
110°	630.9	642.8	642.8	642.8	636.9

TEST NUMBER: P921146

CATALOG NUMBER: DFN2DIP-TR4F0-100D090US935-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	730.0	742.5	740.3	734.4	730.0
115°	827.5	839.3	835.6	833.4	827.5
117.5°	924.3	940.6	930.2	924.3	918.3
120°	1021.8	1038.0	1021.8	1021.8	1015.1
122.5°	1110.4	1131.2	1120.8	1114.9	1110.4
125°	1203.6	1222.0	1216.2	1209.4	1207.3
127.5°	1294.4	1317.3	1309.2	1300.4	1294.4
130°	1379.4	1406.0	1402.3	1397.8	1389.7
132.5°	1474.7	1495.4	1496.8	1486.5	1480.7
135°	1556.7	1579.6	1584.1	1581.8	1576.0
137.5°	1648.3	1666.8	1670.5	1669.0	1660.2
140°	1728.9	1747.3	1757.6	1757.6	1749.5
142.5°	1811.6	1830.1	1836.0	1838.2	1830.1
145°	1890.0	1904.7	1916.5	1918.7	1910.6
147.5°	1960.1	1978.6	1987.4	1991.1	1983.1
150°	2032.6	2045.1	2053.2	2059.9	2053.2
152.5°	2096.8	2109.4	2119.7	2127.9	2119.7
155°	2161.1	2167.0	2173.7	2184.0	2177.4
157.5°	2216.5	2220.9	2224.6	2239.4	2229.0
160°	2266.0	2270.5	2272.7	2285.2	2276.3
162.5°	2311.8	2311.8	2314.0	2328.1	2317.7
165°	2351.0	2348.7	2348.7	2363.5	2353.2
167.5°	2386.4	2379.8	2379.8	2394.5	2384.2
170°	2413.0	2407.1	2404.9	2419.7	2407.1
172.5°	2431.5	2425.6	2423.4	2438.2	2425.6
175°	2446.3	2440.3	2435.9	2450.7	2438.2
177.5°	2454.4	2448.5	2444.0	2456.6	2444.0
180°	2450.7	2450.7	2450.7	2450.7	2450.7

TEST NUMBER: P921146

CATALOG NUMBER: DFN2DIP-TR4F0-100D090US935-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.16	12.07	12.06	13.00	14.19	10.72	11.64	11.63	12.57	13.76
	3H	12.82	13.64	13.74	14.58	15.79	12.35	13.17	13.27	14.10	15.32
	4H	13.41	14.18	14.35	15.13	16.35	12.94	13.71	13.87	14.65	15.88
	6H	13.81	14.53	14.76	15.47	16.71	13.34	14.05	14.28	15.00	16.24
	8H	13.92	14.60	14.87	15.56	16.80	13.44	14.12	14.40	15.09	16.32
	12H	13.97	14.62	14.93	15.57	16.84	13.49	14.14	14.45	15.09	16.36
4H	2H	11.62	12.40	12.57	13.34	14.57	11.28	12.05	12.22	13.00	14.22
	3H	13.49	14.14	14.45	15.11	16.35	13.10	13.75	14.05	14.72	15.96
	4H	14.21	14.80	15.17	15.77	17.03	13.81	14.40	14.77	15.36	16.63
	6H	14.73	15.24	15.70	16.23	17.49	14.32	14.83	15.29	15.82	17.08
	8H	14.88	15.36	15.86	16.34	17.62	14.47	14.94	15.44	15.93	17.20
	12H	14.96	15.38	15.95	16.39	17.67	14.53	14.96	15.53	15.96	17.25
8H	4H	14.41	14.89	15.39	15.87	17.15	14.05	14.53	15.03	15.51	16.79
	6H	15.05	15.44	16.05	16.46	17.74	14.68	15.08	15.68	16.10	17.38
	8H	15.27	15.61	16.28	16.63	17.92	14.90	15.25	15.91	16.26	17.55
	12H	15.40	15.71	16.41	16.71	18.05	15.02	15.32	16.03	16.33	17.67
12H	4H	14.40	14.83	15.39	15.83	17.11	14.05	14.48	15.04	15.48	16.76
	6H	15.08	15.42	16.09	16.44	17.73	14.72	15.07	15.73	16.09	17.38
	8H	15.32	15.63	16.33	16.63	17.97	14.96	15.27	15.98	16.28	17.62

END OF REPORT