

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P921225

Luminaire Tested: DFN2DIP-TR4F0-120D100US935-RLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P921225
REPORT IS A COMBINATION OF REPORTS P902014 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-120D100US935-RLLONL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 17306.1 lumens
Efficiency: N/A
Efficacy: 85.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 202
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9821
Total Harmonic Distortion (THDi): 0.08
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P921225

CATALOG NUMBER: DFN2DIP-TR4F0-120D100US935-RLLONL

Luminous Intensity Polar Plot

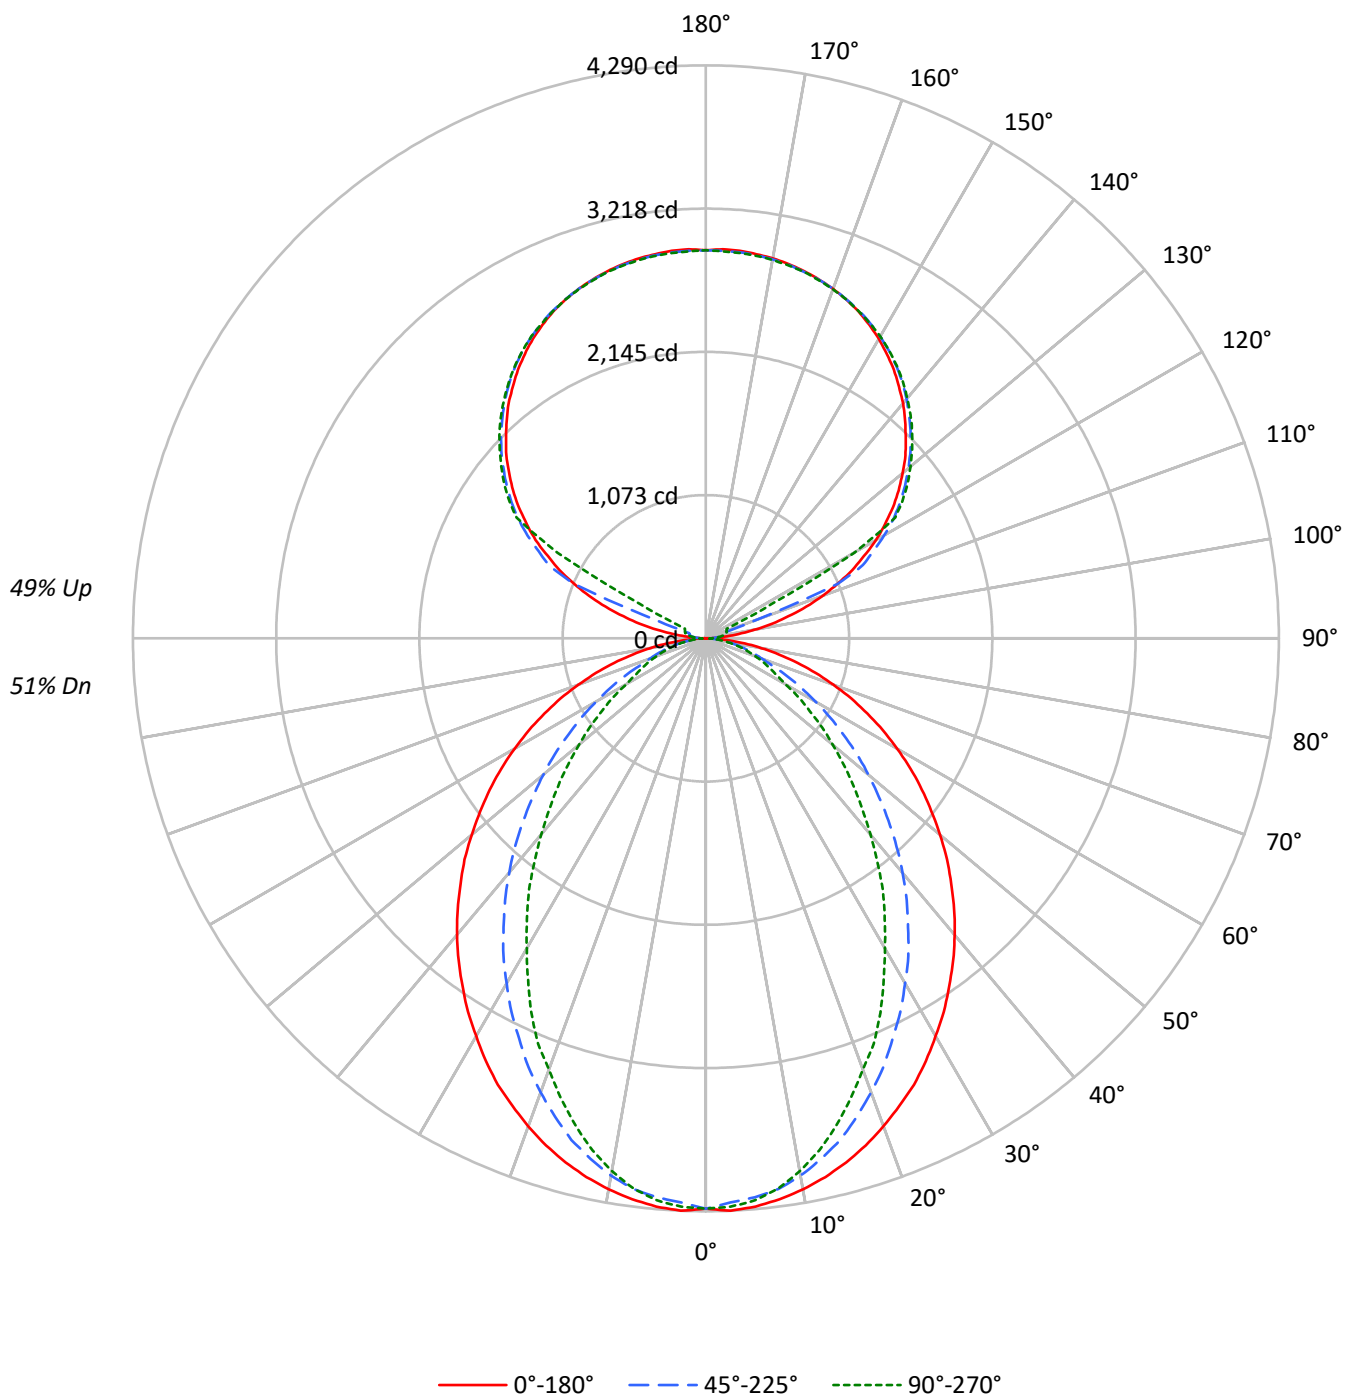

TEST NUMBER: P921225

CATALOG NUMBER: DFN2DIP-TR4F0-120D100US935-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	84	84	84	70	70	70	57	57	57
1	98	94	91	87	91	87	84	81	74	72	70	62	61	59	51	50	49
2	90	83	77	72	83	77	72	67	66	62	59	55	52	50	45	44	42
3	82	73	66	61	76	68	62	57	58	54	50	49	46	43	41	38	36
4	76	65	58	52	70	61	54	49	52	47	43	44	40	37	37	34	32
5	70	58	50	45	64	54	47	42	47	41	37	40	36	33	33	30	28
6	64	53	45	39	59	49	42	37	42	37	33	36	32	29	30	27	25
7	60	48	40	34	55	45	38	33	39	33	29	33	29	26	28	25	22
8	55	43	36	31	51	41	34	29	35	30	26	30	26	23	26	23	20
9	52	40	32	27	48	37	31	26	32	27	23	28	24	21	24	21	18
10	48	36	29	25	45	34	28	24	30	25	21	26	22	19	22	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3392	3392	3392
5°	3398	3339	3360
10°	3364	3273	3250
15°	3318	3165	3081
20°	3257	3016	2874
25°	3194	2848	2673
30°	3110	2677	2419
35°	3027	2493	2196
40°	2943	2302	1940
45°	2846	2090	1708
50°	2745	1877	1482
55°	2640	1649	1264
60°	2518	1410	1041
65°	2377	1168	936
70°	2208	941	847
75°	1994	830	771
80°	1685	696	668
85°	1175	465	502

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2846 cd/sqm

TEST NUMBER: P921225

CATALOG NUMBER: DFN2DIP-TR4F0-120D100US935-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	400.2	2.3
10°-20°	1098.7	6.3
20°-30°	1542.5	8.9
30°-40°	1681.4	9.7
40°-50°	1545.4	8.9
50°-60°	1213.7	7.0
60°-70°	790.0	4.6
70°-80°	406.7	2.3
80°-90°	108.9	0.6
90°-100°	95.8	0.6
100°-110°	357.2	2.1
110°-120°	947.3	5.5
120°-130°	1571.2	9.1
130°-140°	1669.0	9.6
140°-150°	1551.1	9.0
150°-160°	1247.1	7.2
160°-170°	803.6	4.6
170°-180°	276.6	1.6
0°-30°	3041.3	17.6
0°-40°	4722.7	27.3
0°-60°	7481.7	43.2
0°-90°	8787.3	50.8
90°-120°	1400.3	8.1
90°-150°	6191.6	35.8
90°-180°	8519.0	49.2
0°-180°	17306.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4270	4270	4270	4270	4270	
5°	4270	4251	4200	4235	4224	405
15°	4062	4019	3888	3814	3776	1144
25°	3687	3563	3308	3150	3091	1696
35°	3177	2980	2640	2396	2311	1988
45°	2597	2338	1932	1658	1565	2006
55°	1975	1673	1256	1024	951	1764
65°	1333	1020	672	541	529	1322
75°	711	440	309	282	278	752
85°	166	85	73	73	73	191
90°	2	25	42	53	57	16
95°	137	67	82	93	90	162
105°	639	702	128	151	160	683
115°	1209	1245	1297	324	172	1190
125°	1709	1737	1777	1792	1798	1524
135°	2115	2149	2168	2189	2185	1634
145°	2454	2452	2487	2502	2492	1535
155°	2702	2683	2708	2721	2704	1245
165°	2847	2834	2841	2855	2841	804
175°	2912	2897	2902	2916	2895	277
180°	2906	2906	2906	2906	2906	



TEST NUMBER: P921225

CATALOG NUMBER: DFN2DIP-TR4F0-120D100US935-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4270.2	4270.2	4270.2	4270.2	4270.2
2.5°	4289.5	4270.2	4227.6	4266.5	4258.7
5°	4270.2	4250.9	4200.5	4235.3	4223.9
7.5°	4235.3	4212.3	4158.3	4173.4	4154.1
10°	4189.0	4162.0	4084.8	4073.0	4050.0
12.5°	4131.2	4096.4	3991.8	3968.9	3926.2
15°	4061.5	4018.9	3887.7	3814.2	3775.7
17.5°	3980.3	3918.4	3756.0	3671.2	3609.3
20°	3887.7	3810.2	3617.1	3520.7	3435.4
22.5°	3787.2	3698.2	3474.0	3342.7	3285.0
25°	3686.8	3562.9	3307.9	3149.6	3091.4
27.5°	3567.0	3435.4	3153.3	2971.7	2882.7
30°	3439.5	3292.4	2983.2	2786.4	2681.8
32.5°	3315.7	3137.7	2821.2	2589.2	2492.4
35°	3176.7	2979.5	2639.6	2396.1	2310.7
37.5°	3041.4	2828.6	2469.4	2202.5	2106.2
40°	2898.3	2666.7	2291.5	2017.2	1916.8
42.5°	2751.5	2504.3	2114.0	1827.8	1731.5
45°	2596.9	2337.9	1932.3	1657.7	1564.9
47.5°	2450.1	2175.9	1758.5	1483.8	1398.9
50°	2287.8	2013.5	1588.4	1321.5	1240.7
52.5°	2129.2	1839.3	1426.0	1171.0	1097.6
55°	1974.6	1673.3	1255.9	1024.2	950.8
57.5°	1816.3	1507.2	1105.3	888.9	827.0
60°	1654.0	1344.8	946.7	749.9	688.0
62.5°	1495.7	1186.5	811.4	626.1	595.3
65°	1333.3	1020.1	672.4	541.2	529.3
67.5°	1178.8	865.5	541.2	475.2	463.7
70°	1016.4	715.1	448.1	409.6	394.0
72.5°	861.9	575.7	374.7	344.0	336.2
75°	710.9	440.3	309.2	282.1	278.4
77.5°	560.5	312.8	243.6	228.0	220.2
80°	421.1	224.3	185.3	170.1	170.1
82.5°	293.6	150.8	127.5	119.7	119.7
85°	166.1	84.9	73.4	73.4	73.4
87.5°	61.9	30.7	30.7	27.0	27.0
90°	2.0	25.2	41.9	52.7	56.7
92.5°	52.7	44.2	50.5	54.7	56.7
95°	136.6	67.2	81.9	92.6	90.4
97.5°	245.9	73.6	107.1	113.6	115.6
100°	372.3	84.1	119.9	136.6	140.9
102.5°	510.8	506.9	124.1	147.1	153.5
105°	639.2	702.3	128.4	151.3	159.8
107.5°	788.5	840.9	132.6	155.6	164.0
110°	931.5	975.5	368.0	157.8	166.0

TEST NUMBER: P921225

CATALOG NUMBER: DFN2DIP-TR4F0-120D100US935-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1066.1	1103.8	1068.2	161.8	168.3
115°	1208.9	1244.7	1297.4	323.8	172.5
117.5°	1333.0	1375.0	1410.9	1110.1	559.3
120°	1471.9	1503.3	1541.3	1566.5	1282.6
122.5°	1589.5	1623.2	1665.3	1677.8	1680.1
125°	1709.3	1736.8	1776.8	1791.5	1797.7
127.5°	1818.7	1848.1	1879.8	1900.8	1902.8
130°	1921.7	1955.5	1978.5	2001.6	1999.7
132.5°	2026.9	2054.3	2077.3	2096.3	2094.3
135°	2115.3	2149.0	2167.7	2188.9	2184.7
137.5°	2207.7	2232.9	2254.1	2275.1	2268.8
140°	2298.0	2315.1	2338.0	2357.0	2346.5
142.5°	2373.9	2388.7	2415.9	2432.6	2422.2
145°	2453.8	2451.6	2487.3	2502.1	2491.6
147.5°	2523.0	2516.8	2552.4	2562.9	2554.8
150°	2590.4	2575.7	2609.4	2621.9	2611.4
152.5°	2647.1	2630.3	2661.9	2674.5	2659.8
155°	2701.8	2683.0	2708.3	2720.8	2704.0
157.5°	2746.0	2729.3	2748.2	2762.9	2746.0
160°	2784.0	2771.2	2784.0	2796.4	2781.7
162.5°	2817.4	2804.9	2815.4	2830.1	2811.2
165°	2846.8	2834.3	2840.6	2855.3	2840.6
167.5°	2870.1	2857.3	2863.9	2878.6	2859.5
170°	2889.0	2876.3	2880.6	2895.3	2876.3
172.5°	2901.5	2889.0	2893.3	2908.0	2889.0
175°	2912.0	2897.3	2901.5	2916.3	2895.3
177.5°	2916.3	2901.5	2903.8	2918.5	2899.5
180°	2905.8	2905.8	2905.8	2905.8	2905.8

TEST NUMBER: P921225

CATALOG NUMBER: DFN2DIP-TR4F0-120D100US935-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.46	12.30	12.42	13.26	14.53	7.43	8.27	8.39	9.24	10.50
	3H	13.14	13.88	14.10	14.86	16.15	8.62	9.37	9.59	10.35	11.63
	4H	13.74	14.45	14.73	15.43	16.73	9.07	9.78	10.06	10.76	12.06
	6H	14.17	14.82	15.16	15.80	17.11	9.40	10.05	10.39	11.03	12.34
	8H	14.29	14.91	15.29	15.91	17.22	9.49	10.11	10.49	11.11	12.41
	12H	14.36	14.94	15.36	15.94	17.27	9.53	10.12	10.54	11.12	12.44
4H	2H	11.48	12.18	12.47	13.17	14.46	8.03	8.74	9.02	9.72	11.01
	3H	13.31	13.89	14.30	14.91	16.21	9.38	9.97	10.38	10.98	12.29
	4H	14.00	14.54	15.00	15.54	16.87	9.93	10.47	10.93	11.47	12.80
	6H	14.51	14.98	15.53	16.00	17.33	10.35	10.81	11.37	11.84	13.17
	8H	14.69	15.12	15.71	16.14	17.48	10.48	10.91	11.50	11.93	13.27
	12H	14.79	15.17	15.82	16.21	17.56	10.54	10.93	11.58	11.97	13.32
8H	4H	13.97	14.40	14.99	15.42	16.76	10.21	10.64	11.23	11.66	13.00
	6H	14.53	14.89	15.58	15.95	17.29	10.73	11.08	11.77	12.15	13.49
	8H	14.75	15.06	15.80	16.11	17.47	10.92	11.23	11.97	12.28	13.64
	12H	14.89	15.16	15.94	16.21	17.61	11.04	11.32	12.09	12.36	13.76
12H	4H	13.92	14.31	14.96	15.34	16.69	10.21	10.60	11.25	11.64	12.99
	6H	14.51	14.82	15.56	15.87	17.23	10.78	11.09	11.83	12.14	13.50
	8H	14.73	15.01	15.78	16.05	17.45	10.99	11.27	12.04	12.31	13.71

END OF REPORT