

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923694

Luminaire Tested: DFN2DIP-TR4F0-050D090US940-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923694
REPORT IS A COMBINATION OF REPORTS P900461 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-050D090US940-FLLFLL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11516.5 lumens
Efficiency: N/A
Efficacy: 105.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 109.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923694

CATALOG NUMBER: DFN2DIP-TR4F0-050D090US940-FLLFLL

Luminous Intensity Polar Plot

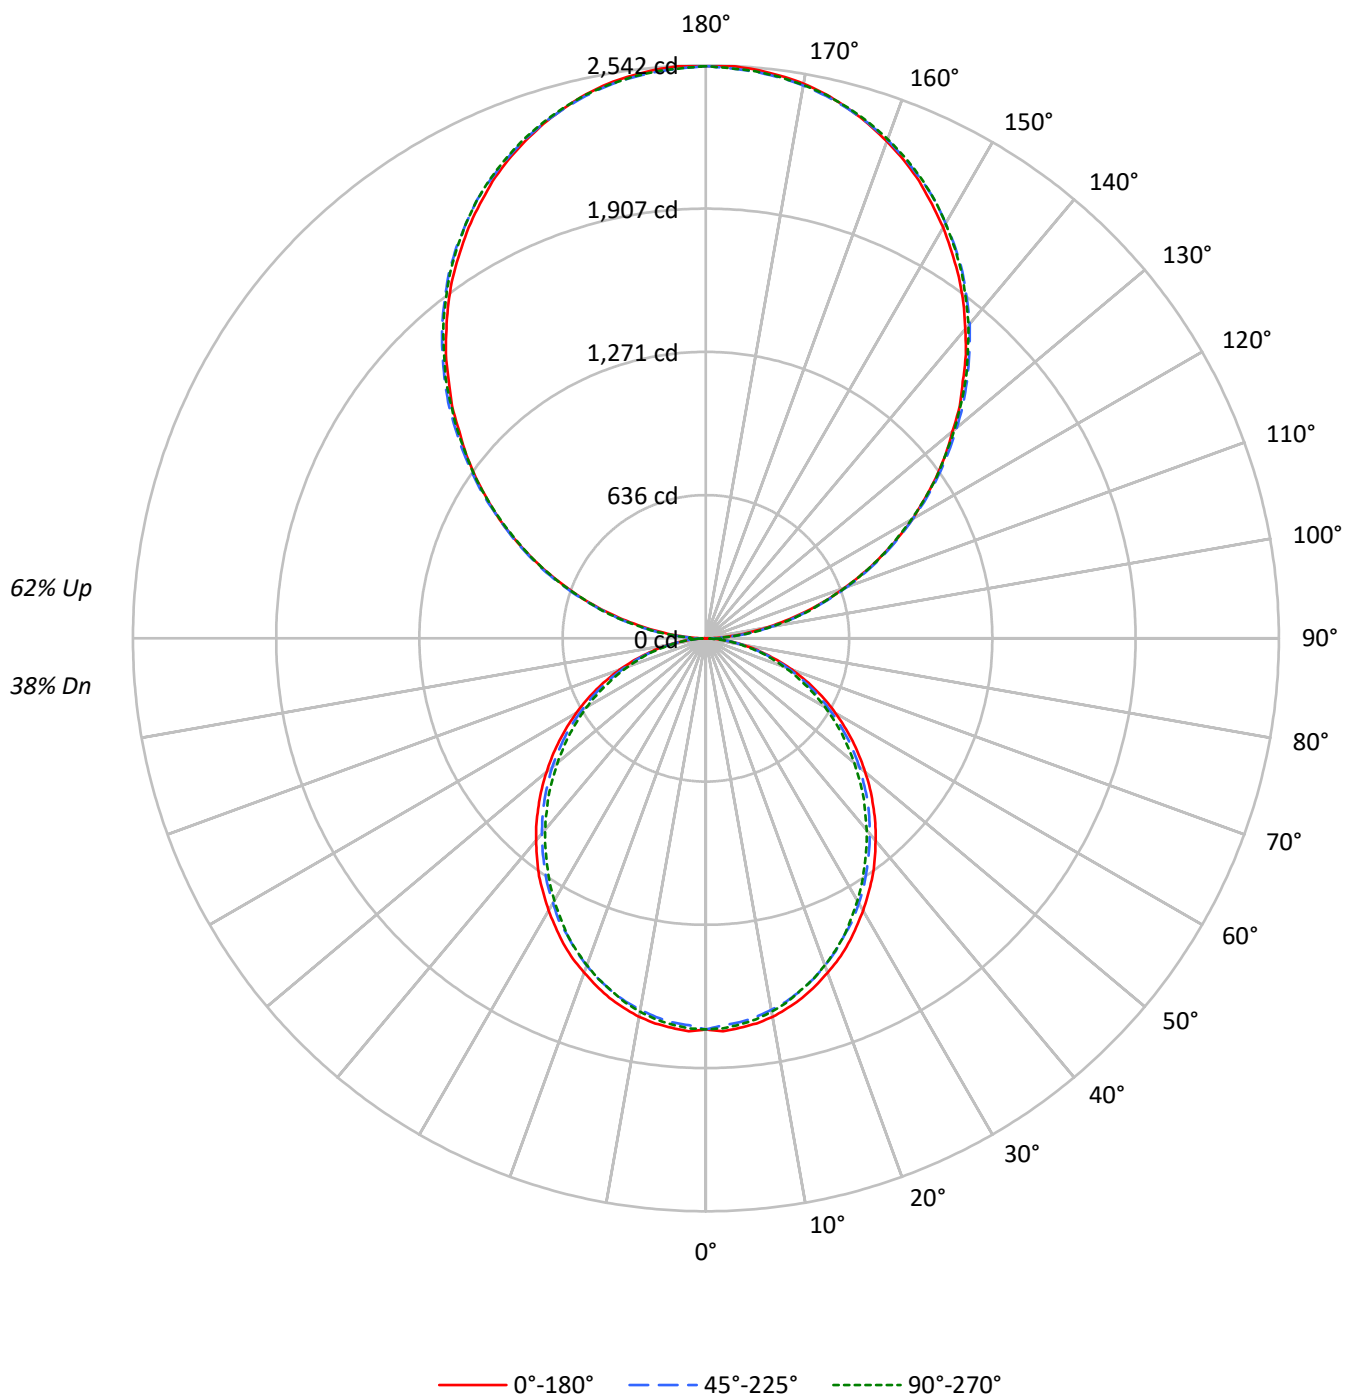

TEST NUMBER: P923694

CATALOG NUMBER: DFN2DIP-TR4F0-050D090US940-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	95	95	95	95	77	77	77	61	61	61	45	45	45
1	95	91	87	84	86	83	79	77	67	65	63	53	52	50	40	39	38
2	87	79	73	68	78	72	67	63	59	55	52	47	44	42	35	34	32
3	79	70	63	57	71	64	57	52	52	47	44	41	38	35	31	29	27
4	72	62	54	48	65	56	50	44	46	41	37	37	33	30	28	26	24
5	66	55	47	41	60	50	43	38	41	36	32	33	29	26	25	23	21
6	61	49	41	35	55	45	38	33	37	32	28	30	26	23	23	20	18
7	56	44	36	31	51	41	34	29	34	28	25	27	23	20	21	18	16
8	52	40	33	27	47	37	30	25	31	25	22	25	21	18	19	16	14
9	49	37	29	24	44	34	27	23	28	23	19	23	19	16	18	15	13
10	45	33	26	22	41	31	24	20	26	21	17	21	17	15	16	14	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1378	1378	1378
5°	1380	1359	1368
10°	1369	1341	1350
15°	1349	1319	1321
20°	1322	1288	1291
25°	1295	1251	1257
30°	1261	1217	1213
35°	1229	1177	1167
40°	1189	1136	1123
45°	1150	1095	1078
50°	1107	1053	1026
55°	1062	1003	978
60°	1011	944	923
65°	955	883	859
70°	884	809	789
75°	786	721	725
80°	668	608	603
85°	483	412	399

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1979 cd/sqm

TEST NUMBER: P923694

CATALOG NUMBER: DFN2DIP-TR4F0-050D090US940-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	163.3	1.4
10°-20°	459.4	4.0
20°-30°	675.2	5.9
30°-40°	784.2	6.8
40°-50°	783.2	6.8
50°-60°	682.9	5.9
60°-70°	504.8	4.4
70°-80°	285.6	2.5
80°-90°	82.6	0.7
90°-100°	157.1	1.4
100°-110°	499.0	4.3
110°-120°	854.0	7.4
120°-130°	1123.1	9.8
130°-140°	1260.7	10.9
140°-150°	1236.2	10.7
150°-160°	1037.0	9.0
160°-170°	687.7	6.0
170°-180°	240.4	2.1
0°-30°	1297.9	11.3
0°-40°	2082.0	18.1
0°-60°	3548.1	30.8
0°-90°	4421.2	38.4
90°-120°	1510.1	13.1
90°-150°	5130.1	44.5
90°-180°	7095.0	61.6
0°-180°	11516.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1735	1735	1735	1735	1735	
5°	1735	1728	1710	1723	1720	165
15°	1651	1642	1620	1627	1618	465
25°	1495	1481	1453	1456	1453	688
35°	1290	1273	1246	1236	1228	805
45°	1049	1038	1012	994	988	810
55°	794	784	764	744	736	710
65°	536	526	509	494	485	530
75°	280	277	268	259	262	299
85°	68	67	65	60	58	76
90°	2	28	75	70	73	11
95°	112	133	137	137	133	124
105°	461	467	471	475	475	486
115°	857	869	865	863	857	848
125°	1246	1266	1260	1253	1250	1114
135°	1612	1636	1641	1638	1632	1246
145°	1957	1973	1985	1987	1979	1223
155°	2238	2244	2251	2262	2255	1030
165°	2435	2432	2432	2448	2437	687
175°	2534	2527	2523	2538	2525	241
180°	2538	2538	2538	2538	2538	

TEST NUMBER: P923694

CATALOG NUMBER: DFN2DIP-TR4F0-050D090US940-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1734.8	1734.8	1734.8	1734.8	1734.8
2.5°	1744.9	1736.6	1718.2	1734.8	1731.7
5°	1734.8	1728.3	1709.9	1723.1	1720.0
7.5°	1723.1	1713.2	1694.9	1708.3	1705.0
10°	1705.0	1693.3	1673.3	1686.5	1681.6
12.5°	1679.8	1669.9	1649.9	1658.2	1654.8
15°	1651.4	1641.5	1619.8	1626.6	1618.2
17.5°	1616.4	1606.5	1584.7	1593.0	1584.7
20°	1578.1	1568.2	1544.8	1549.7	1543.2
22.5°	1539.8	1524.7	1503.0	1503.0	1499.6
25°	1494.7	1481.4	1453.0	1456.3	1453.0
27.5°	1444.6	1432.9	1411.3	1406.3	1398.0
30°	1394.6	1381.3	1356.3	1351.3	1344.6
32.5°	1341.2	1331.3	1304.6	1294.5	1287.8
35°	1289.5	1272.9	1246.2	1236.1	1227.8
37.5°	1231.1	1216.1	1189.4	1177.7	1169.4
40°	1171.2	1157.7	1131.0	1116.1	1109.4
42.5°	1112.8	1099.3	1072.7	1055.9	1046.0
45°	1049.4	1037.7	1012.5	994.3	987.6
47.5°	987.6	975.9	949.2	930.8	920.9
50°	922.5	914.2	890.8	867.5	859.1
52.5°	859.1	847.4	825.8	807.4	795.8
55°	794.2	784.1	764.0	744.0	735.8
57.5°	729.0	720.7	698.9	678.9	672.2
60°	663.9	657.4	634.0	615.5	610.6
62.5°	600.6	588.9	572.2	555.5	548.8
65°	535.6	525.5	508.8	493.8	485.4
67.5°	468.9	460.4	445.5	433.8	427.0
70°	407.1	400.4	385.3	373.6	367.1
72.5°	343.8	337.0	328.7	317.0	312.0
75°	280.2	277.0	268.5	258.6	262.0
77.5°	223.6	216.8	213.5	208.5	203.6
80°	166.9	165.1	161.8	156.9	153.5
82.5°	113.4	113.4	111.8	105.1	105.1
85°	68.3	66.7	65.1	60.0	58.4
87.5°	30.1	26.8	23.4	18.4	16.7
90°	2.3	27.6	75.0	70.4	72.7
92.5°	47.4	64.3	66.6	68.8	68.8
95°	111.7	133.1	137.0	137.0	133.1
97.5°	185.9	205.8	214.3	214.3	214.3
100°	271.6	289.3	295.3	295.3	293.1
102.5°	361.9	375.0	383.3	385.7	383.3
105°	460.7	466.7	471.4	475.2	475.2
107.5°	558.6	567.8	567.8	569.3	558.6
110°	653.4	665.8	665.8	665.8	659.6

TEST NUMBER: P923694

CATALOG NUMBER: DFN2DIP-TR4F0-050D090US940-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	756.0	769.0	766.7	760.6	756.0
115°	857.0	869.2	865.4	863.2	857.0
117.5°	957.3	974.1	963.4	957.3	951.1
120°	1058.3	1075.0	1058.3	1058.3	1051.3
122.5°	1150.0	1171.5	1160.8	1154.7	1150.0
125°	1246.5	1265.6	1259.5	1252.6	1250.4
127.5°	1340.6	1364.3	1355.9	1346.8	1340.6
130°	1428.6	1456.2	1452.3	1447.7	1439.3
132.5°	1527.3	1548.7	1550.2	1539.5	1533.5
135°	1612.2	1635.9	1640.6	1638.3	1632.2
137.5°	1707.1	1726.3	1730.1	1728.6	1719.4
140°	1790.6	1809.6	1820.3	1820.3	1812.0
142.5°	1876.2	1895.3	1901.5	1903.8	1895.3
145°	1957.4	1972.6	1984.9	1987.2	1978.8
147.5°	2030.1	2049.2	2058.3	2062.2	2053.8
150°	2105.1	2118.1	2126.5	2133.3	2126.5
152.5°	2171.6	2184.6	2195.3	2203.8	2195.3
155°	2238.2	2244.3	2251.2	2261.9	2255.0
157.5°	2295.5	2300.2	2304.0	2319.2	2308.5
160°	2346.8	2351.4	2353.8	2366.7	2357.5
162.5°	2394.2	2394.2	2396.6	2411.1	2400.4
165°	2434.8	2432.5	2432.5	2447.8	2437.1
167.5°	2471.6	2464.7	2464.7	2479.9	2469.2
170°	2499.1	2493.0	2490.7	2506.0	2493.0
172.5°	2518.2	2512.1	2509.8	2525.1	2512.1
175°	2533.5	2527.4	2522.8	2538.2	2525.1
177.5°	2541.9	2535.8	2531.2	2544.2	2531.2
180°	2538.2	2538.2	2538.2	2538.2	2538.2

TEST NUMBER: P923694

CATALOG NUMBER: DFN2DIP-TR4F0-050D090US940-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.20	7.97	8.25	9.02	10.45	6.77	7.53	7.82	8.59	10.02
	3H	8.85	9.54	9.91	10.60	12.05	8.38	9.07	9.44	10.13	11.58
	4H	9.44	10.09	10.51	11.15	12.61	8.96	9.61	10.03	10.68	12.13
	6H	9.83	10.43	10.91	11.50	12.96	9.36	9.95	10.44	11.02	12.49
	8H	9.93	10.50	11.02	11.59	13.05	9.46	10.03	10.54	11.11	12.57
	12H	9.98	10.52	11.07	11.60	13.08	9.50	10.04	10.59	11.12	12.60
4H	2H	7.65	8.30	8.73	9.37	10.82	7.31	7.96	8.38	9.02	10.48
	3H	9.51	10.05	10.59	11.14	12.61	9.11	9.66	10.20	10.75	12.22
	4H	10.22	10.72	11.31	11.80	13.29	9.81	10.31	10.90	11.39	12.88
	6H	10.73	11.15	11.83	12.26	13.74	10.32	10.75	11.42	11.85	13.33
	8H	10.87	11.27	11.97	12.37	13.87	10.46	10.86	11.56	11.96	13.46
	12H	10.94	11.30	12.06	12.42	13.92	10.52	10.88	11.64	11.99	13.50
8H	4H	10.41	10.81	11.51	11.90	13.40	10.05	10.45	11.15	11.54	13.04
	6H	11.03	11.36	12.16	12.50	14.00	10.67	11.00	11.79	12.14	13.64
	8H	11.25	11.54	12.38	12.66	14.18	10.88	11.17	12.01	12.30	13.81
	12H	11.38	11.63	12.51	12.75	14.30	11.00	11.25	12.13	12.37	13.92
12H	4H	10.39	10.75	11.50	11.86	13.36	10.04	10.40	11.15	11.51	13.01
	6H	11.06	11.35	12.19	12.47	13.99	10.71	11.00	11.84	12.12	13.64
	8H	11.30	11.55	12.43	12.67	14.22	10.94	11.20	12.07	12.32	13.87